



# HG-MCCB

Molded Case Circuit Breakers &  
Earth Leakage Circuit Breakers



## **Essential for Today, Potential for Tomorrow**

Hyundai Electric solely pursues the growth of our customers' business. From power generation to power distribution, we focus on developing and commercializing products and solutions aimed at increasing the efficiency of energy equipment as well as at proactively monitoring and controlling assets in an integrated manner to improve our customers' productivity and management efficiency. We are well aware that our efforts add to the driving force behind our customers' growth and contribute to the creation and maintenance of a more dynamic world. We focus on achieving innovation and strive to evolve continuously to shape a better tomorrow based on today's technological advancement

the overall  
balance,  
asset  
value  
\$.

the  
specified  
control  
trol

- Re  
ar
- H
- C
- In  
(o

# Solution

## INTEGRIC

### Energy Solution

Energy solution business refers to the business of designing, procuring and establishing a system that enables the efficient use of power energy through integrated management of the production, consumption, sales and operation of energy.



### Asset Management Solution

Asset management solution is a business that maximizes the overall business efficiency by systematically managing the performance, risk, maintenance cost and others as well as by providing an asset management solution suitable to the customer's circumstance depending on the product lifecycle (PLC) of various products.

## Generation

Power Plants

Primary Substation


## Transmission

Secondary Substation

## Distribution

## Utility

- Supplied more than 1.2 million MVA in total to 70 countries around the world for the past 40 over years since 1978
- Satisfies the various demands of customers through the acquisition of quality certifications from international accredited institute
- Participates in the world's key technical committee such as CIGRE and others, pioneering the establishment of technology standard related to power network

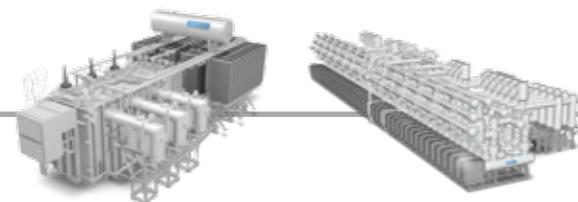

**Power Transformer**  
· up to 800 kV, 1,500 MVA

**Gas Insulated Switchgear**  
· up to 800 kV

- Can be installed in spaces smaller than the open type of substation by using SF6 gas with outstanding insulation and arc extinguishing characteristics
- Secures advanced reliability by producing products that are resistant to external environment and climate effects through the sealing at the charge part
- Extensive project experiences around the world
- Reduces installation period and cost due to simple installation and transportation, convenient maintenance
- Design considering the safety of the workers as priority



**Gas Insulated Switchgear**  
· GIS for 245 ~ 550 kV

**Power Transformer**  
· 800 kV, 1,500 MVA


**Gas Insulated Switchgear**  
· GIS for 170 kV



**Cubicle GIS**

· up to 38 kV


- Produces high quality products using angle-less type
- Multi-functional digital protection relay (HiMAP) applied
- High reliability secured, provides various operation information such as protection, measurement and control
- Firm external box, size and compact, making it safe
- Maintains high quality through stringent quality control system and continuous research and development



**Cast Resin Transformer**

· up to 36 kV, 20 MVA

- Enhanced reliability and secured safety with production of products based on the world's best equipment and stringent quality system
- Realized high efficiency by selecting slot based on FEM
- Realized small and lightweight with optimal design based on FEM analysis method
- Satisfies the quality standards of international accredited institutes (IEC, IEEE, CSA, NEMA, API etc.)

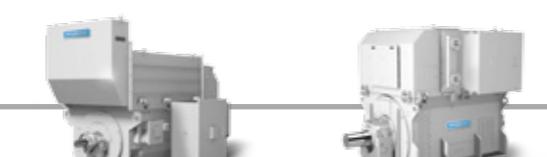

**Generators**

· 2-4 pole



**Synchronous Generator**

· 100 ~ 50,000 kVA  
· 220 ~ 22,000 V, 50/60 Hz  
· over 4 pole

**Wind Turbine Generator**

· up to 5 MW

**H+C Series Motor**

· 150-1,300 HP  
· 2,000 ~ 7,200 V, 50/60 Hz  
· 2-8 pole



## Marine

### Electrical Marine Equipment

- Production of high quality marine devices satisfying the regulations and standards of key marine associations (LRS, ABS, DNV, GL, BV, NK etc.) and world's renowned institutes
- High quality safety secured through the latest equipment and stringent quality control system
- Realization of optimal high efficiency by converging SWGR, Generator, Motor, Telecom, Automation and others



Marine Switchgear



Marine Motor



#### Metal Clad Switchgear

- up to 38 kV
- IEC, ANSI

#### Low Voltage Switchgear & Motor Control Center


- H8PU : 660 V, 3,000 A, 80 kA
- H5600 : 660 V, 3,000 A, 100 kA
- HiMCC : 1,000 V, 5,000 A, 100 kA



#### High Voltage AC Drive

- 220 ~ 440 V, ~ 132 kW

- Realizes powerful control performance through Sensor-less Vector Control and Auto Tuning
- High speed response due to Digital Signal Processor and High Speed My Com
- Compact design, enabling application in various environments
- Inverter manufactured using accumulated technology and know-how (outstanding technology of developing inverter for high-speed rail)

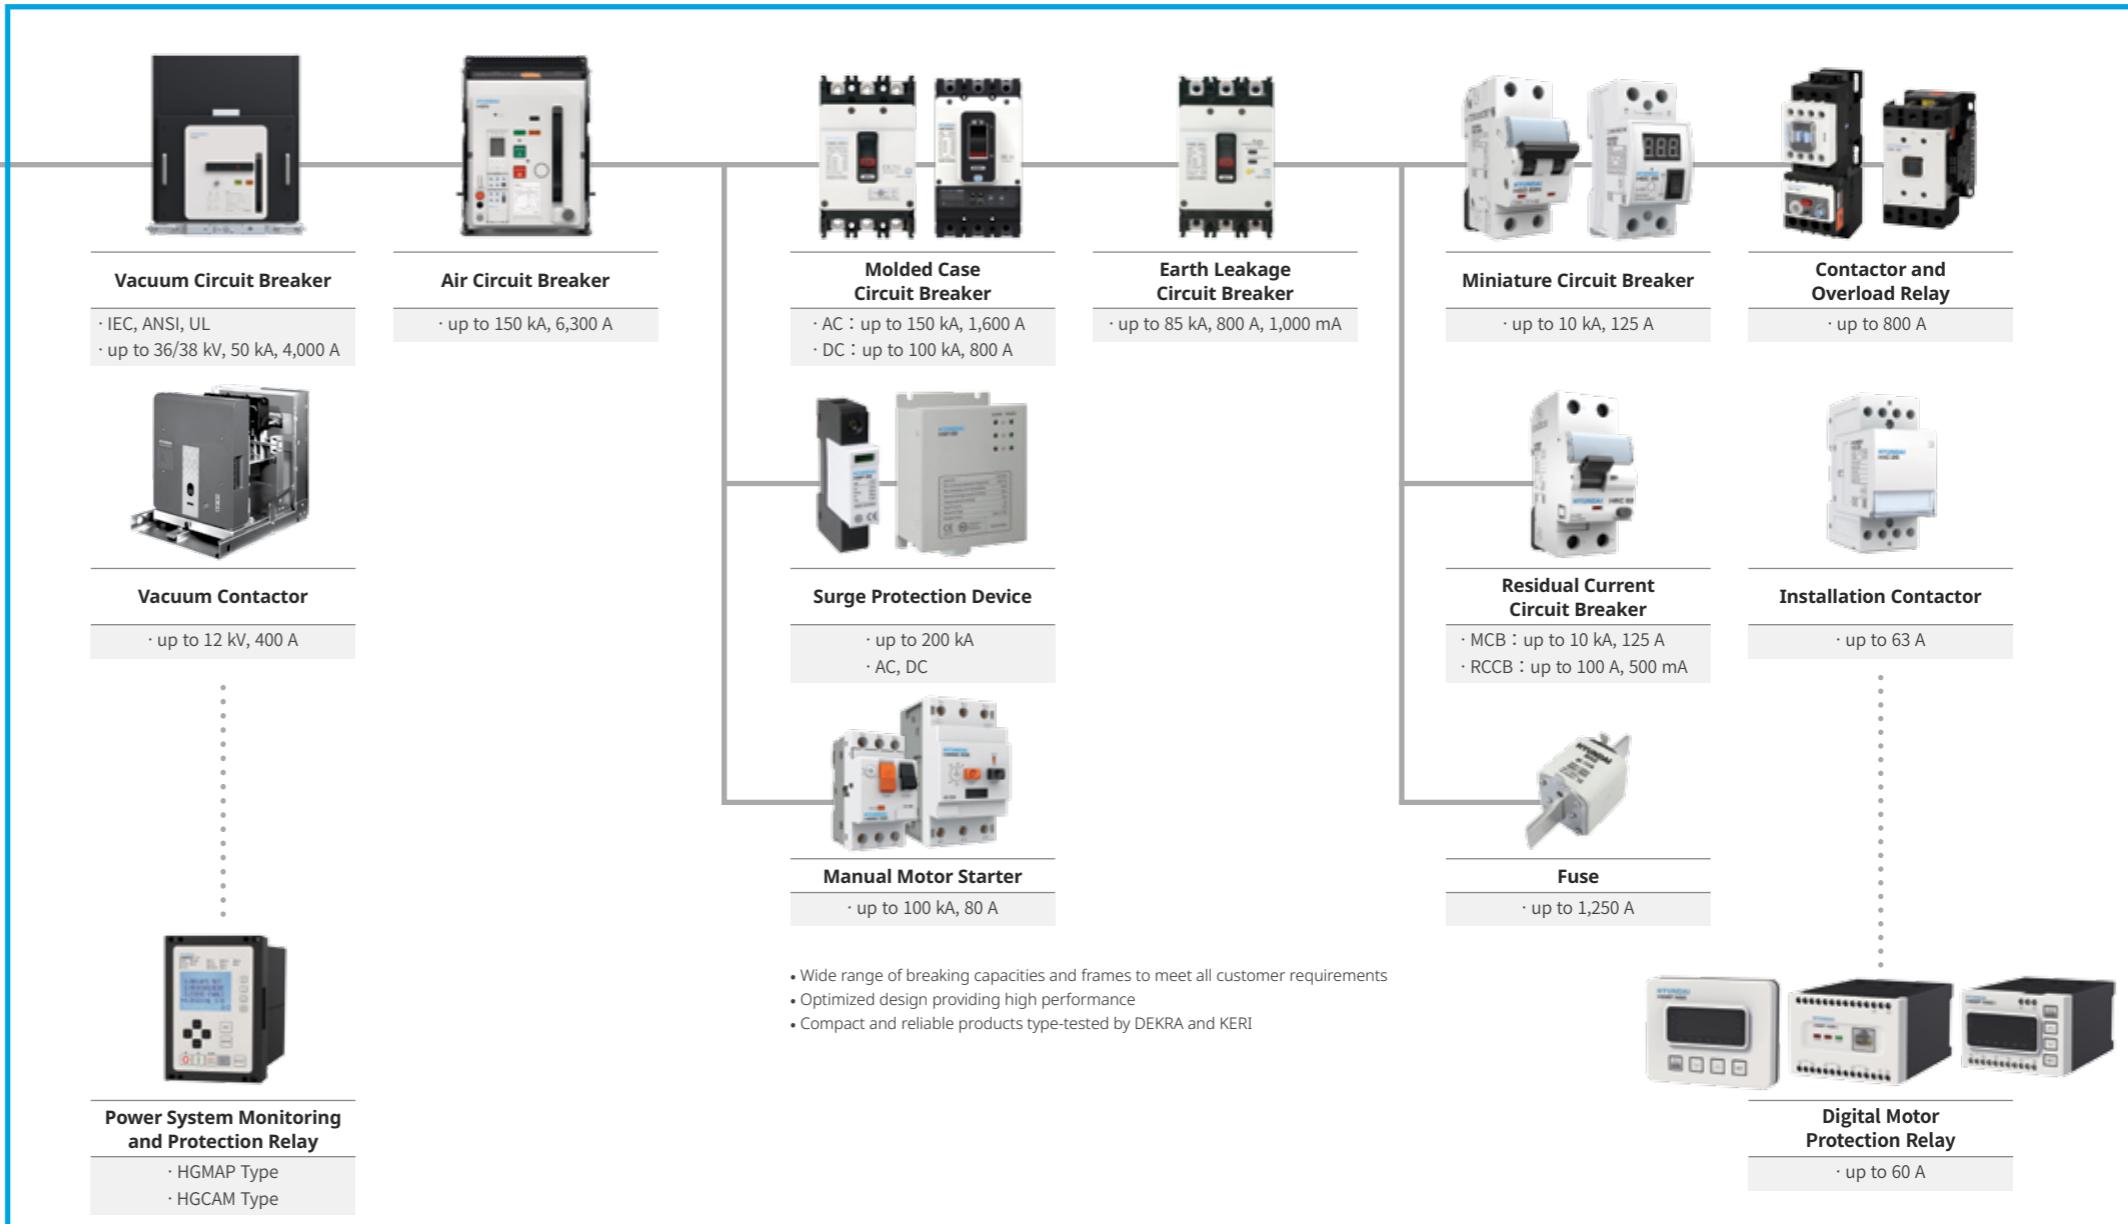

Medium & High Voltage Induction Motor



Inverter Shield Motor



NEMA Premium Efficiency Motor



Explosion-Proof (Class 1 Div.1) Motor





# Molded Case Circuit Breakers & Earth Leakage Circuit Breakers


|  |     |
|--|-----|
| <b>Characteristics</b>                     | 10  |
| <b>Model Selection Table</b>               | 28  |
| <b>Accessories</b>                         |     |
| HGM General Type                           | 72  |
| HGP High Breaking Type                     | 74  |
| Internal Accessories                       | 76  |
| External Accessories                       | 84  |
| <b>Technical Data</b>                      |     |
| Technical Data (HGM/HGE)                   | 110 |
| Technical Data (HGP)                       | 124 |
| Operation Characteristic Curve             | 149 |
| <b>Dimensions</b>                          | 166 |
| <b>Order Code</b>                          | 232 |
| <b>Handling and Maintenance Inspection</b> | 246 |
| <b>Acquired Standards</b>                  | 252 |

MCCB


## HG Series

# Molded Case Circuit Breakers & Earth Leakage Circuit Breakers

Maximized selectivity and safety with wide product range and reinforced breaking performance!

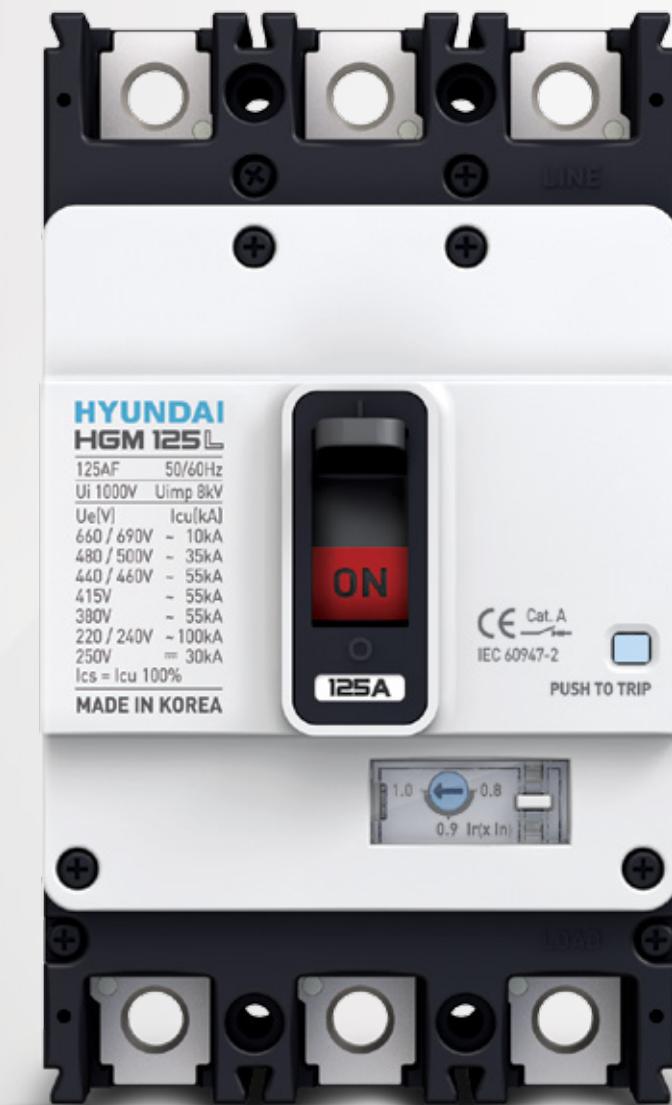

### Rated Short-Circuit Current by AF, ( $I_{cs} = 100\% I_{cu}$ at 440/460 V)

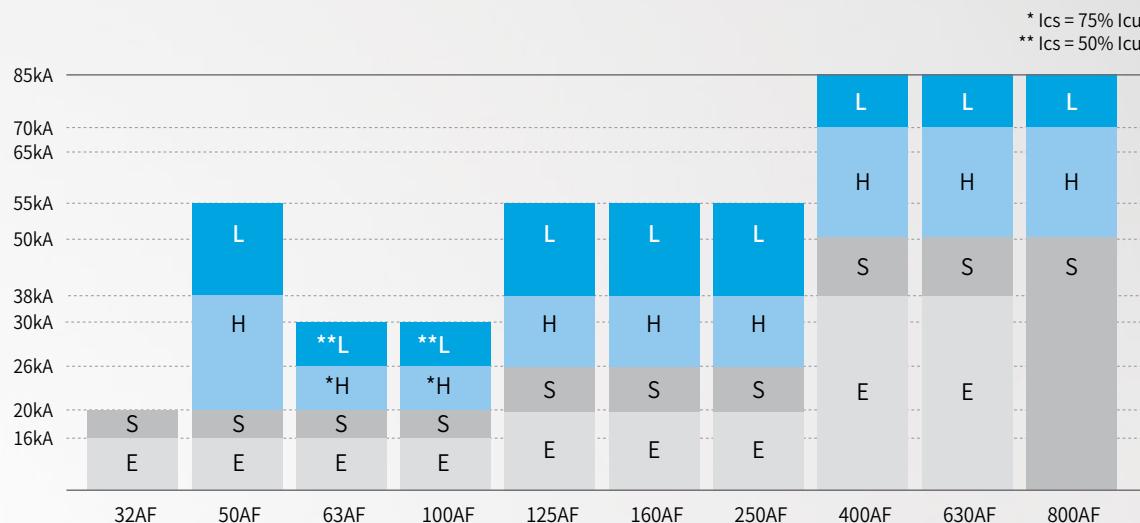

### Wide Product Range

HGM/HGE 32 AF ~ 800 AF

### High Breaking Capacity

16 kA ~ 85 kA (at 460 V),  $I_{cs} = 100\% I_{cu}$

### Rated Insulation Voltage of 1,000 V

### Reinforcement of Protective Coordination

It enables selective breaking.



Molded Case Circuit Breakers

### Adjustable Rated Current (Molded Case Circuit Breaker)

32 ~ 250 AF : 0.8 - 0.9 - 1 Times the Rated Current  
400 ~ 800 AF : 0.63 - 0.8 - 1 Times the Rated Current

### Adjustable Residual Current (Earth Leakage Circuit Breaker)

100 - 300 - 500 - 1,000 (mA)

### Adjustable Residual Current's Non-Operation Hour (Earth Leakage Circuit Breaker)

0 - 200 - 500 - 1,000 (ms)



Earth Leakage Circuit Breakers


## Characteristics

### Enhanced Performance and Various Selectivity

Various Range of Products : 10 Frames, 32 ~ 800 AF

Compatible MCCB, ELCB Dimensions and Common Use of Accessories


Standardization of Product Depth per Frame : 32 ~ 250 AF (68 mm), 400 ~ 800 AF (110 mm)

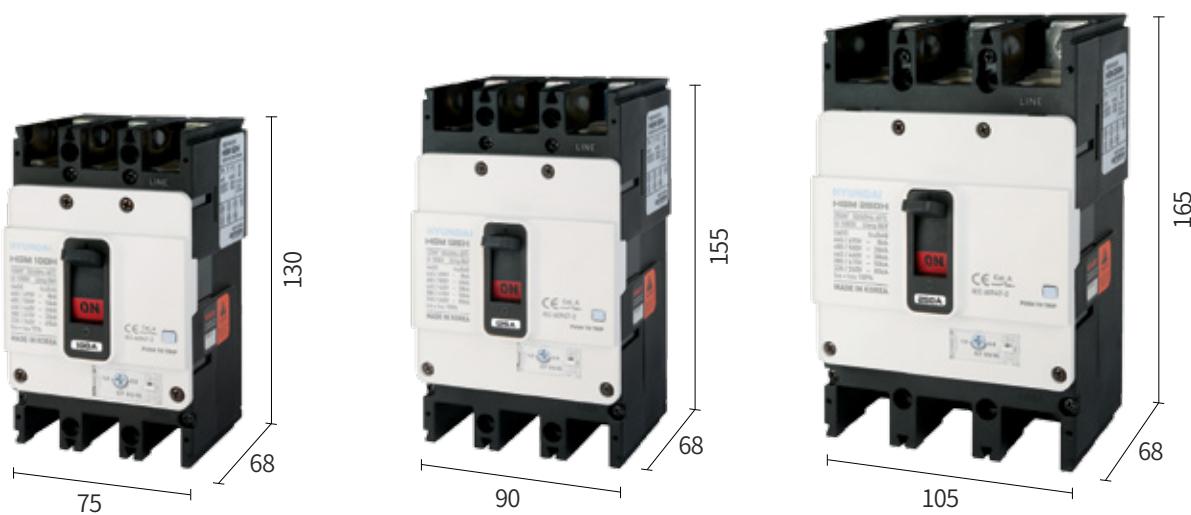


32, 50, 63, 100 AF

50, 125 AF

160, 250 AF



MCCB



ELCB



400 AF

630, 800 AF

Unit : mm

## Characteristics

### HGM Molded Case Circuit Breaker

#### Maximized Insulation Performance

The safety of the product has been maximized through enhanced insulation voltage

- Rated Insulation Voltage,  $U_i$  : 1,000 V
- Rated Impulse Withstand Voltage,  $U_{imp}$  : 8 kV

#### High Breaking Capacity

Maximum breaking capacity was realized with high breaking capacity in Korea.

- 16 ~ 30 kA at 460 V (32 ~ 100 AF)
- 20 ~ 55 kA at 460 V (125 ~ 250 AF)
- 38 ~ 85 kA at 460 V (400 ~ 800 AF)


#### Cable Insulation Performance Suitability

In case there is a presence of abnormal condition such as welding of the main contact after tripping of the circuit breaker by realizing the cable insulation performance in accordance with IEC 60947-2, the handle does not move from ON to OFF position. This makes it safe by preventing the operation of circuit breaker caused by the operator's negligence.

#### Adjustable Rated Current in all Frames


The adjustable rated current of up to 800 AF provides optimal protection for load variations in customer's equipment.

- Long Time ( $\leq 250$  AF) :  
3-step adjusting, 80 % - 90 % - 100 % of rated current
- Long Time (400 AF, 800 AF) :  
3-step adjusting, 63 % - 80 % - 100 % of rated current




#### Sealing Structure (Option) Applied

Dial sealing structure is applied to prevent arbitrary change of the current set value using a protection cover (Prevent operation of thermal magnetic adjustment knob) (Option).



| HYUNDAI     |               |
|-------------|---------------|
| HGM 125H    |               |
| 125AF       | 50/60Hz       |
| $U_i$ 1000V | $U_{imp}$ 8kV |

| $U_e(V)$          | $I_{cu}(kA)$ |
|-------------------|--------------|
| 660 / 690V        | ~ 8kA        |
| 480 / 500V        | ~ 26kA       |
| 440 / 460V        | ~ 38kA       |
| 415V              | ~ 38kA       |
| 380V              | ~ 42kA       |
| 220 / 240V        | ~ 85kA       |
| 250V              | = 20kA       |
| $I_{cs} = I_{cu}$ | 100%         |

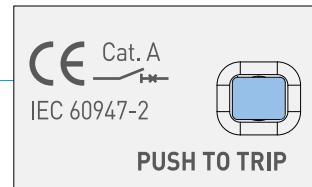


1.0 ← 0.8  
|| 0.9  $I_r(x \ln)$

### Service Breaking Capacity ( $I_{cs} = 100\% \times I_{cu}$ )

100 % service breaking capacity has been realized by significantly improving the breaking capacity by restricting accidental current using an internal current limiting device in case of short-circuit accidents.

- 32 ~ 800 AF
  - 16 ~ 55 kA @ 460 Vac (Below 250 AF)
  - 38 ~ 85 kA @ 460 Vac (400 ~ 800 AF)
- (HGM60, 100 H Type  $I_{cs} = 75\% I_{cu}$ , HGM60,  
100 L Type  $I_{cs} = 50\% I_{cu}$ )

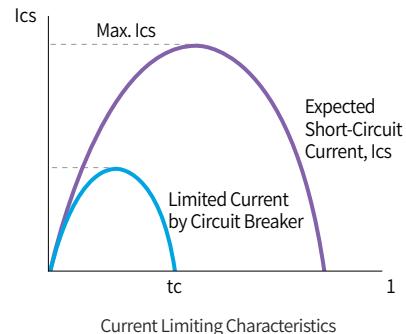

### Various Low Voltage System Protections



HGM Type MCCB realizes current limiting characteristics and outstanding breaking performance and enables various low voltage system protections such as discrimination and cascading.

#### Discrimination

It is a protection method in which when an accident occurs during load, the downstream circuit breaker that is directly related to the accident circuit operates first so that the other sound branch circuit breaker and the upstream main circuit breaker can feed continuously. It is a low voltage system protection method that can minimize the fault point by selectively preventing faults.

#### Cascading

In case an accident occurs during load, the upstream main circuit breaker operates earlier than the downstream circuit breaker of the accident circuit for back-up protection. It is an economic protection method. Thus, a circuit breaker with lower breaking capacity than the estimated short-circuit current can be applied.

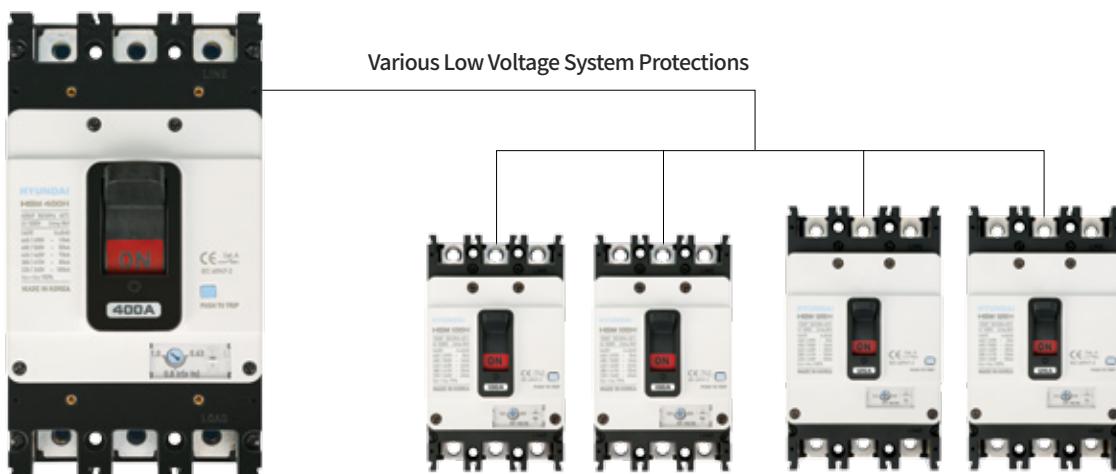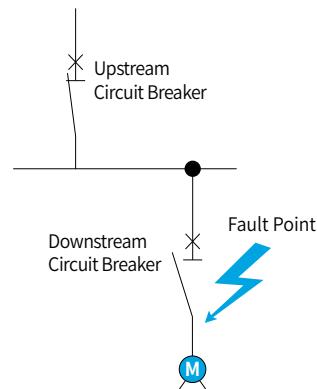

## Characteristics

### HGE Earth Leakage Circuit Breaker

#### Secures Equivalent Breaking Performance with MCCB, Maintains Compatibility with Dimensions and Accessories

- Service Breaking Current,  $I_{cs} = 100\% I_{cu}$
- Rated Impulse Withstand Voltage,  $U_{imp} : 6\text{ kV}$



#### Characteristics of Earth Leakage Protection

- Prevention function of damage caused by reverse connection : A circuit capable of preventing damage in PCB and Trip Coil has been applied to prevent damage despite usage during reserve connection caused by the misuse of user.
- The device is safe as it is equipped with a function that prevents unnecessary malfunction of earth leakage circuit breaker caused by temporary drop of voltage and noise signal.
- With the 3-phase power supply method, it safely breaks even during abnormal system voltage caused by open phase.
- By deploying filter circuit in IC, it safely protects the inverter load from grounding.

#### Adjustable Residual Current / Operating Time

| Item                  | Adjustable Residual Current |        |                      |        |          | Cut-Off Time |                      |        |          |
|-----------------------|-----------------------------|--------|----------------------|--------|----------|--------------|----------------------|--------|----------|
|                       | 30 mA                       | 100 mA | 300 mA               | 500 mA | 1,000 mA | 0 ms         | 200 ms               | 500 ms | 1,000 ms |
| Previous (U-ELCB)     | Fixed                       |        | Adjustable (3 Steps) |        | -        | Fixed        | -                    | -      | -        |
| New Product (HG-ELCB) | Fixed                       |        | Adjustable (4 Steps) |        |          |              | Adjustable (4 Steps) |        |          |

- With adjustable leakage current sensitivity (4 stages), prompt action can be taken without replacing the product depending on the load status.
- Selective protection coordination between upstream circuit breaker and downstream circuit breaker is possible through adjustable residual current and operating time, protecting the circuit safely

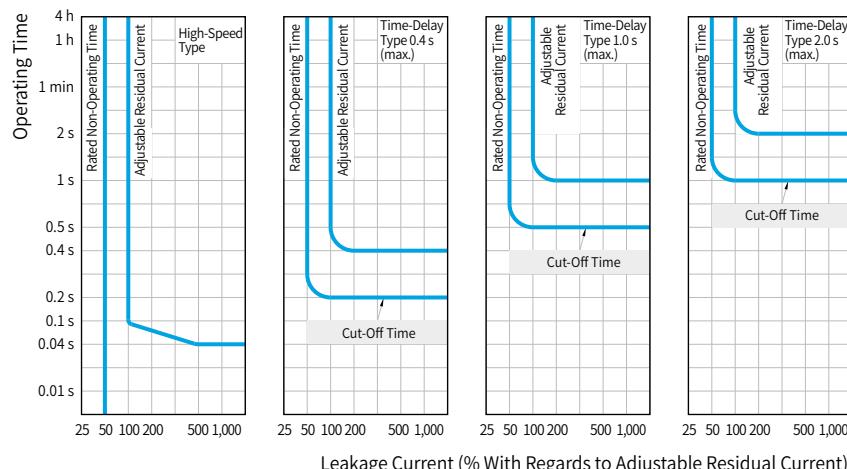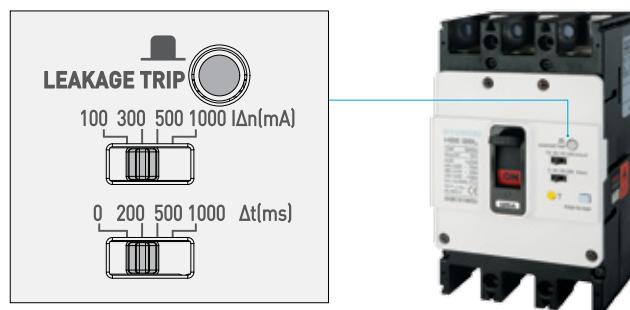

## Applicable standards and certifications

### Applicable Standards

#### Korean Standards

##### [KS C 8321 Molded Case Circuit Breaker for Industrial Uses](#)

(Molded Case Circuit Breaker for Industrial Uses)

##### [KS C 4613 Circuit Breaker Incorporating Residual Current Protection for Industrial Uses \(CBR\)](#)

(Circuit Breaker Incorporating Residual Current Protection for Industrial Uses (CBR))



#### International Standards

##### [IEC 60947-1](#)

Low Voltage Switchgear and Controlgear, Part 1 (General Rules)

##### [IEC 60947-2](#)

Low Voltage Switchgear and Controlgear, Part 2 (Circuit Breakers)

## Approvals and Certifications

HG-Series MCCB has acquired the testing/certification from certified testing institutes registered in STL in accordance with the IEC standard and domestic safety certifications (K 60747-2) and can be installed and applied depending on the usage environment and condition permitted in the standard.

- CB Certification (Certifying Institute, DEKRA)
- Safety Certification
- KS Certification
- Marine Approvals (8 Classifications)



### Vibration/Shock-Proof Test Certification Acquired

Our product has qualified the vibration/shock-proof test in accordance with the IEC 60068-2-6 which is a requirement of IACS, an international vessel inspection institute.

- 5 ~ 13.2 Hz : Displacement (1 mm)
- 13.2 ~ 100 Hz : Acceleration (0.7 g)



#### Our services

Testing, Inspections, Certification DEKRA provides certification of management systems as well as technical support, testing and certification of a wide range of products throughout the life cycle.

## HG Series

# Molded Case Circuit Breakers (HGP Type)

Realizes optimal protection performance regardless of changes in load situation with rated adjustment design!



## Rated Short-Circuit Current by AF (I<sub>cs</sub> = 100 % I<sub>cu</sub> at 440/460 V)

|        |        |         |         |        |        |        |        |        |        |
|--------|--------|---------|---------|--------|--------|--------|--------|--------|--------|
| 150 kA | 50DX   | 125DX   | 160DX   | 100X   | 160X   | 250X   | 400X   | 630X   | 800X   |
| 85 kA  |        |         |         |        |        |        |        |        |        |
| 70 kA  | 50DH   | 125DH   | 160DH   | 100H   | 160H   | 250H   | 400H   | 630H   | 800H   |
| 65 kA  |        |         |         |        |        |        |        |        |        |
| 36 kA* | 50DS   | 125DS   | 160DS   | 100S   | 160S   | 250S   | 400S   | 630S   | 800S   |
| 36 kA* | 50DF   | 125DF   | 160DF   | 100F   | 160F   | 250F   | 400F   | 630F   | 800F   |
|        | 50D AF | 125D AF | 160D AF | 100 AF | 160 AF | 250 AF | 400 AF | 630 AF | 800 AF |

\* F type is for overseas sales.

## Wide Product Range

HGP 50 AF ~ 800 AF

## Realizes Maximum Breaking Capacity in Korea

150 kA (at 460 V)

## Reinforcement of Protective Coordination

It enables selective breaking.

## Acquisition of Various Certifications

DEKRA, marine and KS certifications have been acquired.

## Adjustable Operating Characteristics

### Rated Current

3-Steps, 0.8 - 1 Times the Rated Current

(Thermal Magnetic Type)

9-Steps, 0.4 - 1 Times the Rated Current

(Electronic Type)

### Instantaneous Current

6-Steps, 5 - 6 - 7 - 8 - 9 - 10 Times the Rated Current

(Thermal Magnetic Type)

9-Steps, 1.5 - 10 Times the Rated Current

(Electronic Type, Short Time Current)



Thermal Magnetic Type



Electronic Type

## Characteristics (HGP)

### Outstanding Protection Coordination and Maximized Breaking Capacity

Simplified Dimension with 4 Types from 50 ~ 800 AF

Adjustable Rated Currents in all Models

Owes the Outstanding Breaking Capacity in all Frames : 150 kA at 460 V

Various Breaking Coordination such as Selective Breaking and Others

Guaranteed Breaking Capacity in Reverse Connection



Trip Device : Thermal Magnetic Type

50D, 125D, 160D AF

Trip Device : Thermal Magnetic Type, Electronic Type

100, 160, 250 AF



Thermal Magnetic Type



Electronic Type



Trip Device : Thermal Magnetic Type, Electronic Type

400, 630 AF



Trip Device : Thermal Magnetic Type, Electronic Type

800 AF

Unit : mm

## Characteristics (HGP)

### HGP MCCB Trip Device

- The device to monitor the system and send a breaking signal to protect load and a cable
- The external dimensions and accessories are for common use regardless of the type of a trip device.

- A trip unit is replaceable, which depends on load types and protection characteristics.  
(Common use for the circuit breaker body)
- It has various ratings and adjustable functions.

Thermal Magnetic Type



Electronic Type



| Type   | 2.5 ~ 12.5 | 16 ~ 80 | 100 | 125 ~ 800 |
|--|------------|---------|-----|-----------|
| Thermal Magnetic (Thermal Fixed / Instantaneous Fixed)           |            | ●       | ●   | ●         |
| Thermal Magnetic (Thermal Adjustable / Instantaneous Fixed)      |            | ●       | ●   | ●         |
| Thermal Magnetic (Thermal Adjustable / Instantaneous Adjustable) |            |         | ●   | ●         |
| Electronic (E, A, N, D Type)                                     |            |         | ●   | ●         |
| For Motor Protection, Switch-Disconnector                        | ●          | ●       | ●   | ●         |



- MTM-25-FF : Thermal Fixed / Instantaneous Fixed
- MTM-25-JF : Thermal Adjustable / Instantaneous Fixed
- MTM-25-JJ : Thermal Adjustable / Instantaneous Adjustable



- ETU-25-N : Normal Type
- ETU-25-D : Display Type
- ETU-25-A : Ammeter Type
- ETU-25-E : Energy-meter Type

- MCP-25-OJ : Instantaneous Adjustable

- DSU-25 : No protection

## HGP Type ETU (Electrical Trip Unit)

- Equipped with intelligent electronic function for a new era
- Maximizes a system energy efficiency the function of monitoring commutation and power

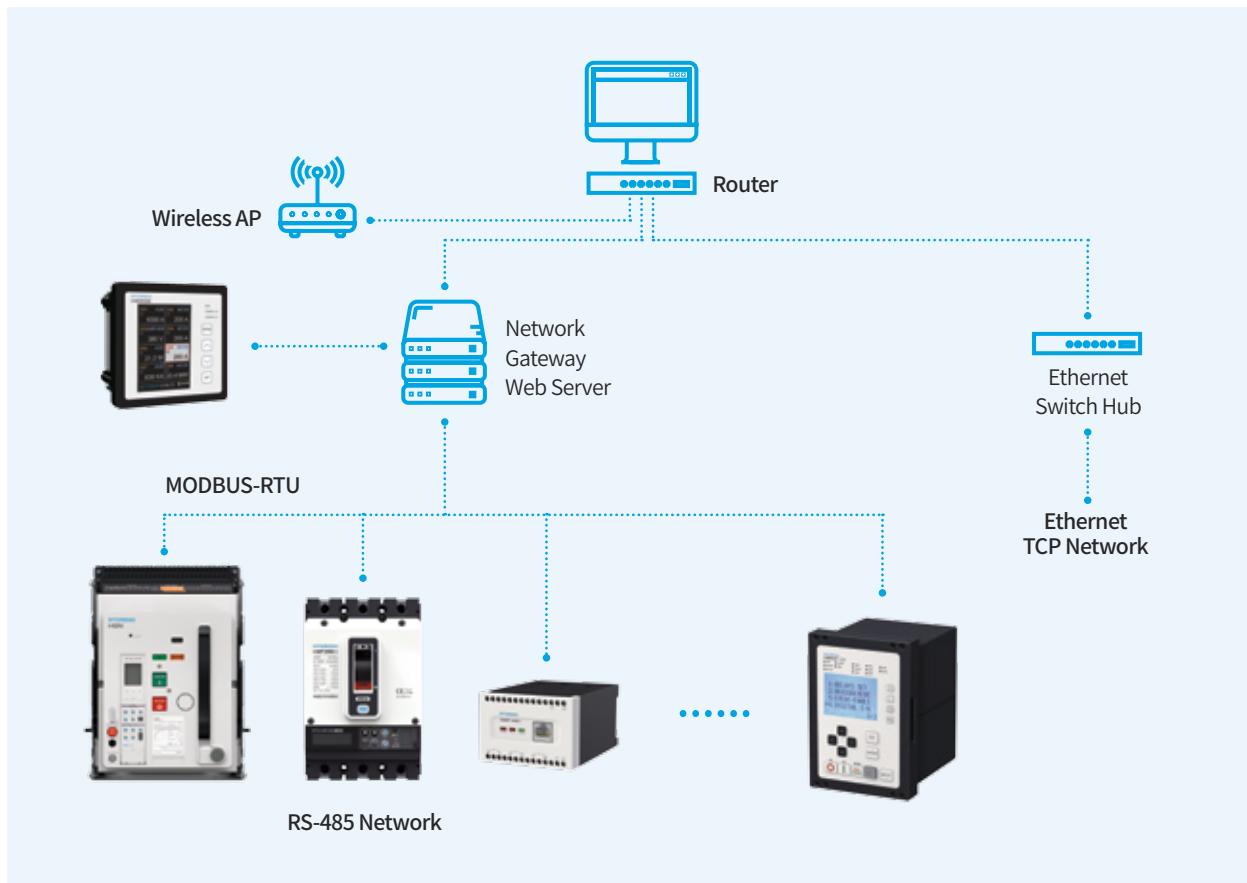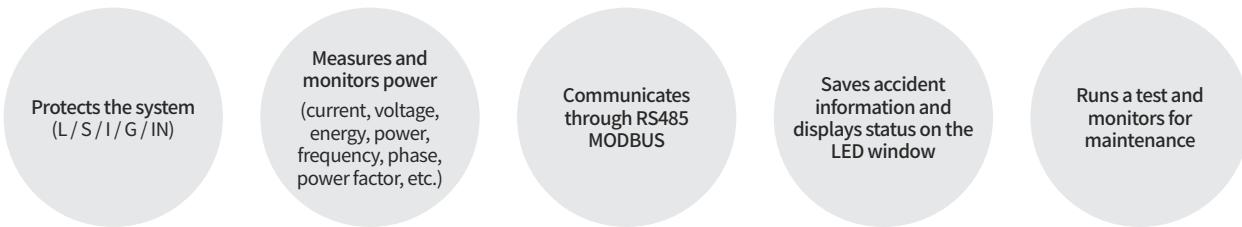

It checks current status on the front display and product status on the LED window.  
(Pre trip alarm)



It monitors the system with a maintenance tool.



It applies a transparent protection cover.  
(prevent pollution and operation)

## Characteristics (HGP)

### HGP Molded Case Circuit Breaker

#### Maximized Insulation Performance

The safety of the product has been maximized through improved insulation voltage

- Rated Insulation Voltage,  $U_i$  : 1,000 V
- Rated Impulse Withstand Voltage,  $U_{imp}$  : 8 kV

#### High Breaking Capacity

Maximum breaking capacity was realized with regards to all frames with high breaking capacity in Korea.

- 150 kA at 460 V (Same performance secured in all frames)


#### Cable Insulation Performance Suitability

In case there is presence of abnormal condition such as welding of the main contact after tripping the circuit breaker by realizing the cable insulation performance in accordance with IEC 60947-2, the handle does not move from ON to OFF position, making it safe by preventing the operation of circuit breaker caused by the operator's negligence.

#### Adjustable Rated Current in all Frames



The adjustable rated current of up to 800 AF provides optimal protection for load variations in customer's equipment.

- Rated Current  
Thermal Magnetic Type : 0.8 - 1 times the rated current (3 Step)  
Electronic Type : 0.4 - 1 times the rated current (9 Step)
- Instantaneous Current  
Thermal Magnetic Type : 5 - 6 - 7 - 8 - 9 - 10 times the rated current (6 Step)  
Electronic Type : 1.5 - 10 times the rated current (9 Step, Short Time Adjusting)



#### Sealing Structure (Option) Applied

Dial sealing structure was applied to prevent arbitrary change of the current set value using a protection cover (Prevent operation of thermal magnetic adjustment knob) (Option).

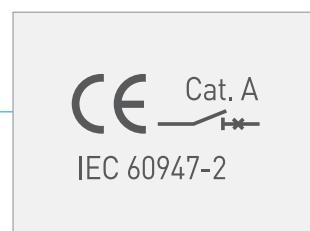


| Ue(V)      | Icu(kA) |
|------------|---------|
| 660 / 690V | ~ 10kA  |
| 480 / 500V | ~ 50kA  |
| 440 / 460V | ~ 70kA  |
| 380 / 415V | ~ 85kA  |
| 220 / 240V | ~ 100kA |
| 240V       | 65kA    |
| Ics = Icu  | 100%    |



### Service Breaking Capacity ( $I_{cs} = 100\% \times I_{cu}$ )

100 % service breaking capacity has been realized by significantly enhancing the breaking capacity by restricting accidental current using an internal current limiting device in case of short-circuit accidents.

- 50 ~ 800 A.F
- 36 ~ 150 kA @ 460 V.ac

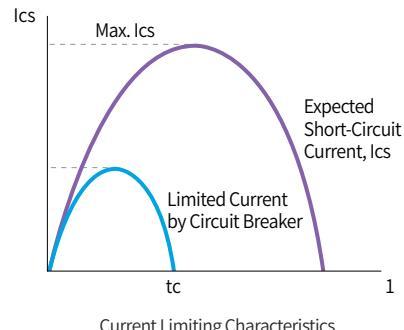

### Guaranteed Breaking Capacity in Reverse Connection

The same breaking performance is guaranteed even if the device is used by mixing LINE (Line side)/LOAD (Load side).


- Realizes integrated barrier circuit breaker that reinforces phase to phase insulation
- Realizes fast breaking operating characteristics by applying instantaneous mechanism part

### Various Low Voltage System Protections

HGP Type MCCB realizes current limiting characteristics and outstanding breaking performance and enables various low voltage system protections such as discrimination and cascading.

#### Discrimination

It is a protection method in which when an accident occurs during load, the downstream circuit breaker that is directly related to the accident circuit operates first so that the other sound branch circuit breaker and the upstream main circuit breaker can feed continuously. It is a low voltage system protection method that can minimize the fault point by selectively preventing faults.

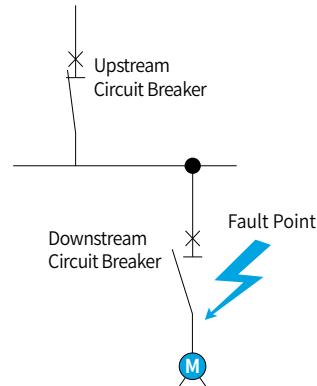


#### Cascading

In case an accident occurs during load, the upstream main circuit breaker operates earlier than the downstream circuit breaker of the accident circuit for back-up protection. It is an economic protection method that enables circuit breaker with lower breaking capacity than the estimated short-circuit current to be applied.



## External Structure and Indications

### Molded Case Circuit Breaker (MCCB)

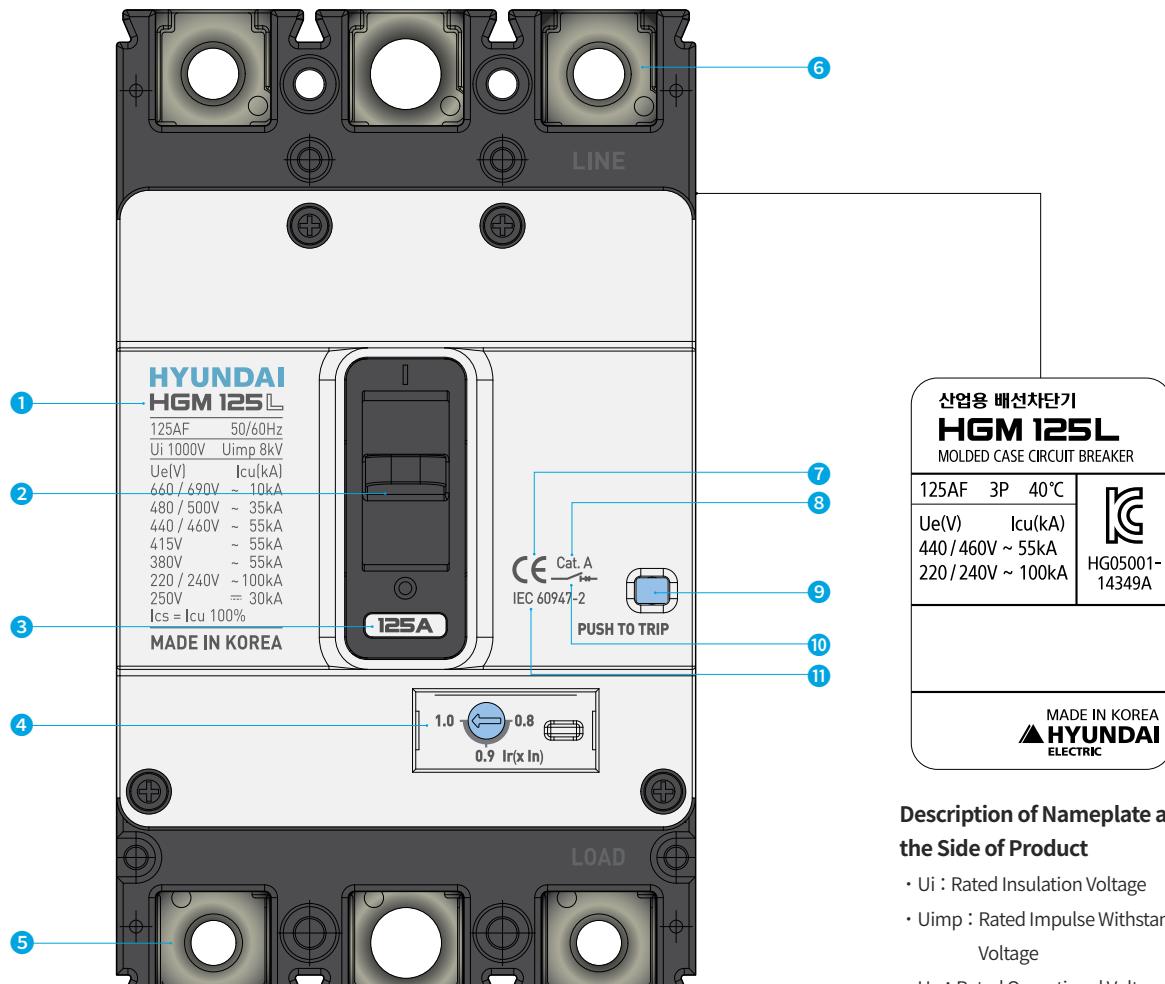

#### Molded Case Circuit Breaker (MCCB)

- ① Manufacturer and Product Name
- ② Operating Handle
- ③ Rated Current Nameplate
- ④ Rated Current Adjusting Dial


- ⑤ Load Side Terminal
- ⑥ Line Side Terminal
- ⑦ CE Marking
- ⑧ Utilization Category

- ⑨ Trip Button
- ⑩ Cable Insulation Performance Suitability
- ⑪ Reference Standard

#### Description of Nameplate at the Side of Product

- $U_i$  : Rated Insulation Voltage
- $U_{imp}$  : Rated Impulse Withstand Voltage
- $U_e$  : Rated Operational Voltage
- $I_{cu}$  : Rated Ultimate Short-Circuit Breaking Capacity (o-co)
- $I_{cs}$  : Rated Service Short-Circuit Breaking Capacity (o-co-co)

## Earth Leakage Circuit Breakers (ELCB)

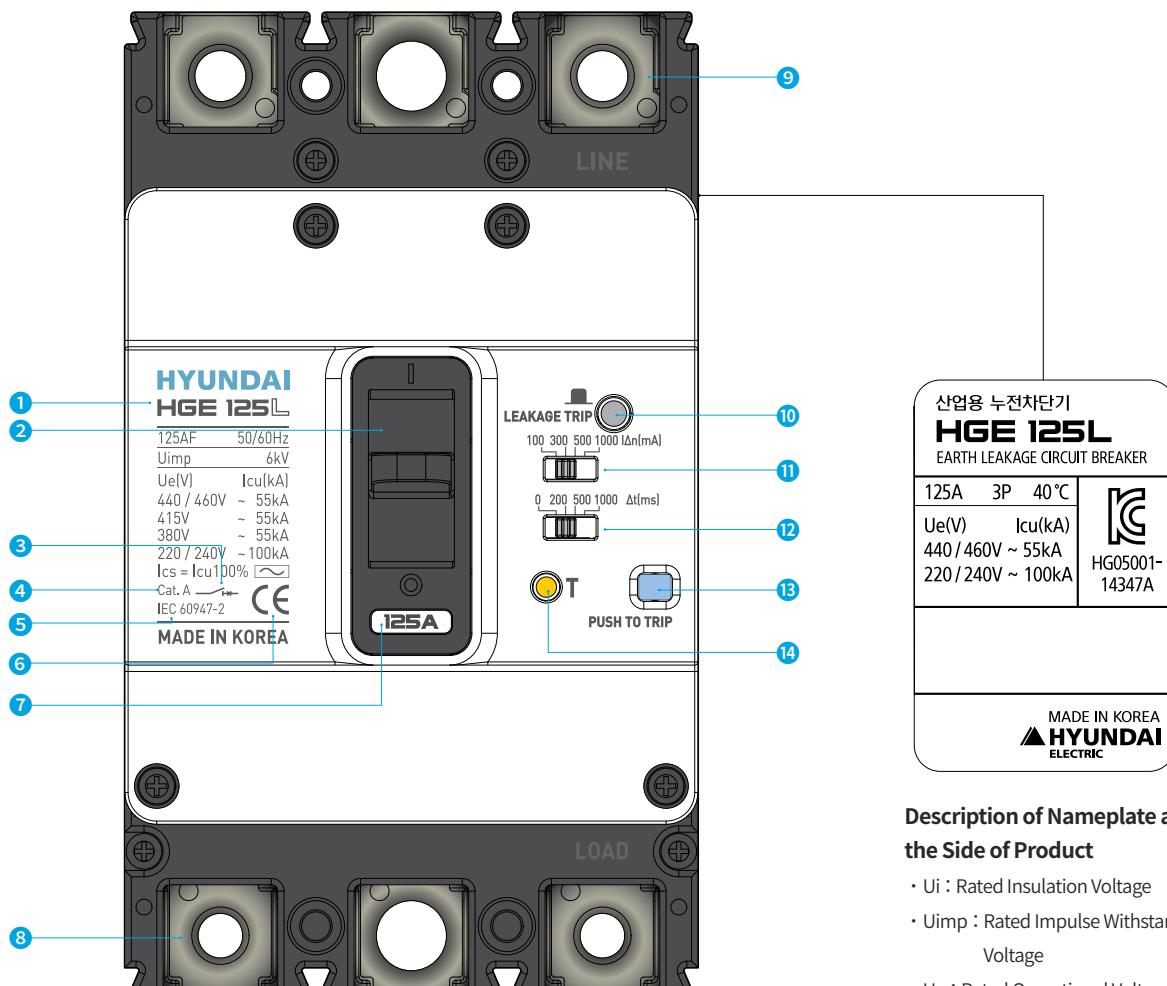

### Description of Nameplate at the Side of Product


- $U_i$  : Rated Insulation Voltage
- $U_{imp}$  : Rated Impulse Withstand Voltage
- $U_e$  : Rated Operational Voltage
- $I_{cu}$  : Rated Ultimate Short-Circuit Breaking Capacity (o-co)
- $I_{cs}$  : Rated Service Short-Circuit Breaking Capacity (o-co-co)

### Earth Leakage Circuit Breakers (ELCB)

- |  |                           |  |   |
|--|---------------------------|--|---|
| ① Manufacturer and Product Name            | ④ Utilization Category    | ⑨ Line Side Terminal                         | ⑯ Rated Non-Operating Time Setting Switch |
| ② Operating Handle                         | ⑤ Reference Standard      | ⑩ Leakage Trip Indication Device             | ⑰ Trip Button                             |
| ③ Cable Insulation Performance Suitability | ⑥ CE Marking              | ⑪ Adjustable Residual Current Setting Switch | ⑲ Leakage Test Button                     |
|  | ⑦ Rated Current Nameplate |  |   |
|  | ⑧ Load Side Terminal      |  |   |

## External Structure and Indications

### Molded Case Circuit Breaker (HGP Type)

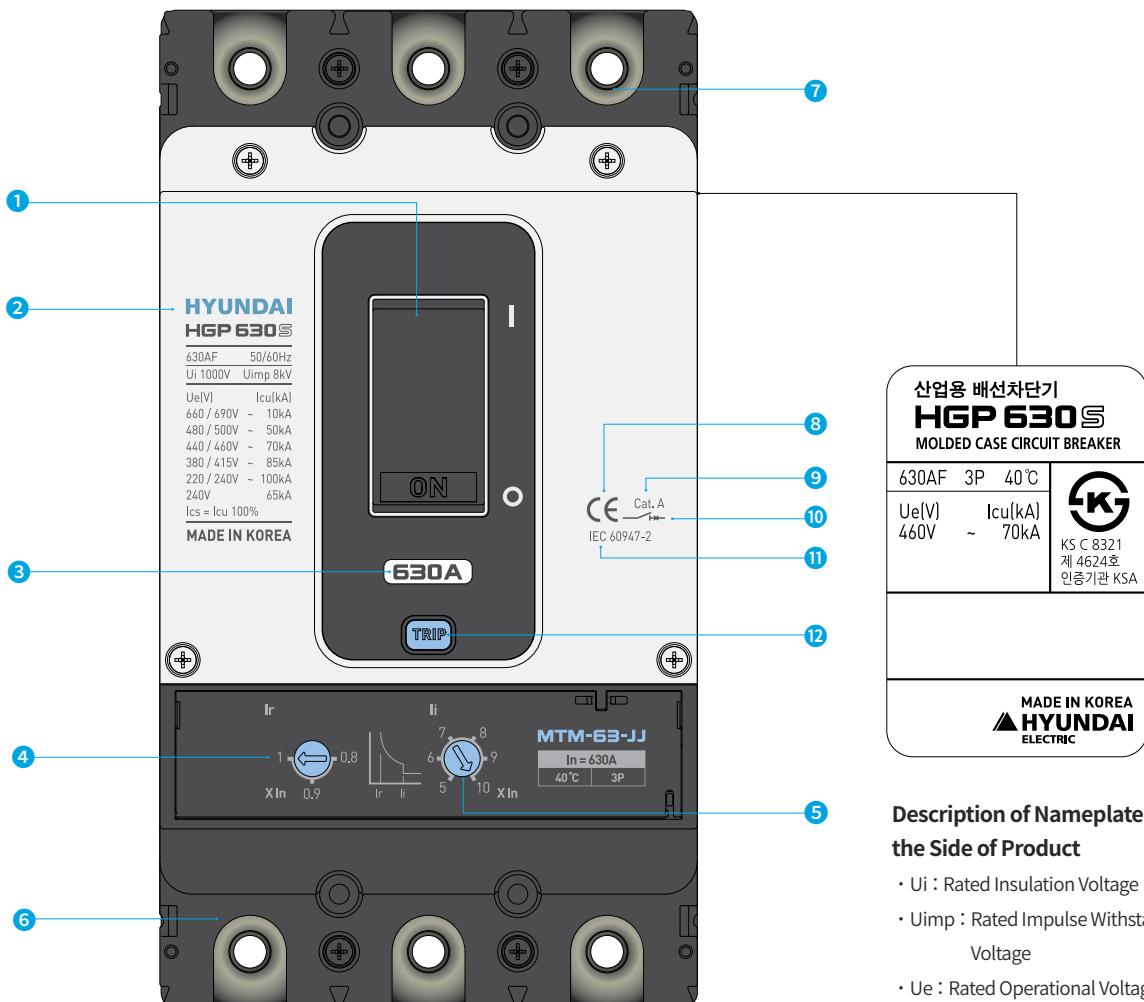


#### Description of Nameplate at the Side of Product

- Ui : Rated Insulation Voltage
- Uimp : Rated Impulse Withstand Voltage
- Ue : Rated Operational Voltage
- Icu : Rated Ultimate Short-Circuit Breaking Capacity (o-co)
- Ics : Rated Service Short-Circuit Breaking Capacity (o-co-co)

#### Molded Case Circuit Breaker (HGP Type)

- |   |  |  |
|---|--|--|
| ① Operating Handle                      | ⑤ Instantaneous Operating Current Adjusting Dial | ⑨ Utilization Category                     |
| ② Manufacturer and Product Name         | ⑥ Load Side Terminal                             | ⑩ Cable Insulation Performance Suitability |
| ③ Rated Current Nameplate               | ⑦ Line Side Terminal                             | ⑪ Reference Standard                       |
| ④ Long Operating Current Adjusting Dial | ⑧ CE Marking                                     | ⑫ Trip Button                              |

## Molded Case Circuit Breaker (HGP DC Type)

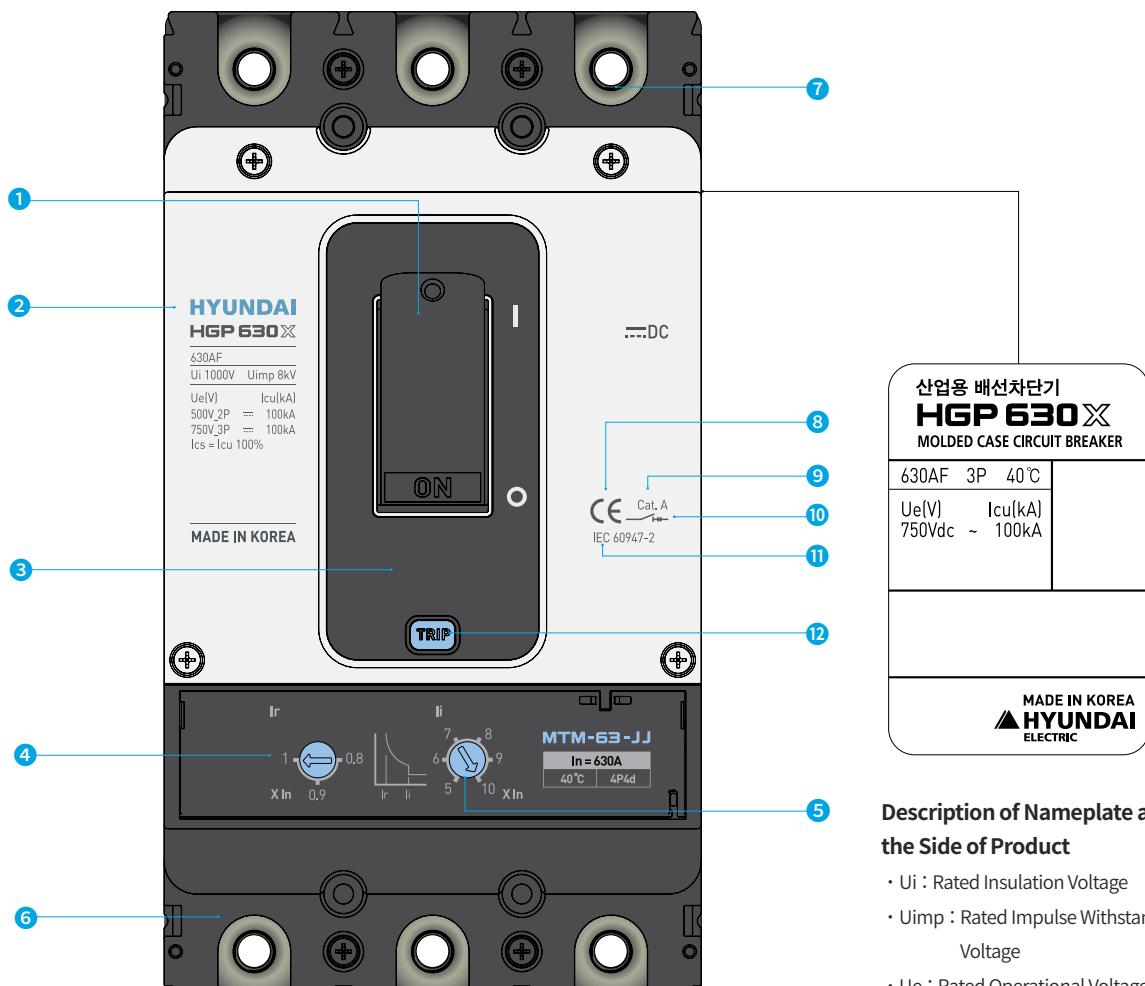

### Description of Nameplate at the Side of Product

- $Ui$  : Rated Insulation Voltage
- $Uimp$  : Rated Impulse Withstand Voltage
- $Ue$  : Rated Operational Voltage
- $Icu$  : Rated Ultimate Short-Circuit Breaking Capacity (o-co)
- $Ics$  : Rated Service Short-Circuit Breaking Capacity (o-co-co)

## Molded Case Circuit Breaker (HGP Type)

- |   |  |  |
|---|--|--|
| ① Operating Handle                      | ⑤ Instantaneous Operating Current Adjusting Dial | ⑨ Utilization Category                     |
| ② Manufacturer and Product Name         | ⑥ Load Side Terminal                             | ⑩ Cable Insulation Performance Suitability |
| ③ Rated Current Nameplate               | ⑦ Line Side Terminal                             | ⑪ Reference Standard                       |
| ④ Long Operating Current Adjusting Dial | ⑧ CE Marking                                     | ⑫ Trip Button                              |

## Model Selection Table

### Molded Case Circuit Breaker (HGM Type) : 32 ~ 250 AF

#### Common Ratings

|  |   |                           |             |
|--|---|---------------------------|-------------|
| Rated Insulation Voltage, $U_i$            | 1,000 V   | Suitability for Isolation | Yes         |
| Rated Operational Voltage, $U_e$           | 690 V   | Utilization Category      | A           |
| Rated Impulse Withstand Voltage, $U_{imp}$ | 8 kV  | Pollution Degree          | 3           |
| Protection Function                        | Overload, Instantaneous, Short-Circuit Protection | Reference Standard        | IEC 60947-2 |

| Model Name   |                              | HGM30  |                        |                | HGM50                  |  |                | HGM60                      |  |                |
|--|------------------------------|--|------------------------|----------------|------------------------|--|----------------|----------------------------|--|----------------|
| Frame  | (AF)                         | 32   |                        |                | 50                     |  |                | 63                         |  |                |
| Number of Poles  | (P)                          | 2, 3, 4 <sup>1)</sup>                            |                        |                | 2, 3, 4 <sup>1)</sup>  |  |                | 2, 3, 4 <sup>1)</sup>      |  |                |
| Rated Current, at 40 °C  | (A)                          | 16, 20, 25, 32                                   |                        |                | 16, 20, 25, 32, 40, 50 |  |                | 16, 20, 25, 32, 40, 50, 63 |  |                |
| <b>Rated Ultimate Short-Circuit Breaking Capacity [Icu] (kA rms)</b> |                              |  |                        |                |                        |  |                |                            |  |                |
| Short-Circuit Breaking Category Code                                 |                              | E  | S                      | E              | S                      | H                                      | L              | E                          | S                                      | H              |
| AC 660/690 V   |                              | 2.5  | 5                      | 2.5            | 5                      | 8                                      | 10             | 2.5                        | 5                                      | 7.5            |
| AC 480/500 V   |                              | 7.5  | 10                     | 7.5            | 10                     | 26                                     | 35             | 7.5                        | 10                                     | 14             |
| <b>AC 415/440/460 V</b>  |                              | <b>16</b>  | <b>20</b>              | <b>16</b>      | <b>20</b>              | <b>38</b>                              | <b>55</b>      | <b>16</b>                  | <b>20</b>                              | <b>26</b>      |
| AC 380 V   |                              | 18   | 22                     | 18             | 22                     | 42                                     | 55             | 18                         | 22                                     | 30             |
| AC 220/240 V   |                              | 35   | 50                     | 35             | 50                     | 85                                     | 100            | 35                         | 50                                     | 50             |
| DC 250 V (2P)  |                              | 5  | 10                     | 5              | 10                     | 20                                     | 30             | 5                          | 10                                     | 15             |
| Service Breaking Capacity [ $I_{cs} = \% I_{cu}$ ]                   |                              | 100  | 100                    | 100            | 100                    | 100                                    | 100            | 100                        | 100                                    | 75             |
| <b>Rated Short-Circuit Making Capacity [Icm] (kA peak)</b>           |                              |  |                        |                |                        |  |                |                            |  |                |
| AC 660/690 V   |                              | 4  | 8                      | 4              | 8                      | 14                                     | 17             | 4                          | 8                                      | 13             |
| AC 480/500 V   |                              | 13   | 17                     | 13             | 17                     | 55                                     | 74             | 13                         | 17                                     | 28             |
| <b>AC 415/440/460 V</b>  |                              | <b>32</b>  | <b>40</b>              | <b>32</b>      | <b>40</b>              | <b>80</b>                              | <b>121</b>     | <b>32</b>                  | <b>40</b>                              | <b>55</b>      |
| AC 380 V   |                              | 36   | 47                     | 36             | 47                     | 89                                     | 121            | 36                         | 47                                     | 63             |
| AC 220/240 V   |                              | 74   | 105                    | 74             | 105                    | 187                                    | 220            | 74                         | 105                                    | 105            |
| DC 250 V (2P)  |                              | 8  | 17                     | 8              | 17                     | 40                                     | 63             | 8                          | 17                                     | 30             |
| <b>Endurance [times] (Durability)</b>                                |                              |  |                        |                |                        |  |                |                            |  |                |
| Mechanical   |                              | 30,000   |                        |                | 30,000                 |  |                | 30,000                     |  |                |
| Electrical (at 460 V)  |                              | 10,000   |                        |                | 10,000                 |  |                | 10,000                     |  |                |
| <b>Trip Device</b>   |                              |  |                        |                |                        |  |                |                            |  |                |
| Thermal<br>Magnetic  | Long Time<br>[LTD]           | Fixed  | (1.0) × In             |                |                        | (1.0) × In                             |                |                            | (1.0) × In                             |                |
|  |                              | Adjustable                                       | (0.8 - 0.9 - 1.0) × In |                |                        | (0.8 - 0.9 - 1.0) × In                 |                |                            | (0.8 - 0.9 - 1.0) × In                 |                |
| Instantaneous [INST]   |                              |  | 400 A                  |                |                        | 16 ~ 32 A : 400 A, 40 ~ 50 A : 10 × In |                |                            | 16 ~ 32 A : 400 A, 40 ~ 63 A : 10 × In |                |
| <b>Accessory</b>   |                              |  |                        |                |                        |  |                |                            |  |                |
| Internal   | Auxiliary Switch             | AUX  | ●                      |                | ●                      |  |                | ●                          |  |                |
|  | Alarm Switch                 | ALT  | ●                      |                | ●                      |  |                | ●                          |  |                |
|  | Shunt Trip                   | SHT  | ●                      |                | ●                      |  |                | ●                          |  |                |
|  | Under-Voltage Trip           | UVT  | ●                      |                | ●                      |  |                | ●                          |  |                |
| External   | Rotary Handle                | Front Contact TFG                                | ●                      |                | ●                      |  |                | ●                          |  |                |
|  |                              | Extension TFH                                    | ●                      |                | ●                      |  |                | ●                          |  |                |
|  | Mechanical Open/Close Device | MOT  | ●                      |                | ●                      |  |                | ●                          |  |                |
|  | Mechanical Interlock         | MIF  | ●                      |                | ●                      |  |                | ●                          |  |                |
|  | Handle Locking Device        | PLD  | ●                      |                | ●                      |  |                | ●                          |  |                |
|  | TDM (LINE/LOAD)              | ● (3P Only)                                      | ● (3P Only)            | ● (3P Only)    | ● (3P Only)            | ● (3P Only)                            |                | ● (3P Only)                |  |                |
|  | TDM (LINE Only)              | ● (3P Only)                                      | ● (3P Only)            | ● (3P Only)    | ● (3P Only)            | ● (3P Only)                            |                | ● (3P Only)                |  |                |
|  | TDF (LINE Only)              | ● (3P Only)                                      | ● (3P Only)            | ● (3P Only)    | ● (3P Only)            | ● (3P Only)                            |                | ● (3P Only)                |  |                |
|  | TDA (1 row)                  | ● (3P Only)                                      | ● (3P Only)            | ● (3P Only)    | ● (3P Only)            | ● (3P Only)                            |                | ● (3P Only)                |  |                |
|  | TDA (2 rows)                 | ● (2, 3P Only)                                   | ● (2, 3P Only)         | ● (2, 3P Only) | ● (2, 3P Only)         | ● (2, 3P Only)                         |                | ● (2, 3P Only)             |  |                |
| Cage Terminal Block  |                              | CTB  | ●                      |                | ●                      |  |                | ●                          |  |                |
| Terminal Cover   |                              | TCF  | ●                      |                | ●                      |  |                | ●                          |  |                |
| Insulation Barrier   |                              | TQQ  | ●                      |                | ●                      |  |                | ●                          |  |                |
| Terminal Bus Bar   |                              | TBB  | -                      |                | -                      |  |                | -                          |  |                |
| <b>Installation and Dimensions</b>                                   |                              |  |                        |                |                        |  |                |                            |  |                |
| Connection/<br>Installation  | Front Connection             | Terminal Screw                                   |                        |                |                        |  |                |                            |  |                |
|  | Rear Connection              | Horizontal/Vertical                              |                        |                |                        |  |                |                            |  |                |
|  | Plug-in                      | Switchgear (Line & Load, Line Only), Switchboard |                        |                |                        |  |                |                            |  |                |
| Dimension<br>(mm)  | DIN Rail Installation        | Possible if DIN Rail adaptor is used             | -                      |                |                        | Possible if DIN Rail adaptor is used   |                |                            |  |                |
|  | a (2/3/4P)                   | 50/75/100  | 50/75/100              | 50/75/100      | 50/75/100              | 60/90/120                              | 60/90/120      | 60/90/120                  | 60/90/120                              | 60/90/120      |
|  | b                            | 130  | 130                    | 130            | 130                    | 155                                    | 155            | 155                        | 155                                    | 155            |
|  | c                            | 68   | 68                     | 68             | 68                     | 68                                     | 68             | 68                         | 68                                     | 68             |
| Weight (kg)  |                              | 2/3/4P   | 0.6/0.8/1.0            | 0.6/0.8/1.0    | 0.6/0.8/1.0            | 0.8/1.0/1.3                            | 0.8/1.0/1.3    | 0.8/1.0/1.3                | 0.8/1.0/1.3                            | 0.8/1.0/1.3    |
| Detailed Rating and Selection  |                              |  | 232 Page               | 232 Page       | 232 Page               | 232 Page                               | 232 Page       | 232 Page                   | 232 Page                               | 232 Page       |
| Characteristic Curve and Appearance                                  |                              |  | 149 / 166 Page         | 149 / 166 Page | 149 / 166 Page         | 150 / 167 Page                         | 150 / 167 Page | 150 / 167 Page             | 150 / 167 Page                         | 150 / 167 Page |

※ 1) 4 Pole Arrangement : Basic specification of R-S-T-N (N-R-S-T is optional.)

2) As for 2P products, only the neutral pole in the 3P product has been eliminated so the dimension is equivalent to the 3P product.

| HGM100                                  |     |  |     | HGM125                                  |     |  |     | HGM160                 |     |     |     | HGM250                 |     |     |     |
|---|-----|--|-----|---|-----|--|-----|------------------------|-----|-----|-----|------------------------|-----|-----|-----|
| 100                                     |     | 125  |     | 160                                     |     | 250                                    |     |                        |     |     |     |                        |     |     |     |
| 2, 3, 4 ①)                              |     | 2, 3, 4 ①)                                   |     | 2 ②), 3, 4 ①)                           |     | 2 ②), 3, 4 ①)                          |     |                        |     |     |     |                        |     |     |     |
| 16, 20, 25, 32, 40, 50, 63, 75, 80, 100 |     | 16, 20, 25, 32, 40, 50, 63, 75, 80, 100, 125 |     | 100, 125, 150, 160                      |     | 100, 125, 150, 160, 175, 200, 225, 250 |     |                        |     |     |     |                        |     |     |     |
| E                                       | S   | H  | L   | E                                       | S   | H                                      | L   | E                      | S   | H   | L   | E                      | S   | H   | L   |
| 2.5                                     | 5   | 7.5  | 8   | 5                                       | 7.5 | 8                                      | 10  | 7.5                    | 8   | 8   | 10  | 7.5                    | 8   | 8   | 10  |
| 7.5                                     | 10  | 14   | 26  | 10                                      | 14  | 26                                     | 35  | 14                     | 20  | 26  | 35  | 14                     | 20  | 26  | 35  |
| 16                                      | 20  | 26   | 30  | 20                                      | 26  | 38                                     | 55  | 20                     | 26  | 38  | 55  | 20                     | 26  | 38  | 55  |
| 18                                      | 22  | 30   | 31  | 22                                      | 30  | 42                                     | 55  | 22                     | 30  | 42  | 55  | 22                     | 30  | 42  | 55  |
| 35                                      | 50  | 50   | 50  | 50                                      | 65  | 85                                     | 100 | 50                     | 65  | 85  | 100 | 50                     | 65  | 85  | 100 |
| 5                                       | 10  | 15   | 15  | 10                                      | 15  | 20                                     | 30  | 10                     | 15  | 20  | 30  | 10                     | 15  | 20  | 30  |
| 100                                     | 100 | 75   | 50  | 100                                     | 100 | 100                                    | 100 | 100                    | 100 | 100 | 100 | 100                    | 100 | 100 | 100 |
| 4                                       | 8   | 13   | 14  | 8                                       | 13  | 14                                     | 17  | 8                      | 13  | 14  | 17  | 8                      | 13  | 14  | 17  |
| 13                                      | 17  | 28   | 55  | 17                                      | 28  | 55                                     | 74  | 17                     | 28  | 55  | 74  | 17                     | 28  | 55  | 74  |
| 32                                      | 40  | 55   | 63  | 40                                      | 55  | 80                                     | 121 | 40                     | 55  | 80  | 121 | 40                     | 55  | 80  | 121 |
| 36                                      | 47  | 63   | 66  | 47                                      | 63  | 89                                     | 121 | 47                     | 63  | 89  | 121 | 47                     | 63  | 89  | 121 |
| 74                                      | 105 | 105  | 105 | 105                                     | 143 | 187                                    | 220 | 105                    | 143 | 187 | 220 | 105                    | 143 | 187 | 220 |
| 8                                       | 17  | 30   | 30  | 17                                      | 30  | 40                                     | 63  | 17                     | 30  | 40  | 63  | 17                     | 30  | 40  | 63  |
| 30,000                                  |     |  |     | 30,000                                  |     |  |     | 25,000                 |     |     |     | 25,000                 |     |     |     |
| 10,000                                  |     |  |     | 10,000                                  |     |  |     | 10,000                 |     |     |     | 10,000                 |     |     |     |
| (1.0) × In                              |     |  |     | (1.0) × In                              |     |  |     | (1.0) × In             |     |     |     | (1.0) × In             |     |     |     |
| (0.8 - 0.9 - 1.0) × In                  |     |  |     | (0.8 - 0.9 - 1.0) × In                  |     |  |     | (0.8 - 0.9 - 1.0) × In |     |     |     | (0.8 - 0.9 - 1.0) × In |     |     |     |
| 16 ~ 32 A : 400 A, 40 ~ 100 A : 10 × In |     |  |     | 16 ~ 32 A : 400 A, 40 ~ 125 A : 10 × In |     |  |     | 10 × In                |     |     |     | 10 × In                |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |
|   |     |  |     |   |     |  |     |                        |     |     |     |                        |     |     |     |

## Model Selection Table

### Molded Case Circuit Breaker (HGM Type) : 400 ~ 800 AF

#### Common Ratings


|  |   |                           |             |
|--|---|---------------------------|-------------|
| Rated Insulation Voltage, $U_i$            | 1,000 V   | Suitability for Isolation | Yes         |
| Rated Operational Voltage, $U_e$           | 690 V   | Utilization Category      | A           |
| Rated Impulse Withstand Voltage, $U_{imp}$ | 8 kV  | Pollution Degree          | 3           |
| Protection Function                        | Overload, Instantaneous, Short-Circuit Protection | Reference Standard        | IEC 60947-2 |

| Model Name   |                               | HGM400                               |   |             |            | HGM630                               |                                     |             |            | HGM800                               |                                     |             |  |  |  |  |
|--|-------------------------------|--------------------------------------|---|-------------|------------|--------------------------------------|-------------------------------------|-------------|------------|--------------------------------------|-------------------------------------|-------------|--|--|--|--|
| Frame  | (AF)                          | 400                                  |   |             |            | 630                                  |                                     |             |            | 800                                  |                                     |             |  |  |  |  |
| Number of Poles  | (P)                           | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup> |   |             |            | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup> |                                     |             |            | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup> |                                     |             |  |  |  |  |
| Rated Current, at 40 °C  | (A)                           | 250, 300, 350, 400                   |   |             |            | 500, 630                             |                                     |             |            | 700, 800                             |                                     |             |  |  |  |  |
| <b>Rated Ultimate Short-Circuit Breaking Capacity [Icu] (kA rms)</b> |                               |                                      |   |             |            |                                      |                                     |             |            |                                      |                                     |             |  |  |  |  |
| Short-Circuit Breaking Category Code                                 |                               | E                                    | S   | H           | L          | E                                    | S                                   | H           | L          | S                                    | H                                   | L           |  |  |  |  |
| AC 660/690 V   |                               | 5                                    | 8   | 10          | 14         | 5                                    | 8                                   | 10          | 14         | 8                                    | 10                                  | 14          |  |  |  |  |
| AC 480/500 V   |                               | 18                                   | 35  | 50          | 65         | 25                                   | 45                                  | 50          | 65         | 45                                   | 50                                  | 65          |  |  |  |  |
| <b>AC 440/460 V</b>  |                               | <b>38</b>                            | <b>50</b>                                   | <b>70</b>   | <b>85</b>  | <b>38</b>                            | <b>50</b>                           | <b>70</b>   | <b>85</b>  | <b>50</b>                            | <b>70</b>                           | <b>85</b>   |  |  |  |  |
| AC 380/415 V   |                               | 45                                   | 65  | 85          | 100        | 45                                   | 65                                  | 85          | 100        | 65                                   | 85                                  | 100         |  |  |  |  |
| AC 220/240 V   |                               | 50                                   | 75  | 100         | 125        | 50                                   | 75                                  | 100         | 125        | 75                                   | 100                                 | 125         |  |  |  |  |
| DC 250 V (2P)  |                               | 20                                   | 25  | 40          | 40         | 20                                   | 25                                  | 40          | 40         | 25                                   | 40                                  | 40          |  |  |  |  |
| Service Breaking Capacity [ $I_{cs} = \% I_{cu}$ ]                   |                               | 100                                  | 100   | 100         | 100        | 100                                  | 100                                 | 100         | 100        | 100                                  | 100                                 | 100         |  |  |  |  |
| <b>Rated Short-Circuit Making Capacity [Icm] (kA peak)</b>           |                               |                                      |   |             |            |                                      |                                     |             |            |                                      |                                     |             |  |  |  |  |
| AC 660/690 V   |                               | 8                                    | 14  | 17          | 28         | 8                                    | 14                                  | 17          | 28         | 14                                   | 17                                  | 28          |  |  |  |  |
| AC 480/500 V   |                               | 36                                   | 74  | 105         | 143        | 53                                   | 95                                  | 105         | 143        | 95                                   | 105                                 | 143         |  |  |  |  |
| <b>AC 440/460 V</b>  |                               | <b>80</b>                            | <b>105</b>                                  | <b>154</b>  | <b>187</b> | <b>80</b>                            | <b>105</b>                          | <b>154</b>  | <b>187</b> | <b>105</b>                           | <b>154</b>                          | <b>187</b>  |  |  |  |  |
| AC 380/415 V   |                               | 95                                   | 143   | 187         | 220        | 95                                   | 143                                 | 187         | 220        | 143                                  | 187                                 | 220         |  |  |  |  |
| AC 220/240 V   |                               | 105                                  | 165   | 220         | 275        | 105                                  | 165                                 | 220         | 275        | 165                                  | 220                                 | 275         |  |  |  |  |
| DC 250 V (2P)  |                               | 40                                   | 53  | 84          | 84         | 40                                   | 53                                  | 84          | 84         | 53                                   | 84                                  | 84          |  |  |  |  |
| <b>Endurance [times] (Durability)</b>                                |                               |                                      |   |             |            |                                      |                                     |             |            |                                      |                                     |             |  |  |  |  |
| Mechanical   |                               | 4,000                                |   |             |            | 2,500                                |                                     |             |            | 2,500                                |                                     |             |  |  |  |  |
| Electrical (at 460 V)  |                               | 1,000                                |   |             |            | 500                                  |                                     |             |            | 500                                  |                                     |             |  |  |  |  |
| <b>Trip Device</b>   |                               |                                      |   |             |            |                                      |                                     |             |            |                                      |                                     |             |  |  |  |  |
| Thermal<br>Magnetic  | Long Time<br>[LTD]            | Fixed                                | (1.0) × $I_{in}$                            |             |            |                                      | (1.0) × $I_{in}$                    |             |            |                                      | (1.0) × $I_{in}$                    |             |  |  |  |  |
|  |                               | Adjustable                           | (0.63 - 0.8 - 1.0) × $I_{in}$ <sup>3)</sup> |             |            |                                      | (0.63 - 0.8 - 1.0) × $I_{in}$       |             |            |                                      | (0.63 - 0.8 - 1.0) × $I_{in}$       |             |  |  |  |  |
| <b>Accessory</b>   |                               |                                      |   |             |            |                                      |                                     |             |            |                                      |                                     |             |  |  |  |  |
| Internal   | Auxiliary Switch              |                                      | AUX   | ●           |            |                                      |                                     | ●           |            |                                      |                                     | ●           |  |  |  |  |
|  | Alarm Switch                  |                                      | ALT   | ●           |            |                                      |                                     | ●           |            |                                      |                                     | ●           |  |  |  |  |
|  | Shunt Trip                    |                                      | SHT   | ●           |            |                                      |                                     | ●           |            |                                      |                                     | ●           |  |  |  |  |
|  | Under-Voltage Trip            |                                      | UVT   | ●           |            |                                      |                                     | ●           |            |                                      |                                     | ●           |  |  |  |  |
| External   | Rotary<br>Handle              | Front Contact                        | TFG   | ●           |            |                                      |                                     | ●           |            |                                      |                                     | ●           |  |  |  |  |
|  |                               | Extension                            | TFH   | ●           |            |                                      |                                     | ●           |            |                                      |                                     | ●           |  |  |  |  |
|  | Mechanical Open/Close Device  |                                      | MOT   | ●           |            |                                      |                                     | ●           |            |                                      |                                     | ●           |  |  |  |  |
|  | Mechanical Interlock          |                                      | MIF   | ●           |            |                                      |                                     | ●           |            |                                      |                                     | ●           |  |  |  |  |
|  | Handle Locking Device         |                                      | PLD   | ●           |            |                                      |                                     | ●           |            |                                      |                                     | ●           |  |  |  |  |
|  | Plug-in                       | TDM (LINE/LOAD)                      |   | ● (3P Only) |            |                                      |                                     | ● (3P Only) |            |                                      |                                     | ● (3P Only) |  |  |  |  |
|  |                               | TDM (LINE Only)                      |   | ● (3P Only) |            |                                      |                                     | ● (3P Only) |            |                                      |                                     | ● (3P Only) |  |  |  |  |
|  |                               | TDF (LINE Only)                      |   | -           |            |                                      |                                     | -           |            |                                      |                                     | -           |  |  |  |  |
|  |                               | TDA (1 row)                          |   | -           |            |                                      |                                     | -           |            |                                      |                                     | -           |  |  |  |  |
|  |                               | TDA (2 rows)                         |   | -           |            |                                      |                                     | -           |            |                                      |                                     | -           |  |  |  |  |
| <b>Installation and Dimensions</b>                                   |                               |                                      |   |             |            |                                      |                                     |             |            |                                      |                                     |             |  |  |  |  |
| Connection/<br>Installation  | Front Connection              |                                      | Terminal Screw                              |             |            |                                      | Terminal Screw, Terminal Bus Bar    |             |            |                                      | Terminal Screw, Terminal Bus Bar    |             |  |  |  |  |
|  | Rear Connection               |                                      | Horizontal/Vertical Cable                   |             |            |                                      | Horizontal/Vertical Cable           |             |            |                                      | Horizontal/Vertical Cable           |             |  |  |  |  |
| Dimension<br>(mm)  | Plug-in                       |                                      | Switchgear (Line & Load, Line Only)         |             |            |                                      | Switchgear (Line & Load, Line Only) |             |            |                                      | Switchgear (Line & Load, Line Only) |             |  |  |  |  |
|  | a (2/3/4P)                    |                                      | 140/140/184                                 |             |            |                                      | 210/210/280                         |             |            |                                      | 210/210/280                         |             |  |  |  |  |
|  | b                             |                                      | 257   |             |            |                                      | 280                                 |             |            |                                      | 280                                 |             |  |  |  |  |
| Weight (kg)  | c                             |                                      | 110   |             |            |                                      | 110                                 |             |            |                                      | 110                                 |             |  |  |  |  |
|  | 2/3/4P                        |                                      | 4/4.5/5.4                                   |             |            |                                      | 8.7/9.5/12.5                        |             |            |                                      | 8.7/9.5/12.5                        |             |  |  |  |  |
|  | Detailed Rating and Selection |                                      | 232 Page                                    |             |            |                                      | 232 Page                            |             |            |                                      | 232 Page                            |             |  |  |  |  |
| <b>Characteristic Curve and Appearance</b>                           |                               |                                      |   |             |            |                                      |                                     |             |            |                                      |                                     |             |  |  |  |  |
|  |                               | 151 / 169 Page                       |   |             |            | 152 / 170 Page                       |                                     |             |            | 152 / 170 Page                       |                                     |             |  |  |  |  |

\* 1) 4 Pole Arrangement : Basic specification of R-S-T-N (N-R-S-T is optional.)

2) As for 2P products, only the neutral pole in the 3P product has been eliminated so the dimension is equivalent to the 3P product.

3) As for adjustable type, applicable to above 300 A.

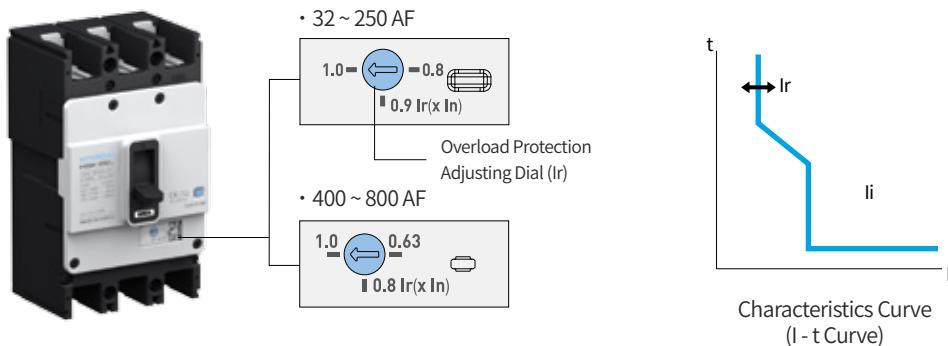

### Trip Unit Characteristics – Thermal Magnetic

| Rated Current (A) In             |                               | 16          | 20 | 25   | 32   | 40  | 50  | 63   | 75   | 80  | 100   | 125   |
|----------------------------------|-------------------------------|-------------|----|------|------|-----|-----|------|------|-----|-------|-------|
| MCCB                             | HGM30                         | ●           | ●  | ●    | ●    |     |     |      |      |     |       |       |
|                                  | HGM50                         | ●           | ●  | ●    | ●    | ●   | ●   |      |      |     |       |       |
|                                  | HGM60                         | ●           | ●  | ●    | ●    | ●   | ●   | ●    |      |     |       |       |
|                                  | HGM100                        | ●           | ●  | ●    | ●    | ●   | ●   | ●    | ●    | ●   | ●     |       |
|                                  | HGM125                        | ●           | ●  | ●    | ●    | ●   | ●   | ●    | ●    | ●   | ●     | ●     |
| Moment Characteristics Ir        |                               |             |    |      |      |     |     |      |      |     |       |       |
| Setting Value (A)                | Fixed                         | 16          | 20 | 25   | 32   | 40  | 50  | 63   | 75   | 80  | 100   | 125   |
|                                  | 0.8×In                        | 12.8        | 16 | 20   | 25.6 | 32  | 40  | 50.4 | 60   | 64  | 80    | 100   |
|                                  | 0.9×In                        | 14.4        | 18 | 22.5 | 28.8 | 36  | 45  | 56.7 | 67.5 | 72  | 90    | 112.5 |
|                                  | 1.0×In                        | 16          | 20 | 25   | 32   | 40  | 50  | 63   | 75   | 80  | 100   | 125   |
| Instantaneous Characteristics Ii |                               |             |    |      |      |     |     |      |      |     |       |       |
| Setting Value (A)                | 10×In                         | 400         |    |      |      | 400 | 500 | 630  | 750  | 800 | 1,000 | 1,250 |
|                                  | Max. Non-Tripping Current (A) | 320         |    |      |      | 320 | 400 | 504  | 600  | 640 | 800   | 1,000 |
|                                  | Min. Tripping Current (A)     | 480         |    |      |      | 480 | 600 | 756  | 900  | 960 | 1,200 | 1,500 |
| Neutral Pole Protection          |                               |             |    |      |      |     |     |      |      |     |       |       |
| 4P3D                             |                               | Unprotected |    |      |      |     |     |      |      |     |       |       |
| 4P4D                             |                               | -           |    |      |      |     |     |      |      |     |       |       |

| Rated Current (A) In             |                               | 100         | 125   | 150   | 160   | 175   | 200   | 225   | 250             | 300   | 350   | 400   | 500   | 630   | 700   | 800   |
|----------------------------------|-------------------------------|-------------|-------|-------|-------|-------|-------|-------|-----------------|-------|-------|-------|-------|-------|-------|-------|
| MCCB                             | HGM160                        | ●           | ●     | ●     | ●     |       |       |       |                 |       |       |       |       |       |       |       |
|                                  | HGM250                        | ●           | ●     | ●     | ●     | ●     | ●     | ●     | ●               | ●     |       |       |       |       |       |       |
|                                  | HGM400                        |             |       |       |       |       |       |       | ● <sup>1)</sup> | ●     | ●     | ●     |       |       |       |       |
|                                  | HGM630                        |             |       |       |       |       |       |       |                 |       | ●     | ●     |       |       |       |       |
|                                  | HGM800                        |             |       |       |       |       |       |       |                 |       |       | ●     | ●     |       |       |       |
| Moment Characteristics Ir        |                               |             |       |       |       |       |       |       |                 |       |       |       |       |       |       |       |
| Setting Value (A)                | Fixed                         | 100         | 125   | 150   | 160   | 175   | 200   | 225   | 250             | 300   | 350   | 400   | 500   | 630   | 700   | 800   |
|                                  | 0.63×In                       |             |       |       |       |       |       |       |                 | 189   | 221   | 252   | 315   | 397   | 441   | 504   |
|                                  | 0.8×In                        | 80          | 100   | 120   | 128   | 140   | 160   | 180   | 200             | 240   | 280   | 320   | 400   | 504   | 560   | 640   |
|                                  | 0.9×In                        | 90          | 112.5 | 135   | 144   | 157.5 | 180   | 202.5 | 225             |       |       |       |       |       |       |       |
|                                  | 1.0×In                        | 100         | 125   | 150   | 160   | 175   | 200   | 225   | 250             | 300   | 350   | 400   | 500   | 630   | 700   | 800   |
| Instantaneous Characteristics Ii |                               |             |       |       |       |       |       |       |                 |       |       |       |       |       |       |       |
| Setting Value (A)                | 10×In                         | 1,000       | 1,250 | 1,500 | 1,600 | 1,750 | 2,000 | 2,250 | 2,500           | 3,000 | 3,500 | 4,000 | 5,000 | 6,300 | 7,000 | 8,000 |
|                                  | Max. Non-Tripping Current (A) | 800         | 1,000 | 1,200 | 1,280 | 1,400 | 1,600 | 1,800 | 2,000           | 2,400 | 2,800 | 3,200 | 4,000 | 5,040 | 5,600 | 6,400 |
|                                  | Min. Tripping Current (A)     | 1,200       | 1,500 | 1,800 | 1,920 | 2,100 | 2,400 | 2,700 | 3,000           | 3,600 | 4,200 | 4,800 | 6,000 | 7,560 | 8,400 | 9,600 |
| Neutral Pole Protection          |                               |             |       |       |       |       |       |       |                 |       |       |       |       |       |       |       |
| 4P3D                             |                               | Unprotected |       |       |       |       |       |       |                 |       |       |       |       |       |       |       |
| 4P4D                             |                               | -           |       |       |       |       |       |       |                 |       |       |       |       |       |       |       |

※ 1) HGM400 250 A is fixed type only.

## Model Selection Table

### Switch - Disconnector (HGM NA Type) : 50 ~ 800 AF

Switch - disconnector is a switch for disconnection without protective function and as the appearance is equivalent to the circuit breaker, all accessories of the circuit breaker can be shared.

#### Common Ratings

|  |         |                           |                                   |
|--|---------|---------------------------|-----------------------------------|
| Rated Insulation Voltage, $U_i$            | 1,000 V | Suitability for Isolation | Yes                               |
| Rated Operational Voltage, $U_e$           | 690 V   | Utilization Category      | AC 22 A/AC 23 A - DC 22 A/DC 23 A |
| Rated Impulse Withstand Voltage, $U_{imp}$ | 8 kV    | Pollution Degree          | 3                                 |
|  |         | Reference Standard        | IEC 60947-3                       |

| Model Name   |                              | HGM50NA                                 | HGM100NA   | HGM125NA           | HGM160NA                               |
|--|------------------------------|---|--|--------------------|--|
| Frame  | (AF)                         | 50                                      | 100  | 125                | 160                                    |
| Number of Poles  | (P)                          | 3, 4 <sup>1)</sup>                      | 3, 4 <sup>1)</sup>   | 3, 4 <sup>1)</sup> | 3, 4 <sup>1)</sup>                     |
| Conventional Free Air Thermal Current, $I_{th}$ at 60 °C           | (A)                          | 50                                      | 100  | 125                | 160                                    |
| <b>Rated Operational Current [Ie]</b>                              |                              |   |  |                    |  |
| AC 690 V (50/60 Hz)  |                              | 50                                      | 100  | 125                | 160                                    |
| DC 125 V (1 Pole Connection)                                       |                              | 50                                      | 100  | 125                | 160                                    |
| DC 250 V (2 Pole Connection)                                       |                              | 50                                      | 100  | 125                | 160                                    |
| Rated Short Circuit Making Current [ $I_{cm}$ ] (kA Peak @ AC 460) |                              | 0.8                                     | 1.7  | 2.1                | 2.7                                    |
| Rated Short Time Withstand Current [ $I_{cw}$ ] (kA rms)           |                              | 1                                       | 1  | 1                  | 2                                      |
| <b>Endurance [times] (Durability)</b>                              |                              |   |  |                    |  |
| Mechanical   |                              | 30,000                                  | 30,000   | 30,000             | 25,000                                 |
| In @ 440 V   |                              | 10,000                                  | 10,000   | 10,000             | 10,000                                 |
| <b>Accessory</b>   |                              |   |  |                    |  |
| Internal   | Auxiliary Switch             | AUX                                     | ●  | ●                  | ●                                      |
|  | Alarm Switch                 | ALT                                     | ●  | ●                  | ●                                      |
|  | Shunt Trip                   | SHT                                     | ●  | ●                  | ●                                      |
|  | Under-Voltage Trip           | UVT                                     | ●  | ●                  | ●                                      |
| External   | Rotary Handle                | Front Contact TFG                       | ●  | ●                  | ●                                      |
|  | Extension                    | TFH                                     | ●  | ●                  | ●                                      |
|  | Mechanical Open/Close Device | MOT                                     | ●  | ●                  | ●                                      |
|  | Mechanical Interlock         | MIF                                     | ●  | ●                  | ●                                      |
|  | Handle Locking Device        | PLD                                     | ●  | ●                  | ●                                      |
|  | Plug-in                      | TDM (LINE/LOAD)                         | ● (3P Only)  | ● (3P Only)        | ● (3P Only)                            |
|  |                              | TDM (LINE Only)                         | ● (3P Only)  | ● (3P Only)        | ● (3P Only)                            |
|  |                              | TDF (LINE Only)                         | ● (3P Only)  | ● (3P Only)        | -                                      |
|  |                              | TDA (1 row)                             | ● (3P Only)  | ● (3P Only)        | -                                      |
|  |                              | TDA (2 rows)                            | ● (3P Only)  | ● (3P Only)        | -                                      |
|  | Cage Terminal Block          | CTB                                     | ●  | ●                  | ●                                      |
|  | Terminal Cover               | TCF                                     | ●  | ●                  | ●                                      |
|  | Insulation Barrier           | TQQ                                     | ●  | ●                  | ●                                      |
|  | Terminal Bus Bar             | TBB                                     | -  | -                  | ●                                      |
| <b>Installation and Dimensions</b>                                 |                              |   |  |                    |  |
| Connection/<br>Installation  | Front Connection             |   | Terminal Screw   |                    | Terminal Screw,<br>Terminal Bus Bar    |
|  | Rear Connection              |   | Horizontal/Vertical  |                    | Horizontal/Vertical                    |
|  | Plug-in                      |   | Switchgear (Line & Load, Line Only),<br>Distribution Panel |                    | Switchgear<br>(Line & Load, Line Only) |
|  | DIN Rail Installation        | Possible if DIN Rail adaptor is be used |  | -                  | -                                      |
| Dimension<br>(mm)  | a (3/4P)                     | 75/100                                  | 75/100   | 90/120             | 105/140                                |
|  | b                            | 130                                     | 130  | 155                | 165                                    |
|  | c                            | 68                                      | 68   | 68                 | 68                                     |
| Weight (kg)  | 3/4P                         | 0.8/1.0                                 | 0.8/1.0  | 1.0/1.3            | 1.3/1.7                                |
| Detailed Rating and Selection                                      |                              | 232 Page                                | 232 Page   | 232 Page           | 232 Page                               |
| Characteristic Curve and Appearance                                |                              | 166 Page                                | 166 Page   | 167 Page           | 168 Page                               |

\* 1) 4 Pole Arrangement : Basic specification of R-S-T-N (N-R-S-T is optional.)

### Applicable Field of Switch – Disconnectors

- Bus bar connection and disconnection
- Disconnection of switchgear and control panel
- Switch for emergency power switchover (ATS)

| HGM250NA                               | HGM400NA                               | HGM630NA                               | HGM800NA          |
|--|--|--|-------------------|
| 250                                    | 400                                    | 630                                    | 800               |
| 3,4 <sup>1)</sup>                      | 3,4 <sup>1)</sup>                      | 3,4 <sup>1)</sup>                      | 3,4 <sup>1)</sup> |
| 250                                    | 400                                    | 630                                    | 800               |
| 250                                    | 400                                    | 630                                    | 800               |
| 250                                    | 400                                    | 630                                    | 800               |
| 4.2                                    | 6.8                                    | 10.7                                   | 13.6              |
| 2                                      | 4                                      | 6.3                                    | 8                 |
| 25,000                                 | 4,000                                  | 2,500                                  | 2,500             |
| 10,000                                 | 1,000                                  | 500                                    | 500               |
| ●                                      | ●                                      | ●                                      | ●                 |
| ●                                      | ●                                      | ●                                      | ●                 |
| ●                                      | ●                                      | ●                                      | ●                 |
| ●                                      | ●                                      | ●                                      | ●                 |
| ●                                      | ●                                      | ●                                      | ●                 |
| ●                                      | ●                                      | ●                                      | ●                 |
| ●                                      | ●                                      | ●                                      | ●                 |
| ●                                      | ●                                      | ●                                      | ●                 |
| ●                                      | ●                                      | ●                                      | ●                 |
| ● (3P Only)                            | ● (3P Only)                            | ● (3P Only)                            | ● (3P Only)       |
| ● (3P Only)                            | ● (3P Only)                            | ● (3P Only)                            | ● (3P Only)       |
| -                                      | -                                      | -                                      | -                 |
| -                                      | -                                      | -                                      | -                 |
| -                                      | -                                      | -                                      | -                 |
| ●                                      | ●                                      | ●                                      | ●                 |
| ●                                      | ●                                      | ●                                      | ●                 |
| ●                                      | ●                                      | ●                                      | ●                 |
| ●                                      | ●                                      | ●                                      | ●                 |
| Terminal Screw,<br>Terminal Bus Bar    | Terminal Screw                         | Terminal Screw,<br>Terminal Bus Bar    |                   |
| Horizontal/Vertical                    | Horizontal/Vertical Cable              | Horizontal/Vertical Cable              |                   |
| Switchgear<br>(Line & Load, Line Only) | Switchgear<br>(Line & Load, Line Only) | Switchgear<br>(Line & Load, Line Only) |                   |
| -                                      | -                                      | -                                      | -                 |
| 105/140                                | 140/184                                | 210/280                                | 210/280           |
| 165                                    | 257                                    | 280                                    | 280               |
| 68                                     | 110                                    | 110                                    | 110               |
| 1.3/1.7                                | 4.5/5.4                                | 9.5/12.5                               | 9.5/12.5          |
| 232 Page                               | 232 Page                               | 232 Page                               | 232 Page          |
| 168 Page                               | 169 Page                               | 170 Page                               | 170 Page          |

## Model Selection Table

### Motor Protection Circuit Breakers (HGM MO Type) : 50 ~ 250 AF

#### Common Ratings

|  |   |                           |             |
|--|---|---------------------------|-------------|
| Rated Insulation Voltage, $U_i$            | 1,000 V                                 | Suitability for Isolation | Yes         |
| Rated Operational Voltage, $U_e$           | 690 V                                   | Utilization Category      | A           |
| Rated Impulse Withstand Voltage, $U_{imp}$ | 8 kV                                    | Pollution Degree          | 3           |
| Protection Function                        | Instantaneous, Short-Circuit Protection | Reference Standard        | IEC 60947-2 |

| Model Name   |                       | HGM50                        |   |             |                | HGM60                                   |                |           |           |
|--|-----------------------|------------------------------|---|-------------|----------------|---|----------------|-----------|-----------|
| Frame  | (AF)                  |                              | 50  |             |                |   | 63             |           |           |
| Number of Poles  | (P)                   |                              | 3   |             |                |   | 3              |           |           |
| Rated Current, at 40 °C  | (A)                   |                              | 40, 50  |             |                |   | 40, 50, 63     |           |           |
| <b>Rated Ultimate Short-Circuit Breaking Capacity [Icu] (kA rms)</b> |                       |                              |   |             |                |   |                |           |           |
| Short-Circuit Breaking Category Code                                 |                       | E                            | S   | H           | L              | E                                       | S              | H         | L         |
| AC 660/690 V   |                       | 2.5                          | 5   | 8           | 10             | 2.5                                     | 5              | 7.5       | 8         |
| AC 480/500 V   |                       | 7.5                          | 10  | 26          | 35             | 7.5                                     | 10             | 14        | 26        |
| <b>AC 415/440/460 V</b>  |                       | <b>16</b>                    | <b>20</b>   | <b>38</b>   | <b>55</b>      | <b>16</b>                               | <b>20</b>      | <b>26</b> | <b>30</b> |
| AC 380 V   |                       | 18                           | 22  | 42          | 55             | 18                                      | 22             | 30        | 31        |
| AC 220/240 V   |                       | 35                           | 50  | 85          | 100            | 35                                      | 50             | 50        | 50        |
| DC 250 V (2P)  |                       | 5                            | 10  | 20          | 30             | 5                                       | 10             | 15        | 15        |
| Service Breaking Capacity [ $I_{cs} = \% I_{cu}$ ]                   |                       | 100                          | 100   | 100         | 100            | 100                                     | 100            | 75        | 50        |
| <b>Rated Short-Circuit Making Capacity [Icm] (kA peak)</b>           |                       |                              |   |             |                |   |                |           |           |
| AC 660/690 V   |                       | 4                            | 8   | 14          | 17             | 4                                       | 8              | 13        | 14        |
| AC 480/500 V   |                       | 13                           | 17  | 55          | 74             | 13                                      | 17             | 28        | 55        |
| <b>AC 415/440/460 V</b>  |                       | <b>32</b>                    | <b>40</b>   | <b>80</b>   | <b>121</b>     | <b>32</b>                               | <b>40</b>      | <b>55</b> | <b>63</b> |
| AC 380 V   |                       | 36                           | 47  | 89          | 121            | 36                                      | 47             | 63        | 66        |
| AC 220/240 V   |                       | 74                           | 105   | 187         | 220            | 74                                      | 105            | 105       | 105       |
| DC 250 V (2P)  |                       | 8                            | 17  | 40          | 63             | 8                                       | 17             | 30        | 30        |
| <b>Endurance [times] (Durability)</b>                                |                       |                              |   |             |                |   |                |           |           |
| Mechanical   |                       |                              | 30,000  |             |                |   | 30,000         |           |           |
| Electrical (at 460 V)  |                       |                              | 10,000  |             |                |   | 10,000         |           |           |
| <b>Trip Device</b>   |                       |                              |   |             |                |   |                |           |           |
| Magnetic   | Instantaneous [INST]  |                              | 10×In   |             |                |   | 10×In          |           |           |
| <b>Accessory</b>   |                       |                              |   |             |                |   |                |           |           |
| Internal   | Auxiliary Switch      | AUX                          | ●   |             |                | ●                                       |                |           |           |
|  | Alarm Switch          | ALT                          | ●   |             |                | ●                                       |                |           |           |
|  | Shunt Trip            | SHT                          | ●   |             |                | ●                                       |                |           |           |
|  | Under-Voltage Trip    | UVT                          | ●   |             |                | ●                                       |                |           |           |
| External   | Plug-in               | Rotary Handle                | Front Contact TFG                                       | ●           |                |   | ●              |           |           |
|  |                       | Extension                    | TFH   | ●           |                |   | ●              |           |           |
|  |                       | Mechanical Open/Close Device | MOT   | ●           |                |   | ●              |           |           |
|  |                       | Mechanical Interlock         | MIF   | ●           |                |   | ●              |           |           |
|  |                       | Handle Locking Device        | PLD   | ●           |                |   | ●              |           |           |
|  | TDM (LINE/LOAD)       | TDM (LINE/LOAD)              | ● (3P Only)   | ● (3P Only) |                | ● (3P Only)                             |                |           |           |
|  |                       | TDM (LINE Only)              | ● (3P Only)   | ● (3P Only) |                | ● (3P Only)                             |                |           |           |
|  |                       | TDF (LINE Only)              | ● (3P Only)   | ● (3P Only) |                | ● (3P Only)                             |                |           |           |
|  |                       | TDA (1 row)                  | ● (3P Only)   | ● (3P Only) |                | ● (3P Only)                             |                |           |           |
|  |                       | TDA (2 rows)                 | ● (2, 3P Only)  | ● (3P Only) |                | ● (2, 3P Only)                          |                |           |           |
|  | Cage Terminal Block   | CTB                          | ●   |             |                | ●                                       |                |           |           |
|  | Terminal Cover        | TCF                          | ●   |             |                | ●                                       |                |           |           |
|  | Insulation Barrier    | TQQ                          | ●   |             |                | ●                                       |                |           |           |
|  | Terminal Bus Bar      | TBB                          | -   |             |                | -                                       |                |           |           |
| <b>Installation and Dimensions</b>                                   |                       |                              |   |             |                |   |                |           |           |
| Connection/ Installation   | Front Connection      |                              | Terminal Screw  |             |                |   |                |           |           |
|  | Rear Connection       |                              | Horizontal/Vertical                                     |             |                |   |                |           |           |
|  | Plug-in               |                              | Switchgear (Line & Load, Line Only), Distribution Panel |             |                |   |                |           |           |
|  | DIN Rail Installation |                              | Possible if DIN Rail adaptor is used                    | -           |                | Possible if DIN Rail adaptor is be used |                |           |           |
| Dimension (mm)   | a                     |                              | 75  |             | 90             |   | 75             |           |           |
|  | b                     |                              | 130   |             | 155            |   | 130            |           |           |
|  | c                     |                              | 68  |             | 68             |   | 68             |           |           |
| Weight (kg)  | 3P                    |                              | 0.8   |             | 1.0            |   | 0.8            |           |           |
| Detailed Rating and Selection  |                       |                              | 232 Page  |             | 232 Page       |   | 232 Page       |           |           |
| Characteristic Curve and Appearance                                  |                       |                              | 149 / 166 Page  |             | 150 / 167 Page |   | 149 / 166 Page |           |           |

| HGM100  |                |             |             | HGM125                       |             |             |                | HGM160                              |             |                |             | HGM250                                 |                |             |             |
|---|----------------|-------------|-------------|------------------------------|-------------|-------------|----------------|-------------------------------------|-------------|----------------|-------------|--|----------------|-------------|-------------|
| 100   |                |             |             | 125                          |             |             |                | 160                                 |             |                |             | 250                                    |                |             |             |
| 3   |                |             |             | 3                            |             |             |                | 3                                   |             |                |             | 3                                      |                |             |             |
| 40, 50, 63, 75, 80, 100                                 |                |             |             | 40, 50, 63, 75, 80, 100, 125 |             |             |                | 100, 125, 150, 160                  |             |                |             | 100, 125, 150, 160, 175, 200, 225, 250 |                |             |             |
| E   | S              | H           | L           | E                            | S           | H           | L              | E                                   | S           | H              | L           | E                                      | S              | H           | L           |
| 2.5   | 5              | 7.5         | 8           | 5                            | 7.5         | 8           | 10             | 7.5                                 | 8           | 8              | 10          | 7.5                                    | 8              | 8           | 10          |
| 7.5   | 10             | 14          | 26          | 10                           | 14          | 26          | 35             | 14                                  | 20          | 26             | 35          | 14                                     | 20             | 26          | 35          |
| 16  | 20             | 26          | 30          | 20                           | 26          | 38          | 55             | 20                                  | 26          | 38             | 55          | 20                                     | 26             | 38          | 55          |
| 18  | 22             | 30          | 31          | 22                           | 30          | 42          | 55             | 22                                  | 30          | 42             | 55          | 22                                     | 30             | 42          | 55          |
| 35  | 50             | 50          | 50          | 50                           | 65          | 85          | 100            | 50                                  | 65          | 85             | 100         | 50                                     | 65             | 85          | 100         |
| 5   | 10             | 15          | 15          | 10                           | 15          | 20          | 30             | 10                                  | 15          | 20             | 30          | 10                                     | 15             | 20          | 30          |
| 100   | 100            | 75          | 50          | 100                          | 100         | 100         | 100            | 100                                 | 100         | 100            | 100         | 100                                    | 100            | 100         | 100         |
| 4   | 8              | 13          | 14          | 8                            | 13          | 14          | 17             | 8                                   | 13          | 14             | 17          | 8                                      | 13             | 14          | 17          |
| 13  | 17             | 28          | 55          | 17                           | 28          | 55          | 74             | 17                                  | 28          | 55             | 74          | 17                                     | 28             | 55          | 74          |
| 32  | 40             | 55          | 63          | 40                           | 55          | 80          | 121            | 40                                  | 55          | 80             | 121         | 40                                     | 55             | 80          | 121         |
| 36  | 47             | 63          | 66          | 47                           | 63          | 89          | 121            | 47                                  | 63          | 89             | 121         | 47                                     | 63             | 89          | 121         |
| 74  | 105            | 105         | 105         | 105                          | 143         | 187         | 220            | 105                                 | 143         | 187            | 220         | 105                                    | 143            | 187         | 220         |
| 8   | 17             | 30          | 30          | 17                           | 30          | 40          | 63             | 17                                  | 30          | 40             | 63          | 17                                     | 30             | 40          | 63          |
| 30,000  |                |             |             | 30,000                       |             |             |                | 25,000                              |             |                |             | 25,000                                 |                |             |             |
| 10,000  |                |             |             | 10,000                       |             |             |                | 10,000                              |             |                |             | 10,000                                 |                |             |             |
| 10×In   |                |             |             | 10×In                        |             |             |                | 10×In                               |             |                |             | 10×In                                  |                |             |             |
| ● (3P Only)   | ● (3P Only)    | ● (3P Only) | ● (3P Only) | ● (3P Only)                  | ● (3P Only) | ● (3P Only) | ● (3P Only)    | ● (3P Only)                         | ● (3P Only) | ● (3P Only)    | ● (3P Only) | ● (3P Only)                            | ● (3P Only)    | ● (3P Only) | ● (3P Only) |
| ● (3P Only)   | ● (3P Only)    | ● (3P Only) | ● (3P Only) | ● (3P Only)                  | ● (3P Only) | ● (3P Only) | ● (3P Only)    | ● (3P Only)                         | ● (3P Only) | ● (3P Only)    | ● (3P Only) | -                                      | -              | -           | -           |
| ● (3P Only)   | ● (3P Only)    | ● (3P Only) | ● (3P Only) | ● (3P Only)                  | ● (3P Only) | ● (3P Only) | ● (3P Only)    | ● (3P Only)                         | ● (3P Only) | ● (3P Only)    | ● (3P Only) | -                                      | -              | -           | -           |
| ● (3P Only)   | ● (3P Only)    | ● (3P Only) | ● (3P Only) | ● (3P Only)                  | ● (3P Only) | ● (3P Only) | ● (3P Only)    | ● (3P Only)                         | ● (3P Only) | ● (3P Only)    | ● (3P Only) | -                                      | -              | -           | -           |
| ● (2, 3P Only)  | ● (3P Only)    | ● (3P Only) | ● (3P Only) | ● (3P Only)                  | ● (3P Only) | ● (3P Only) | ● (3P Only)    | ● (3P Only)                         | ● (3P Only) | ● (3P Only)    | ● (3P Only) | -                                      | -              | -           | -           |
| ●   | ●              | ●           | ●           | ●                            | ●           | ●           | ●              | ●                                   | ●           | ●              | ●           | ●                                      | ●              | ●           | ●           |
| ●   | ●              | ●           | ●           | ●                            | ●           | ●           | ●              | ●                                   | ●           | ●              | ●           | ●                                      | ●              | ●           | ●           |
| ●   | ●              | ●           | ●           | ●                            | ●           | ●           | ●              | ●                                   | ●           | ●              | ●           | ●                                      | ●              | ●           | ●           |
| ●   | ●              | ●           | ●           | ●                            | ●           | ●           | ●              | ●                                   | ●           | ●              | ●           | ●                                      | ●              | ●           | ●           |
| Terminal Screw  |                |             |             |                              |             |             |                | Terminal Screw, Terminal Bus Bar    |             |                |             |  |                |             |             |
| Horizontal/Vertical                                     |                |             |             |                              |             |             |                | Horizontal/Vertical                 |             |                |             |  |                |             |             |
| Switchgear (Line & Load, Line Only), Distribution Panel |                |             |             |                              |             |             |                | Switchgear (Line & Load, Line Only) |             |                |             |  |                |             |             |
| Possible if DIN Rail adaptor is be used                 | -              |             |             | -                            |             |             | -              |                                     |             | -              |             |  | -              |             |             |
| 75  | 90             |             |             | 105                          |             |             | 105            |                                     |             | 105            |             |  | 105            |             |             |
| 130   | 155            |             |             | 165                          |             |             | 165            |                                     |             | 165            |             |  | 165            |             |             |
| 68  | 68             |             |             | 68                           |             |             | 68             |                                     |             | 68             |             |  | 68             |             |             |
| 0.8   | 1.0            |             |             | 1.3                          |             |             | 1.3            |                                     |             | 1.3            |             |  | 1.3            |             |             |
| 232 Page  | 232 Page       |             |             | 232 Page                     |             |             | 232 Page       |                                     |             | 232 Page       |             |  | 232 Page       |             |             |
| 149 / 166 Page  | 150 / 167 Page |             |             | 151 / 168 Page               |             |             | 151 / 168 Page |                                     |             | 151 / 168 Page |             |  | 151 / 168 Page |             |             |


## Model Selection Table

### Motor Protection Circuit Breakers (HGM MO Type) : 400 ~ 800 AF

#### Common Ratings

|  |   |                           |             |
|--|---|---------------------------|-------------|
| Rated Insulation Voltage, $U_i$            | 1,000 V                                 | Suitability for Isolation | Yes         |
| Rated Operational Voltage, $U_e$           | 690 V                                   | Utilization Category      | A           |
| Rated Impulse Withstand Voltage, $U_{imp}$ | 8 kV                                    | Pollution Degree          | 3           |
| Protection Function                        | Instantaneous, Short-Circuit Protection | Reference Standard        | IEC 60947-2 |

| Model Name   |                              | HGM400             |                                     |                |            | HGM630      |                                     |                |            | HGM800      |            |                |  |  |  |
|--|------------------------------|--------------------|-------------------------------------|----------------|------------|-------------|-------------------------------------|----------------|------------|-------------|------------|----------------|--|--|--|
| Frame  | (AF)                         | 400                |                                     |                |            | 630         |                                     |                |            | 800         |            |                |  |  |  |
| Number of Poles  | (P)                          | 3                  |                                     |                |            | 3           |                                     |                |            | 3           |            |                |  |  |  |
| Rated Current, at 40 °C  | (A)                          | 250, 300, 350, 400 |                                     |                |            | 500, 630    |                                     |                |            | 700, 800    |            |                |  |  |  |
| <b>Rated Ultimate Short-Circuit Breaking Capacity [Icu] (kA rms)</b> |                              |                    |                                     |                |            |             |                                     |                |            |             |            |                |  |  |  |
| Short-Circuit Breaking Category Code                                 |                              | E                  | S                                   | H              | L          | E           | S                                   | H              | L          | S           | H          | L              |  |  |  |
| AC 660/690 V   |                              | 5                  | 8                                   | 10             | 14         | 5           | 8                                   | 10             | 14         | 8           | 10         | 14             |  |  |  |
| AC 480/500 V   |                              | 18                 | 35                                  | 50             | 65         | 25          | 45                                  | 50             | 65         | 45          | 50         | 65             |  |  |  |
| <b>AC 440/460 V</b>  |                              | <b>38</b>          | <b>50</b>                           | <b>70</b>      | <b>85</b>  | <b>38</b>   | <b>50</b>                           | <b>70</b>      | <b>85</b>  | <b>50</b>   | <b>70</b>  | <b>85</b>      |  |  |  |
| AC 380/415 V   |                              | 45                 | 65                                  | 85             | 100        | 45          | 65                                  | 85             | 100        | 65          | 85         | 100            |  |  |  |
| AC 220/240 V   |                              | 50                 | 75                                  | 100            | 125        | 50          | 75                                  | 100            | 125        | 75          | 100        | 125            |  |  |  |
| DC 250 V (2P)  |                              | 20                 | 25                                  | 40             | 40         | 20          | 25                                  | 40             | 40         | 25          | 40         | 40             |  |  |  |
| Service Breaking Capacity [ $I_{cs} = \% I_{cu}$ ]                   |                              | 100                | 100                                 | 100            | 100        | 100         | 100                                 | 100            | 100        | 100         | 100        | 100            |  |  |  |
| <b>Rated Short-Circuit Making Capacity [Icm] (kA peak)</b>           |                              |                    |                                     |                |            |             |                                     |                |            |             |            |                |  |  |  |
| AC 660/690 V   |                              | 8                  | 14                                  | 17             | 28         | 8           | 14                                  | 17             | 28         | 14          | 17         | 28             |  |  |  |
| AC 480/500 V   |                              | 36                 | 74                                  | 105            | 143        | 53          | 95                                  | 105            | 143        | 95          | 105        | 143            |  |  |  |
| <b>AC 440/460 V</b>  |                              | <b>80</b>          | <b>105</b>                          | <b>154</b>     | <b>187</b> | <b>80</b>   | <b>105</b>                          | <b>154</b>     | <b>187</b> | <b>105</b>  | <b>154</b> | <b>187</b>     |  |  |  |
| AC 380/415 V   |                              | 95                 | 143                                 | 187            | 220        | 95          | 143                                 | 187            | 220        | 143         | 187        | 220            |  |  |  |
| AC 220/240 V   |                              | 105                | 165                                 | 220            | 275        | 105         | 165                                 | 220            | 275        | 165         | 220        | 275            |  |  |  |
| DC 250 V (2P)  |                              | 40                 | 53                                  | 84             | 84         | 40          | 53                                  | 84             | 84         | 53          | 84         | 84             |  |  |  |
| <b>Endurance [times] (Durability)</b>                                |                              |                    |                                     |                |            |             |                                     |                |            |             |            |                |  |  |  |
| Mechanical   |                              | 4,000              |                                     |                |            | 2,500       |                                     |                |            | 2,500       |            |                |  |  |  |
| Electrical (at 460 V)  |                              | 1,000              |                                     |                |            | 500         |                                     |                |            | 500         |            |                |  |  |  |
| <b>Trip Device</b>   |                              |                    |                                     |                |            |             |                                     |                |            |             |            |                |  |  |  |
| Magnetic   | Instantaneous [INST]         | 10×In              |                                     |                |            | 10×In       |                                     |                |            | 10×In       |            |                |  |  |  |
| <b>Accessory</b>   |                              |                    |                                     |                |            |             |                                     |                |            |             |            |                |  |  |  |
| Internal   | Auxiliary Switch             |                    | AUX                                 | ●              |            | ●           |                                     | ●              |            | ●           |            |                |  |  |  |
|  | Alarm Switch                 |                    | ALT                                 | ●              |            | ●           |                                     | ●              |            | ●           |            |                |  |  |  |
|  | Shunt Trip                   |                    | SHT                                 | ●              |            | ●           |                                     | ●              |            | ●           |            |                |  |  |  |
|  | Under-Voltage Trip           |                    | UVT                                 | ●              |            | ●           |                                     | ●              |            | ●           |            |                |  |  |  |
| External   | Rotary Handle                | Front Contact      | TFG                                 | ●              |            | ●           |                                     | ●              |            | ●           |            | ●              |  |  |  |
|  |                              | Extension          | TFH                                 | ●              |            | ●           |                                     | ●              |            | ●           |            | ●              |  |  |  |
|  | Mechanical Open/Close Device |                    | MOT                                 | ●              |            | ●           |                                     | ●              |            | ●           |            | ●              |  |  |  |
|  | Mechanical Interlock         |                    | MIF                                 | ●              |            | ●           |                                     | ●              |            | ●           |            | ●              |  |  |  |
|  | Handle Locking Device        |                    | PLD                                 | ●              |            | ●           |                                     | ●              |            | ●           |            | ●              |  |  |  |
|  | Plug-in                      | TDM (LINE/LOAD)    |                                     | ● (3P Only)    |            | ● (3P Only) |                                     | ● (3P Only)    |            | ● (3P Only) |            | ● (3P Only)    |  |  |  |
|  |                              | TDM (LINE Only)    |                                     | ● (3P Only)    |            | ● (3P Only) |                                     | ● (3P Only)    |            | ● (3P Only) |            | ● (3P Only)    |  |  |  |
|  |                              | TDF (LINE Only)    |                                     | -              |            | -           |                                     | -              |            | -           |            | -              |  |  |  |
|  |                              | TDA (1 row)        |                                     | -              |            | -           |                                     | -              |            | -           |            | -              |  |  |  |
|  |                              | TDA (2 rows)       |                                     | -              |            | -           |                                     | -              |            | -           |            | -              |  |  |  |
|  | Cage Terminal Block          |                    | CTB                                 | ●              |            | ●           |                                     | ●              |            | ●           |            | ●              |  |  |  |
|  | Terminal Cover               |                    | TCF                                 | ●              |            | ●           |                                     | ●              |            | ●           |            | ●              |  |  |  |
|  | Insulation Barrier           |                    | TQQ                                 | ●              |            | ●           |                                     | ●              |            | ●           |            | ●              |  |  |  |
|  | Terminal Bus Bar             |                    | TBB                                 | ●              |            | ●           |                                     | ●              |            | ●           |            | ●              |  |  |  |
| <b>Installation and Dimensions</b>                                   |                              |                    |                                     |                |            |             |                                     |                |            |             |            |                |  |  |  |
| Connection/<br>Installation  | Front Connection             |                    | Terminal Screw                      |                |            |             | Terminal Screw, Terminal Bus Bar    |                |            |             |            |                |  |  |  |
|  | Rear Connection              |                    | Horizontal/Vertical Cable           |                |            |             | Horizontal/Vertical Cable           |                |            |             |            |                |  |  |  |
| Dimension<br>(mm)  | Plug-in                      |                    | Switchgear (Line & Load, Line Only) |                |            |             | Switchgear (Line & Load, Line Only) |                |            |             |            |                |  |  |  |
|  | a (3P)                       |                    | 140                                 |                |            |             | 210                                 |                |            |             |            |                |  |  |  |
|  | b                            |                    | 257                                 |                |            |             | 280                                 |                |            |             |            |                |  |  |  |
|  | c                            |                    | 110                                 |                |            |             | 110                                 |                |            |             |            |                |  |  |  |
| Weight (kg)  |                              | 3P                 |                                     | 4.5            |            |             |                                     | 9.5            |            |             |            | 9.5            |  |  |  |
| Detailed Rating and Selection  |                              |                    |                                     | 232 Page       |            |             |                                     | 232 Page       |            |             |            | 232 Page       |  |  |  |
| Characteristic Curve and Appearance                                  |                              |                    |                                     | 151 / 169 Page |            |             |                                     | 152 / 170 Page |            |             |            | 152 / 170 Page |  |  |  |

Characteristics Curve  
(I - t Curve)

### Trip Unit Characteristics - Thermal Magnetic

| Rated Current (A) In             |                               | 40  | 50  | 63  | 75  | 80  | 100   | 125   |
|----------------------------------|-------------------------------|-----|-----|-----|-----|-----|-------|-------|
| MCCB                             | HGM50                         | ●   | ●   |     |     |     |       |       |
|                                  | HGM60                         | ●   | ●   | ●   |     |     |       |       |
|                                  | HGM100                        | ●   | ●   | ●   | ●   | ●   | ●     |       |
|                                  | HGM125                        | ●   | ●   | ●   | ●   | ●   | ●     | ●     |
| Instantaneous Characteristics li |                               |     |     |     |     |     |       |       |
| Setting Value (A)                | 10×In                         | 400 | 500 | 630 | 750 | 800 | 1,000 | 1,250 |
|                                  | Max. Non-Tripping Current (A) | 320 | 400 | 504 | 600 | 640 | 800   | 1,000 |
|                                  | Min. Tripping Current (A)     | 480 | 600 | 756 | 900 | 960 | 1,200 | 1,500 |

| Rated Current (A) In             |                               | 100   | 125   | 150   | 160   | 175   | 200   | 225   | 250   | 300   | 350   | 400   | 500   | 630   | 700   | 800   |
|----------------------------------|-------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| MCCB                             | HGM160                        | ●     | ●     | ●     | ●     |       |       |       |       |       |       |       |       |       |       |       |
|                                  | HGM250                        | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     |       |       |       |       |       |       |       |
|                                  | HGM400                        |       |       |       |       |       |       |       | ●     | ●     | ●     | ●     |       |       |       |       |
|                                  | HGM630                        |       |       |       |       |       |       |       |       |       |       | ●     | ●     |       |       |       |
|                                  | HGM800                        |       |       |       |       |       |       |       |       |       |       |       | ●     | ●     |       |       |
| Instantaneous Characteristics li |                               |       |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| Setting Value (A)                | 10×In                         | 1,000 | 1,250 | 1,500 | 1,600 | 1,750 | 2,000 | 2,250 | 2,500 | 3,000 | 3,500 | 4,000 | 5,000 | 6,300 | 7,000 | 8,000 |
|                                  | Max. Non-Tripping Current (A) | 800   | 1,000 | 1,200 | 1,280 | 1,400 | 1,600 | 1,800 | 2,000 | 2,400 | 2,800 | 3,200 | 4,000 | 5,040 | 5,600 | 6,400 |
|                                  | Min. Tripping Current (A)     | 1,200 | 1,500 | 1,800 | 1,920 | 2,100 | 2,400 | 2,700 | 3,000 | 3,600 | 4,200 | 4,800 | 6,000 | 7,560 | 8,400 | 9,600 |

## Model Selection Table

### ZCT Embedded Molded Case Circuit Breaker (HGM Type) : 32 ~ 250 AF

As a model with a built-in ZCT in MCCB, it is a device that detects grounding when connected to an external ELR (Earth Leakage Relay) that can enhance reliability.

#### Common Ratings

|  |   |                           |             |
|--|---|---------------------------|-------------|
| Rated Insulation Voltage, $U_i$            | 1,000 V   | Suitability for Isolation | Yes         |
| Rated Operational Voltage, $U_e$           | 690 V   | Utilization Category      | A           |
| Rated Impulse Withstand Voltage, $U_{imp}$ | 8 kV  | Pollution Degree          | 3           |
| Protection Function                        | Overload, Instantaneous, Short-Circuit Protection | Reference Standard        | IEC 60947-2 |

| Model Name   |                              | HGM30                                |   |           | HGM50                                  |           |            | HGM60                                  |           |           |           |
|--|------------------------------|--------------------------------------|---|-----------|--|-----------|------------|--|-----------|-----------|-----------|
| Frame  | (AF)                         | 32                                   |   |           | 50                                     |           |            | 63                                     |           |           |           |
| Number of Poles  | (P)                          | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup> |   |           | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup>   |           |            | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup>   |           |           |           |
| Rated Current, at 40°C   | (A)                          | 16, 20, 25, 32                       |   |           | 16, 20, 25, 32, 40, 50                 |           |            | 16, 20, 25, 32, 40, 50, 63             |           |           |           |
| <b>Rated Ultimate Short-Circuit Breaking Capacity [Icu] (kA rms)</b> |                              |                                      |   |           |  |           |            |  |           |           |           |
| Short-Circuit Breaking Category Code                                 |                              | E                                    | S   | E         | S                                      | H         | L          | E                                      | S         | H         | L         |
| AC 660/690 V   |                              | 2.5                                  | 5   | 2.5       | 5                                      | 8         | 10         | 2.5                                    | 5         | 7.5       | 8         |
| AC 480/500 V   |                              | 7.5                                  | 10  | 7.5       | 10                                     | 26        | 35         | 7.5                                    | 10        | 14        | 26        |
| <b>AC 415/440/460 V</b>  |                              | <b>16</b>                            | <b>20</b>   | <b>16</b> | <b>20</b>                              | <b>38</b> | <b>55</b>  | <b>16</b>                              | <b>20</b> | <b>26</b> | <b>30</b> |
| AC 380 V   |                              | 18                                   | 22  | 18        | 22                                     | 42        | 55         | 18                                     | 22        | 30        | 31        |
| AC 220/240 V   |                              | 35                                   | 50  | 35        | 50                                     | 85        | 100        | 35                                     | 50        | 50        | 50        |
| Service Breaking Capacity [Ics = % Icu]                              |                              | 100                                  | 100   | 100       | 100                                    | 100       | 100        | 100                                    | 100       | 75        | 50        |
| <b>Rated Short-Circuit Making Capacity [Icm] (kA peak)</b>           |                              |                                      |   |           |  |           |            |  |           |           |           |
| AC 660/690 V   |                              | 4                                    | 8   | 4         | 8                                      | 14        | 17         | 4                                      | 8         | 13        | 14        |
| AC 480/500 V   |                              | 13                                   | 17  | 13        | 17                                     | 55        | 74         | 13                                     | 17        | 28        | 55        |
| <b>AC 415/440/460 V</b>  |                              | <b>32</b>                            | <b>40</b>   | <b>32</b> | <b>40</b>                              | <b>80</b> | <b>121</b> | <b>32</b>                              | <b>40</b> | <b>55</b> | <b>63</b> |
| AC 380 V   |                              | 36                                   | 47  | 36        | 47                                     | 89        | 121        | 36                                     | 47        | 63        | 66        |
| AC 220/240 V   |                              | 74                                   | 105   | 74        | 105                                    | 187       | 220        | 74                                     | 105       | 105       | 105       |
| DC 250 V (2P)  |                              | 8                                    | 17  | 8         | 17                                     | 40        | 63         | 8                                      | 17        | 30        | 30        |
| <b>Endurance [times] (Durability)</b>                                |                              |                                      |   |           |  |           |            |  |           |           |           |
| Mechanical   |                              | 30,000                               |   |           | 30,000                                 |           |            | 30,000                                 |           |           |           |
| Electrical (at 460 V)  |                              | 10,000                               |   |           | 10,000                                 |           |            | 10,000                                 |           |           |           |
| ZCT Output Characteristics   |                              | 200 mA/100 mV                        |   |           | 200 mA/100 mV                          |           |            | 200 mA/100 mV                          |           |           |           |
| <b>Trip Device</b>   |                              |                                      |   |           |  |           |            |  |           |           |           |
| Thermal  | Long Time [LTD]              | (1.0) × In                           |   |           | (1.0) × In                             |           |            | (1.0) × In                             |           |           |           |
| Magnetic   | Instantaneous [INST]         | 400 A                                |   |           | 16 ~ 32 A : 400 A, 40 ~ 50 A : 10 × In |           |            | 16 ~ 32 A : 400 A, 40 ~ 63 A : 10 × In |           |           |           |
| <b>Accessory</b>   |                              |                                      |   |           |  |           |            |  |           |           |           |
| Internal   | Auxiliary Switch             | AUX                                  | ●   |           | ●                                      |           |            | ●                                      |           |           |           |
|  | Alarm Switch                 | ALT                                  | ●   |           | ●                                      |           |            | ●                                      |           |           |           |
|  | Shunt Trip                   | SHT                                  | ●   |           | ●                                      |           |            | ●                                      |           |           |           |
|  | Under-Voltage Trip           | UVT                                  | ●   |           | ●                                      |           |            | ●                                      |           |           |           |
| External   | Rotary Handle                | Front Contact TFG                    | ●   |           | ●                                      |           |            | ●                                      |           |           |           |
|  | Extension                    | TFH                                  | ●   |           | ●                                      |           |            | ●                                      |           |           |           |
|  | Mechanical Open/Close Device | MOT                                  | ●   |           | ●                                      |           |            | ●                                      |           |           |           |
|  | Mechanical Interlock         | MIF                                  | ●   |           | ●                                      |           |            | ●                                      |           |           |           |
|  | Handle Locking Device        | PLD                                  | ●   |           | ●                                      |           |            | ●                                      |           |           |           |
|  | Plug-in                      | TDM (LINE/LOAD)                      | ● (3P Only)   |           | ● (3P Only)                            |           |            | ● (3P Only)                            |           |           |           |
|  |                              | TDM (LINE Only)                      | ● (3P Only)   |           | ● (3P Only)                            |           |            | ● (3P Only)                            |           |           |           |
|  |                              | TDF (LINE Only)                      | ● (3P Only)   |           | ● (3P Only)                            |           |            | ● (3P Only)                            |           |           |           |
|  |                              | TDA (1 row)                          | ● (3P Only)   |           | ● (3P Only)                            |           |            | ● (3P Only)                            |           |           |           |
|  |                              | TDA (2 rows)                         | ● (2, 3P Only)  |           | ● (2, 3P Only)                         |           |            | ● (2, 3P Only)                         |           |           |           |
|  | Cage Terminal Block          | CTB                                  | ●   |           | ●                                      |           |            | ●                                      |           |           |           |
|  | Terminal Cover               | TCF                                  | ●   |           | ●                                      |           |            | ●                                      |           |           |           |
|  | Insulation Barrier           | TQQ                                  | ●   |           | ●                                      |           |            | ●                                      |           |           |           |
|  | Terminal Bus Bar             | TBB                                  | -   |           | -                                      |           |            | -                                      |           |           |           |
| <b>Installation and Dimensions</b>                                   |                              |                                      |   |           |  |           |            |  |           |           |           |
| Connection/<br>Installation  | Front Connection             |                                      | Terminal Screw  |           |  |           |            |  |           |           |           |
|  | Rear Connection              |                                      | Horizontal/Vertical                                     |           |  |           |            |  |           |           |           |
|  | Plug-in                      |                                      | Switchgear (Line & Load, Line Only), Distribution Panel |           |  |           |            |  |           |           |           |
| Dimension<br>(mm)  | DIN Rail Installation        | Possible if DIN Rail adaptor is used |   |           | -                                      |           |            | Possible if DIN Rail adaptor is used   |           |           |           |
|  | a (2/3/4P)                   | 75/75/100                            |   |           | 90/90/120                              |           |            | 75/75/100                              |           |           |           |
|  | b                            | 130                                  |   |           | 155                                    |           |            | 130                                    |           |           |           |
|  | c                            | 68                                   |   |           | 68                                     |           |            | 68                                     |           |           |           |
| Weight (kg)  |                              | 2/3/4P                               | 0.7/0.8/1.0   |           | 0.7/0.8/1.0                            |           |            | 0.9/1.0/1.3                            |           |           |           |
| Detailed Rating and Selection  |                              | 232 Page                             |   |           | 232 Page                               |           |            | 232 Page                               |           |           |           |
| Characteristic Curve and Appearance                                  |                              | 149 / 166 Page                       |   |           | 149 / 166 Page                         |           |            | 150 / 167 Page                         |           |           |           |
|  |                              |                                      |   |           |  |           |            | 149 / 166 Page                         |           |           |           |

\* 1) 4 Pole Arrangement : Basic specification of R-S-T-N

2) As for 2P products, only the neutral pole in the 3P product has been eliminated so the dimension is equivalent to the 3P product.

| HGM100  |             |  |             | HGM125                                  |             |  |             | HGM160                              |             |             |             | HGM250         |             |             |             |
|---|-------------|--|-------------|---|-------------|--|-------------|-------------------------------------|-------------|-------------|-------------|----------------|-------------|-------------|-------------|
| 100<br>2 2)<br>3, 4 1)                                  |             | 125<br>2 2)<br>3, 4 1)                       |             | 160<br>2 2)<br>3, 4 1)                  |             | 250<br>2 2)<br>3, 4 1)                 |             |                                     |             |             |             |                |             |             |             |
| 16, 20, 25, 32, 40, 50, 63, 75, 80, 100                 |             | 16, 20, 25, 32, 40, 50, 63, 75, 80, 100, 125 |             | 100, 125, 150, 160                      |             | 100, 125, 150, 160, 175, 200, 225, 250 |             |                                     |             |             |             |                |             |             |             |
| E   | S           | H  | L           | E                                       | S           | H                                      | L           | E                                   | S           | H           | L           | E              | S           | H           | L           |
| 2.5   | 5           | 7.5  | 8           | 5                                       | 7.5         | 8                                      | 10          | 7.5                                 | 8           | 8           | 10          | 7.5            | 8           | 8           | 10          |
| 7.5   | 10          | 14   | 26          | 10                                      | 14          | 26                                     | 35          | 14                                  | 20          | 26          | 35          | 14             | 20          | 26          | 35          |
| 16  | 20          | 26   | 30          | 20                                      | 26          | 38                                     | 55          | 20                                  | 26          | 38          | 55          | 20             | 26          | 38          | 55          |
| 18  | 22          | 30   | 31          | 22                                      | 30          | 42                                     | 55          | 22                                  | 30          | 42          | 55          | 22             | 30          | 42          | 55          |
| 35  | 50          | 50   | 50          | 50                                      | 65          | 85                                     | 100         | 50                                  | 65          | 85          | 100         | 50             | 65          | 85          | 100         |
| 100   | 100         | 75   | 50          | 100                                     | 100         | 100                                    | 100         | 100                                 | 100         | 100         | 100         | 100            | 100         | 100         | 100         |
| 4   | 8           | 13   | 14          | 8                                       | 13          | 14                                     | 17          | 8                                   | 13          | 14          | 17          | 8              | 13          | 14          | 17          |
| 13  | 17          | 28   | 55          | 17                                      | 28          | 55                                     | 74          | 17                                  | 28          | 55          | 74          | 17             | 28          | 55          | 74          |
| 32  | 40          | 55   | 63          | 40                                      | 55          | 80                                     | 121         | 40                                  | 55          | 80          | 121         | 40             | 55          | 80          | 121         |
| 36  | 47          | 63   | 66          | 47                                      | 63          | 89                                     | 121         | 47                                  | 63          | 89          | 121         | 47             | 63          | 89          | 121         |
| 74  | 105         | 105  | 105         | 105                                     | 143         | 187                                    | 220         | 105                                 | 143         | 187         | 220         | 105            | 143         | 187         | 220         |
| 8   | 17          | 30   | 30          | 17                                      | 30          | 40                                     | 63          | 17                                  | 30          | 40          | 63          | 17             | 30          | 40          | 63          |
| 30,000  |             |  |             | 30,000                                  |             |  |             | 25,000                              |             |             |             | 25,000         |             |             |             |
| 10,000  |             |  |             | 10,000                                  |             |  |             | 10,000                              |             |             |             | 10,000         |             |             |             |
| 200 mA/100 mV   |             |  |             | 200 mA/100 mV                           |             |  |             | 200 mA/100 mV                       |             |             |             | 200 mA/100 mV  |             |             |             |
| (1.0) × In  |             |  |             | (1.0) × In                              |             |  |             | (1.0) × In                          |             |             |             | (1.0) × In     |             |             |             |
| 16 ~ 32 A : 400 A, 40 ~ 100 A : 10 × In                 |             |  |             | 16 ~ 32 A : 400 A, 40 ~ 125 A : 10 × In |             |  |             | 10 × In                             |             |             |             | 10 × In        |             |             |             |
| ●   | ●           | ●  | ●           | ●                                       | ●           | ●                                      | ●           | ●                                   | ●           | ●           | ●           | ●              | ●           | ●           | ●           |
| ● (3P Only)   | ● (3P Only) | ● (3P Only)                                  | ● (3P Only) | ● (3P Only)                             | ● (3P Only) | ● (3P Only)                            | ● (3P Only) | ● (3P Only)                         | ● (3P Only) | ● (3P Only) | ● (3P Only) | ● (3P Only)    | ● (3P Only) | ● (3P Only) | ● (3P Only) |
| ● (3P Only)   | ● (3P Only) | ● (3P Only)                                  | ● (3P Only) | ● (3P Only)                             | ● (3P Only) | ● (3P Only)                            | ● (3P Only) | -                                   | -           | -           | -           | -              | -           | -           | -           |
| ● (3P Only)   | ● (3P Only) | ● (3P Only)                                  | ● (3P Only) | ● (3P Only)                             | ● (3P Only) | ● (3P Only)                            | ● (3P Only) | -                                   | -           | -           | -           | -              | -           | -           | -           |
| ● (2, 3P Only)  | ● (3P Only) | ● (3P Only)                                  | ● (3P Only) | ● (3P Only)                             | ● (3P Only) | ● (3P Only)                            | ● (3P Only) | -                                   | -           | -           | -           | -              | -           | -           | -           |
| ●   | ●           | ●  | ●           | ●                                       | ●           | ●                                      | ●           | ●                                   | ●           | ●           | ●           | ●              | ●           | ●           | ●           |
| Terminal Screw  |             |  |             |   |             |  |             | Terminal Screw, Terminal Bus Bar    |             |             |             |                |             |             |             |
| Horizontal/Vertical                                     |             |  |             |   |             |  |             | Horizontal/Vertical                 |             |             |             |                |             |             |             |
| Switchgear (Line & Load, Line Only), Distribution Panel |             |  |             |   |             |  |             | Switchgear (Line & Load, Line Only) |             |             |             |                |             |             |             |
| Possible if DIN Rail adaptor is used                    |             |  |             | -                                       |             |  |             | -                                   |             |             |             | -              |             |             |             |
| 75/75/100   |             |  |             | 90/90/120                               |             |  |             | 105/105/140                         |             |             |             | 105/105/140    |             |             |             |
| 130   |             |  |             | 155                                     |             |  |             | 165                                 |             |             |             | 165            |             |             |             |
| 68  |             |  |             | 68                                      |             |  |             | 68                                  |             |             |             | 68             |             |             |             |
| 0.7/0.8/1.0   |             |  |             | 0.9/1.0/1.3                             |             |  |             | 1.1/1.3/1.7                         |             |             |             | 1.1/1.3/1.7    |             |             |             |
| 232 Page  |             |  |             | 232 Page                                |             |  |             | 232 Page                            |             |             |             | 232 Page       |             |             |             |
| 149 / 166 Page  |             |  |             | 150 / 167 Page                          |             |  |             | 151 / 168 Page                      |             |             |             | 151 / 168 Page |             |             |             |

## Model Selection Table

### ZCT Embedded Molded Case Circuit Breaker (HGM Type) : 400 ~ 800 AF


#### Common Ratings

|  |   |                           |             |
|--|---|---------------------------|-------------|
| Rated Insulation Voltage, $U_i$            | 1,000 V   | Suitability for Isolation | Yes         |
| Rated Operational Voltage, $U_e$           | 690 V   | Utilization Category      | A           |
| Rated Impulse Withstand Voltage, $U_{imp}$ | 8 kV  | Pollution Degree          | 3           |
| Protection Function                        | Overload, Instantaneous, Short-Circuit Protection | Reference Standard        | IEC 60947-2 |

| Model Name   | HGM400                               |                                     |                |            | HGM630              |                                     |                |            | HGM800              |            |                |  |  |  |
|--|--------------------------------------|-------------------------------------|----------------|------------|---------------------|-------------------------------------|----------------|------------|---------------------|------------|----------------|--|--|--|
| Frame (AF)   | 400                                  |                                     |                |            | 630                 |                                     |                |            | 800                 |            |                |  |  |  |
| Number of Poles (P)  | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup> |                                     |                |            | 2 <sup>2)</sup> , 3 |                                     |                |            | 2 <sup>2)</sup> , 3 |            |                |  |  |  |
| Rated Current, at 40 °C (A)  | 250, 300, 350, 400                   |                                     |                |            | 500, 630            |                                     |                |            | 700, 800            |            |                |  |  |  |
| <b>Rated Ultimate Short-Circuit Breaking Capacity [Icu] (kA rms)</b> |                                      |                                     |                |            |                     |                                     |                |            |                     |            |                |  |  |  |
| Short-Circuit Breaking Category Code                                 | E                                    | S                                   | H              | L          | E                   | S                                   | H              | L          | S                   | H          | L              |  |  |  |
| AC 660/690 V   | 5                                    | 8                                   | 10             | 14         | 5                   | 8                                   | 10             | 14         | 8                   | 10         | 14             |  |  |  |
| AC 480/500 V   | 18                                   | 35                                  | 50             | 65         | 25                  | 45                                  | 50             | 65         | 45                  | 50         | 65             |  |  |  |
| <b>AC 440/460 V</b>  | <b>38</b>                            | <b>50</b>                           | <b>70</b>      | <b>85</b>  | <b>38</b>           | <b>50</b>                           | <b>70</b>      | <b>85</b>  | <b>50</b>           | <b>70</b>  | <b>85</b>      |  |  |  |
| AC 380/415 V   | 45                                   | 65                                  | 85             | 100        | 45                  | 65                                  | 85             | 100        | 65                  | 85         | 100            |  |  |  |
| AC 220/240 V   | 50                                   | 75                                  | 100            | 125        | 50                  | 75                                  | 100            | 125        | 75                  | 100        | 125            |  |  |  |
| Service Breaking Capacity [Ics = % Icu]                              | 100                                  | 100                                 | 100            | 100        | 100                 | 100                                 | 100            | 100        | 100                 | 100        | 100            |  |  |  |
| <b>Rated Short-Circuit Making Capacity [Icm] (kA peak)</b>           |                                      |                                     |                |            |                     |                                     |                |            |                     |            |                |  |  |  |
| AC 660/690 V   | 8                                    | 14                                  | 17             | 28         | 8                   | 14                                  | 17             | 28         | 14                  | 17         | 28             |  |  |  |
| AC 480/500 V   | 36                                   | 74                                  | 105            | 143        | 53                  | 95                                  | 105            | 143        | 95                  | 105        | 143            |  |  |  |
| <b>AC 440/460 V</b>  | <b>80</b>                            | <b>105</b>                          | <b>154</b>     | <b>187</b> | <b>80</b>           | <b>105</b>                          | <b>154</b>     | <b>187</b> | <b>105</b>          | <b>154</b> | <b>187</b>     |  |  |  |
| AC 380/415 V   | 95                                   | 143                                 | 187            | 220        | 95                  | 143                                 | 187            | 220        | 143                 | 187        | 220            |  |  |  |
| AC 220/240 V   | 105                                  | 165                                 | 220            | 275        | 105                 | 165                                 | 220            | 275        | 165                 | 220        | 275            |  |  |  |
| DC 250 V (2P)  | 40                                   | 53                                  | 84             | 84         | 40                  | 53                                  | 84             | 84         | 53                  | 84         | 84             |  |  |  |
| <b>Endurance [times] (Durability)</b>                                |                                      |                                     |                |            |                     |                                     |                |            |                     |            |                |  |  |  |
| Mechanical   | 4,000                                |                                     |                |            | 2,500               |                                     |                |            | 2,500               |            |                |  |  |  |
| Electrical (at 460 V)  | 1,000                                |                                     |                |            | 500                 |                                     |                |            | 500                 |            |                |  |  |  |
| ZCT Output Characteristics   | 200 mA/100 mV                        |                                     |                |            | 200 mA/100 mV       |                                     |                |            | 200 mA/100 mV       |            |                |  |  |  |
| <b>Trip Device</b>   |                                      |                                     |                |            |                     |                                     |                |            |                     |            |                |  |  |  |
| Thermal  | Long time [LTD]                      |                                     |                |            | (1.0) × In          |                                     |                |            | (1.0) × In          |            |                |  |  |  |
| Magnetic   | Instantaneous [INST]                 |                                     |                |            | 10 × In             |                                     |                |            | 10 × In             |            |                |  |  |  |
| <b>Accessory</b>   |                                      |                                     |                |            |                     |                                     |                |            |                     |            |                |  |  |  |
| Internal   | Auxiliary Switch                     | AUX                                 | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
|  | Alarm Switch                         | ALT                                 | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
|  | Shunt Trip                           | SHT                                 | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
|  | Under-Voltage Trip                   | UVT                                 | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
| External   | Rotary Handle                        | Front Contact TFG                   | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
|  |                                      | Extension TFH                       | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
|  | Mechanical Open/Close Device         | MOT                                 | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
|  | Mechanical Interlock                 | MIF                                 | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
|  | Handle Locking Device                | PLD                                 | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
|  | Plug-in                              | TDM (LINE/LOAD)                     | ● (3P Only)    |            | ● (3P Only)         |                                     |                |            | ● (3P Only)         |            |                |  |  |  |
|  |                                      | TDM (LINE Only)                     | ● (3P Only)    |            | ● (3P Only)         |                                     |                |            | ● (3P Only)         |            |                |  |  |  |
|  |                                      | TDF (LINE Only)                     | -              |            | -                   |                                     |                |            | -                   |            |                |  |  |  |
|  |                                      | TDA (1 row)                         | -              |            | -                   |                                     |                |            | -                   |            |                |  |  |  |
|  |                                      | TDA (2 rows)                        | -              |            | -                   |                                     |                |            | -                   |            |                |  |  |  |
|  | Cage Terminal Block                  | CTB                                 | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
|  | Terminal Cover                       | TCF                                 | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
|  | Insulation Barrier                   | TQQ                                 | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
|  | Terminal Bus Bar                     | TBB                                 | ●              |            | ●                   |                                     |                |            | ●                   |            |                |  |  |  |
| <b>Installation and Dimensions</b>                                   |                                      |                                     |                |            |                     |                                     |                |            |                     |            |                |  |  |  |
| Connection/<br>Installation  | Front Connection                     | Terminal Screw                      |                |            |                     | Terminal Screw, Terminal Bus Bar    |                |            |                     |            |                |  |  |  |
|  | Rear Connection                      | Horizontal/Vertical Cable           |                |            |                     | Horizontal/Vertical Cable           |                |            |                     |            |                |  |  |  |
|  | Plug-in                              | Switchgear (Line & Load, Line Only) |                |            |                     | Switchgear (Line & Load, Line Only) |                |            |                     |            |                |  |  |  |
| Dimension<br>(mm)  | a (2/3/4P)                           | 140/140/184                         |                |            |                     | 210/210                             |                |            |                     | 210/210    |                |  |  |  |
|  | b                                    | 257                                 |                |            |                     | 280                                 |                |            |                     | 280        |                |  |  |  |
|  | c                                    | 110                                 |                |            |                     | 110                                 |                |            |                     | 110        |                |  |  |  |
| Weight (kg)  | 2/3/4P                               | 4/4.5/5.4                           |                |            |                     | 8.7/9.5                             |                |            |                     | 8.7/9.5    |                |  |  |  |
| Detailed Rating and Selection  |                                      |                                     | 232 Page       |            |                     |                                     | 232 Page       |            |                     |            | 232 Page       |  |  |  |
| Characteristic Curve and Appearance                                  |                                      |                                     | 151 / 169 Page |            |                     |                                     | 152 / 170 Page |            |                     |            | 152 / 170 Page |  |  |  |

※ 1) 4 Pole Arrangement : Basic specification of R-S-T-N

2) As for 2P products, only the neutral pole in the 3P product has been eliminated so the dimension is equivalent to the 3P product.

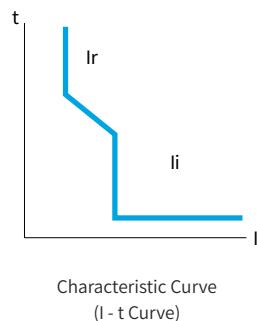

## Trip Unit Characteristics - Thermal Magnetic

| Rated Current (A) In             |                               | 16  | 20  | 25  | 32  | 40  | 50  | 63  | 75          | 80    | 100   | 125 |
|----------------------------------|-------------------------------|-----|-----|-----|-----|-----|-----|-----|-------------|-------|-------|-----|
| MCCB                             | HGM30                         | ●   | ●   | ●   | ●   |     |     |     |             |       |       |     |
|                                  | HGM50                         | ●   | ●   | ●   | ●   | ●   | ●   |     |             |       |       |     |
|                                  | HGM60                         | ●   | ●   | ●   | ●   | ●   | ●   | ●   |             |       |       |     |
|                                  | HGM100                        | ●   | ●   | ●   | ●   | ●   | ●   | ●   | ●           | ●     | ●     | ●   |
|                                  | HGM125                        | ●   | ●   | ●   | ●   | ●   | ●   | ●   | ●           | ●     | ●     | ●   |
| Moment Characteristics Ir        |                               |     |     |     |     |     |     |     |             |       |       |     |
| Setting Value (A)                | 1.0×In                        | 16  | 20  | 25  | 32  | 40  | 50  | 63  | 75          | 80    | 100   | 125 |
| Instantaneous Characteristics Ii |                               |     |     |     |     |     |     |     |             |       |       |     |
| Setting Value (A)                | 10×In                         | 400 | 400 | 400 | 400 | 500 | 630 | 750 | 800         | 1,000 | 1,250 |     |
|                                  | Max. Non-Tripping Current (A) | 320 | 320 | 320 | 320 | 400 | 504 | 600 | 640         | 800   | 1,000 |     |
|                                  | Min. Operational Current (A)  | 480 | 480 | 480 | 480 | 600 | 756 | 900 | 960         | 1,200 | 1,500 |     |
| Neutral Pole Protection          |                               |     |     |     |     |     |     |     |             |       |       |     |
| 4P3D                             |                               |     |     |     |     |     |     |     | Unprotected |       |       |     |
| 4P4D                             |                               |     |     |     |     |     |     |     | -           |       |       |     |

## Model Selection Table

### Earth Leakage Circuit Breaker (HGE Type) : 32 ~ 250 AF

#### Common Ratings

|                                       |  |                           |             |
|---------------------------------------|--|---------------------------|-------------|
| Rated Operational Voltage, Ue         | AC 220/460 V   | Suitability for Isolation | Yes         |
| Usable Voltage Range                  | AC 187 ~ 506 V   | Utilization Category      | A           |
| Rated Impulse Withstand Voltage, Uimp | 6 kV   | Pollution Degree          | 3           |
| Protection Function                   | Earth Leakage, Overload, Instantaneous, Short-Circuit Protection | Reference Standard        | IEC 60947-2 |

| Model Name  |                              | HGE30                                 | HGE50   |                                       |                | HGE60                                |  |     |
|---|------------------------------|---------------------------------------|---|---------------------------------------|----------------|--------------------------------------|--|-----|
| Frame   | (AF)                         | 32                                    | 50  |                                       |                | 63                                   |  |     |
| Number of Poles   | (P)                          | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup>  | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup>                    |                                       |                | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup> |  |     |
| Rated Current, at 40 °C                                       | (A)                          | 16, 20, 25, 32                        | 16, 20, 25, 32, 40, 50                                  |                                       |                | 16, 20, 25, 32, 40, 50, 63           |  |     |
| High Speed Type   |                              |                                       |   |                                       |                |                                      |  |     |
| Adjustable Residual Current                                   | (mA)                         | 30                                    | 30  |                                       |                | 30                                   |  |     |
| Max. Operational Time   | (s)                          | 0.1                                   | 0.1   |                                       |                | 0.1                                  |  |     |
| Time Delay Type   |                              |                                       |   |                                       |                |                                      |  |     |
| Adjustable Residual Current                                   | (mA)                         | 100 - 300 - 500<br>- 1,000 Adjustable | 100 - 300 - 500 - 1,000 Adjustable                      |                                       |                | 100 - 300 - 500 - 1,000 Adjustable   |  |     |
| Maximum Operational Time                                      | (s)                          | 0.1 - 0.4 - 1.0 - 2.0                 | 0.1 - 0.4 - 1.0 - 2.0                                   |                                       |                | 0.1 - 0.4 - 1.0 - 2.0                |  |     |
| Inertial Delay Time   | (ms)                         | 0 - 200 - 500<br>- 1,000 Adjustable   | 0 - 200 - 500 - 1,000 Adjustable                        |                                       |                | 0 - 200 - 500 - 1,000 Adjustable     |  |     |
| Rated Ultimate Short-Circuit Breaking Capacity [Icu] (kA rms) |                              |                                       |   |                                       |                |                                      |  |     |
| Short-Circuit Breaking Category Code                          | E                            | S                                     | E   | S                                     | H              | L                                    | E                                      | S   |
| AC 415/440/460 V  | 16                           | 20                                    | 16  | 20                                    | 38             | 55                                   | 16                                     | 20  |
| AC 380 V  | 16                           | 22                                    | 18  | 22                                    | 42             | 55                                   | 18                                     | 22  |
| AC 220/240V   | 35                           | 50                                    | 35  | 50                                    | 85             | 100                                  | 35                                     | 50  |
| Service Breaking Capacity [Ics = % Icu]                       | 100                          | 100                                   | 100   | 100                                   | 100            | 100                                  | 100                                    | 75  |
| Rated Short-Circuit Making Capacity [Icm] (kA peak)           |                              |                                       |   |                                       |                |                                      |  |     |
| AC 415/440/460 V  | 32                           | 40                                    | 32  | 40                                    | 80             | 121                                  | 32                                     | 40  |
| AC 380 V  | 36                           | 47                                    | 36  | 47                                    | 89             | 121                                  | 36                                     | 47  |
| AC 220/240 V  | 74                           | 105                                   | 74  | 105                                   | 187            | 220                                  | 74                                     | 105 |
| Endurance [times] (Durability)                                |                              |                                       |   |                                       |                |                                      |  |     |
| Mechanical  |                              | 30,000                                |   | 30,000                                |                |                                      | 30,000                                 |     |
| Electrical (at 460 V)   |                              | 10,000                                |   | 10,000                                |                |                                      | 10,000                                 |     |
| Trip Device   |                              |                                       |   |                                       |                |                                      |  |     |
| Thermal   | Long Time [LTD]              | (1.0) × In                            |   | (1.0) × In                            |                |                                      | (1.0) × In                             |     |
| Magnetic  | Instantaneous [INST]         | 400 A                                 |   | 16 ~ 32 A : 400 A, 40, 50 A : 10 × In |                |                                      | 16 ~ 32 A : 400 A, 40 ~ 63 A : 10 × In |     |
| Accessory   |                              |                                       |   |                                       |                |                                      |  |     |
| Internal  | Auxiliary Switch             | AUX                                   | ●   |                                       | ●              |                                      | ●                                      |     |
|   | Alarm Switch                 | ALT                                   | ●   |                                       | ●              |                                      | ●                                      |     |
|   | Shunt Trip                   | SHT                                   | -   |                                       | -              |                                      | -                                      |     |
|   | Under-Voltage Trip           | UVT                                   | -   |                                       | -              |                                      | -                                      |     |
| External  | Rotary Handle                | Front Contact TFG                     | ●   |                                       | ●              |                                      | ●                                      |     |
|   |                              | Extension TFH                         | ●   |                                       | ●              |                                      | ●                                      |     |
|   | Mechanical Open/Close Device | MOT                                   | ●   |                                       | ●              |                                      | ●                                      |     |
|   | Mechanical Interlock         | MIF                                   | ●   |                                       | ●              |                                      | ●                                      |     |
|   | Handle Locking Device        | PLD                                   | ●   |                                       | ●              |                                      | ●                                      |     |
|   | Plug-in                      | TDM (LINE/LOAD)                       | ● (3P Only)   | ● (3P Only)                           | ● (3P Only)    |                                      | ● (3P Only)                            |     |
|   |                              | TDM (LINE Only)                       | ● (3P Only)   | ● (3P Only)                           | ● (3P Only)    |                                      | ● (3P Only)                            |     |
|   |                              | TDF (LINE Only)                       | ● (3P Only)   | ● (3P Only)                           | ● (3P Only)    |                                      | ● (3P Only)                            |     |
|   |                              | TDA (1 row)                           | ● (3P Only)   | ● (3P Only)                           | ● (3P Only)    |                                      | ● (3P Only)                            |     |
|   |                              | TDA (2 rows)                          | ● (2, 3P Only)  | ● (2, 3P Only)                        | ● (2, 3P Only) |                                      | ● (2, 3P Only)                         |     |
|   | Cage Terminal Block CTB      |                                       | ●   |                                       | ●              |                                      | ●                                      |     |
|   | Terminal Cover TCF           |                                       | ●   |                                       | ●              |                                      | ●                                      |     |
|   | Insulation Barrier TQO       |                                       | ●   |                                       | ●              |                                      | ●                                      |     |
|   | Terminal Bus Bar TBB         |                                       | -   |                                       | -              |                                      | -                                      |     |
| Installation and Dimensions                                   |                              |                                       |   |                                       |                |                                      |  |     |
| Connection/<br>Installation                                   | Front Connection             |                                       | Terminal Screw  |                                       |                |                                      |  |     |
|   | Rear Connection              |                                       | Horizontal/Vertical                                     |                                       |                |                                      |  |     |
|   | Plug-in                      |                                       | Switchgear (Line & Load, Line Only), Distribution Panel |                                       |                |                                      |  |     |
| Dimension<br>(mm)   | DIN Rail Installation        | Possible if DIN Rail adaptor is used  |   | -                                     |                | Possible if DIN Rail adaptor is used |  |     |
|   | a (2/3/4P)                   | 75/75/100                             | 75/75/100   |                                       | 90/90/120      |                                      | 75/75/100                              |     |
|   | b                            | 130                                   | 130   |                                       | 155            |                                      | 130                                    |     |
|   | c                            | 68                                    | 68  |                                       | 68             |                                      | 68                                     |     |
| Weight (kg)   | 2/3/4P                       | 0.8/0.9/1.3                           | 0.8/0.9/1.3   | 1.0/1.1/1.4                           |                | 0.8/0.9/1.3                          |  |     |
| Detailed Rating and Selection                                 |                              | 232 Page                              | 232 Page  | 232 Page                              |                | 232 Page                             |  |     |
| Characteristic Curve and Appearance                           |                              | 149 / 171 Page                        | 149 / 171 Page  | 150 / 172 Page                        |                | 149 / 171 Page                       |  |     |

※ 1) 4 Pole Arrangement : Basic specification of R-S-T-N

2) As for 2P products, only the neutral pole in the 3P product has been eliminated so the dimension is equivalent to the 3P product.

| HGE100  |                 |                 |                 | HGE125                                       |                |                |                | HGE160                               |                 |                 |                 | HGE250                                 |                |                |                |
|---|-----------------|-----------------|-----------------|--|----------------|----------------|----------------|--------------------------------------|-----------------|-----------------|-----------------|--|----------------|----------------|----------------|
| 100   |                 |                 |                 | 125  |                |                |                | 160                                  |                 |                 |                 | 250                                    |                |                |                |
| 2 <sup>2)</sup> , 3, 4 <sup>1)</sup>                    |                 |                 |                 | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup>         |                |                |                | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup> |                 |                 |                 | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup>   |                |                |                |
| 16, 20, 25, 32, 40, 50, 63, 75, 80, 100                 |                 |                 |                 | 16, 20, 25, 32, 40, 50, 63, 75, 80, 100, 125 |                |                |                | 100, 125, 150, 160                   |                 |                 |                 | 100, 125, 150, 160, 175, 200, 225, 250 |                |                |                |
| 30  |                 |                 |                 | 30   |                |                |                | 30                                   |                 |                 |                 | 30                                     |                |                |                |
| 0.1   |                 |                 |                 | 0.1  |                |                |                | 0.1                                  |                 |                 |                 | 0.1                                    |                |                |                |
| 100 - 300 - 500 - 1,000 Adjustable                      |                 |                 |                 | 100 - 300 - 500 - 1,000 Adjustable           |                |                |                | 100 - 300 - 500 - 1,000 Adjustable   |                 |                 |                 | 100 - 300 - 500 - 1,000 Adjustable     |                |                |                |
| 0.1 - 0.4 - 1.0 - 2.0                                   |                 |                 |                 | 0.1 - 0.4 - 1.0 - 2.0                        |                |                |                | 0.1 - 0.4 - 1.0 - 2.0                |                 |                 |                 | 0.1 - 0.4 - 1.0 - 2.0                  |                |                |                |
| 0 - 200 - 500 - 1,000 Adjustable                        |                 |                 |                 | 0 - 200 - 500 - 1,000 Adjustable             |                |                |                | 0 - 200 - 500 - 1,000 Adjustable     |                 |                 |                 | 0 - 200 - 500 - 1,000 Adjustable       |                |                |                |
| E   | S               | H               | L               | E  | S              | H              | L              | E                                    | S               | H               | L               | E                                      | S              | H              | L              |
| 16  | 20              | 26              | 30              | 20   | 26             | 38             | 55             | 20                                   | 26              | 38              | 55              | 20                                     | 26             | 38             | 55             |
| 18  | 22              | 30              | 31              | 22   | 30             | 42             | 55             | 22                                   | 30              | 42              | 55              | 22                                     | 30             | 42             | 55             |
| 30  | 50              | 50              | 50              | 50   | 65             | 85             | 100            | 50                                   | 65              | 85              | 100             | 50                                     | 65             | 85             | 100            |
| 100   | 100             | 75              | 50              | 100  | 100            | 100            | 100            | 100                                  | 100             | 100             | 100             | 100                                    | 100            | 100            | 100            |
| 32  | 40              | 55              | 63              | 40   | 55             | 80             | 121            | 40                                   | 55              | 80              | 121             | 40                                     | 55             | 80             | 121            |
| 36  | 47              | 63              | 66              | 47   | 63             | 89             | 121            | 47                                   | 63              | 89              | 121             | 47                                     | 63             | 89             | 121            |
| 74  | 105             | 105             | 105             | 105  | 143            | 187            | 220            | 105                                  | 143             | 187             | 220             | 105                                    | 143            | 187            | 220            |
| 30,000  |                 |                 |                 | 30,000                                       |                |                |                | 25,000                               |                 |                 |                 | 25,000                                 |                |                |                |
| 10,000  |                 |                 |                 | 10,000                                       |                |                |                | 10,000                               |                 |                 |                 | 10,000                                 |                |                |                |
| (1.0) × In  |                 |                 |                 | (1.0) × In                                   |                |                |                | (1.0) × In                           |                 |                 |                 | (1.0) × In                             |                |                |                |
| 16 ~ 32 A : 400 A, 40 ~ 100 A : 10 × In                 |                 |                 |                 | 16 ~ 32 A : 400 A, 40 ~ 125 A : 10 × In      |                |                |                | 10 × In                              |                 |                 |                 | 10 × In                                |                |                |                |
| ●   | ●               | ●               | ●               | ●  | ●              | ●              | ●              | ●                                    | ●               | ●               | ●               | ●                                      | ●              | ●              | ●              |
| -   | -               | -               | -               | -  | -              | -              | -              | -                                    | -               | -               | -               | -                                      | -              | -              | -              |
| ●   | ●               | ●               | ●               | ●  | ●              | ●              | ●              | ●                                    | ●               | ●               | ●               | ●                                      | ●              | ●              | ●              |
| ●   | ●               | ●               | ●               | ●  | ●              | ●              | ●              | ●                                    | ●               | ●               | ●               | ●                                      | ●              | ●              | ●              |
| ●   | ●               | ●               | ●               | ●  | ●              | ●              | ●              | ●                                    | ●               | ●               | ●               | ●                                      | ●              | ●              | ●              |
| ●   | ●               | ●               | ●               | ●  | ●              | ●              | ●              | ●                                    | ●               | ●               | ●               | ●                                      | ●              | ●              | ●              |
| ● (3P Only)   | ● (3P Only)     | ● (3P Only)     | ● (3P Only)     | ● (3P Only)                                  | ● (3P Only)    | ● (3P Only)    | ● (3P Only)    | ● (3P Only)                          | ● (3P Only)     | ● (3P Only)     | ● (3P Only)     | ● (3P Only)                            | ● (3P Only)    | ● (3P Only)    | ● (3P Only)    |
| ● (3P Only)   | ● (3P Only)     | ● (3P Only)     | ● (3P Only)     | ● (3P Only)                                  | ● (3P Only)    | ● (3P Only)    | ● (3P Only)    | ● (3P Only)                          | ● (3P Only)     | ● (3P Only)     | ● (3P Only)     | ● (3P Only)                            | ● (3P Only)    | ● (3P Only)    | ● (3P Only)    |
| ● (3P Only)   | ● (3P Only)     | ● (3P Only)     | ● (3P Only)     | ● (3P Only)                                  | ● (3P Only)    | ● (3P Only)    | ● (3P Only)    | ● (3P Only)                          | ● (3P Only)     | ● (3P Only)     | ● (3P Only)     | ● (3P Only)                            | ● (3P Only)    | ● (3P Only)    | ● (3P Only)    |
| ● (2, 3P Only)  | ● (3P Only)     | ● (3P Only)     | ● (3P Only)     | ● (3P Only)                                  | ● (3P Only)    | ● (3P Only)    | ● (3P Only)    | ● (3P Only)                          | ● (3P Only)     | ● (3P Only)     | ● (3P Only)     | ● (3P Only)                            | ● (3P Only)    | ● (3P Only)    | ● (3P Only)    |
| ●   | ●               | ●               | ●               | ●  | ●              | ●              | ●              | ●                                    | ●               | ●               | ●               | ●                                      | ●              | ●              | ●              |
| ●   | ●               | ●               | ●               | ●  | ●              | ●              | ●              | ●                                    | ●               | ●               | ●               | ●                                      | ●              | ●              | ●              |
| ●   | ●               | ●               | ●               | ●  | ●              | ●              | ●              | ●                                    | ●               | ●               | ●               | ●                                      | ●              | ●              | ●              |
| Terminal Screw  |                 |                 |                 |  |                |                |                | Terminal Screw, Terminal Bus Bar     |                 |                 |                 |  |                |                |                |
| Horizontal/Vertical                                     |                 |                 |                 |  |                |                |                | Horizontal/Vertical                  |                 |                 |                 |  |                |                |                |
| Switchgear (Line & Load, Line Only), Distribution Panel |                 |                 |                 |  |                |                |                | Switchgear (Line & Load, Line Only)  |                 |                 |                 |  |                |                |                |
| Possible if DIN Rail adaptor is used                    | -               | -               | -               | -  | -              | -              | -              | -                                    | -               | -               | -               | -                                      | -              | -              | -              |
| 75/75/100   | 90/90/120       | 155             | 165             | 105/105/140                                  | 105/105/140    | 165            | 165            | 68                                   | 68              | 68              | 68              | 149 / 171 Page                         | 150 / 172 Page | 151 / 173 Page | 151 / 173 Page |
| 130   | 68              | 1.0 / 1.1 / 1.4 | 1.3 / 1.5 / 1.9 | 232 Page                                     | 232 Page       | 232 Page       | 232 Page       | 1.3 / 1.5 / 1.9                      | 1.3 / 1.5 / 1.9 | 1.3 / 1.5 / 1.9 | 1.3 / 1.5 / 1.9 | 232 Page                               | 232 Page       | 232 Page       | 232 Page       |
| 68  | 68              | 1.0 / 1.1 / 1.4 | 1.3 / 1.5 / 1.9 | 232 Page                                     | 232 Page       | 232 Page       | 232 Page       | 1.3 / 1.5 / 1.9                      | 1.3 / 1.5 / 1.9 | 1.3 / 1.5 / 1.9 | 1.3 / 1.5 / 1.9 | 232 Page                               | 232 Page       | 232 Page       | 232 Page       |
| 0.8 / 0.9 / 1.3   | 1.0 / 1.1 / 1.4 | 1.3 / 1.5 / 1.9 | 1.3 / 1.5 / 1.9 | 150 / 172 Page                               | 150 / 172 Page | 151 / 173 Page | 151 / 173 Page | 1.3 / 1.5 / 1.9                      | 1.3 / 1.5 / 1.9 | 1.3 / 1.5 / 1.9 | 1.3 / 1.5 / 1.9 | 151 / 173 Page                         | 151 / 173 Page | 151 / 173 Page | 151 / 173 Page |
| 232 Page  | 232 Page        | 232 Page        | 232 Page        | 150 / 172 Page                               | 150 / 172 Page | 151 / 173 Page | 151 / 173 Page | 1.3 / 1.5 / 1.9                      | 1.3 / 1.5 / 1.9 | 1.3 / 1.5 / 1.9 | 1.3 / 1.5 / 1.9 | 151 / 173 Page                         | 151 / 173 Page | 151 / 173 Page | 151 / 173 Page |
| 149 / 171 Page  | 150 / 172 Page  | 151 / 173 Page  | 151 / 173 Page  | 150 / 172 Page                               | 150 / 172 Page | 151 / 173 Page | 151 / 173 Page | 1.3 / 1.5 / 1.9                      | 1.3 / 1.5 / 1.9 | 1.3 / 1.5 / 1.9 | 1.3 / 1.5 / 1.9 | 151 / 173 Page                         | 151 / 173 Page | 151 / 173 Page | 151 / 173 Page |

## Model Selection Table

### Earth Leakage Circuit Breaker (HGE Type) : 400 ~ 800 AF


#### Common Ratings

|                                       |  |                           |             |
|---------------------------------------|--|---------------------------|-------------|
| Rated Operational Voltage, Ue         | AC 220/460 V   | Suitability for Isolation | Yes         |
| Usable Voltage Range                  | AC 187 ~ 506 V   | Utilization Category      | A           |
| Rated Impulse Withstand Voltage, Uimp | 6 kV   | Pollution Degree          | 3           |
| Protection Function                   | Earth Leakage, Overload, Instantaneous, Short-Circuit Protection | Reference Standard        | IEC 60947-2 |



| Model Name  | HGE400                               | HGE630                              | HGE800                              |             |
|---|--------------------------------------|-------------------------------------|-------------------------------------|-------------|
| Frame (AF)  | 400                                  | 630                                 | 800                                 |             |
| Number of Poles (P)   | 2 <sup>2)</sup> , 3, 4 <sup>1)</sup> | 2 <sup>2)</sup> , 3                 | 2 <sup>2)</sup> , 3                 |             |
| Rated Current, at 40 °C (A)                                   | 250, 300, 350, 400                   | 500, 630                            | 700, 800                            |             |
| High Speed Type   |                                      |                                     |                                     |             |
| Adjustable Residual Current (mA)                              | 30                                   | 30                                  | 30                                  |             |
| Max. Operational Time (s)                                     | 0.1                                  | 0.1                                 | 0.1                                 |             |
| Time Delay Type   |                                      |                                     |                                     |             |
| Adjustable Residual Current (mA)                              | 100 - 300 - 500 - 1,000 Adjustable   | 100 - 300 - 500 - 1,000 Adjustable  | 100 - 300 - 500 - 1,000 Adjustable  |             |
| Max. Operational Time (s)                                     | 0.1 - 0.4 - 1.0 - 2.0                | 0.1 - 0.4 - 1.0 - 2.0               | 0.1 - 0.4 - 1.0 - 2.0               |             |
| Inertial Delay Time (ms)                                      | 0 - 200 - 500 - 1,000 Adjustable     | 0 - 200 - 500 - 1,000 Adjustable    | 0 - 200 - 500 - 1,000 Adjustable    |             |
| Rated Ultimate Short-Circuit Breaking Capacity [Icu] (kA rms) | E S H L                              | E S H L                             | E S H L                             |             |
| Short-Circuit Breaking Category Code                          | 38 50 70 85                          | 38 50 70 85                         | 50 70 85                            |             |
| AC 440/460 V  | 38                                   | 50                                  | 70                                  |             |
| AC 380/415 V  | 45                                   | 65                                  | 85                                  |             |
| AC 220/240 V  | 50                                   | 75                                  | 100                                 |             |
| Service Breaking Capacity [Ics = % Icu]                       | 100 100 100 100                      | 100 100 100 100                     | 100 100 100 100                     |             |
| Rated Short-Circuit Making Capacity [Icm] (kA peak)           | 80 105 154 187                       | 80 105 154 187                      | 105 154 187                         |             |
| AC 440/460 V  | 80                                   | 105                                 | 154                                 |             |
| AC 380/415 V  | 95                                   | 143                                 | 187                                 |             |
| AC 220/240 V  | 105                                  | 165                                 | 220                                 |             |
| Endurance [times] (Durability)                                |                                      |                                     |                                     |             |
| Mechanical  | 4,000                                | 2,500                               | 2,500                               |             |
| Electrical (at 460 V)   | 1,000                                | 500                                 | 500                                 |             |
| Trip Device   |                                      |                                     |                                     |             |
| Thermal   | Long Time [LTD]                      | (1.0) × In                          | (1.0) × In                          |             |
| Magnetic  | Instantaneous [INST]                 | 10 × In                             | 10 × In                             |             |
| Accessory   |                                      |                                     |                                     |             |
| Internal  | Auxiliary Switch                     | AUX                                 | ●                                   |             |
|   | Alarm Switch                         | ALT                                 | ●                                   |             |
|   | Shunt Trip                           | SHT                                 | ●                                   |             |
|   | Under-Voltage Trip                   | UVT                                 | ●                                   |             |
| External  | Rotary Handle                        | Front Contact TFG                   | ●                                   |             |
|   | Mechanical Open/Close Device         | Extension TFH                       | ●                                   |             |
|   | Mechanical Interlock                 | MOT                                 | ●                                   |             |
|   | Handle Locking Device                | MIF                                 | ●                                   |             |
|   | Plug-in                              | TDM (LINE/LOAD)                     | ● (3P Only)                         | ● (3P Only) |
|   |                                      | TDM (LINE Only)                     | ● (3P Only)                         | ● (3P Only) |
|   |                                      | TDF (LINE Only)                     | -                                   | -           |
|   |                                      | TDA (1 row)                         | -                                   | -           |
|   |                                      | TDA (2 rows)                        | -                                   | -           |
|   | Cage Terminal Block                  | CTB                                 | ●                                   | ●           |
| Terminal Cover  | TCF                                  | ●                                   | ●                                   |             |
| Insulation Barrier  | TQQ                                  | ●                                   | ●                                   |             |
| Terminal Bus Bar  | TBB                                  | ●                                   | ●                                   |             |
| Installation and Dimensions                                   |                                      |                                     |                                     |             |
| Connection/Installation                                       | Front Connection                     | Terminal Screw                      | Terminal Screw, Terminal Bus Bar    |             |
|   | Rear Connection                      | Horizontal/Vertical Cable           | Horizontal/Vertical Cable           |             |
|   | Plug-in                              | Switchgear (Line & Load, Line Only) | Switchgear (Line & Load, Line Only) |             |
| Dimension (mm)  | a (2/3/4P)                           | 140/140/184                         | 210/210                             |             |
|   | b                                    | 257                                 | 280                                 |             |
|   | c                                    | 110                                 | 110                                 |             |
| Weight (kg)   | 3/4P                                 | 4/4.5/5.4                           | 8.7/9.5                             |             |
| Detailed Rating and Selection                                 |                                      | 232 Page                            | 232 Page                            |             |
| Characteristic Curve and Appearance                           |                                      | 151 / 174 Page                      | 152 / 175 Page                      |             |

\* 1) 4 Pole Arrangement : Basic specification of R-S-T-N

2) As for 2P products, only the neutral pole in the 3P product has been eliminated so the dimension is equivalent to the 3P product.



Over-Current Protection Characteristics

Earth Leakage Protection Characteristics  
(Time Delay Type)

### Trip Unit Characteristics - Thermal Magnetic

| Rated Current (A) In                      |                               | 16                                      | 20  | 25  | 32  | 40  | 50  | 63  | 75  | 80    | 100   | 125 |
|---|-------------------------------|---|-----|-----|-----|-----|-----|-----|-----|-------|-------|-----|
| ELCB                                      | HGE30                         | ●                                       | ●   | ●   | ●   |     |     |     |     |       |       |     |
|   | HGE50                         | ●                                       | ●   | ●   | ●   | ●   | ●   |     |     |       |       |     |
|   | HGE60                         | ●                                       | ●   | ●   | ●   | ●   | ●   | ●   |     |       |       |     |
|   | HGE100                        | ●                                       | ●   | ●   | ●   | ●   | ●   | ●   | ●   | ●     | ●     |     |
|   | HGE125                        | ●                                       | ●   | ●   | ●   | ●   | ●   | ●   | ●   | ●     | ●     | ●   |
| Moment Characteristics $I_r$              |                               |   |     |     |     |     |     |     |     |       |       |     |
| Setting Value (A)                         | 1.0 × In                      | 16                                      | 20  | 25  | 32  | 40  | 50  | 63  | 75  | 80    | 100   | 125 |
| Instantaneous Characteristics $i_i$       |                               |   |     |     |     |     |     |     |     |       |       |     |
| Setting Value (A)                         | 10 × In                       | 400                                     | 400 | 400 | 400 | 500 | 630 | 750 | 800 | 1,000 | 1,250 |     |
|   | Max. Non-Tripping Current (A) | 320                                     | 320 | 320 | 320 | 400 | 504 | 600 | 640 | 800   | 1,000 |     |
|   | Min. Operational Current (A)  | 480                                     | 480 | 480 | 480 | 600 | 756 | 900 | 960 | 1,200 | 1,500 |     |
| Rated Non-Operational Time $I_{\Delta n}$ |                               |   |     |     |     |     |     |     |     |       |       |     |
| High-Speed Type                           |                               | Fixed : 30 mA                           |     |     |     |     |     |     |     |       |       |     |
| Time Delay Type                           |                               | Adjustable : 100 - 300 - 500 - 1,000 mA |     |     |     |     |     |     |     |       |       |     |
| Inertial Propagation Time $\Delta t$      |                               |   |     |     |     |     |     |     |     |       |       |     |
| High-Speed Type                           |                               | Fixed : 0 ms                            |     |     |     |     |     |     |     |       |       |     |
| Time Delay Type                           |                               | Adjustable : 0 - 200 - 500 - 1,000 ms   |     |     |     |     |     |     |     |       |       |     |
| Neutral Pole Protection                   |                               |   |     |     |     |     |     |     |     |       |       |     |
| 4P3D                                      |                               | Unprotected                             |     |     |     |     |     |     |     |       |       |     |
| 4P4D                                      |                               | -                                       |     |     |     |     |     |     |     |       |       |     |

| Rated Current (A) In                      |                               | 100                                     | 125   | 150   | 160   | 175   | 200   | 225   | 250   | 300   | 350   | 400   | 500   | 630   | 700   | 800   |
|---|-------------------------------|---|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| ELCB                                      | HGE160                        | ●                                       | ●     | ●     | ●     |       |       |       |       |       |       |       |       |       |       |       |
|   | HGE250                        | ●                                       | ●     | ●     | ●     | ●     | ●     | ●     | ●     |       |       |       |       |       |       |       |
|   | HGE400                        |   |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
|   | HGE630                        |   |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
|   | HGE800                        |   |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| Moment Characteristics $I_r$              |                               |   |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| Setting Value (A)                         | 1.0 × In                      | 100                                     | 125   | 150   | 160   | 175   | 200   | 225   | 250   | 300   | 350   | 400   | 500   | 630   | 700   | 800   |
| Instantaneous Characteristics $i_i$       |                               |   |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| Setting Value (A)                         | 10 × In                       | 1,000                                   | 1,250 | 1,500 | 1,600 | 1,750 | 2,000 | 2,250 | 2,500 | 3,000 | 3,500 | 4,000 | 5,000 | 6,300 | 7,000 | 8,000 |
|   | Max. Non-Tripping Current (A) | 800                                     | 1,000 | 1,200 | 1,280 | 1,400 | 1,600 | 1,800 | 2,000 | 2,400 | 2,800 | 3,200 | 4,000 | 5,040 | 5,600 | 6,400 |
|   | Min. Operational Current (A)  | 1,200                                   | 1,500 | 1,800 | 1,920 | 2,100 | 2,400 | 2,700 | 3,000 | 3,600 | 4,200 | 4,800 | 6,000 | 7,560 | 8,400 | 9,600 |
| Rated Non-Operational Time $I_{\Delta n}$ |                               |   |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| High-Speed Type                           |                               | Fixed : 30 mA                           |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| Time Delay Type                           |                               | Adjustable : 100 - 300 - 500 - 1,000 mA |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| Inertial Propagation Time $\Delta t$      |                               |   |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| High-Speed Type                           |                               | Fixed : 0 ms                            |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| Time Delay Type                           |                               | Adjustable : 100 - 200 - 500 - 1,000 ms |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| Neutral Pole Protection                   |                               |   |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| 4P3D                                      |                               | Unprotected                             |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| 4P4D                                      |                               | -                                       |       |       |       |       |       |       |       |       |       |       |       |       |       |       |

## Model Selection Table

### High Breaking Capacity Type of Molded Case Circuit Breaker (HGP Type) : 50 ~ 800 AF

#### Common Ratings

|  |   |                           |             |
|--|---|---------------------------|-------------|
| Rated Insulation Voltage, $U_i$            | 1,000 V   | Suitability for Isolation | Yes         |
| Rated Operational Voltage, $U_e$           | 690 V   | Utilization Category      | A           |
| Rated Impulse Withstand Voltage, $U_{imp}$ | 8 kV  | Pollution Degree          | 3           |
| Protection Function                        | Overload, Instantaneous, Short-Circuit Protection | Reference Standard        | IEC 60947-2 |

| Model Name   |                               | HGP50D                              |            |            |            | HGP125D                                      |            |            |            | HGP160D                             |            |            |            | HGP100                              |            |   |            |  |  |
|--|-------------------------------|-------------------------------------|------------|------------|------------|--|------------|------------|------------|-------------------------------------|------------|------------|------------|-------------------------------------|------------|---|------------|--|--|
| Frame  | (AF)                          | 50                                  |            |            |            | 125  |            |            |            | 160                                 |            |            |            | 100                                 |            |   |            |  |  |
| Number of Poles  | (P)                           | 3, 4 <sup>1)</sup>                  |            |            |            | 3, 4 <sup>1)</sup>                           |            |            |            | 3, 4 <sup>1)</sup>                  |            |            |            | 3, 4 <sup>1)</sup>                  |            |   |            |  |  |
| <b>Rated Ultimate Short-Circuit Breaking Capacity [Icu] (kA rms)</b> |                               |                                     |            |            |            |  |            |            |            |                                     |            |            |            |                                     |            |   |            |  |  |
| Short-Circuit Breaking Category Code                                 |                               | F <sup>2)</sup>                     | S          | H          | X          | F <sup>2)</sup>                              | S          | H          | X          | F <sup>2)</sup>                     | S          | H          | X          | F <sup>2)</sup>                     | S          | H   | X          |  |  |
| AC 660/690 V   |                               | 6                                   | 8          | 8          | 10         | 6  | 8          | 8          | 10         | 6                                   | 8          | 8          | 10         | 6                                   | 8          | 8   | 10         |  |  |
| <b>AC 480/500 V</b>  |                               | <b>25</b>                           | <b>50</b>  | <b>65</b>  | <b>100</b> | <b>25</b>                                    | <b>50</b>  | <b>65</b>  | <b>100</b> | <b>25</b>                           | <b>50</b>  | <b>65</b>  | <b>100</b> | <b>25</b>                           | <b>50</b>  | <b>65</b>                                 | <b>100</b> |  |  |
| <b>AC 440/460 V</b>  |                               | <b>36</b>                           | <b>65</b>  | <b>85</b>  | <b>150</b> | <b>36</b>                                    | <b>65</b>  | <b>85</b>  | <b>150</b> | <b>36</b>                           | <b>65</b>  | <b>85</b>  | <b>150</b> | <b>36</b>                           | <b>65</b>  | <b>85</b>                                 | <b>150</b> |  |  |
| AC 380/415 V   |                               | 50                                  | 85         | 100        | 150        | 50   | 85         | 100        | 150        | 50                                  | 85         | 100        | 150        | 50                                  | 85         | 100                                       | 150        |  |  |
| AC 220/240 V   |                               | 65                                  | 100        | 130        | 200        | 65   | 100        | 130        | 200        | 65                                  | 100        | 130        | 200        | 65                                  | 100        | 130                                       | 200        |  |  |
| DC 250 V <sup>3)</sup>   |                               | 36                                  | 65         | 85         | 100        | 36   | 65         | 85         | 100        | 36                                  | 65         | 85         | 100        | 36                                  | 65         | 85  | 100        |  |  |
| Service Breaking Capacity [Ics = % Icu]                              |                               | 100                                 | 100        | 100        | 100        | 100  | 100        | 100        | 100        | 100                                 | 100        | 100        | 100        | 100                                 | 100        | 100                                       | 100        |  |  |
| <b>Rated Short-Circuit Making Capacity [Icm] (kA peak)</b>           |                               |                                     |            |            |            |  |            |            |            |                                     |            |            |            |                                     |            |   |            |  |  |
| AC 660/690 V   |                               | 9                                   | 14         | 14         | 17         | 9  | 14         | 14         | 17         | 9                                   | 14         | 14         | 17         | 9                                   | 14         | 14  | 17         |  |  |
| <b>AC 480/500 V</b>  |                               | <b>53</b>                           | <b>105</b> | <b>143</b> | <b>220</b> | <b>53</b>                                    | <b>105</b> | <b>143</b> | <b>220</b> | <b>53</b>                           | <b>105</b> | <b>143</b> | <b>220</b> | <b>53</b>                           | <b>105</b> | <b>143</b>                                | <b>220</b> |  |  |
| <b>AC 440/460 V</b>  |                               | <b>76</b>                           | <b>143</b> | <b>187</b> | <b>330</b> | <b>76</b>                                    | <b>143</b> | <b>187</b> | <b>330</b> | <b>76</b>                           | <b>143</b> | <b>187</b> | <b>330</b> | <b>76</b>                           | <b>143</b> | <b>187</b>                                | <b>330</b> |  |  |
| AC 380/415 V   |                               | 105                                 | 187        | 220        | 330        | 105  | 187        | 220        | 330        | 105                                 | 187        | 220        | 330        | 105                                 | 187        | 220                                       | 330        |  |  |
| AC 220/240 V   |                               | 143                                 | 220        | 286        | 440        | 143  | 220        | 286        | 440        | 143                                 | 220        | 286        | 440        | 143                                 | 220        | 286                                       | 440        |  |  |
| <b>Endurance [times] (Durability)</b>                                |                               |                                     |            |            |            |  |            |            |            |                                     |            |            |            |                                     |            |   |            |  |  |
| Mechanical   |                               | 25,000                              |            |            |            | 25,000                                       |            |            |            | 25,000                              |            |            |            | 25,000                              |            |   |            |  |  |
| In @ 440 V   |                               | 10,000                              |            |            |            | 10,000                                       |            |            |            | 10,000                              |            |            |            | 10,000                              |            |   |            |  |  |
| <b>Trip Device</b>   |                               | ●                                   |            |            |            | ●  |            |            |            | ●                                   |            |            |            | ●                                   |            |   |            |  |  |
| Thermal Magnetic   | Rated Current, at 40 °C (A)   | 16, 20, 25, 32, 40, 50              |            |            |            | 16, 20, 25, 32, 40, 50, 63, 75, 80, 100, 125 |            |            |            | 100, 125, 160                       |            |            |            | 40, 50, 63, 80, 100                 |            |   |            |  |  |
|  | Long Time [LTD]               | (0.8-0.9-1.0) × In                  |            |            |            | (0.8-0.9-1.0) × In                           |            |            |            | (0.8-0.9-1.0) × In                  |            |            |            | (0.7-0.8-0.9-1.0) × In              |            |   |            |  |  |
|  | Instantaneous [INST]          | 16~32 A: 400 A, 40~50 A : 10 × In   |            |            |            | 16~32 A: 400 A, 40~50 A : 10 × In            |            |            |            | 10 × In                             |            |            |            | 10 × In                             |            |   |            |  |  |
| Electronic   | Rated Current, at 40 °C (A)   | -                                   |            |            |            | -  |            |            |            | -                                   |            |            |            | 40, 100                             |            |   |            |  |  |
|  | Long Time [LTD]               | Ir (A)                              | N, D, A, E | -          |            |  |            | -          |            |                                     |            | -          |            |                                     |            | 0.4-0.45-0.5-0.56-0.63-0.7-0.8-0.9-1 × In |            |  |  |
|  |                               | Tr (s)                              | N          | -          |            |  |            | -          |            |                                     |            | -          |            |                                     |            | 16 @ 6lr                                  |            |  |  |
|  | Short Time [STD]              | Isd (A)                             | N, D, A, E | -          |            |  |            | -          |            |                                     |            | -          |            |                                     |            | 0.5-1-2-4-6-8-16 @ 6 × Ir                 |            |  |  |
|  |                               | Tsd (s)                             | N          | -          |            |  |            | -          |            |                                     |            | -          |            |                                     |            | 1.5-2-3-4-5-6-7-8-10 × In                 |            |  |  |
|  | Instantaneous [INST]          | li (A)                              | N          | -          |            |  |            | -          |            |                                     |            | -          |            |                                     |            | 0.1                                       |            |  |  |
|  |                               |                                     | D, A, E    | -          |            |  |            | -          |            |                                     |            | -          |            |                                     |            | 0.1-0.2-0.3-0.4                           |            |  |  |
|  | Ground Fault Protection [GFT] | Ig (A)                              | N          | -          |            |  |            | -          |            |                                     |            | -          |            |                                     |            | NA  |            |  |  |
|  |                               |                                     | D, A, E    | -          |            |  |            | -          |            |                                     |            | -          |            |                                     |            | OFF-0.2-0.3-0.4-0.5-0.6-0.7-0.8-1 × In    |            |  |  |
|  | N Pole Protection (L, S)      | (A)                                 | N          | -          |            |  |            | -          |            |                                     |            | -          |            |                                     |            | NA  |            |  |  |
|  |                               |                                     | D, A, E    | -          |            |  |            | -          |            |                                     |            | -          |            |                                     |            | 0.1-0.2-0.3-0.4                           |            |  |  |
| <b>Installation and Dimensions</b>                                   |                               | -                                   |            |            |            | -  |            |            |            | -                                   |            |            |            | -                                   |            |   |            |  |  |
| Connection/ Installation   | Front Connection              | Terminal Screw                      |            |            |            | Terminal Screw                               |            |            |            | Terminal Screw                      |            |            |            | Terminal Screw, Terminal Bus Bar    |            |   |            |  |  |
|  | Rear Connection               | Horizontal/Vertical Cable           |            |            |            | Horizontal/Vertical Cable                    |            |            |            | Horizontal/Vertical Cable           |            |            |            | Horizontal/Vertical Cable           |            |   |            |  |  |
| Dimension (mm)   | Plug-in                       | Switchgear (Line & Load, Line Only) |            |            |            | Switchgear (Line & Load, Line Only)          |            |            |            | Switchgear (Line & Load, Line Only) |            |            |            | Switchgear (Line & Load, Line Only) |            |   |            |  |  |
|  | a (3/4P)                      | 90/120                              |            |            |            | 90/120                                       |            |            |            | 90/120                              |            |            |            | 105/140                             |            |   |            |  |  |
|  | b                             | 140                                 |            |            |            | 140  |            |            |            | 140                                 |            |            |            | 165                                 |            |   |            |  |  |
|  | c                             | 86                                  |            |            |            | 86   |            |            |            | 86                                  |            |            |            | 86.5                                |            |   |            |  |  |

※ 1) 4 Pole Arrangement : Basic specification of R-S-T-N

2) Only applicable to oversea products/ship products

Accessory

|          |   |
|----------|---|
| Internal | Auxiliary switch (AUX), Alarm switch (ALT), Shunt trip (SHT), Undervoltage trip (UVT)   |
| External | Rotary handle - Front Contact Type (TFG)/Extension Type (TFH), Motor operator (MOT), Mechanical interlock (MIF), Locking device (PLD), Cage terminal block (CTB), Insulation terminal cover (TCF), Insulation barrier (TQQ)<br>※ Plug-in TDM is only for 3 pole and can be selected by LINE/LODE(P3), LINE Only(F3).Terminal extensions (TBB) excludes HGP50D, 125D and 160D types. |


| HGP160                                      |     |   |     | HGP250                                      |     |   |     | HGP400                                      |     |   |     | HGP630                                      |     |   |     | HGP800                                      |     |  |     |
|---|-----|---|-----|---|-----|---|-----|---|-----|---|-----|---|-----|---|-----|---|-----|--|-----|
| 160   |     |   |     | 250   |     |   |     | 400   |     |   |     | 630   |     |   |     | 800   |     |  |     |
| 3, 4 <sup>1)</sup>                          |     |   |     | 3, 4 <sup>1)</sup>                          |     |   |     | 3, 4 <sup>1)</sup>                          |     |   |     | 3, 4 <sup>1)</sup>                          |     |   |     | 3, 4 <sup>1)</sup>                          |     |  |     |
| F <sup>2)</sup>                             | S   | H   | X   | F <sup>2)</sup>                             | S   | H   | X   | F <sup>2)</sup>                             | S   | H   | X   | F <sup>2)</sup>                             | S   | H   | X   | F <sup>2)</sup>                             | S   | H                                      | X   |
| 6   | 8   | 8   | 10  | 6   | 8   | 8   | 10  | 10  | 20  | 35  | 10  | 10  | 20  | 35  | 10  | 10  | 20  | 35                                     |     |
| 25  | 50  | 65  | 100 | 25  | 50  | 65  | 100 | 25  | 50  | 70  | 100 | 25  | 50  | 70  | 100 | 25  | 50  | 70                                     | 100 |
| 36  | 65  | 85  | 150 | 36  | 65  | 85  | 150 | 36  | 70  | 85  | 150 | 36  | 70  | 85  | 150 | 36  | 70  | 85                                     | 150 |
| 50  | 85  | 100   | 150 | 50  | 85  | 100   | 150 | 50  | 85  | 100   | 150 | 50  | 85  | 100   | 150 | 50  | 85  | 100                                    | 150 |
| 65  | 100 | 130   | 200 | 65  | 100 | 130   | 200 | 65  | 100 | 130   | 200 | 65  | 100 | 130   | 200 | 65  | 100 | 130                                    | 200 |
| 36  | 65  | 85  | 100 | 36  | 65  | 85  | 100 | 36  | 65  | 85  | 100 | 36  | 65  | 85  | 100 | 36  | 65  | 85                                     | 100 |
| 100   | 100 | 100   | 100 | 100   | 100 | 100   | 100 | 100   | 100 | 100   | 100 | 100   | 100 | 100   | 100 | 100   | 100 | 100                                    | 100 |
| 9   | 14  | 14  | 17  | 9   | 14  | 14  | 17  | 17  | 40  | 74  | 17  | 17  | 40  | 74  | 17  | 17  | 40  | 74                                     |     |
| 53  | 105 | 143   | 220 | 53  | 105 | 143   | 220 | 53  | 105 | 154   | 220 | 53  | 105 | 154   | 220 | 53  | 105 | 154                                    | 220 |
| 76  | 143 | 187   | 330 | 76  | 143 | 187   | 330 | 76  | 154 | 187   | 330 | 76  | 154 | 187   | 330 | 76  | 154 | 187                                    | 330 |
| 105   | 187 | 220   | 330 | 105   | 187 | 220   | 330 | 105   | 187 | 220   | 330 | 105   | 187 | 220   | 330 | 105   | 187 | 220                                    | 330 |
| 143   | 220 | 286   | 440 | 143   | 220 | 286   | 440 | 143   | 220 | 286   | 440 | 143   | 220 | 286   | 440 | 143   | 220 | 286                                    | 440 |
| 25,000                                      |     | 25,000                                      |     | 20,000                                      |     | 20,000                                      |     | 20,000                                      |     | 20,000                                      |     | 20,000                                      |     | 20,000                                      |     | 20,000                                      |     | 20,000                                 |     |
| 10,000                                      |     | 10,000                                      |     | 6,000                                       |     | 6,000                                       |     | 4,000                                       |     | 4,000                                       |     | 3,000                                       |     | 3,000                                       |     |   |     |  |     |
| ●   |     | ●   |     | ●   |     | ●   |     | ●   |     | ●   |     | ●   |     | ●   |     | ●   |     | ●                                      |     |
| 100, 125, 150, 160                          |     | 125, 150, 160, 175,<br>200, 225, 250        |     | 300, 350, 400                               |     | 500, 630                                    |     | 700, 800                                    |     |   |     |   |     |   |     |   |     |  |     |
| (0.7-0.8-0.9-1.0)×In                        |     | (0.7-0.8-0.9-1.0)×In                        |     | (0.8-0.9-1.0)×In                            |     | (0.8-0.9-1.0)×In                       |     |
| (5-6-7-8-9-10)×In                           |     | (5-6-7-8-9-10)×In                           |     | (5-6-7-8-9-10)×In                           |     | (5-6-7-8-9-10)×In                           |     | (5-6-7-8-9-10)×In                           |     | (5-6-7-8-9-10)×In                           |     | (5-6-7-8-9-10)×In                           |     | (5-6-7-8-9-10)×In                           |     | (5-6-7-8-9-10)×In                           |     | (5-6-7-8-9-10)×In                      |     |
| ●   |     | ●   |     | ●   |     | ●   |     | ●   |     | ●   |     | ●   |     | ●   |     | ●   |     | ●                                      |     |
| 100, 160                                    |     | 160, 250                                    |     | 250, 400                                    |     | 630   |     | 800   |     |   |     |   |     |   |     |   |     |  |     |
| 0.4-0.45-0.5-0.56-0.63-<br>0.7-0.8-0.9-1×In |     | 0.4-0.45-0.5-0.56-0.63-<br>0.7-0.8-0.9-1×In |     | 0.4-0.45-0.5-0.56-0.63-<br>0.7-0.8-0.9-1×In |     | 0.4-0.45-0.5-0.56-0.63-<br>0.7-0.8-0.9-1×In |     | 0.4-0.45-0.5-0.56-0.63-<br>0.7-0.8-0.9-1×In |     | 0.4-0.45-0.5-0.56-0.63-<br>0.7-0.8-0.9-1×In |     | 0.4-0.45-0.5-0.56-0.63-<br>0.7-0.8-0.9-1×In |     | 0.4-0.45-0.5-0.56-0.63-<br>0.7-0.8-0.9-1×In |     | 0.4-0.45-0.5-0.56-0.63-<br>0.7-0.8-0.9-1×In |     |  |     |
| 16 @ 6lr                                    |     | 16 @ 6lr                                    |     | 16 @ 6lr                                    |     | 16 @ 6lr                                    |     | 16 @ 6lr                                    |     | 16 @ 6lr                                    |     | 16 @ 6lr                                    |     | 16 @ 6lr                                    |     | 16 @ 6lr                                    |     | 16 @ 6lr                               |     |
| 0.5-1-2-4-6-8-16 @ 6×lr                     |     | 0.5-1-2-4-6-8-16 @ 6×lr                     |     | 0.5-1-2-4-6-8-16 @ 6×lr                     |     | 0.5-1-2-4-6-8-16 @ 6×lr                     |     | 0.5-1-2-4-6-8-16 @ 6×lr                     |     | 0.5-1-2-4-6-8-16 @ 6×lr                     |     | 0.5-1-2-4-6-8-16 @ 6×lr                     |     | 0.5-1-2-4-6-8-16 @ 6×lr                     |     | 0.5-1-2-4-6-8-16 @ 6×lr                     |     | 0.5-1-2-4-6-8-16 @ 6×lr                |     |
| 1.5-2-3-4-5-6-7-8-10×In                     |     | 1.5-2-3-4-5-6-7-8-10×In                     |     | 1.5-2-3-4-5-6-7-8-10×In                     |     | 1.5-2-3-4-5-6-7-8-10×In                     |     | 1.5-2-3-4-5-6-7-8-10×In                     |     | 1.5-2-3-4-5-6-7-8-10×In                     |     | 1.5-2-3-4-5-6-7-8-10×In                     |     | 1.5-2-3-4-5-6-7-8-10×In                     |     | 1.5-2-3-4-5-6-7-8-10×In                     |     | 1.5-2-3-4-5-6-7-8-10×In                |     |
| 0.1   |     | 0.1   |     | 0.1   |     | 0.1   |     | 0.1   |     | 0.1   |     | 0.1   |     | 0.1   |     | 0.1   |     | 0.1                                    |     |
| 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                        |     |
| 1,500 @ 100 A,<br>2,400 @ 160 A             |     | 2,400 @ 160 A,<br>3,000 A @ 250 A           |     | 3,000 @ 250 A,<br>4,800 @ 400 A             |     | 6,900                                       |     | 8,800                                       |     |   |     |   |     |   |     |   |     |  |     |
| 1.5-2-4-6-8-10-11-<br>12-13-14-15×In        |     | 1.5-2-4-6-8-10-11×In                        |     | 1.5-2-4-6-8-10-11×In                   |     |
| 0.05  |     | 0.05  |     | 0.05  |     | 0.05  |     | 0.05  |     | 0.05  |     | 0.05  |     | 0.05  |     | 0.05  |     | 0.05                                   |     |
| NA  |     | NA  |     | NA  |     | NA  |     | NA  |     | NA  |     | NA  |     | NA  |     | NA  |     | NA                                     |     |
| OFF-0.2-0.3-0.4-0.5-<br>0.6-0.7-0.8-1×In    |     | OFF-0.2-0.3-0.4-0.5-<br>0.6-0.7-0.8-1×In    |     | OFF-0.2-0.3-0.4-0.5-<br>0.6-0.7-0.8-1×In    |     | OFF-0.2-0.3-0.4-0.5-<br>0.6-0.7-0.8-1×In    |     | OFF-0.2-0.3-0.4-0.5-<br>0.6-0.7-0.8-1×In    |     | OFF-0.2-0.3-0.4-0.5-<br>0.6-0.7-0.8-1×In    |     | OFF-0.2-0.3-0.4-0.5-<br>0.6-0.7-0.8-1×In    |     | OFF-0.2-0.3-0.4-0.5-<br>0.6-0.7-0.8-1×In    |     | OFF-0.2-0.3-0.4-0.5-<br>0.6-0.7-0.8-1×In    |     |  |     |
| NA  |     | NA  |     | NA  |     | NA  |     | NA  |     | NA  |     | NA  |     | NA  |     | NA  |     | NA                                     |     |
| 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                             |     | 0.1-0.2-0.3-0.4                        |     |
| OFF-0.5-1-1.6 <sup>4)</sup> ×In             |     | OFF-0.5-1-1.6 <sup>4)</sup> ×In             |     | OFF-0.5-1-1.6 <sup>4)</sup> ×In             |     | OFF-0.5-1-1.6 <sup>4)</sup> ×In             |     | OFF-0.5-1-1.6 <sup>4)</sup> ×In             |     | OFF-0.5-1-1.6 <sup>4)</sup> ×In             |     | OFF-0.5-1-1.6 <sup>4)</sup> ×In             |     | OFF-0.5-1-1.6 <sup>4)</sup> ×In             |     | OFF-0.5-1-1.6 <sup>4)</sup> ×In             |     | OFF-0.5-1-1.6 <sup>4)</sup> ×In        |     |
| Terminal Screw,<br>Terminal Bus Bar         |     | Terminal Screw,<br>Terminal Bus Bar         |     | Terminal Screw,<br>Terminal Bus Bar         |     | Terminal Screw,<br>Terminal Bus Bar         |     | Terminal Screw,<br>Terminal Bus Bar         |     | Terminal Screw,<br>Terminal Bus Bar         |     | Terminal Screw,<br>Terminal Bus Bar         |     | Terminal Screw,<br>Terminal Bus Bar         |     | Terminal Screw,<br>Terminal Bus Bar         |     | Terminal Screw,<br>Terminal Bus Bar    |     |
| Horizontal/Vertical Cable                   |     | Horizontal/Vertical Cable                   |     | Horizontal/Vertical Cable                   |     | Horizontal/Vertical Cable                   |     | Horizontal/Vertical Cable                   |     | Horizontal/Vertical Cable                   |     | Horizontal/Vertical Cable                   |     | Horizontal/Vertical Cable                   |     | Horizontal/Vertical Cable                   |     | Horizontal/Vertical Cable              |     |
| Switchgear<br>(Line & Load, Line Only)      |     | Switchgear<br>(Line & Load, Line Only)      |     | Switchgear<br>(Line & Load, Line Only)      |     | Switchgear<br>(Line & Load, Line Only)      |     | Switchgear<br>(Line & Load, Line Only)      |     | Switchgear<br>(Line & Load, Line Only)      |     | Switchgear<br>(Line & Load, Line Only)      |     | Switchgear<br>(Line & Load, Line Only)      |     | Switchgear<br>(Line & Load, Line Only)      |     | Switchgear<br>(Line & Load, Line Only) |     |
| 105/140                                     |     | 105/140                                     |     | 140/186.5                                   |     | 140/186.5                                   |     | 140/186.5                                   |     | 140/186.5                                   |     | 140/186.5                                   |     | 140/186.5                                   |     | 210/280                                     |     | 210/280                                |     |
| 165   |     | 165   |     | 260   |     | 260   |     | 260   |     | 260   |     | 260   |     | 260   |     | 320   |     | 320                                    |     |
| 86.5  |     | 86.5  |     | 110   |     | 110   |     | 110   |     | 110   |     | 110   |     | 110   |     | 135   |     | 135                                    |     |

※ 3) DC is only applicable to thermal magnetic

4) Only applicable if lr &lt; 0.63 ("1" is applicable if lr ≥ 0.63)


## Model Selection Table

### Trip Unit's Model Name and Function (Thermal Magnetic)

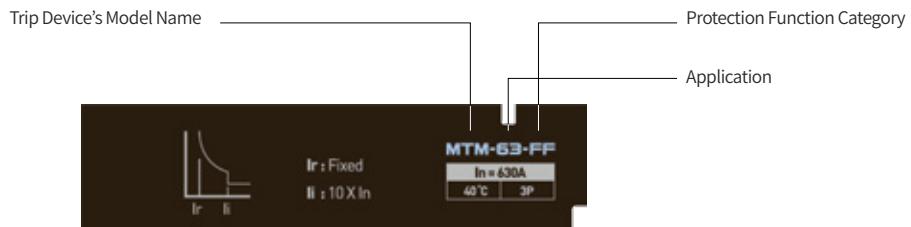

| Overcurrent Protection | Instantaneous Current Protection | TRIP Unit Name |         |               |        |        |               |        |               |               |
|------------------------|----------------------------------|----------------|---------|---------------|--------|--------|---------------|--------|---------------|---------------|
|                        |                                  | HGP50D         | HGP125D | HGP160D       | HGP100 | HGP160 | HGP250        | HGP400 | HGP630        | HGP800        |
| Fixed                  | Fixed                            |                |         | MTM - 16 - FF |        |        | MTM - 25 - FF |        | MTM - 63 - FF | MTM - 80 - FF |
| Adjustable             | Fixed                            |                |         | MTM - 16 - JF |        |        | MTM - 25 - JF |        | MTM - 63 - JF | MTM - 80 - JF |
| Adjustable             | Adjustable                       |                |         | -             |        |        | MTM - 25 - JJ |        | MTM - 63 - JJ | MTM - 80 - JJ |


### Trip Unit Characteristics – Thermal Magnetic HGP50D, 125D, 160D

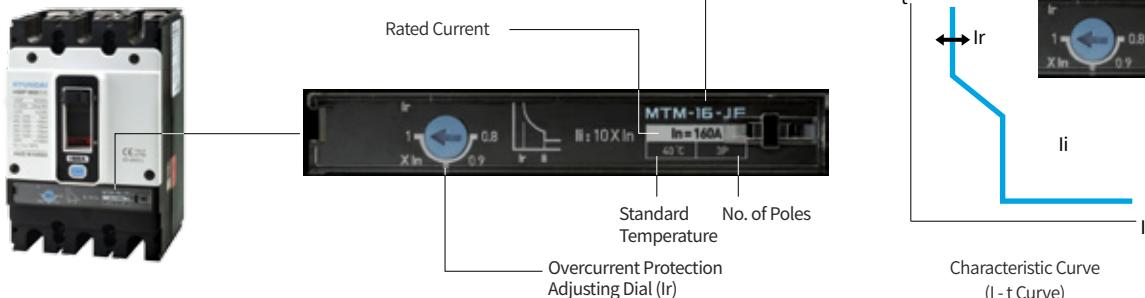

| Rated Current (A) In                  | 16                            | 20  | 25  | 32  | 40  | 50               | 63               | 75               | 80               | 100              | 125              | 150   | 160   |       |
|---------------------------------------|-------------------------------|-----|-----|-----|-----|------------------|------------------|------------------|------------------|------------------|------------------|-------|-------|-------|
| MCCB                                  | HGP50D                        | ●   | ●   | ●   | ●   | ●                | ●                |                  |                  |                  |                  |       |       |       |
|                                       | HGP125D                       | ●   | ●   | ●   | ●   | ●                | ●                | ●                | ●                | ●                | ●                | ●     |       |       |
|                                       | HGP160D                       |     |     |     |     |                  |                  |                  |                  |                  |                  |       |       |       |
|                                       | HGP100                        |     |     |     | ●   | ●                | ●                | ●                | ●                | ●                | ●                | ●     |       |       |
| Moment Characteristics $I_r$          |                               |     |     |     |     |                  |                  |                  |                  |                  |                  |       |       |       |
| Fixed (FF)                            | 1.0×In                        | 16  | 20  | 25  | 32  | 40               | 50               | 63               | 75               | 80               | 100              | 125   | 150   | 160   |
|                                       | 0.7×In <sup>1)</sup>          |     |     |     |     | 28 <sup>1)</sup> | 35 <sup>1)</sup> | 44 <sup>1)</sup> | 53 <sup>1)</sup> | 56 <sup>1)</sup> | 70 <sup>1)</sup> |       |       |       |
| Adjustable<br>(JF, JJ)                | 0.8×In                        | 13  | 16  | 20  | 26  | 32               | 40               | 50               | 60               | 64               | 80               | 100   | 120   | 128   |
|                                       | 0.9×In                        | 14  | 18  | 23  | 29  | 36               | 45               | 57               | 68               | 72               | 90               | 113   | 135   | 144   |
|                                       | 1.0×In                        | 16  | 20  | 25  | 32  | 40               | 50               | 63               | 75               | 80               | 100              | 125   | 150   | 160   |
| Instantaneous Characteristics $I_i$   |                               |     |     |     |     |                  |                  |                  |                  |                  |                  |       |       |       |
| Fixed<br>(FF, JF)                     | 10×In                         | 160 | 200 | 250 | 320 | 400              | 500              | 630              | 750              | 800              | 1,000            | 1,250 | 1,500 | 1,600 |
|                                       | Max. Non-Tripping Current (A) | 128 | 160 | 200 | 256 | 320              | 400              | 504              | 600              | 640              | 800              | 1,000 | 1,200 | 1,280 |
|                                       | Min. Tripping Current (A)     | 192 | 240 | 300 | 384 | 480              | 600              | 756              | 900              | 960              | 1,200            | 1,500 | 1,800 | 1,920 |
| Neutral Pole Protection               |                               |     |     |     |     |                  |                  |                  |                  |                  |                  |       |       |       |
| 4P3D (Neutral Unprotected)            | ●                             | ●   | ●   | ●   | ●   | ●                | ●                | ●                | ●                | ●                | ●                | ●     | ●     |       |
| 4P4D (Neutral Protected 100 % $I_r$ ) | ●                             | ●   | ●   | ●   | ●   | ●                | ●                | ●                | ●                | ●                | ●                | ●     | ●     |       |

<sup>1)</sup> Only applicable to HGP100

## Trip Unit Characteristics – Thermal Magnetic HGP250, 400, 630, 800

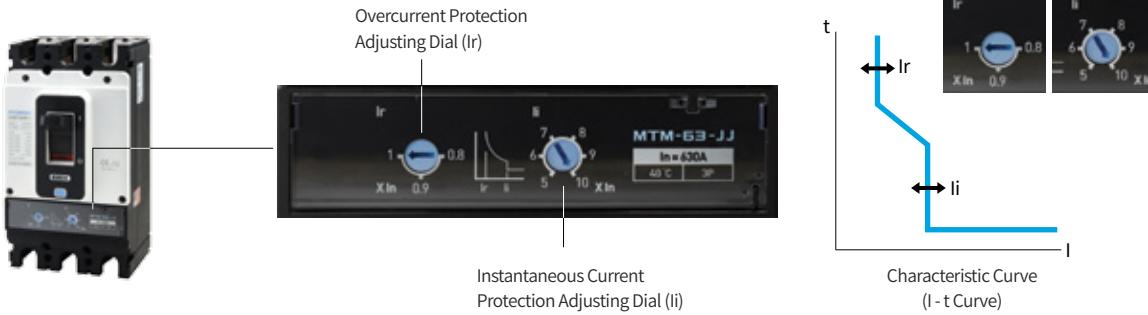


| Rated Current (A) In              | 100                           | 125   | 150   | 160   | 175   | 200   | 225   | 250   | 300   | 350   | 400   | 500   | 630   | 700   | 800   |       |
|-----------------------------------|-------------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| MCCB                              | HGP100                        | ● 1)  |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
|                                   | HGP160                        | ●     | ●     | ●     | ●     |       |       |       |       |       |       |       |       |       |       |       |
|                                   | HGP250                        |       | ●     | ●     | ●     | ●     | ●     | ●     |       |       |       |       |       |       |       |       |
|                                   | HGP400                        |       |       |       |       |       |       |       | ●     | ●     | ●     |       |       |       |       |       |
|                                   | HGP630                        |       |       |       |       |       |       |       |       |       | ●     | ●     |       |       |       |       |
|                                   | HGP800                        |       |       |       |       |       |       |       |       |       |       | ●     | ●     |       |       |       |
| Moment Characteristics Ir         |                               |       |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| Fixed (FF)                        | 1.0×In                        | 100   | 125   | 150   | 160   | 175   | 200   | 225   | 250   | 300   | 350   | 400   | 500   | 630   | 700   | 800   |
| Adjustable (JF, JJ)               | 0.7×In                        | 70    | 88    | 105   | 112   | 123   | 140   | 158   | 175   |       |       |       |       |       |       |       |
|                                   | 0.8×In                        | 80    | 100   | 120   | 128   | 140   | 160   | 180   | 200   | 240   | 280   | 320   | 400   | 504   | 560   | 640   |
|                                   | 0.9×In                        | 90    | 113   | 135   | 144   | 158   | 180   | 203   | 225   | 270   | 315   | 360   | 450   | 567   | 630   | 720   |
|                                   | 1.0×In                        | 100   | 125   | 150   | 160   | 175   | 200   | 225   | 250   | 300   | 350   | 400   | 500   | 630   | 700   | 800   |
| Instantaneous Characteristics li  |                               |       |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| Fixed (FF, JF)                    | 10×In                         | 1,000 | 1,250 | 1,500 | 1,600 | 1,750 | 2,000 | 2,250 | 2,500 | 3,000 | 3,500 | 4,000 | 5,000 | 6,300 | 7,000 | 8,000 |
|                                   | Max. Non-Tripping Current (A) | 800   | 1,000 | 1,200 | 1,280 | 1,400 | 1,600 | 1,800 | 2,000 | 2,400 | 2,800 | 3,200 | 4,000 | 5,040 | 5,600 | 6,400 |
|                                   | Min. Tripping Current (A)     | 1,200 | 1,500 | 1,800 | 1,920 | 2,100 | 2,400 | 2,700 | 3,000 | 3,600 | 4,200 | 4,800 | 6,000 | 7,560 | 8,400 | 9,600 |
| Adjustable (JJ)                   | 5×In                          | 500   | 625   | 750   | 800   | 875   | 1,000 | 1,125 | 1,250 | 1,500 | 1,750 | 2,000 | 2,500 | 3,150 | 3,500 | 4,000 |
|                                   | Max. Non-Tripping Current (A) | 400   | 500   | 600   | 640   | 700   | 800   | 900   | 1,000 | 1,200 | 1,400 | 1,600 | 2,000 | 2,520 | 2,800 | 3,200 |
|                                   | Min. Tripping Current (A)     | 600   | 750   | 900   | 960   | 1,050 | 1,200 | 1,350 | 1,500 | 1,800 | 2,100 | 2,400 | 3,000 | 3,780 | 4,200 | 4,800 |
|                                   | 6×In                          | 600   | 750   | 900   | 960   | 1,050 | 1,200 | 1,350 | 1,500 | 1,800 | 2,100 | 2,400 | 3,000 | 3,780 | 4,200 | 4,800 |
|                                   | Max. Non-Tripping Current (A) | 480   | 600   | 720   | 768   | 840   | 960   | 1,080 | 1,200 | 1,440 | 1,680 | 1,920 | 2,400 | 3,024 | 3,360 | 3,840 |
|                                   | Min. Tripping Current (A)     | 720   | 900   | 1,080 | 1,152 | 1,260 | 1,440 | 1,620 | 1,800 | 2,160 | 2,520 | 2,880 | 3,600 | 4,536 | 5,040 | 5,760 |
|                                   | 7×In                          | 700   | 875   | 1,050 | 1,120 | 1,225 | 1,400 | 1,575 | 1,750 | 2,100 | 2,450 | 2,800 | 3,500 | 4,410 | 4,900 | 5,600 |
|                                   | Max. Non-Tripping Current (A) | 560   | 700   | 840   | 896   | 980   | 1,120 | 1,260 | 1,400 | 1,680 | 1,960 | 2,240 | 2,800 | 3,528 | 3,920 | 4,480 |
|                                   | Min. Tripping Current (A)     | 840   | 1,050 | 1,260 | 1,344 | 1,470 | 1,680 | 1,890 | 2,100 | 2,520 | 2,940 | 3,360 | 4,200 | 5,292 | 5,880 | 6,720 |
|                                   | 8×In                          | 800   | 1,000 | 1,200 | 1,280 | 1,400 | 1,600 | 1,800 | 2,000 | 2,400 | 2,800 | 3,200 | 4,000 | 5,040 | 5,600 | 6,400 |
|                                   | Max. Non-Tripping Current (A) | 640   | 800   | 960   | 1,024 | 1,120 | 1,280 | 1,440 | 1,600 | 1,920 | 2,240 | 2,560 | 3,200 | 4,032 | 4,480 | 5,120 |
|                                   | Min. Tripping Current (A)     | 960   | 1,200 | 1,440 | 1,536 | 1,680 | 1,920 | 2,160 | 2,400 | 2,880 | 3,360 | 3,840 | 4,800 | 6,048 | 6,720 | 7,680 |
|                                   | 9×In                          | 900   | 1,125 | 1,350 | 1,440 | 1,575 | 1,800 | 2,025 | 2,250 | 2,700 | 3,150 | 3,600 | 4,500 | 5,670 | 6,300 | 7,200 |
|                                   | Max. Non-Tripping Current (A) | 720   | 900   | 1,080 | 1,152 | 1,260 | 1,440 | 1,620 | 1,800 | 2,160 | 2,520 | 2,880 | 3,600 | 4,536 | 5,040 | 5,760 |
|                                   | Min. Tripping Current (A)     | 1,080 | 1,350 | 1,620 | 1,728 | 1,890 | 2,160 | 2,430 | 2,700 | 3,240 | 3,780 | 4,320 | 5,400 | 6,804 | 7,560 | 8,640 |
|                                   | 10×In                         | 1,000 | 1,250 | 1,500 | 1,600 | 1,750 | 2,000 | 2,250 | 2,500 | 3,000 | 3,500 | 4,000 | 5,000 | 6,300 | 7,000 | 8,000 |
|                                   | Max. Non-Tripping Current (A) | 800   | 1,000 | 1,200 | 1,280 | 1,400 | 1,600 | 1,800 | 2,000 | 2,400 | 2,800 | 3,200 | 4,000 | 5,040 | 5,600 | 6,400 |
|                                   | Min. Tripping Current (A)     | 1,200 | 1,500 | 1,800 | 1,920 | 2,100 | 2,400 | 2,700 | 3,000 | 3,600 | 4,200 | 4,800 | 6,000 | 7,560 | 8,400 | 9,600 |
| Neutral Pole Protection           |                               |       |       |       |       |       |       |       |       |       |       |       |       |       |       |       |
| 4P3D (Neutral Unprotected)        | ●                             | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     |       |
| 4P4D (Neutral Protected 100 % Ir) | ●                             | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     | ●     |       |

※ 1) HGP100 100 A product is only applicable to Instantaneous fixed type.


## Model Selection Table

### Trip Unit's Model Name and Function (ETU)

#### ETU Part Name

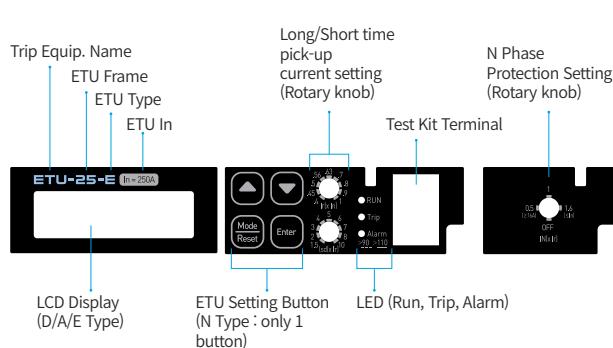

#### LCD Display / ICON (N Type is not applicable)

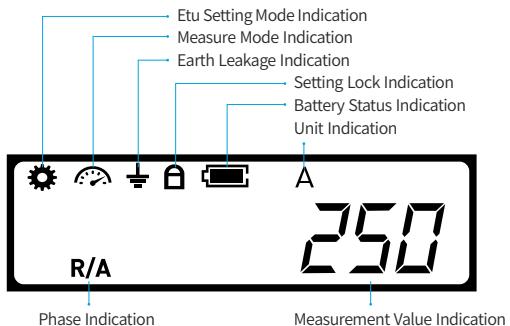










#### ETU Type / AF

| Type              | Model (AF) | Trip Unit |     |     |          |          |
|-------------------|------------|-----------|-----|-----|----------|----------|
|                   |            | 40        | 100 | 160 | 250      | 250      |
| Normal Type       |            |           |     |     | ETU-25-N | ETU-63-N |
| Display Type      |            |           |     |     | ETU-25-D | ETU-63-D |
| Ammeter Type      |            |           |     |     | ETU-25-A | ETU-63-A |
| Energy-meter Type |            |           |     |     | ETU-25-E | ETU-63-E |
|                   |            |           |     |     |          | ETU-80-N |
|                   |            |           |     |     |          | ETU-80-D |
|                   |            |           |     |     |          | ETU-80-A |
|                   |            |           |     |     |          | ETU-80-E |

#### Trip Unit Characteristics – Electronic Type

|                 | N  | D   | A  | E  | Remark                                      |
|-----------------|--|---|--|--|---|
| HMI             | Dial 2 EA  | • Dial 2 EA,<br>Key Button 4 EA<br>• Segment LCD  | • Dial 2 EA,<br>Key Button 4 EA<br>• Segment LCD   | • Dial 2 EA, Key Button 4 EA<br>• Segment LCD  | Dial Setting<br>(Ir, Isd)                   |
| Protection      | • L (Dial)<br>• S (Dial)<br>• I (Fixed)<br>• IN (Dial)               | • L (Dial, Key Button)<br>• S (Dial)<br>• I (Key Button)<br>• G (Key Button)<br>• IN (Dial) | • L (Dial, Key Button)<br>• S (Dial)<br>• I (Key Button)<br>• G (Key Button)<br>• IN (Dial)  | • L (Dial, Key Button)<br>• S (Dial)<br>• I (Key Button)<br>• G (Key Button)<br>• IN (Dial)  | L, S time to be<br>changed<br>by key button |
| Measurement     |  | • IR, IS, IT, IN, IG  | • IR, IS, IT, IN, IG<br>• Iavg, Imax, Imin   | • IR, IS, IT, IN, IG<br>• Iavg, Imax, Imin<br>• V, phase to neutral, phase to phase,<br>P, total/per phase, power factor<br>Q, total/per phase<br>S, total/per phase<br>Active(kW), Reactive(kVAr), Apparent(kVA)<br>F, THD (I, V, per phase, VLN, VLL)<br>Harmonic (15 th), Demand I, P |   |
| History / Event | • 20 Trip information<br>(damaged phase, type, time)                 | • 20 Trip information<br>(damaged phase, type, time)  | • 20 Trip information<br>(damaged phase, type, time)<br>• 32 System Event  | • 20 Trip information<br>(damaged phase, type, time)<br>• 32 System Event  | External power<br>required<br>DC 24 V       |
| Power           | • Self-Power   | • Self-Power  | • Self-Power<br>External power input (24 V DC)   | • Self-Power<br>External power input (24 V DC)   |   |
| Battery         | ●  | ●   | ●  | ●  | External power<br>required<br>DC 24 V       |
| Add-on function | • Test terminal  | • Test terminal   | • Test terminal<br>• ZSI OUT : 250 AF<br>• ZSI IN/OUT : 630 AF, 800 AF<br>• Trip / Alarm Counter<br>• Operating time 50 % In Over - 24 h | • Test terminal<br>• ZSI OUT : 250 AF<br>• ZSI IN/OUT : 630 AF, 800 AF<br>• Trip / Alarm Counter<br>• Operating time 50 % In Over - 24 h   |   |
| Communication   |  |   | • RS-485 MODBUS-RTU  | • RS-485 MODBUS-RTU  | External power<br>required DC 24 V          |
| Indication      | • LED 3 ea<br>• Run LED / Trip LED<br>Alarm LED (90 % off, 110 % on) | • LED 3 ea<br>• Run LED / Trip LED<br>Alarm LED (90 % off, 110 % on)                        | • LED 3 ea<br>• Run LED / Trip LED<br>Alarm LED (90 % off, 110 % on)   | • LED 3 ea<br>• Run LED / Trip LED<br>Alarm LED (90 % off, 110 % on)   | External power<br>required DC 24 V          |

## Trip Unit Overview

| Type                | ETU N  | ETU D   | ETU A  | ETU E   |
|---------------------|--|---|--|---|
| Protection Elements |  <ul style="list-style-type: none"> <li>For protecting the switchgear / general industry</li> <li>L, S, I</li> </ul>  |  <ul style="list-style-type: none"> <li>For protecting the switchgear / general industry</li> <li>L, S, I, G</li> </ul>  |  <ul style="list-style-type: none"> <li>For protecting the switchgear / general industry</li> <li>L, S, I, G</li> </ul>  |  <ul style="list-style-type: none"> <li>For protecting the switchgear / general industry</li> <li>L, S, I, G</li> </ul>  |
| Trip Unit           | <br>250 AF<br><br>630 AF<br><br>800 AF  | <br>250 AF<br><br>630 AF<br><br>800 AF   | <br>250 AF<br><br>630 AF<br><br>800 AF | <br>250 AF<br><br>630 AF<br><br>800 AF |
| Setting and Display | <ul style="list-style-type: none"> <li>Use the dial to set the pick-up for LT and ST.</li> <li>The setting of time delay has been fixed for operation.</li> </ul> <br>LT pick-up setting<br><br>ST pick-up setting | <ul style="list-style-type: none"> <li>A user can set LT and ST pick-up with a dial.</li> <li>A user can set the time delay for operation with a keypad.</li> <li>A user can set a pick-up and time delay of Instantaneous and grounding operation with a keypad.</li> <li>A user can move around information displayed on the LED window and set relaying with Menu, Up, Down, and Enter button.</li> </ul> <br>LT pick-up setting<br><br>ST pick-up setting | <ul style="list-style-type: none"> <li>It displays load and trip status, which are in use, on the LED window.</li> </ul>    | <ul style="list-style-type: none"> <li>It displays load and trip status, which are in use, on the LED window.</li> </ul>   |
|                     | <ul style="list-style-type: none"> <li>A user can check battery replacement time by pressing the keypad with the battery symbol.</li> </ul>   | <ul style="list-style-type: none"> <li>A user can check battery replacement time on the LED window.</li> </ul>   |  |   |

※ A battery is consumable. 6 years of use is guaranteed under normal working conditions.

※ Even if the battery is discharged, the trip function of the ETU operates.

## Model Selection Table

### Trip Unit – Basic (N Type)

#### Protection

##### Overload : Long Time Protection Fixed Time Delay ( $I_{rd}$ )

It protects the system from overload through fixed operation time and adjustable setting range.

##### Short Circuit : Short time Protection Fixed Time Delay ( $I_{sd}$ )

It protects the system from short-circuit accidents through fixed operation time and adjustable setting range.

##### Short Circuit : Instantaneous Protection ( $I_i$ )

It protects the system from short-circuit accidents with a fixed setting range.

##### Neutral Wire : Neutral Protection ( $I_{in}$ )


- A 3-phase circuit breaker does not protect a neutral wire.
  - In a 4-phase circuit breaker, a setting range is set with a regulating device (dial) to protect the neutral wire.
    - OFF : It does not protect a neutral wire.
    - 0.5 ①) : It protects a neutral wire at 0.5  $I_r$  (x in).
    - 1 : It protects a neutral wire at 1  $I_r$  (x in).
    - 1.6 : It protects a neutral wire at 1.6  $I_r$  (x in).
- However, when it exceeds 0.63 A (rated current) in the setting range, a neutral wire is protected at 1  $I_r$  (x in).

※ ①) It is set to 16 A or higher.

#### Display

##### Status LED

- RUN LED : It informs the operation status of a circuit breaker.
- Trip LED : It turns on when a circuit breaker operates.
- Alarm LED : It turns off at  $I > 0.9 \times I_r$  and turns on at  $I > 1.1 \times I_r$ .
- Battery Check : It checks battery replacement time by pressing the N-Type Battery Check button.
  - Usable : 3 LED lamps turn on.
  - Replacement Time : One Alarm LED turns on.

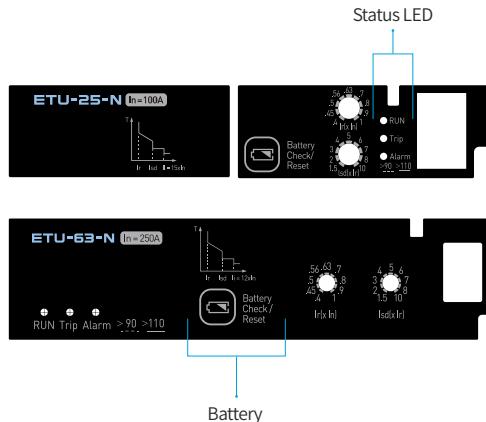

#### Protection Setting Range

##### N Type

|   |   | L Long-Time Protection     |                     |                  |                   |             |     |      |      |     |     |     |   |    |
|---|---|----------------------------|---------------------|------------------|-------------------|-------------|-----|------|------|-----|-----|-----|---|----|
|   |   | Pick-up [A]                | $I_r = I_n x$       | Dial Setting     | 0.4               | 0.45        | 0.5 | 0.56 | 0.63 | 0.7 | 0.8 | 0.9 | 1 |    |
| t | I | Time Delay [s]             | Accuracy $\pm 20\%$ | tr =             | 1.5 $\times I_r$  | 378         |     |      |      |     |     |     |   |    |
|   |   |                            |                     |                  | 6 $\times I_r$    | 16          |     |      |      |     |     |     |   |    |
|   |   |                            |                     |                  | 7.2 $\times I_r$  | 11          |     |      |      |     |     |     |   |    |
|   |   | Thermal Memory             |                     |                  | 20 minutes        |             |     |      |      |     |     |     |   |    |
|   |   | S Short-Time Protection    |                     |                  |                   |             |     |      |      |     |     |     |   |    |
|   |   | Pick-up [A]                | Accuracy $\pm 15\%$ | $I_{sd} = I_r x$ | dial setting      | 1.5         | 2   | 3    | 4    | 5   | 6   | 7   | 8 | 10 |
|   |   | Time Delay [s]             |                     | tsd =            | Fixed             |             |     |      |      |     |     |     |   |    |
|   |   |                            |                     |                  | Non Tripping Time | 0.08        |     |      |      |     |     |     |   |    |
|   |   |                            |                     |                  | Max Time          | 0.14        |     |      |      |     |     |     |   |    |
|   |   | I Instantaneous Protection |                     |                  |                   |             |     |      |      |     |     |     |   |    |
|   |   | Pick-up [A]                | Accuracy $\pm 15\%$ | $I_i =$          | $I_n = 40 A$      | 600         |     |      |      |     |     |     |   |    |
|   |   |                            |                     |                  | $I_n = 100 A$     | 1,500       |     |      |      |     |     |     |   |    |
|   |   |                            |                     |                  | $I_n = 160 A$     | 2,400       |     |      |      |     |     |     |   |    |
|   |   |                            |                     |                  | $I_n = 250 A$     | 3,000       |     |      |      |     |     |     |   |    |
|   |   |                            |                     |                  | $I_n = 400 A$     | 4,800       |     |      |      |     |     |     |   |    |
|   |   |                            |                     |                  | $I_n = 630 A$     | 6,900       |     |      |      |     |     |     |   |    |
|   |   |                            |                     |                  | $I_n = 800 A$     | 8,800       |     |      |      |     |     |     |   |    |
|   |   | Time Delay [s]             |                     |                  | Maximum Time      | $\leq 0.05$ |     |      |      |     |     |     |   |    |
|   |   | IN Neutral Protection      |                     |                  |                   |             |     |      |      |     |     |     |   |    |
|   |   | Pick-up                    | $IN = I_r x$        |                  | OFF               | 0.5         | 1   | 1.6  |      |     |     |     |   |    |

## Trip Unit – D/A/E Type

### Protection

#### Overload : Long time Protection (I<sub>r</sub>)

It protects the system from overload through an adjustable setting range and an operational time range.

#### Short Circuit : Short time Protection (I<sub>sd</sub>)

It protects the system from short-circuit accidents through an adjustable setting range and an operational time range.

#### Short Circuit : Instantaneous Protection (I<sub>i</sub>)

It protects the system from short-circuit accidents with an adjustable setting range.

#### Grounding : Ground Fault Protection (I<sub>g</sub>)

It protects the system with an adjustable setting range and an operation time range. To find grounding, the residual current is detected in a circuit.

#### Neutral Wire : Neutral Protection (I<sub>n</sub>)

- A 3-phase circuit breaker does not protect a neutral wire.
  - In a 4-phase circuit breaker, a setting range is set with a regulating device (dial) to protect the neutral wire.
    - OFF : It does not protect a neutral wire.
    - 0.5 <sup>1)</sup> : It protects a neutral wire at 0.5 I<sub>r</sub> (x in).
    - 1 : It protects a neutral wire at 1 I<sub>r</sub> (x in).
    - 1.6 : It protects a neutral wire at 1.6 I<sub>r</sub> (x in).
- However, when it exceeds 0.63 A (rated current) in the setting range, a neutral wire is protected at 1 I<sub>r</sub> (x in).

※ 1) It is set to 16 A or higher.

### Protection Setting Range

#### D/A/E Type

| L Long-Time Protection     |   |   |   |      |      |      |      |     |     |     |                       |  |  |
|----------------------------|---|---|---|------|------|------|------|-----|-----|-----|-----------------------|--|--|
| t                          | I <sub>r</sub> = I <sub>n</sub> x                   | Dial Setting<br>Button Setting            | 0.4   | 0.45 | 0.5  | 0.56 | 0.63 | 0.7 | 0.8 | 0.9 | 1                     |  |  |
|                            |   |   | Correction in 1 A increments. Max correction value = Dial Setting |      |      |      |      |     |     |     |                       |  |  |
|                            |   | Time Delay [s]<br>Accuracy ±20 %          | tr =  | 0.5  | 1    | 2    | 4    | 6   | 8   | 16  |                       |  |  |
|                            |   | 1.5 × I <sub>r</sub>                      |   | 11.8 | 23.7 | 47.3 | 94.7 | 142 | 189 | 378 |                       |  |  |
|                            |   | 6 × I <sub>r</sub>                        |   | 0.5  | 1    | 2    | 4    | 6   | 8   | 16  |                       |  |  |
|                            |   | 7.2 × I <sub>r</sub>                      |   | 345  | 690  | 1.38 | 2.76 | 4.2 | 5.5 | 11  |                       |  |  |
| Thermal Memory             |   |   |   |      |      |      |      |     |     |     |                       |  |  |
| 20 minutes                 |   |   |   |      |      |      |      |     |     |     |                       |  |  |
| S Short-Time Protection    |   |   |   |      |      |      |      |     |     |     |                       |  |  |
| P                          | I <sub>sd</sub> = I <sub>r</sub> x<br>Accuracy ±15% | Dial Setting<br>Button Setting            | 1.5   | 2    | 3    | 4    | 5    | 6   | 7   | 8   | 10                    |  |  |
|                            |   |   | I <sup>2</sup> OFF  | 0.1  | 0.2  | 0.3  | 0.4  |     |     |     |                       |  |  |
| T                          | tsd =   | I <sup>2</sup> ON                         | 0.1   | 0.2  | 0.3  | 0.4  |      |     |     |     |                       |  |  |
|                            |   |   | Non Tripping Time   | 0.08 | 0.14 | 0.23 | 0.35 |     |     |     |                       |  |  |
|                            |   | Max Time                                  | 0.14  | 0.2  | 0.32 | 0.5  |      |     |     |     |                       |  |  |
| I Instantaneous Protection |   |   |   |      |      |      |      |     |     |     |                       |  |  |
| P                          | I <sub>i</sub> = I <sub>n</sub> x<br>Accuracy ±15%  | I <sub>n</sub> = 40 A,<br>100 A,<br>160 A | 1.5   | 2    | 4    | 6    | 8    | 10  | 11  | 12  | 13                    |  |  |
|                            |   |   | I <sub>n</sub> ≥ 250 A  | 1.5  | 2    | 4    | 6    | 8   | 10  | 11  |                       |  |  |
| Time Delay [s]             |   |   |   |      |      |      |      |     |     |     |                       |  |  |
| Maximum Time ≤ 0.05        |   |   |   |      |      |      |      |     |     |     |                       |  |  |
| In Neutral Protection      |   |   |   |      |      |      |      |     |     |     |                       |  |  |
| Pick-up                    | IN = I <sub>r</sub> x                               |   | OFF   | 0.5  | 1    | 1.6  |      |     |     |     |                       |  |  |
| G Ground-Fault Protection  |   |   |   |      |      |      |      |     |     |     |                       |  |  |
| P                          | I <sub>g</sub> = I <sub>n</sub> x<br>Accuracy ±15%  | Button Setting                            | 0.2   | 0.3  | 0.4  | 0.5  | 0.6  | 0.7 | 0.8 | 1   | OFF                   |  |  |
|                            |   |   | I <sup>2</sup> OFF  | 0.4  | 0.5  | 0.6  | 0.7  | 0.8 | 1   | OFF | I <sub>n</sub> = 40 A |  |  |
| T                          | tsd =   | I <sup>2</sup> ON                         | 0.1   | 0.2  | 0.3  | 0.4  |      |     |     |     |                       |  |  |
|                            |   |   | Non Tripping Time   | 0.08 | 0.14 | 0.23 | 0.35 |     |     |     |                       |  |  |
|                            |   | Max Time                                  | 0.14  | 0.20 | 0.32 | 0.5  |      |     |     |     |                       |  |  |


### Display

#### Status LED

- RUN LED : It informs the operation status of a circuit breaker.
- Trip LED : It turns on when a circuit breaker operates.
- Alarm LED : It turns off at  $I > 0.9 \times I_r$  and turns on at  $I > 1.1 \times I_r$ .


#### Button

- It moves around the screens on the display and sets the trip units.
- There are 4 buttons: Up, Down, Menu/Reset, and Enter

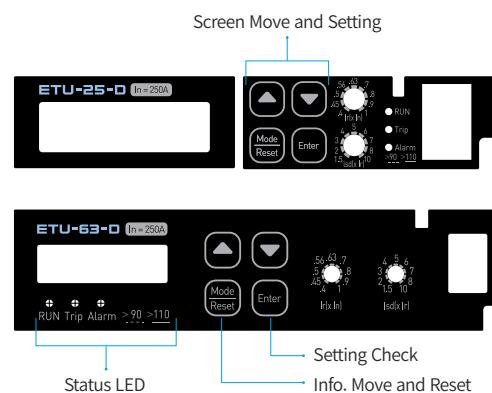

## Technical Data (ETU)

### Circuit Diagram

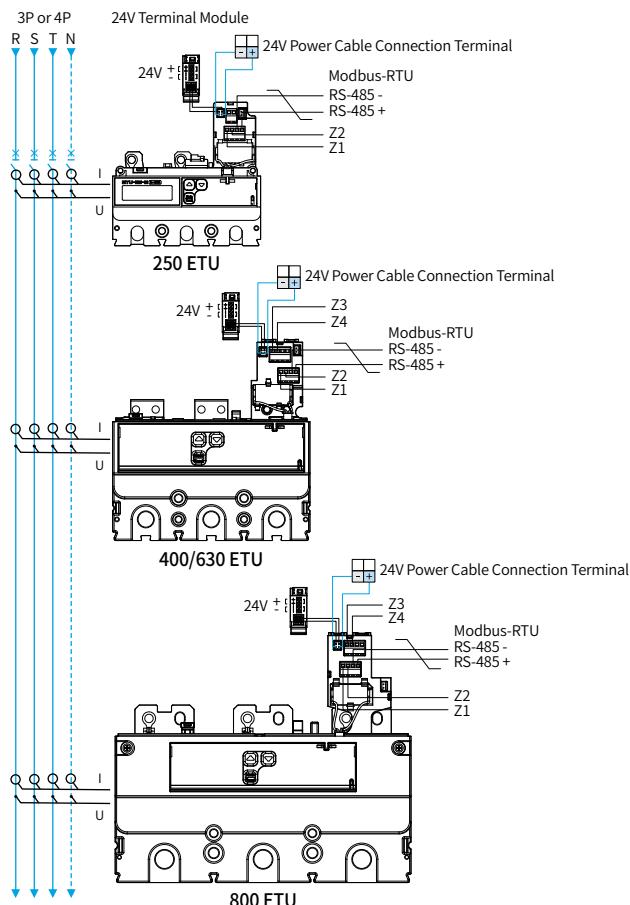

ETU A/E

**Power**  
-(Black), +(Red) : 24 V DC Power Supply

A/E

**ZSI (Zone Selective Interlocking)**  
Z1 : ZSI OUT 0  
Z2 : ZSI OUT 1  
Z3 : ZSI IN 0  
Z4 : ZSI IN 1

E

**Voltage Measurement**

### Internal Options Related to HGP Electronic Type

| Type                              | Image | Features  | Type                      | Image | Features  |
|-----------------------------------|-------|---|---------------------------|-------|---|
| FAL<br>250 AF<br>630 AF<br>800 AF |       | Transmits a fault signal of ETU Indicator Fault Alarm LED   | DC 24 V<br>Terminal Block |       | ETU Trip Unit<br>The options for the connection of "A" and "E" type to the external power source<br>Easy to connect a power cable between the products<br>※ The same purpose as DC 24 V power cable |
| DC 24 V<br>Power<br>Cable         |       | ETU Trip Unit<br>The options for the connection of "A" and "E" type to the external power source (DC 24 V)<br>- 1.5 m | DC 3.6 V<br>Battery       |       | A replaceable battery is necessary for the function of saving the ETU time and accidents.<br>- 10 EA vinyl packing  |

### External Options Related to HGP Electronic Type

| Type     | Image | Features   |
|----------|-------|--|
| Test Kit |       | The external options used to test and set an electronic product. |

## Trip Unit – D/A/E Type


### Display

It displays the setting info. of a trip unit and key measured values on the LCD window.

- D/A Type : Current
- E Type : Current, voltage, and energy

When it is connected with an external power source, it becomes possible to check a trip unit info. and set it even with the MCCB (molded case circuit breaker) open. The following functions activate when it is connected to an external power source.

- Connects with a communication system
- Displays trip info.

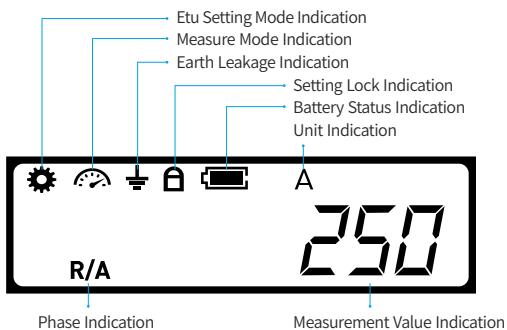


### Test Terminal

For its maintenance, ETU has a test terminal at the front. When the test terminal is connected to the ETU test kit, it is possible to set the ETU and simulate a trip operation.

### Test Kit Composition

- A dedicated adapter (AC 100 ~ 220 V 50/60 Hz)
- A dedicated cable to connect the ETU test terminal
- A user manual

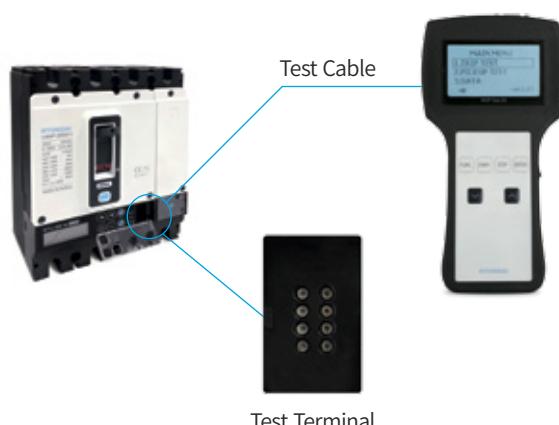

### Metering

#### Metering

The trip unit types (D, A, and E) display each phase and current to a neutral wire in RMS. A user can check information in each phase displayed with the Up and Down button.

The A type measures current and the E type provides information of voltage, power, and energy through a display device and communication.

### Power Quality

The E type displays total harmonic distortion (THD) of load current and voltage, and 15th order harmonic waves. The relevant information is sent to a PC or a monitor through MODBUS communication.


### Alarm Contact (FAL)

As an additional option, an alarm switch can be constructed only for ETU operations not connected with the MCCB trip alarm switch.


### FAL Output Characteristics

Static Outputs : AC 100 ~ 220 V, 64 mA max

### FAL Structure and Terminal

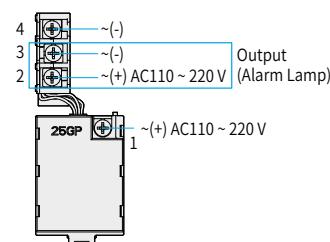

### FAL Circuit Diagram




※ A lamp is not provided.

## Technical Data (ETU)

### Operation and Setting – ETU LCD

The ETU LCD provides a user with information of load status and relay settings.

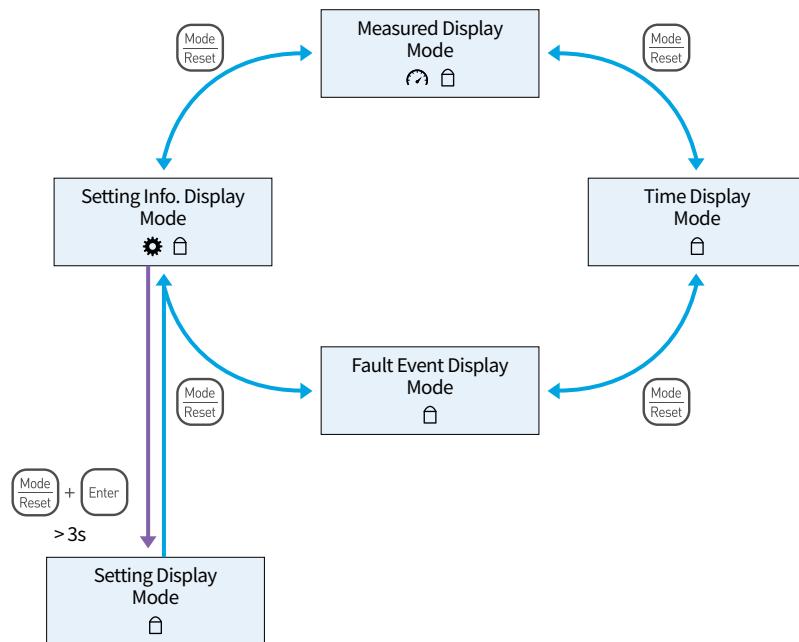

It displays current metering on the default screen.

A user can move to the metering screen to display with the buttons.

In case there is information on phases in the metering screen, it turns sequentially (phase after phase) every 3 seconds.

With the button, a user can move around the screens (Current, Voltage, Power, and Energy).

### Metering Display

| Model | Mode | Order  | Description    |
|-------|------|--|----------------|
| D/A/E | 1    | Instantaneous Current I1                           | R/A <b>250</b> |
|       | 2    | Instantaneous Current I2                           | S/B <b>250</b> |
|       | 3    | Instantaneous Current I3                           | T/C <b>250</b> |
|       | 4    | Instantaneous Neutral Current IN (4P or with ENCT) | N <b>0</b>     |
|       | 5    | Instantaneous Ground Current Ig                    | A <b>20</b>    |

| Model | Mode | Order                      | Description        |
|-------|------|----------------------------|--------------------|
| E     | 6    | Phase to Phase Voltage U12 | R/A S/B <b>380</b> |
|       | 7    | Phase to Phase Voltage U23 | S/B T/C <b>380</b> |
|       | 8    | Phase to Phase Voltage U31 | R/A T/C <b>380</b> |
|       | 9    | Phase to Phase Voltage V1N | R/A <b>220</b>     |
|       | 10   | Phase to Phase Voltage V2N | S/B <b>220</b>     |

## Metering Display

| Model | Mode | Order | Description                |                     | Model | Mode | Order | Description                            |                      |
|-------|------|-------|----------------------------|---------------------|-------|------|-------|--|----------------------|
| E     |      | 11    | Phase to Phase Voltage V3N | V<br>T/C            | E     |      | 15    | Active Energy Ep (readout and reset)   | k Wh<br>R/A S/B T/C  |
|       |      | 12    | Total Active Power Ptot    | k W<br>R/A S/B T/C  |       |      | 16    | Reactive Energy Eq (readout and reset) | kVArh<br>R/A S/B T/C |
|       |      | 13    | Total Reactive Power Qtot  | kVAR<br>R/A S/B T/C |       |      | 17    | Apparent Energy Es (readout and reset) | kVA h<br>R/A S/B T/C |
|       |      | 14    | Total Apparent Power Stot  | kVA<br>R/A S/B T/C  |       |      |       |  |                      |

## Setting Information Display

A user can check the relay settings on the default display screen with the button.

A user moves around the setting screens with the button.

| Model | Mode | Order | Description   |                       | Model | Mode | Order | Description  |                        |
|-------|------|-------|---|-----------------------|-------|------|-------|--|------------------------|
| D/A/E |      | 1     | Ir Long Time Protection Pickup Value  | A<br>Ir= R/A S/B T/C  | D/A/E |      | 7     | li Instantaneous Protection Pickup Value (N phase is display when it is 4P or with ENCT.)                    | A<br>R/A S/B T/C       |
|       |      | 2     | Ir Long Time Protection Neutral Pickup Value (4P or with ENCT)  | A<br>Ir= N            |       |      | 8     | Ig Ground Fault Protection Pickup Value  | A<br>Ig= N R/A S/B T/C |
|       |      | 3     | tr Long Time Protection Time Delay @ 6 Ir   | s<br>Tr=              |       |      | 9     | tg Ground Fault Protection Time Delay Value - ON : I <sup>2</sup> t Active - OFF : I <sup>2</sup> t Reactive | s<br>Tg=               |
|       |      | 4     | Isd Short Time Protection Pickup Value  | A<br>Isd= R/A S/B T/C |       |      | 10    | Communication Address : 1~250  | A                      |
|       |      | 5     | Isd Short Time Protection Neutral Pickup Value (4P or with ENCT)                                      | A<br>Isd= N           |       |      | 11    | Communication Baud Rate b 9.6 : 9600 bps b 19.2 : 19200 bps b 38.4 : 38400 bps                               | A                      |
|       |      | 6     | tsd Short Time Protection Time Delay - ON : I <sup>2</sup> t Active - OFF : I <sup>2</sup> t Reactive | s<br>Tsd=             |       |      |       |  |                        |

## Technical Data (ETU)

### Operation and Setting – ETU LCD

#### Setting Information Display

| Model | Mode | Order | Description                              |
|-------|------|-------|--|
| D/A/E |      | 12    | <p>Thermal ON/OFF<br/>  ON/OFF Check</p> |

#### Setting Change Screen

To change the ETU settings, keep pressing the two buttons + for more than 3 seconds and the Lock symbol disappears. Then a user can change the settings. When no entry has been made for 10 seconds or the button is pressed, the Lock symbol is displayed automatically. A user moves around the setting screens with the buttons. (Mode :

#### 1. Relay Setting

|     |                              |  |  |
|-----|------------------------------|--|--|
| 1   | Ir Setting Screen<br>        | +  > 3 Seconds Hold<br>The Lock Symbol Disappears.   |  |
| 1.1 | The Lock Symbol Not Seen<br> | Flashing + The State of Changing The Settings  |  |
| 1.2 | Ir Setting<br>               | Setting The Current Value a User Wants<br>Step 1 A Fine Adjustment and Dial Adjustment (~ Max Dial Settings) |  |
| 1.3 | Saving Ir Settings<br>       | Saving The Settings  |  |
| 2   | tr Setting Screen<br>        | Move<br><br>Flashing + The State of Changing The Settings  |  |
| 2.1 | tr Setting and Saving<br>    | Setting the desired trip time. : 0.5 ~ 16<br><br>Saving The Settings   |  |
| 3   | Isd Setting Screen Move<br>  | Move   |  |

## Setting Change Screen

### 1. Relay Setting

|     |                            |   |                         |
|-----|----------------------------|---|-------------------------|
| 3.1 | Isd Setting Screen<br>     | <br>Pickup Range Dial Setting : 1.5 ~ 10  | <br>Isd=<br>R/A S/B T/C |
| 4   | tsd Setting Screen<br>     | <br>Move<br>Flashing + The State of Changing The Settings   | <br>Tsd=<br>OFF         |
| 4.1 | tsd Setting and Saving<br> | <br>Time Delay Setting - OFF.1 : $I^2t$ OFF 0.1 s<br>- On.4 : $I^2t$ ON 0.4 s<br><br><br>Saving The Settings                | <br>Tsd=<br>0.4 s       |
| 5   | lg Setting<br>             | <br>Move<br><br><br>Flashing + The State of Changing The Settings   | <br>lg=<br>0.2          |
| 5.1 | lg Setting and Saving<br>  | <br>Pickup Range : 0.2 ~ $1 \times In$<br><br><br>Saving The Settings   | <br>lg=<br>0.2          |
| 6   | tg Setting<br>             | <br>Move<br><br><br>Flashing + The State of Changing The Settings   | <br>tg=<br>OFF          |
| 6.1 | tg Setting and Saving<br>  | <br>Time Delay Setting : 0.1 ~ 0.4<br>- OFF.1 : $I^2t$ OFF 0.1 s<br>- On.4 : $I^2t$ ON 0.4 s<br><br><br>Saving The Settings | <br>tg=<br>0.4 s        |
| 7   | li Setting<br>             | <br>Move<br><br><br>Flashing + The State of Changing The Settings   | <br>li=<br>R/A S/B T/C  |
| 7.1 | li Setting and Saving<br>  | <br>Pickup Range : 1.5 ~ $11 \times In$<br>N is displayed when it is 4P or with ENCT.<br><br><br>Saving The Settings        | <br>li=<br>R/A S/B T/C  |
| 8   | IN Setting<br>             | <br>Move<br>Setting with The Pickup Range Dial.<br>OFF - 0.5 - 1 - 1.6  | <br>IN=<br>OFF          |

## Technical Data (ETU)

### Operation and Setting – ETU LCD

#### Setting Change Screen

| 2. Communication Settings Address (A/E) |   |  |   |
|---|---|--|---|
| 9                                       | Communication Address Setting Screen<br>        |  + <br>> 3 Seconds Hold<br>The Lock Symbol Disappears.     |    |
| 9.1                                     | The Lock Symbol Disappears.<br>  | <br>Flashing + The State of Changing The Settings   |    |
| 9.2                                     | Setting<br>  | <br>Address Setting : 1 ~ 250   |    |
| 9.3                                     | Saving Settings<br>  | <br>Save  |  |
| 10                                      | Communication Baud Rate Setting Screen<br>  |  + <br>> 3 Seconds Hold<br>The Lock Symbol Disappears. |  |
| 10.1                                    | The Lock Symbol Disappears.<br>  | <br>Flashing + The State of Changing The Settings   |  |
| 10.2                                    | Setting<br>  | <br>Setting The Desired Communication Speed.<br>b 9.6 : 9600 bps<br>b 19.2 : 19200 bps<br>b 38.4 : 38400 bps                              |  |
| 10.3                                    | Saving Settings<br>  | <br>Save  |  |

## Setting Change Screen

Basically, the MCCB has thermal characteristics. The thermal functions are aimed to prevent a fire caused by heat and a device from it by simulating the thermal energy of a bus-bar, which runs at a regular phase.

When a user wants to deactivate the functions in a certain situation, he or she can do so by setting on the setting screen as follows.

### 3. Thermal On/Off (A/E)

|      |                            |   |  |
|------|----------------------------|---|--|
| 11   | Thermal On/Off Screen<br>  | Move<br>Setting Display   |  |
| 11.1 | Thermal On/Off Setting<br> | Flashing + The State of Changing The Settings<br>Setting Change<br>- ON : Thermal ON<br>- OFF : Thermal OFF $I^2t$ Applying |  |
| 11.2 | Thermal On/Off Saving<br>  | Save  |  |
| 11.3 | Thermal On/Off Screen<br>  | Move The Screen   |  |

## Reset

### Energy Reset (Active, Reactive, Apparent) E Type

|   |  |   |  |
|---|--|---|--|
| 1 | Energy Metering Screen<br>               | +  >3 Seconds Hold<br>The Lock Symbol Disappears. |  |
| 2 | The Lock Symbol Disappears.<br>          | A Measured Value Flashes.                         |  |
| 3 | Energy Reset<br>                         | Energy Values Reset.                              |  |
| 6 | Return to The Energy Metering Screen<br> |   |  |

## Model Selection Table

### Motor Protection Type of Molded Case Circuit Breaker (HGP Type) : 100 ~ 800 AF

The circuit breaker for motor protection is a circuit breaker for instantaneous trip (magnetic only) equipped with instantaneous and short circuit protection functions only, it is suitable for protecting the motor by assembling it together with the overcurrent relay/ electronic connector.

#### Common Ratings

|  |   |                           |             |
|--|---|---------------------------|-------------|
| Rated Insulation Voltage, $U_i$            | 1,000 V                                 | Suitability for Isolation | Yes         |
| Rated Operational Voltage, $U_e$           | 690 V                                   | Utilization Category      | A           |
| Rated Impulse Withstand Voltage, $U_{imp}$ | 8 kV                                    | Pollution Degree          | 3           |
| Protection Function                        | Instantaneous, Short-Circuit Protection | Reference Standard        | IEC 60947-2 |

| Model Name   | HGP100   |            |            |            | HGP250   |             |             |            |
|--|--|------------|------------|------------|--|-------------|-------------|------------|
| Frame (AF)   | 100  |            |            |            | 250  |             |             |            |
| Number of Poles (P)                                  | 3  |            |            |            | 3  |             |             |            |
| Rated Current, at 40 °C (A)                          | 2.5, 3.2, 6.3, 12.5, 20, 32, 50, 63, 80, 100   |            |            |            | 125, 150, 175, 200, 225 I <sup>a</sup> " <sup>1j</sup> |             |             |            |
| Rated Short-Circuit Breaking Capacity [Icu] (kA rms) |  |            |            |            |  |             |             |            |
| Short-Circuit Breaking Category Code                 | F* <sup>1j</sup>   | S          | H          | X          | F* <sup>1j</sup>                                       | S           | H           | X          |
| AC 660/690 V   | 6  | 8          | 8          | 10         | 6  | 8           | 8           | 10         |
| <b>AC 480/500 V</b>                                  | <b>25</b>  | <b>50</b>  | <b>65</b>  | <b>100</b> | <b>25</b>  | <b>50</b>   | <b>65</b>   | <b>100</b> |
| <b>AC 440/460 V</b>                                  | <b>36</b>  | <b>65</b>  | <b>85</b>  | <b>150</b> | <b>36</b>  | <b>65</b>   | <b>85</b>   | <b>150</b> |
| AC 380/415 V   | 50   | 85         | 100        | 150        | 50   | 85          | 100         | 150        |
| AC 220/240 V   | 65   | 100        | 130        | 200        | 65   | 100         | 130         | 200        |
| Service Breaking Capacity [Ics = % Icu]              | 100  | 100        | 100        | 100        | 100  | 100         | 100         | 100        |
| Rated Short-Circuit Making Capacity [Icm] (kA peak)  |  |            |            |            |  |             |             |            |
| AC 660/690 V   | 9  | 14         | 14         | 17         | 9  | 14          | 14          | 17         |
| AC 480/500 V   | 53   | 105        | 143        | 220        | 53   | 105         | 143         | 220        |
| <b>AC 440/460 V</b>                                  | <b>76</b>  | <b>143</b> | <b>187</b> | <b>330</b> | <b>76</b>  | <b>143</b>  | <b>187</b>  | <b>330</b> |
| AC 380/415 V   | 105  | 187        | 220        | 330        | 105  | 187         | 220         | 330        |
| AC 220/240 V   | 143  | 220        | 286        | 440        | 143  | 220         | 286         | 440        |
| Endurance [times] (Durability)                       |  |            |            |            |  |             |             |            |
| Mechanical   | 25,000   |            |            |            | 25,000   |             |             |            |
| In @ 440 V   | 10,000   |            |            |            | 10,000   |             |             |            |
| Trip Device  |  |            |            |            |  |             |             |            |
| Thermal Magnetic                                     | Long Time [LTD]<br>Instantaneous [INST]  | -          | ●          |            | (6 - 7 - 8 - 9 - 10 - 11 - 12 - 13 - 14) × In          |             | ●           | -          |
|  |  |            |            |            |  |             |             |            |
| Electronic   | Long Time [LTD]<br>Short Time [STD]<br>Instantaneous [INST]  | -          | -          | -          | -  | -           | -           | -          |
| Accessory  |  |            |            |            |  |             |             |            |
| Internal   | Auxiliary Switch AUX<br>Alarm Switch ALT<br>Shunt Trip SHT<br>Under-Voltage Trip UVT   | ●          | ●          | ●          | ●  | ●           | ●           | ●          |
| External   | Rotary Handle Front Contact TFG<br>Extension TFH<br>Mechanical Open/Close Device MOT<br>Mechanical Interlock MIF<br>Handle Locking Device PLD<br>Plug-in TDM (LINE/LOAD)<br>TDM (LINE Only)<br>Cage Terminal Block CTB<br>Terminal Cover TCF<br>Insulation Barrier TQQ<br>Terminal Bus Bar TBB | ●          | ●          | ●          | ● (3P Only)  | ● (3P Only) | ● (3P Only) | ●          |

| Installation and Dimensions         |  |  |  |
|-------------------------------------|--|--|--|
| Connection/ Installation            | Front Connection<br>Rear Connection<br>Plug-in | Terminal Screw, Terminal Bus Bar<br>Horizontal/Vertical Cable<br>Switchgear (Line & Load, Line Only) | Terminal Screw, Terminal Bus Bar<br>Horizontal/Vertical Cable<br>Switchgear (Line & Load, Line Only) |
| Dimension (mm)                      | a<br>b<br>c                                    | 105<br>165<br>86.5   | 105<br>165<br>86.5   |
| Weight (kg)                         | 3/4P   | 2/2.6  | 2/2.6  |
| Detailed Rating and Selection       |  | 234 Page   | 234 Page   |
| Characteristic Curve and Appearance |  | 157 / 177 Page   | 157 / 177 Page   |

\* <sup>1j</sup> F type is for overseas sales.

| HGP400                           |     |     |     | HGP630                              |     |     |     | HGP800                              |     |     |     |
|----------------------------------|-----|-----|-----|-------------------------------------|-----|-----|-----|-------------------------------------|-----|-----|-----|
| F*                               | S   | H   | X   | F*                                  | S   | H   | X   | F*                                  | S   | H   | X   |
| 400                              |     |     |     | 630                                 |     |     |     | 800                                 |     |     |     |
| 3                                |     |     |     | 3                                   |     |     |     | 3                                   |     |     |     |
| 350,400                          |     |     |     | 500,630                             |     |     |     | 700,800                             |     |     |     |
| 10                               | 10  | 20  | 35  | 10                                  | 10  | 20  | 35  | 10                                  | 10  | 20  | 35  |
| 25                               | 50  | 70  | 100 | 25                                  | 50  | 70  | 100 | 25                                  | 50  | 70  | 100 |
| 36                               | 70  | 85  | 150 | 36                                  | 70  | 85  | 150 | 36                                  | 70  | 85  | 150 |
| 50                               | 85  | 100 | 150 | 50                                  | 85  | 100 | 150 | 50                                  | 85  | 100 | 150 |
| 65                               | 100 | 130 | 200 | 65                                  | 100 | 130 | 200 | 65                                  | 100 | 130 | 200 |
| 100                              | 100 | 100 | 100 | 100                                 | 100 | 100 | 100 | 100                                 | 100 | 100 | 100 |
| 17                               | 17  | 40  | 74  | 17                                  | 17  | 40  | 74  | 17                                  | 17  | 40  | 74  |
| 53                               | 105 | 154 | 220 | 53                                  | 105 | 154 | 220 | 53                                  | 105 | 154 | 220 |
| 76                               | 154 | 187 | 330 | 76                                  | 154 | 187 | 330 | 76                                  | 154 | 187 | 330 |
| 105                              | 187 | 220 | 330 | 105                                 | 187 | 220 | 330 | 105                                 | 187 | 220 | 330 |
| 143                              | 220 | 286 | 440 | 143                                 | 220 | 286 | 440 | 143                                 | 220 | 286 | 440 |
| 20,000                           |     |     |     | 20,000                              |     |     |     | 10,000                              |     |     |     |
| 6,000                            |     |     |     | 4,000                               |     |     |     | 3,000                               |     |     |     |
| ●                                |     |     |     | ●                                   |     |     |     | ●                                   |     |     |     |
| -                                |     |     |     | -                                   |     |     |     | -                                   |     |     |     |
| (5 - 6 - 7 - 8 - 9 - 10) × In    |     |     |     | (5 - 6 - 7 - 8 - 9 - 10) × In       |     |     |     | (5 - 6 - 7 - 8 - 9 - 10) × In       |     |     |     |
| -                                |     |     |     | -                                   |     |     |     | -                                   |     |     |     |
| -                                |     |     |     | -                                   |     |     |     | -                                   |     |     |     |
| -                                |     |     |     | -                                   |     |     |     | -                                   |     |     |     |
| -                                |     |     |     | -                                   |     |     |     | -                                   |     |     |     |
| ●                                |     |     |     | ●                                   |     |     |     | ●                                   |     |     |     |
| ● (3P Only)                      |     |     |     | ● (3P Only)                         |     |     |     | ● (3P Only)                         |     |     |     |
| ● (3P Only)                      |     |     |     | ● (3P Only)                         |     |     |     | ● (3P Only)                         |     |     |     |
| ●                                |     |     |     | ●                                   |     |     |     | ●                                   |     |     |     |
| ●                                |     |     |     | ●                                   |     |     |     | ●                                   |     |     |     |
| ●                                |     |     |     | ●                                   |     |     |     | ●                                   |     |     |     |
| ●                                |     |     |     | ●                                   |     |     |     | ●                                   |     |     |     |
| ●                                |     |     |     | ●                                   |     |     |     | ●                                   |     |     |     |
| Terminal Screw, Terminal Bus Bar |     |     |     | Horizontal/Vertical Cable           |     |     |     | Terminal Screw, Terminal Bus Bar    |     |     |     |
|                                  |     |     |     |                                     |     |     |     | Horizontal/Vertical Cable           |     |     |     |
|                                  |     |     |     | Switchgear (Line & Load, Line Only) |     |     |     | Switchgear (Line & Load, Line Only) |     |     |     |
| 140                              |     |     |     | 140                                 |     |     |     | 210                                 |     |     |     |
| 260                              |     |     |     | 260                                 |     |     |     | 320                                 |     |     |     |
| 110                              |     |     |     | 110                                 |     |     |     | 135                                 |     |     |     |
| 5.4/7.2                          |     |     |     | 5.4/7.2                             |     |     |     | 15.1/19.6                           |     |     |     |
| 234 Page                         |     |     |     | 234 Page                            |     |     |     | 234 Page                            |     |     |     |
| 158 / 178 Page                   |     |     |     | 158 / 178 Page                      |     |     |     | 158 / 179 Page                      |     |     |     |

## Model Selection Table

### Trip Unit Characteristics





## Model Selection Table

### Switch Disconnectors (HGP NA Type) : 50 ~ 800 AF

Switch disconnector is a short circuit switch without protection function and as the appearance is equivalent to the circuit breaker, all accessories can be shared with the circuit breaker.

#### Common Ratings

|  |         |                           |                                   |
|--|---------|---------------------------|-----------------------------------|
| Rated Insulation Voltage, $U_i$            | 1,000 V | Suitability for Isolation | Yes                               |
| Rated Operational Voltage, $U_e$           | 690 V   | Utilization Category      | AC 22 A/AC 23 A - DC 22 A/DC 23 A |
| Rated Impulse Withstand Voltage, $U_{imp}$ | 8 kV    | Pollution Degree          | 3                                 |
|  |         | Reference Standard        | IEC 60947-3                       |

| Model Name  | HGP50DNA                     | HGP125DNA                           | HGP160DNA          |          |
|---|------------------------------|-------------------------------------|--------------------|----------|
| Frame (AF)  | 50                           | 125                                 | 160                |          |
| Number of Poles (P)                                 | 3, 4 <sup>1)</sup>           | 3, 4 <sup>1)</sup>                  | 3, 4 <sup>1)</sup> |          |
| Conventional Thermal Current, $I_{th}$ at 60 °C (A) | 50                           | 125                                 | 160                |          |
| <b>Rated Operational Current [Ie]</b>               |                              |                                     |                    |          |
| AC 690V (50/60 Hz)                                  | 50                           | 125                                 | 160                |          |
| DC 250 V (1 Pole)                                   | 50                           | 125                                 | 160                |          |
| DC 250 V (2 Pole in Series)                         | 50                           | 125                                 | 160                |          |
| Rated Short-Circuit Making Capacity [Icm] (kA Peak) | 2.1                          | 2.8                                 | 3.6                |          |
| <b>Rated Short-Time Withstand Current [Icw]</b>     |                              |                                     |                    |          |
| 1s (Arms)   | 1,800                        | 2,200                               | 2,200              |          |
| 3s (Arms)   | 1,800                        | 2,200                               | 2,200              |          |
| 20 s (Arms)   | 690                          | 960                                 | 960                |          |
| <b>Endurance [times] (Durability)</b>               |                              |                                     |                    |          |
| Mechanical  | 25,000                       | 25,000                              | 25,000             |          |
| In @ 440 V  | 10,000                       | 10,000                              | 10,000             |          |
| <b>Accessory</b>                                    |                              |                                     |                    |          |
| Internal  | Auxiliary Switch             | AUX                                 | ●                  |          |
|   | Alarm Switch                 | ALT                                 | ●                  |          |
|   | Shunt Trip                   | SHT                                 | ●                  |          |
|   | Under-Voltage Trip           | UVT                                 | ●                  |          |
| External  | Rotary Handle                | Front Contact TFG                   | ●                  |          |
|   | Extension                    | TFH                                 | ●                  |          |
|   | Mechanical Open/Close Device | MOT                                 | ●                  |          |
|   | Mechanical Interlock         | MIF                                 | ●                  |          |
|   | Handle Locking Device        | PLD                                 | ●                  |          |
|   | Plug-in                      | TDM (LINE/LOAD)                     | ● (3P Only)        |          |
|   |                              | TDM (LINE Only)                     | ● (3P Only)        |          |
|   | Cage Terminal Block          | CTB                                 | ●                  |          |
|   | Terminal Cover               | TCF                                 | ●                  |          |
|   | Insulation Barrier           | TQQ                                 | ●                  |          |
| <b>Installation and Dimensions</b>                  |                              |                                     |                    |          |
| Connection/Installation                             | Front Connection             | Terminal Screw                      |                    |          |
|   | Rear Connection              | Horizontal/Vertical Cable           |                    |          |
|   | Plug-in                      | Switchgear (Line & Load, Line Only) |                    |          |
| Dimension (mm)                                      | a (3/4P)                     | 90/120                              | 90/120             | 90/120   |
|   | b                            | 140                                 | 140                | 140      |
|   | c                            | 86                                  | 86                 | 86       |
| Weight (kg)   | 3/4P                         | 1.5/1.8                             | 1.5/1.8            | 1.5/1.8  |
| Detailed Rating and Selection                       |                              | 234 Page                            | 234 Page           | 234 Page |
| Characteristic Curve and Appearance                 |                              | 176 Page                            | 176 Page           | 176 Page |

\* 1) 4 Pole Arrangement : Basic specification of R-S-T-N

### Applicable Field of Switch – Disconnectors

- Bus bar connection and disconnection
- Disconnection of switchgear and control panel
- Switch for emergency power switchover (ATS)

| HGP250NA                            | HGP400NA                            | HGP630NA                            | HGP800NA                            |
|-------------------------------------|-------------------------------------|-------------------------------------|-------------------------------------|
| 250                                 | 400                                 | 630                                 | 800                                 |
| 3,4 <sup>1)</sup>                   | 3,4 <sup>1)</sup>                   | 3,4 <sup>1)</sup>                   | 3,4 <sup>1)</sup>                   |
| 250                                 | 400                                 | 630                                 | 800                                 |
| 250                                 | 400                                 | 630                                 | 800                                 |
| 250                                 | 400                                 | 630                                 | 800                                 |
| 250                                 | 400                                 | 630                                 | 800                                 |
| 4.9                                 | 7.1                                 | 8.5                                 | 12                                  |
| 3,500                               | 5,000                               | 6,300                               | 8,000                               |
| 3,500                               | 5,000                               | 6,300                               | 8,000                               |
| 1,350                               | 1,920                               | 2,320                               | 2,560                               |
| 25,000                              | 20,000                              | 20,000                              | 10,000                              |
| 10,000                              | 6,000                               | 4,000                               | 3,000                               |
| ●                                   | ●                                   | ●                                   | ●                                   |
| ●                                   | ●                                   | ●                                   | ●                                   |
| ●                                   | ●                                   | ●                                   | ●                                   |
| ●                                   | ●                                   | ●                                   | ●                                   |
| ●                                   | ●                                   | ●                                   | ●                                   |
| ●                                   | ●                                   | ●                                   | ●                                   |
| ●                                   | ●                                   | ●                                   | ●                                   |
| ●                                   | ●                                   | ●                                   | ●                                   |
| ●                                   | ●                                   | ●                                   | ●                                   |
| ● (3P Only)                         | ● (3P Only)                         | ● (3P Only)                         | ● (3P Only)                         |
| ● (3P Only)                         | ● (3P Only)                         | ● (3P Only)                         | ● (3P Only)                         |
| ●                                   | ●                                   | ●                                   | ●                                   |
| ●                                   | ●                                   | ●                                   | ●                                   |
| ●                                   | ●                                   | ●                                   | ●                                   |
| ●                                   | ●                                   | ●                                   | ●                                   |
| Terminal Screw                      | Terminal Screw                      | Terminal Screw                      | Terminal Screw                      |
| Horizontal/Vertical Cable           | Horizontal/Vertical Cable           | Horizontal/Vertical Cable           | Horizontal/Vertical Cable           |
| Switchgear (Line & Load, Line Only) |
| 105/140                             | 140/186.5                           | 140/186.5                           | 210/280                             |
| 165                                 | 260                                 | 260                                 | 320                                 |
| 86.5                                | 110                                 | 110                                 | 135                                 |
| 2/2.6                               | 5.4/7.2                             | 5.4/7.2                             | 15.1/19.6                           |
| 234 Page                            | 234 Page                            | 234 Page                            | 234 Page                            |
| 177 Page                            | 178 Page                            | 178 Page                            | 179 Page                            |

## Model Selection Table

### Molded Case Circuit Breaker (HGP DC Type)

#### Common Ratings

|  |   |                           |     |
|--|---|---------------------------|-----|
| Rated Insulation Voltage, $U_i$            | 1,000 V   | Suitability for Isolation | Yes |
| Rated Impulse Withstand Voltage, $U_{imp}$ | 8 kV  | Utilization Category      | A   |
| Protection Function                        | Overload, Instantaneous, Short-Circuit Protection | Pollution Degree          | 3   |

| Model Name   |                              | HGP100              |                                      |                                  |     | HGP160             |                                       |                                  |     |
|--|------------------------------|---------------------|--------------------------------------|----------------------------------|-----|--------------------|---------------------------------------|----------------------------------|-----|
| Frame  | (AF)                         | 100                 |                                      |                                  |     | 160                |                                       |                                  |     |
| Number of Poles  | (P)                          | 3, 4 <sup>1)</sup>  |                                      |                                  |     | 3, 4 <sup>1)</sup> |                                       |                                  |     |
| Rated Current, at 40 °C  | (A)                          | 40, 50, 63, 80, 100 |                                      |                                  |     | 100, 125, 150, 160 |                                       |                                  |     |
| <b>Rated Ultimate Short-Circuit Breaking Capacity [Icu] (kA rms)</b> |                              |                     |                                      |                                  |     |                    |                                       |                                  |     |
| Short-Circuit Breaking Category Code                                 |                              | F                   | S                                    | H                                | X   | F                  | S                                     | H                                | X   |
| DC 750 V for 3P  |                              | 10                  | 55                                   | 85                               | 100 | 10                 | 55                                    | 85                               | 100 |
| DC 1,000 V for 4P  |                              | 10                  | 55                                   | 85                               | 100 | 10                 | 55                                    | 85                               | 100 |
| Service Breaking Capacity [ $I_{cs} = \% I_{cu}$ ]                   |                              | 100                 | 100                                  | 100                              | 100 | 100                | 100                                   | 100                              | 100 |
| <b>Trip Device</b>   |                              |                     |                                      |                                  |     |                    |                                       |                                  |     |
| Thermal Magnetic   | Long Time [LTD]              |                     | $(0.7 - 0.8 - 0.9 - 1.0) \times I_n$ |                                  |     |                    | $(0.7 - 0.8 - 0.9 - 1.0) \times I_n$  |                                  |     |
|  | Instantaneous [INST]         |                     | $10 \times I_n$                      |                                  |     |                    | $(5 - 6 - 7 - 8 - 9 - 10) \times I_n$ |                                  |     |
| <b>Accessory</b>   |                              |                     |                                      |                                  |     |                    |                                       |                                  |     |
| Internal   | Auxiliary Switch             |                     | AUX                                  | ●                                |     |                    | ●                                     |                                  |     |
|  | Alarm Switch                 |                     | ALT                                  | ●                                |     |                    | ●                                     |                                  |     |
|  | Shunt Trip                   |                     | SHT                                  | ●                                |     |                    | ●                                     |                                  |     |
|  | Under-Voltage Trip           |                     | UVT                                  | ●                                |     |                    | ●                                     |                                  |     |
| External   | Rotary Handle                | Front Contact       | TFG                                  | ●                                |     |                    | ●                                     |                                  |     |
|  |                              | Extension           | TFH                                  | ●                                |     |                    | ●                                     |                                  |     |
|  | Mechanical Open/Close Device |                     | MOT                                  | ●                                |     |                    | ●                                     |                                  |     |
|  | Mechanical Interlock         |                     | MIF                                  | ●                                |     |                    | ●                                     |                                  |     |
|  | Handle Locking Device        |                     | PLD                                  | ●                                |     |                    | ●                                     |                                  |     |
|  | Cage Terminal Block          |                     | CTB                                  | ●                                |     |                    | ●                                     |                                  |     |
|  | Terminal Cover <sup>2)</sup> |                     | TCF                                  | ●                                |     |                    | ●                                     |                                  |     |
|  | Insulation Barrier           |                     | TQQ                                  | ●                                |     |                    | ●                                     |                                  |     |
|  | Terminal Bus Bar             |                     | TBB                                  | ●                                |     |                    | ●                                     |                                  |     |
|  | Series Busbar                |                     | SBB                                  | ●                                |     |                    | ●                                     |                                  |     |
| <b>Installation and Dimensions</b>                                   |                              |                     |                                      |                                  |     |                    |                                       |                                  |     |
| Dimension (mm)   | Connection/Installation      |                     | Front Connection                     | Terminal Screw, Terminal Bus Bar |     |                    |                                       | Terminal Screw, Terminal Bus Bar |     |
|  | a (3/4P)                     |                     |                                      | 105/140                          |     |                    |                                       | 105/140                          |     |
|  | b                            |                     |                                      | 165                              |     |                    |                                       | 165                              |     |
| Certificates   | c                            |                     |                                      | 86.5                             |     |                    |                                       | 86.5                             |     |
| Certificates   | CB:DEKRA                     |                     |                                      | ●                                |     |                    |                                       | ●                                |     |

※ 1) 4 Pole Arrangement : Basic specification of R-S-T-N

2) DC product has only 4P



## Technical Data (HGP DC Type)

### Installation


#### Precautions for Use

Please keep in mind the following installation conditions when applying the product to a solar power system. Otherwise, it could lead to damage to the product and the system.

### Circuit Diagram

Referring to the contact circuit diagram below, connect the adjacent poles in series.

In the case where a 3P product is used for a 2P product, connect it skipping the phase(s) in the middle.

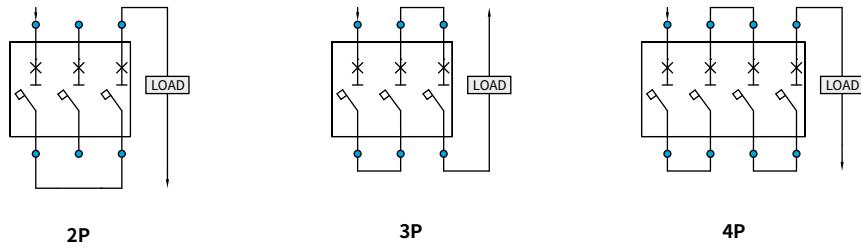

### Connection

In wiring the circuit, a wire must be at least as long as 60 cm.

If it is shorter than that, it can produce excessive heat.

When using the busbar, operate it referring to the Rated Current Derating Table on the right.

When using a self-produced busbar, please keep it to the dimension on page 229 ~ 230. And it is recommended to plate it (busbar) with silver or tin. (A busbar and a heat sink are optional. You need to make an additional order if you want it.) (SBB 25/63/80 GP)

### Insulation

Please insert a barrier between the phases after connecting a busbar or a cable if they do not use the same phase.

### External Environment

In the case that the internal temperature of the panel is above 40 °C, derate the temperature, referring to the Rated Current Derating Table on the right.

## Technical Data

### Environmental Operating Conditions

#### Temperature Derating


The overcurrent characteristic of MCCB has been set to the ambient temperature of 40 °C. If the ambient temperature is less or more than 40 °C, the overcurrent characteristics may differ.

#### If the Ambient Temperature is less than 40 °C

In order to ensure that the circuit breaker's overcurrent meet the derating curve at the given ambient temperature, the real current ( $I_r$ ) has to be adjusted. The temperature correction ratio or each MCCB is shown in the circuit breaker's characteristics curve.

#### If the Ambient Temperature is more than 40 °C

As the internal temperature of MCCB is a sum of increased temperature due to current flow and the ambient temperature, if the ambient temperature exceeds 40 °C, thermal damage of internal insulation material of MCCB may occur causing the circuit breaker to trip at an early stage. When applying ambient temperature higher than 40 °C, the rated current must be adjusted as shown in the following rated current correction table.

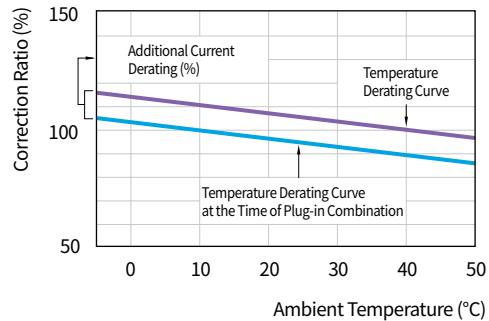

$I_n$  (Rated Current) :

Circuit breaker's rating at ambient temperature of 40 °C

$I_r$  (Real Current) :

Circuit breaker's rating at the given temperature


$$I_r = \text{Correction Ratio (\%)} \times I_n$$

Rated Current Derating Table : HGP DC Type/Standard Mounting (Fixed Type)


| Model                      | Rated Current<br>(A <sub>c</sub> ) | Ambient Temperature (°C) |     |     |     |     |     |     |     |     | Connection |                              |
|----------------------------|------------------------------------|--------------------------|-----|-----|-----|-----|-----|-----|-----|-----|------------|------------------------------|
|                            |                                    | 10                       | 20  | 30  | 40  | 45  | 50  | 55  | 60  | 65  |            |                              |
| HGP100<br>HGP160<br>HGP250 | 40                                 | 46                       | 44  | 42  | 40  | 39  | 38  | 37  | 36  | 35  | 34         | HGP250<br>Busbar             |
|                            | 50                                 | 58                       | 55  | 53  | 50  | 49  | 48  | 46  | 45  | 44  | 43         |                              |
|                            | 63                                 | 72                       | 69  | 66  | 63  | 61  | 60  | 58  | 57  | 55  | 54         |                              |
|                            | 80                                 | 92                       | 88  | 84  | 80  | 78  | 76  | 74  | 72  | 70  | 68         |                              |
|                            | 100                                | 115                      | 110 | 105 | 100 | 98  | 95  | 93  | 90  | 88  | 85         |                              |
|                            | 125                                | 144                      | 138 | 131 | 125 | 122 | 119 | 116 | 113 | 109 | 106        |                              |
|                            | 150                                | 173                      | 165 | 158 | 150 | 146 | 143 | 139 | 135 | 131 | 128        |                              |
|                            | 160                                | 184                      | 176 | 168 | 160 | 156 | 152 | 148 | 144 | 140 | 136        |                              |
|                            | 175                                | 201                      | 193 | 184 | 175 | 171 | 166 | 162 | 158 | 153 | 149        |                              |
|                            | 200                                | 230                      | 220 | 210 | 200 | 195 | 190 | 185 | 180 | 175 | 170        |                              |
| HGP400<br>HGP630           | 225                                | 259                      | 248 | 236 | 225 | 219 | 214 | 208 | 203 | 197 | 191        | HGP250<br>Busbar + Heat Sink |
|                            | 250                                | 288                      | 275 | 263 | 250 | 244 | 238 | 231 | 225 | 219 | 213        |                              |
|                            | 300                                | 323                      | 315 | 308 | 300 | 291 | 282 | 273 | 264 | 255 | 246        |                              |
|                            | 350                                | 376                      | 368 | 359 | 350 | 340 | 330 | 320 | 310 | 300 | 290        |                              |
|                            | 400                                | 430                      | 420 | 410 | 400 | 388 | 376 | 364 | 352 | 340 | 328        |                              |
| HGP800                     | 500                                | 538                      | 525 | 513 | 500 | 485 | 470 | 455 | 440 | 425 | 410        | HGP630<br>Busbar + Heat Sink |
|                            | 630                                | 677                      | 662 | 646 | 630 | 611 | 592 | 573 | 554 | 535 | 516        |                              |
|                            | 700                                | 753                      | 735 | 718 | 700 | 679 | 658 | 637 | 616 | 595 | 574        |                              |
|                            | 800                                | 860                      | 840 | 820 | 800 | 776 | 752 | 728 | 704 | 680 | 656        |                              |

## Accessory

### HGM General-Type

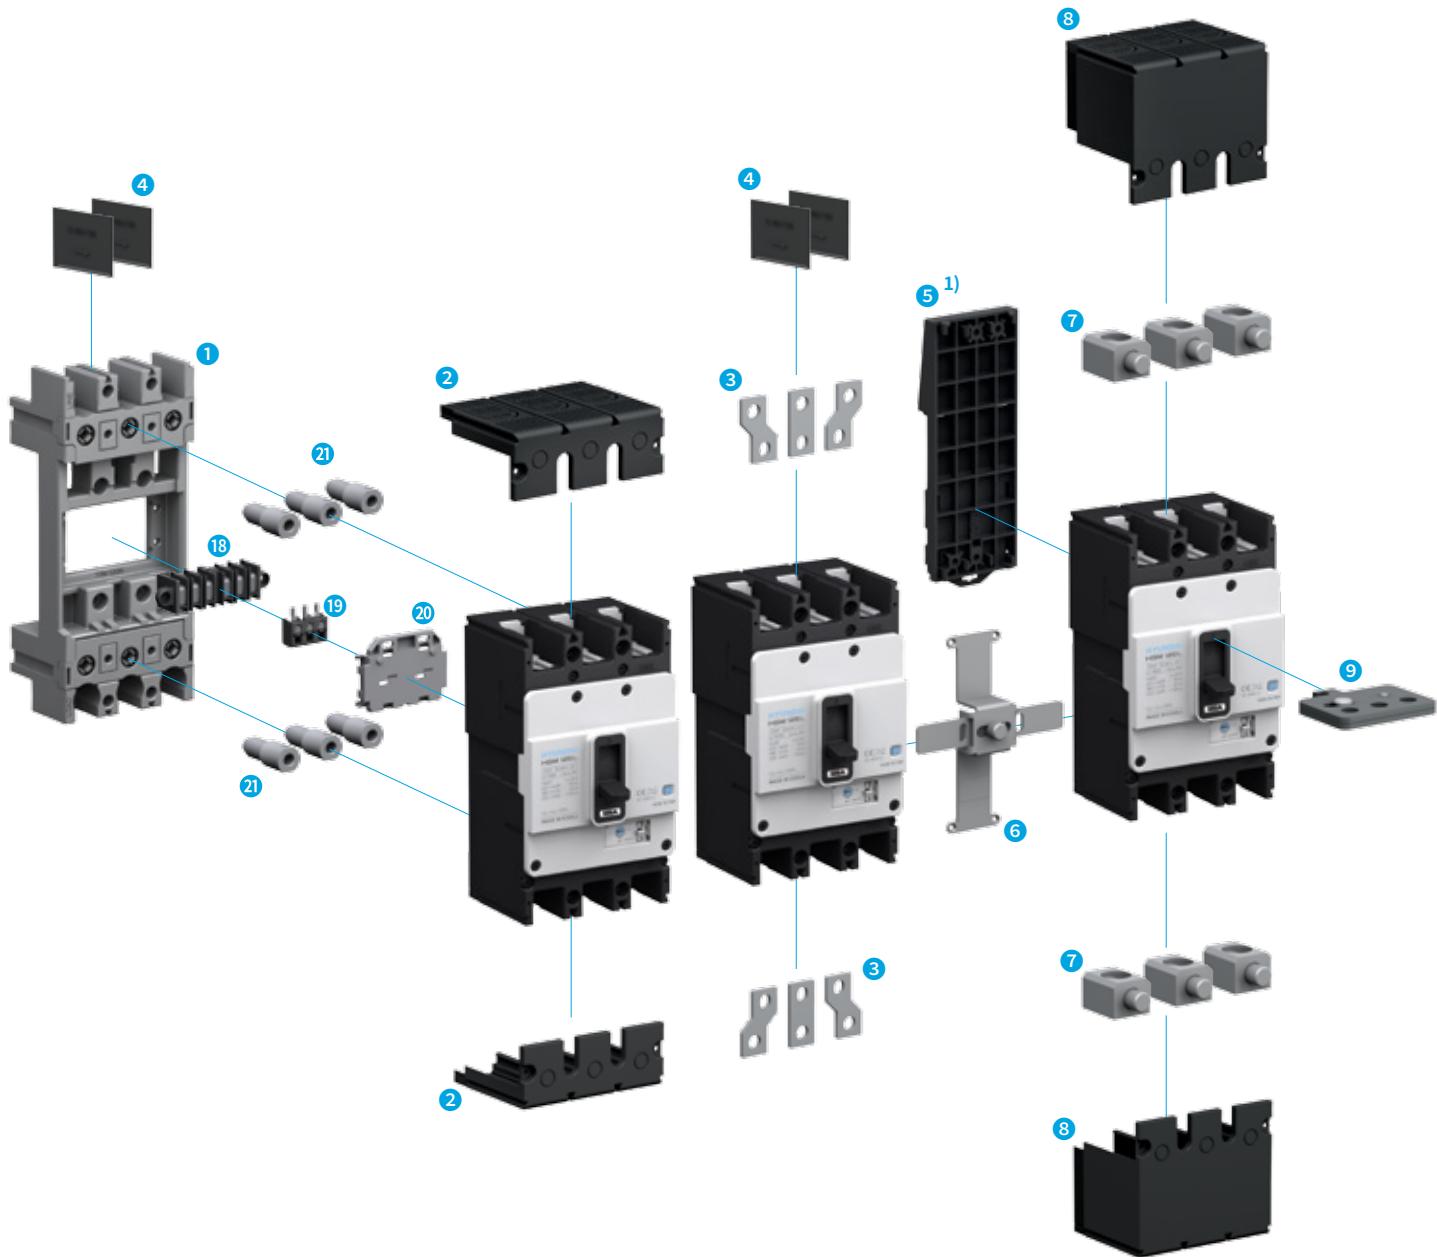

※ 1) DIN Rail Adaptor (DRA) : For HGM/HGE100

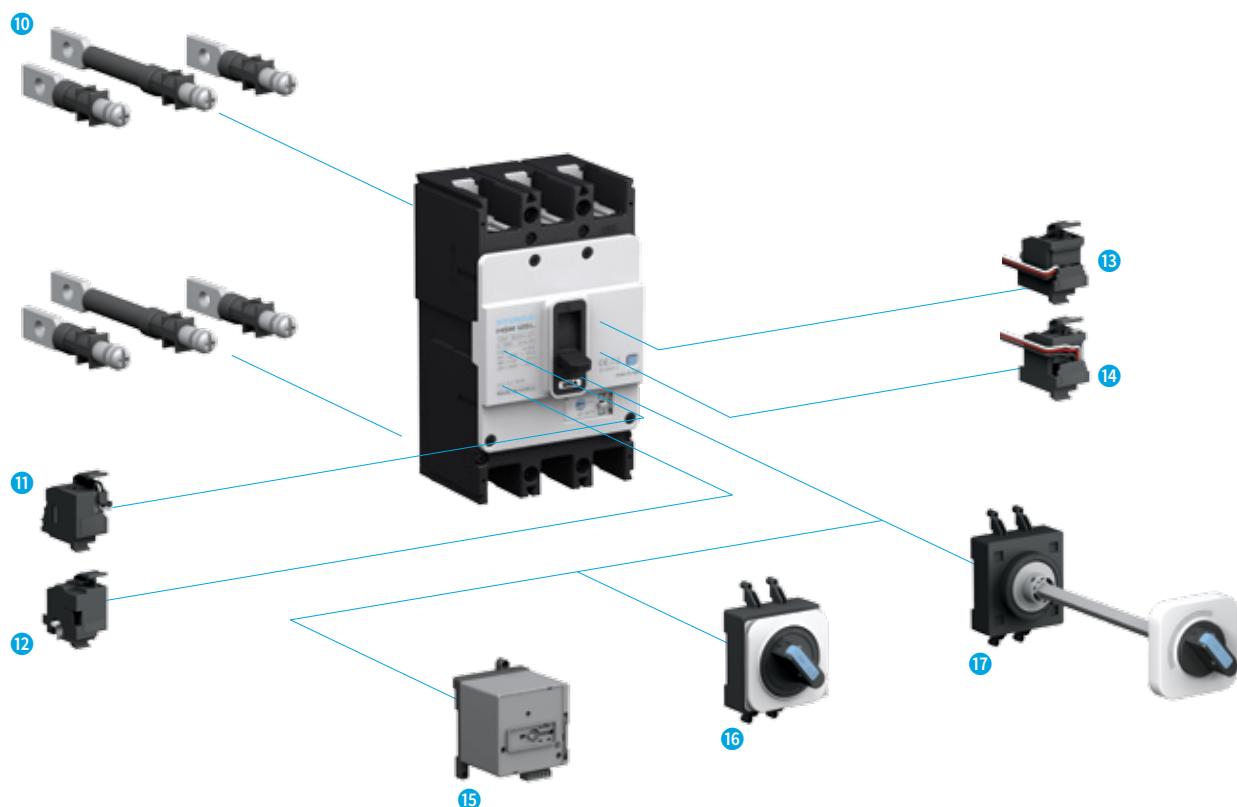



#### HGM Type MCCB

- |                                      |                                       |   |
|--------------------------------------|---------------------------------------|---|
| ① Plug-in Device (TDA, TDM, TDF)     | ⑧ Terminal Cover (General-Type) (TCF) | ⑯ Motor Operator (MOT)                    |
| ② Terminal Cover (For Plug-in) (TCP) | ⑨ Padlock (PLD)                       | ⑰ Front Contact Rotary Handle (TFG)       |
| ③ Bus Bar (TBB)                      | ⑩ Rear Connection Terminal (RCT)      | ⑱ Extension Rotary Handle (TFH)           |
| ④ Insulation Barrier (TQQ)           | ⑪ Shunt Trip Switch (SHT)             | ⑲ Plug-in Terminal Block (CBM)            |
| ⑤ DIN Rail Adaptor (DRA)             | ⑫ Under-Voltage Trip Switch (UVT)     | ⑳ Plug-in Terminal Block (CBB BLOCK UNIT) |
| ⑥ Mechanical Interlock (MIF)         | ⑬ Auxiliary Switch (AUX)              | ㉑ Plug-in Terminal Block (CBB PLATE)      |
| ⑦ Lug Terminal (CTB)                 | ⑭ Trip Alarm Switch (ALT)             | ㉒ Plug-in Terminal (PC MALE)              |

## Accessory

### HGP High Breaking Capacity

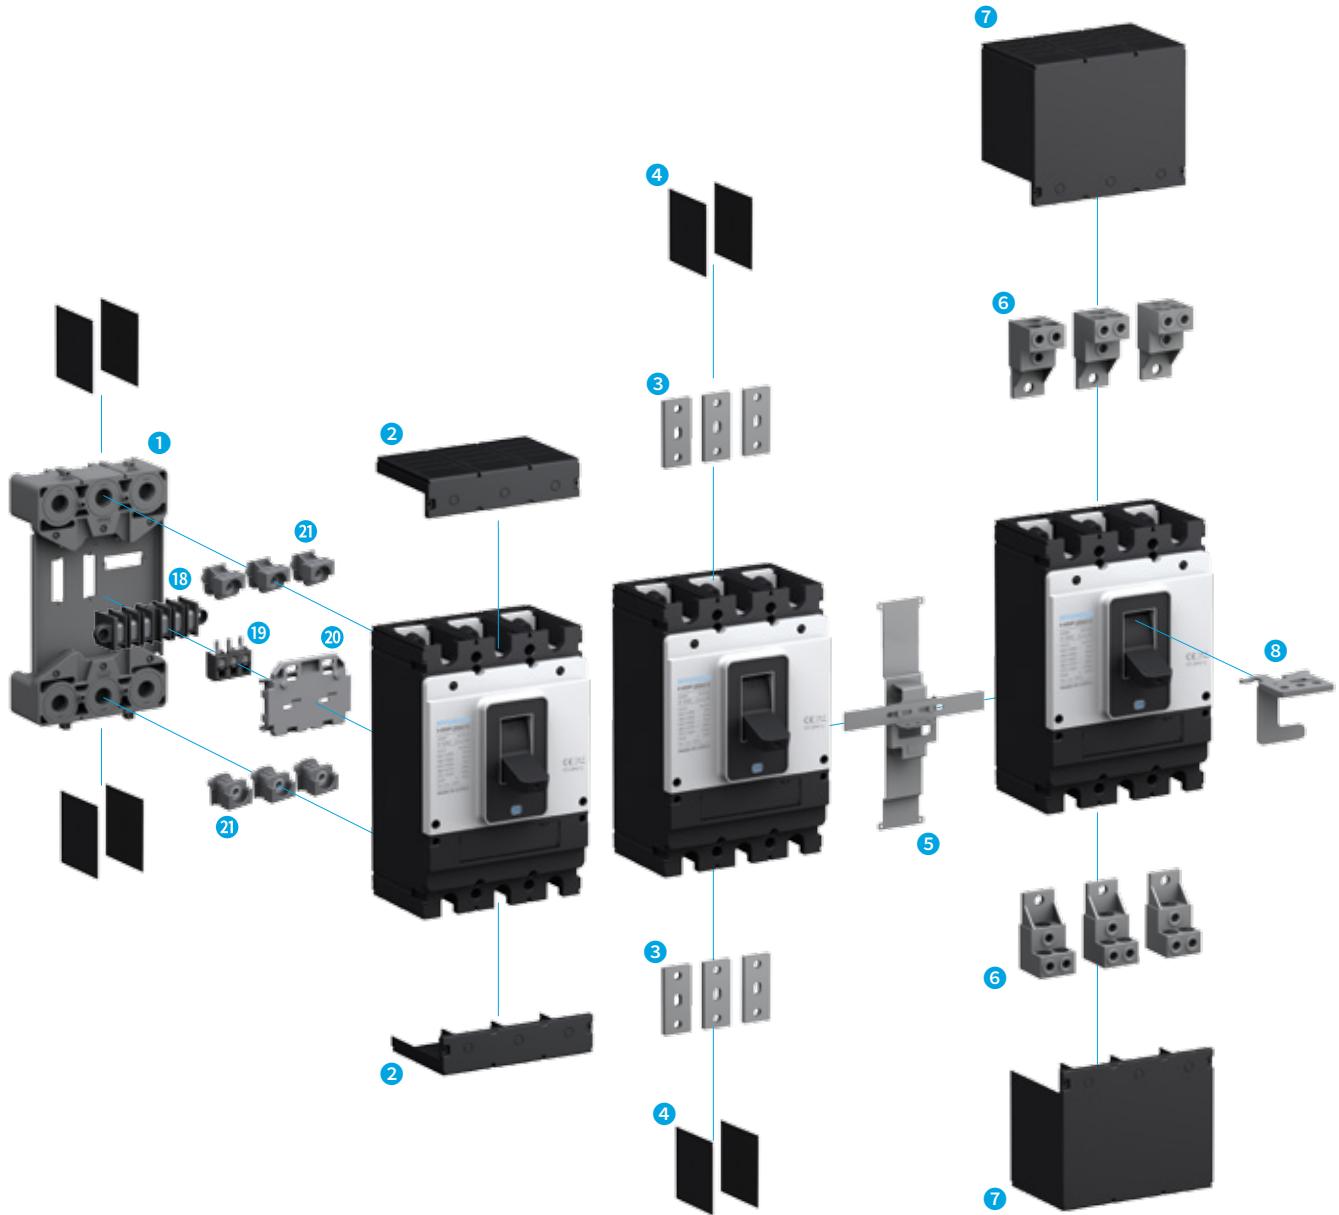


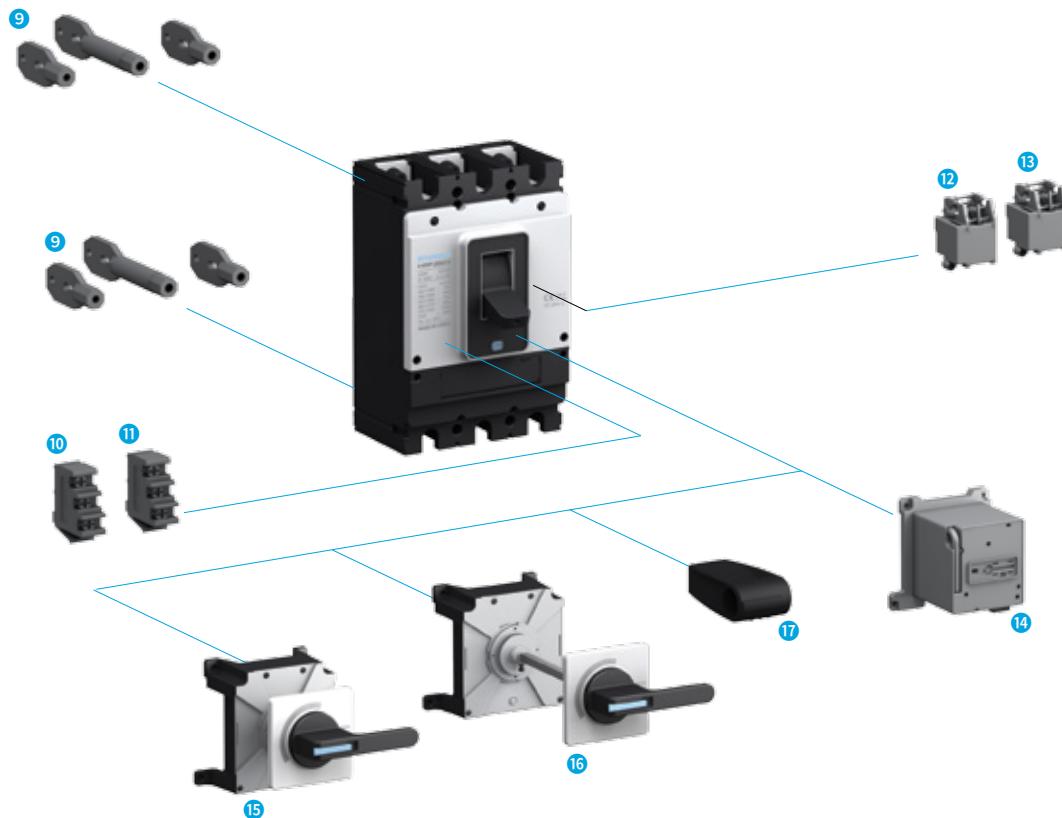


### HGP Type MCCB

- |   |                                   |   |
|---|-----------------------------------|---|
| ① Plug-In Device (TDM)                          | ⑧ Padlock (PLD)                   | ⑯ Front Contact Rotary Handle (TFG)       |
| ② Terminal Cover (For Plug-in) (TCF Short Type) | ⑨ Rear Connection Terminal (RCT)  | ⑰ Extension Rotary Handle (TFH)           |
| ③ Bus Bar (TBB)                                 | ⑩ Auxiliary Switch (AUX)          | ⑱ Auxiliary Handle (THA)                  |
| ④ Insulation Barrier (TQQ)                      | ⑪ Trip alarm Switch (ALT)         | ⑲ Plug-in Terminal Block (CBM)            |
| ⑤ Mechanical Interlock MIF                      | ⑫ Shunt trip Switch (SHT)         | ⑳ Plug-in Terminal Block (CBB BLOCK UNIT) |
| ⑥ Lug Terminal (CTB)                            | ⑬ Under-Voltage Trip Switch (UVT) | ㉑ Plug-in Terminal Block (CBB PLATE)      |
| ⑦ Terminal Cover (General-Type) (TCF Long Type) | ⑭ Motor Operator (MOT)            | ㉒ Plug-in Terminal (PC MALE)              |


## Internal Accessories (HGM)

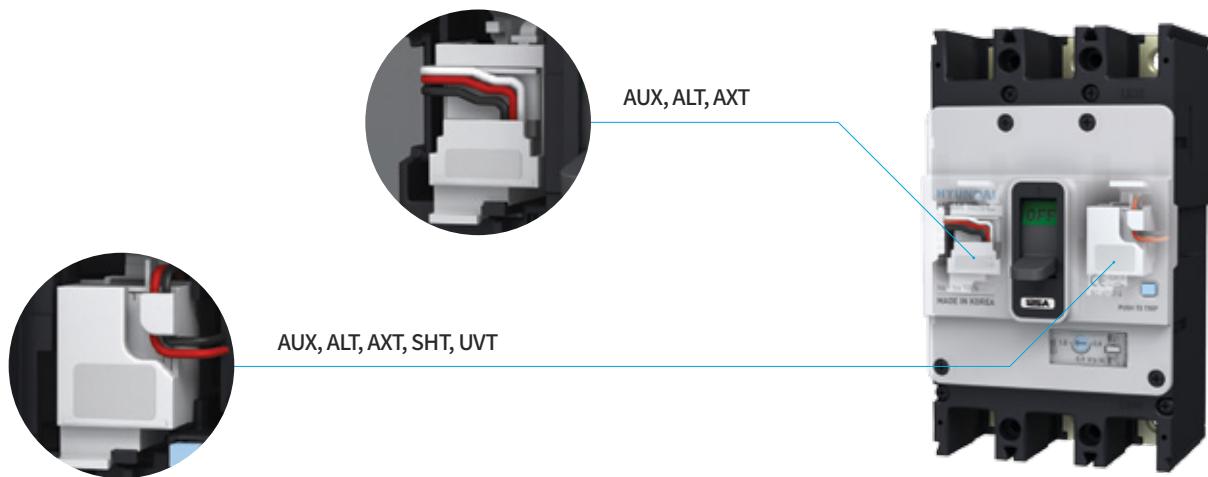


HGM30, 50E/S, 60, 100

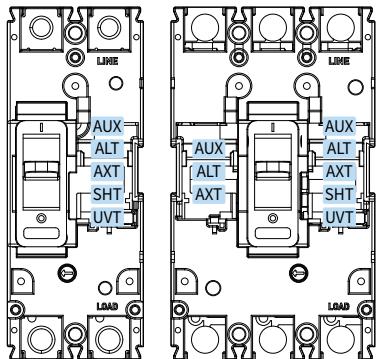

HGM50H/L, 125

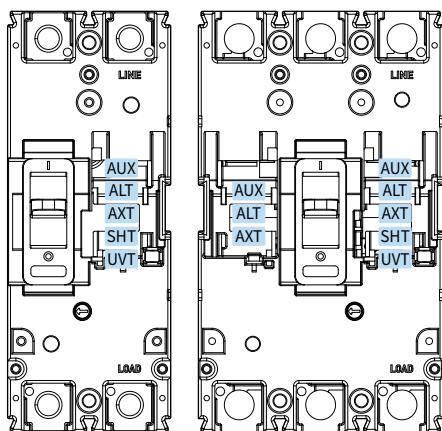

HGM160, 250

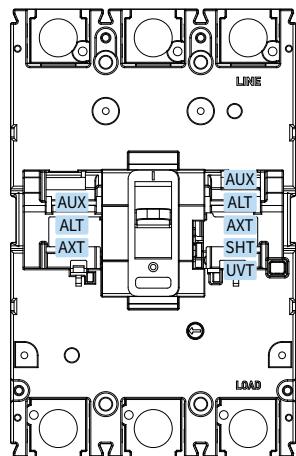

### Possible Installation Combinations (Below 250 AF)

| Type                 | Pole  | AUX |   | ALT |   | SHT |   | UVT |   | AXT |   | AUX |   | AUX |   | SHT |   | UVT |   | SHT |   | UVT |   |  |
|----------------------|-------|-----|---|-----|---|-----|---|-----|---|-----|---|-----|---|-----|---|-----|---|-----|---|-----|---|-----|---|--|
|                      |       | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ |  |
| HGM30<br>~<br>HGM125 | 2     | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ |  |
| HGM30<br>~<br>HGM250 | 3/4   | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ | □   | ■ |  |
| HGE30<br>~<br>HGE250 | 2/3/4 | □   | ■ | □   | ■ |     |   | □   | ■ |     |   |     |   |     |   |     |   |     |   |     |   |     |   |  |



\* AUX : Auxiliary Switch □ / ALT : Alarm Switch ■ / SHT : Shunt Trip □ / UVT : Under-Voltage Trip □ / AXT : Auxiliary Alarm Switch □■ (AUX/ALT Integrated Type)

## HGM Type's Internal Accessories and Possible Location for Installation

- Auxiliary Switch (AUX)
- Alarm Switch (ALT)
- Auxiliary + Trip Alarm Switch (AXT)
- Shunt Trip Coil (SHT)
- Under-Voltage Trip Coil (UVT)

HGM630, 800

HGM400

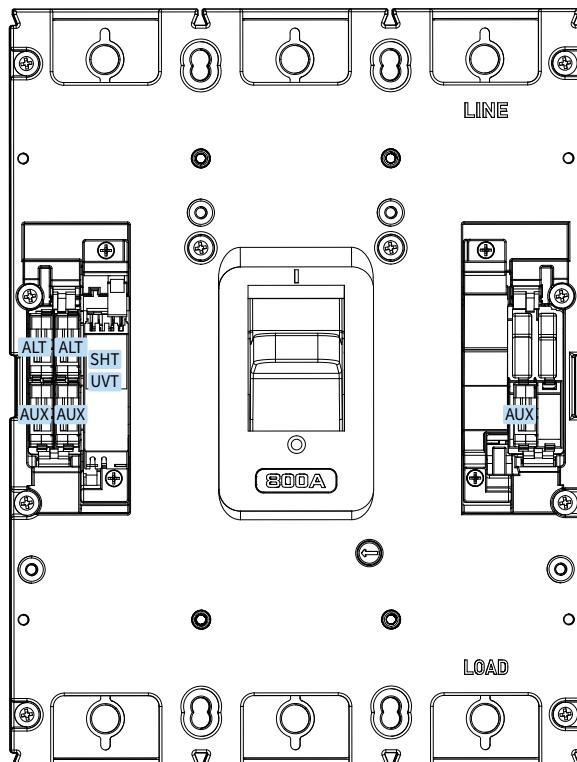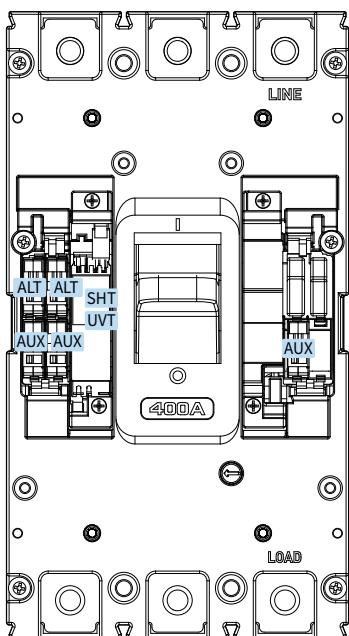

Possible Installation Combinations (400 ~ 800 AF)

Left Side of Handle      Right Side of Handle  
Breaker Handle

| Type             | Pole         | AUX | ALT | SHT | UVT | AUX | SHT | UVT | SHT | UVT | SHT | UVT |
|------------------|--------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
|                  |              |     |     |     |     | ALT | AUX | AUX | ALT | ALT | AUX | AUX |
| HGM400           | 2/3/4        |     |     |     |     |     |     |     |     |     |     |     |
| HGM630<br>HGM800 | 2/3<br>4RSTN |     |     |     |     |     |     |     |     |     |     |     |
| HGM630<br>HGM800 | 4NRST        |     |     |     |     |     |     |     |     |     |     |     |
| HGE400           | 2/3/4        |     |     |     |     |     |     |     |     |     |     |     |
| HGE630<br>HGE800 | 2/3          |     |     |     |     |     |     |     |     |     |     |     |

※ AUX : Auxiliary Switch □ / ALT : Alarm Switch ■ / SHT : Shunt Trip □ / UVT : Under-Voltage Trip □  
HGM Type's ZCT embedded type of product can be combined equally as HGE Type.

## Internal Accessories (HGM)

### Auxiliary Switch (AUX) / Trip Alarm Switch (ALT)

It is a contact for indicating the status of the circuit breaker in a remote position.

This contact can be used to realize not only the indication function but also electrical functions such as electrical lock and relay.







#### Auxiliary Switch (AUX)

- Indicates the ON/OFF status of the circuit breaker contact.
- Status is OFF during TRIP.
- It is comprised of C contact.

#### Auxiliary + Trip Alarm Switch (AXT)

- This switch is an integrated combination of auxiliary switch and trip alarm switch.

#### Contact Circuit Diagram

|           | Auxiliary Switch (AUX)  | Trip Alarm Switch (ALT)   |
|-----------|---|---|
| MCCB ON   |   |   |
| MCCB OFF  |  |  |
| MCCB TRIP |  |  |

#### Rating of Contact

|                                    |                |                |
|------------------------------------|----------------|----------------|
| Rated Conventional Thermal Current | 5 A            |                |
| Minimum Load                       | 160 mA, 5 VDC  |                |
| Rated Operation Current            | Resistive Load | Inductive Load |
| AC 125 V                           | 5 A            | 3 A            |
| AC 250 V                           | 3 A            | 2 A            |
| DC 30 V                            | 4 A            | 3 A            |
| DC 125 V                           | 0.4 A          | 0.4 A          |
| DC 250 V                           | 0.2 A          | 0.2 A          |

#### Trip Alarm Switch (ALT)

- It is only activated when the circuit breaker has tripped due to an overload, short circuit or operation of shunt trip switch and does not operate during general ON/OFF.
- Returns to original state when circuit breaker has been reset.
- It is comprised of C contact.

#### Possible Location for Installation

| Type            | Pole  | AUX   | ALT   | AXT   |
|-----------------|-------|---|---|---|
| HGM30 ~ HGM125  | 2     |   |   |   |
| HGM30 ~ HGM250  | 3/4   |  |  |  |
| HGE30 ~ HGE250  | 2/3/4 |  |  |  |
| HGM400          | 2/3/4 |  |  |   |
| HGE400          | 2/3/4 |  |  |   |
| HGM630 ~ HGM800 | 2/3/4 |  |  |   |
| HGE630 ~ HGE800 | 2/3   |  |  |   |

※ AUX : Auxiliary Switch □

ALT : Alarm Switch ■

AXT : Auxiliary Alarm Switch □■ (AUX/ALT Integrated Type)



AUX



ALT

## Shunt Trip Device (SHT)

Shunt trip device (SHT) is a device that remotely trips the circuit breaker by applying voltage to both terminals of the coil.

### Operating Condition

- $U \geq 0.7 \times U_n$  (More than 70 % of rated voltage applied)
- As for impulse type voltage, more than 20 ms applied

### Rated Voltage and Characteristics (100 ~ 250 AF)

| Rated voltage (Un)        | Power Consumption |                |
|---------------------------|-------------------|----------------|
|                           | VA (W)            | A (A)          |
| DC                        | 24 V              | 50.2           |
|                           | 48 V              | 94.6           |
|                           | 60 V              | 91.2           |
|                           | 100 ~ 120 V       | 11.8           |
|                           | 125 V             | 58.1           |
| AC<br>(50/60 Hz)          | 100 ~ 120 V       | 75.2           |
|                           | 200 ~ 250 V       | 64.8           |
|                           | 380 ~ 480 V       | 131            |
| Rated Operational Voltage |                   | 0.7 ~ 1.1 × Un |
| Operating Time            |                   | 50 ms          |


※ Controller output voltage : DC 45 V

### SHT Wiring



※ Not applicable to  
HGM400, 630, 800 AF DC 24 V

2. HGM400, 630, 800 AF DC 24 V  
(SHT + Controller)



### Possible Location for Installation

| Type              | Pole  | SHT | UVT |
|-------------------|-------|-----|-----|
| HGM30 ~<br>HGM125 | 2     |     |     |
| HGM30 ~<br>HGM250 | 3/4   |     |     |
| HGE30 ~<br>HGE250 | 2/3/4 |     |     |
| HGM400            | 2/3/4 |     |     |
| HGE400            | 2/3/4 |     |     |
| HGM630<br>HGM800  | 2/3/4 |     |     |
| HGE630<br>HGE800  | 2/3   |     |     |

※ SHT : Shunt Trip

UVT : Under-Voltage Trip



SHT

## Internal Accessories (HGM)

### Under-Voltage Trip Device (UVT)

In case the circuit voltage drops to less than 35 % of the rated voltage ( $U_n$ ), UVT automatically initiates a trip in the circuit breaker to prevent damage to the load.

#### Opening Conditions


- Operating characteristics are guaranteed to conform to the IEC 60947-2 standard criteria.
- Trip Condition of Circuit Breaker :  $U \leq 0.35 \times U_n$
- Fixed Type : 50 ms (400 ~ 800 AF)
- Time Delay Type : 500 ~ 1,000 ms (Below 250 AF)
- No Trip Condition of Circuit Breaker :  $U \geq 0.7 \times U_n$
- In the  $U = 0.35 \sim 0.7 \times U_n$  interval, the circuit breaker can be tripped but the operation is not guaranteed.

#### Time Delay Function

Malfunction is prevented during a short momentary voltage drop of below 500 ms. (Below 250 AF)

#### UVT Wiring

##### 1. HGM30 ~ 250 AF (UVT + Controller)



※ DC 24 V among HGM400 and above products require a controller.

##### 2. HGM400, 630, 800 AF (UVT Only)



#### Closing Conditions

- In case of circuit breakers assembled with UVT, the circuit breaker cannot be ON (Closing) when voltage is not applied to the UVT.
- The reset operation after the circuit breaker's trip caused by UVT operation may differ depending on the circuit breaker's type and UVT structure.
- In order to close the circuit breaker, Voltage must be applied to UVT.
- Closing Condition :  $U \geq 0.85 \times U_n$

#### Rated Voltage and Characteristics (Below 250 AF)

| Rated Voltage ( $U_n$ )   | Power Consumption  |                    |
|---------------------------|--------------------|--------------------|
|                           | VA (W)             | A (mA)             |
| DC                        | 24 V               | 0.96               |
|                           | 48 V               | 1.1                |
|                           | 100 ~ 110 V        | 2.2                |
|                           | 100 ~ 120 V        | 5.1                |
| AC<br>(50/60 Hz)          | 200 ~ 230 V        | 6                  |
|                           | 380 ~ 415 V        | 9.6                |
|                           | 440 ~ 480 V        | 12.5               |
|                           | Starting Voltage   | 0.35 ~ 0.7 × $U_n$ |
| Opening                   |                    | 0.85 × $U_n$       |
| Closing                   |                    | 0.85 × $U_n$       |
| Rated Operational Voltage | 0.85 ~ 1.1 × $U_n$ |                    |
| Operating Time            | 500 ~ 1,000 ms     |                    |

※ Do not use UVT for electrical interlocking system.

※ Controller output voltage : DC 45 V



UVT




UVT Controller



## Internal Accessories (HGP)

### HGP Type's Internal Accessories and Possible Location for Installation


- Auxiliary Switch (AUX)
- Alarm Switch (ALT)
- Shunt Trip Coil (SHT)
- Under-Voltage Trip Coil (UVT)
- Fault Alarm Contact (FAL), Only for Electronic

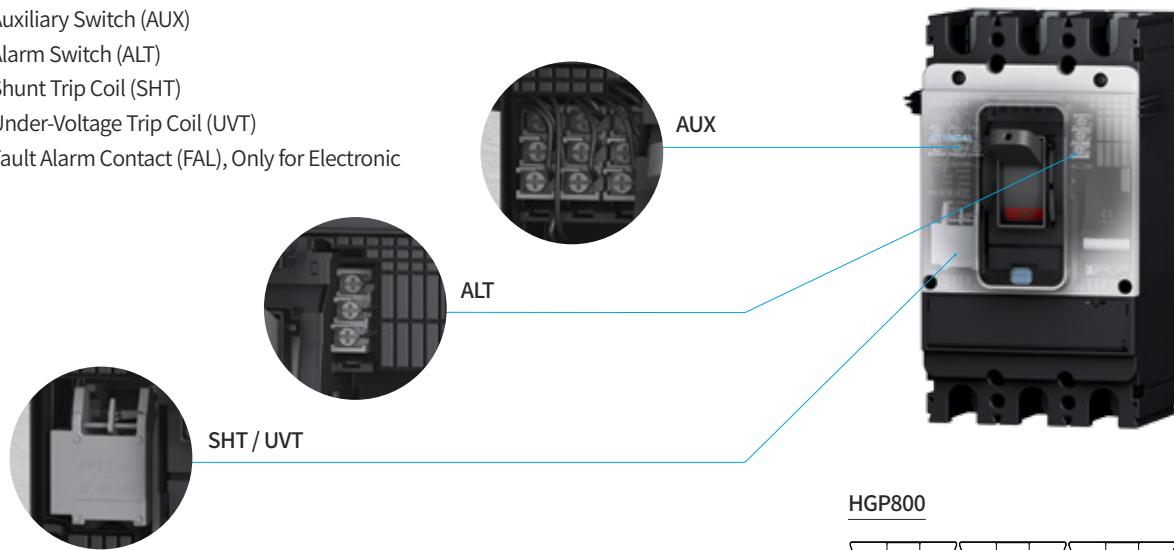


HGP50D, 125D, 160D

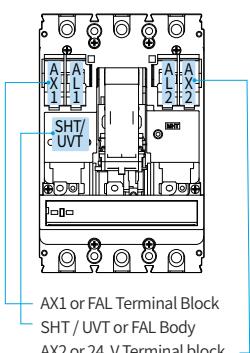HGP250  
(New Type)

HGP400, 630

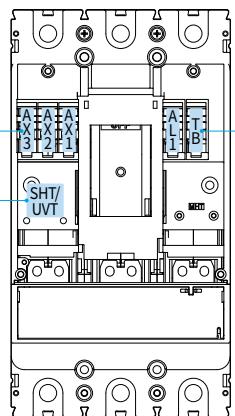

HGP800

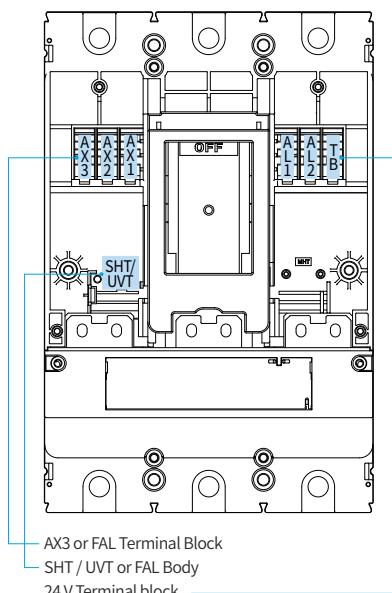

Left Side of Handle      Right Side of Handle  
Breaker Handle

### Possible Location for Installation

| Type                         | Pole | AUX | ALT | SHT | UVT | SHT<br>AUX | SHT<br>ALT | UVT<br>AUX | UVT<br>ALT | SHT<br>AUX | UVT<br>ALT |
|------------------------------|------|-----|-----|-----|-----|------------|------------|------------|------------|------------|------------|
| HGP50D<br>HGP125D<br>HGP160D | 3/4  |     |     |     |     |            |            |            |            |            |            |
| HGP250                       | 3/4  |     |     |     |     |            |            |            |            |            |            |
| HGP400<br>HGP630             | 3/4  |     |     |     |     |            |            |            |            |            |            |
| HGP800                       | 3/4  |     |     |     |     |            |            |            |            |            |            |

※ AUX : Auxiliary Switch □ / ALT : Alarm Switch ■ / SHT : Shunt Trip □ / UVT : Under-Voltage Trip □ / AXT : Auxiliary Alarm Switch □■ (AUX/ALT Integrated Type)

## Internal Accessories (HGP)

### Auxiliary Switch (AUX)/ Trip Alarm Switch (ALT)

It is a contact for indication to inform the status of the circuit breaker in a remote position.

This contact can be used to realize not only the indication function but also electrical functions such as electrical lock and relay.

#### Auxiliary Switch (AUX)

- Indicates the ON/OFF status of the circuit breaker contact.
- Status is OFF during TRIP.
- It is comprised of C contact.

#### Trip Alarm Switch (ALT)

- It is only activated when the circuit breaker has tripped due to an overload, short circuit or operation of shunt trip switch and does not operate during general ON/OFF.
- Returns to original state when circuit breaker has been reset.
- It is comprised of C contact.

#### Contact Circuit Diagram

|           | Auxiliary Switch (AUX)  | Trip Alarm Switch (ALT)   |
|-----------|---|---|
| MCCB ON   |    |    |
| MCCB OFF  |  |  |
| MCCB TRIP |  |  |

#### Possible Location for Installation

| Type                         | AUX   | ALT   |
|------------------------------|---|---|
| HGP50D<br>HGP125D<br>HGP160D |    |    |
| HGP250                       |  |  |
| HGP400<br>HGP630             |  |  |
| HGP800                       |  |  |

#### Rating of Contact

|                                    |                |                |
|------------------------------------|----------------|----------------|
| Rated Conventional Thermal Current | 5 A            |                |
| Minimum Load                       | 160 mA, 5 VDC  |                |
| Rated Operation Current            | Resistive Load | Inductive Load |
| AC                                 | 125 V          | 5 A            |
|                                    | 250 V          | 3 A            |
| DC                                 | 30 V           | 4 A            |
|                                    | 125 V          | 0.4 A          |
|                                    | 250 V          | 0.2 A          |



HGP160D ALT



HGP250 ~ 800 ALT  
HGP160D ~ 800 AUX

## Shunt Trip Device (SHT) / Under-Voltage Device (UVT)

SHT/UVT is installed inside the circuit breaker and it offers the function of remote tripping the circuit breaker by controlling the voltage applied to both terminals of the coil.

### Shunt Trip Device (SHT)

It is able to remotely trip the circuit breaker by applying voltage to the shunt trip device installed in the circuit breaker.

#### Operating Condition

- $U \geq 0.7 \times U_n$  (More than 70 % of rated voltage applied)
- As for impulse type voltage, more than 20 ms applied

#### Rated Voltage and Characteristics


| Rated Voltage ( $U_n$ )   | Power Consumption         |        |
|---------------------------|---------------------------|--------|
|                           | W or VA                   | A (mA) |
| DC                        | 24 V                      | 1.2    |
|                           | 100 ~ 110 V               | 2.8    |
|                           | 100 ~ 120 V               | 3.3    |
| AC<br>(50/60 Hz)          | 200 ~ 230 V               | 5.2    |
|                           | 380 ~ 415 V               | 13.9   |
|                           | 440 ~ 480 V               | 10.9   |
| Rated Operational Voltage | $0.7 \sim 1.1 \times U_n$ |        |
| Operating Time            | 50 ms                     |        |

※ Controller output voltage : DC 45 V


#### Possible Location for Installation

| Type    | SHT | UVT |
|---------|-----|-----|
| HGP50D  |     |     |
| HGP125D |     |     |
| HGP160D |     |     |
| HGP250  |     |     |
| HGP400  |     |     |
| HGP630  |     |     |
| HGP800  |     |     |

#### SHT Wiring

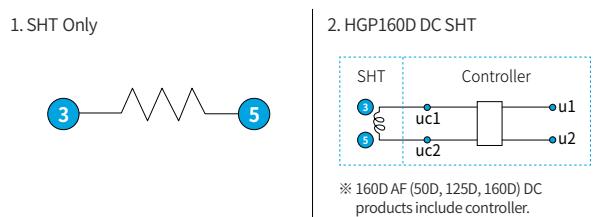

#### UVT Wiring

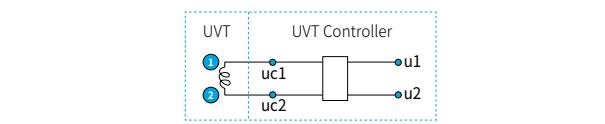

### Under-Voltage Device (UVT)

If the under-voltage trip device is installed in the circuit breaker, the circuit breaker is tripped or is not closed in case the circuit voltage is below the reference value.

In case the circuit voltage drops to less than 35 % of the rated voltage ( $U_n$ ), UVT automatically initiates a trip in the circuit breaker to prevent damage to the load.

#### Opening Conditions

- Operating characteristics are guaranteed to conform to the IEC 60947-2 standard criteria.
- Trip Condition of Circuit Breaker :  $U \leq 0.35 \times U_n$
- No Trip Condition of Circuit Breaker :  $U \geq 0.7 \times U_n$
- In the  $U = 0.35 \sim 0.7 \times U_n$  interval, the circuit breaker can be tripped but the operation is not guaranteed.

#### Closing Conditions

- In case of circuit breakers assembled with UVT, the circuit breaker can be OFF/RESET when voltage is not applied but the circuit breaker cannot be ON (Closing).
- In order to close the circuit breaker, Voltage must be applied to UVT.
- Closing Condition :  $U \geq 0.85 \times U_n$

#### Rated Voltage and Characteristics

| Rated Voltage ( $U_n$ )   | Power Consumption          |        |
|---------------------------|----------------------------|--------|
|                           | Pick Up                    |        |
|                           | W or VA                    | A (mA) |
| DC                        | 24 V                       | 2.6    |
|                           | 100 ~ 110 V                | 5      |
|                           | 100 ~ 120 V                | 4.5    |
| AC<br>(50/60 Hz)          | 200 ~ 230 V                | 5.6    |
|                           | 380 ~ 415 V                | 10.8   |
|                           | 440 ~ 480 V                | 12.5   |
| Starting Voltage          | $0.35 \sim 0.7 \times U_n$ |        |
| Closing                   | $0.85 \times U_n$          |        |
| Rated Operational Voltage | $0.85 \sim 1.1 \times U_n$ |        |
| Operating Time            | 50 ms                      |        |

※ Do not use UVT for electrical interlocking system.

※ Controller output voltage : DC 45 V



HGP50D ~ 160D SHT/  
UVT



HGP250  
SHT/UVT



HGP400 ~ 800 SHT/  
UVT



UVT Controller

## External Accessories (HGM)

### Locking Device

#### Handle Locking Device Using Padlock (PLD)

This device is used for locking the handle of circuit breaker to the OFF position by using a padlock. Padlock is not provided separately and up to 3 can be used. The applicable specifications of padlocks are as below.

| Type     | Application     | Padlock Diameter <sup>1)</sup> |
|----------|-----------------|--------------------------------|
| PLD 10GM | HGM30 ~ HGM250  | 5 mm                           |
|          | HGE30 ~ HGE250  |                                |
| PLD 40GM | HGM400 ~ HGM800 | 6 mm                           |
|          | HGE400 ~ HGE800 |                                |

#### Mechanical Interlock

This device interlocks two circuit breakers by using a mechanical interlock.




#### Key Features

- It prevents two breakers from closing at the same time.
- All circuit breakers are turned OFF. The applicable specifications of padlocks are as below.



| Type       | 2P         | 3P          | 4P (RSTN)   | 4P (NRST) | Application               | Padlock Diameter <sup>1)</sup> |
|------------|------------|-------------|-------------|-----------|---------------------------|--------------------------------|
| MIF 10GM 2 | MIF 10GM 3 | MIF 10GM R4 | MIF 10GM N4 |           | HGM/HGE30, 50E/S, 60, 100 |                                |
| MIF 12GM 2 | MIF 12GM 3 | MIF 12GM R4 | MIF 12GM N4 |           | HGM/HGE50H/L, 125         | 5 mm                           |
| -          | MIF 25GM 3 | MIF 25GM R4 | MIF 25GM N4 |           | HGM/HGE160, 250           |                                |
| -          | MIF 40GM 3 | MIF 40GM R4 | MIF 40GM N4 |           | HGM/HGE400                |                                |
| -          | MIF 80GM 3 | MIF 80GM R4 | MIF 80GM N4 |           | HGM/HGE630, 800           | 6 mm                           |




PLD

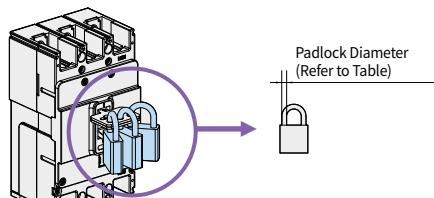Padlock Diameter  
(Refer to Table)


MIF

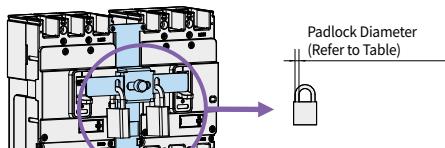Padlock Diameter  
(Refer to Table)

Right Off Lock



Left Off Lock



Double Off Lock

※ 1) Padlock not included

## Terminal Cover

As a part that insulates the circuit breaker's live and load side of terminal area from the outside, it prevents electric shock and short-circuit accidents that may occur due to direct contact of people's hand or tools such as drivers with the live current part. When the terminal cover is used, the protection grade of IP40 is applied to the power part. Based on the connection method of the circuit breaker, it can be classified into long or short type for use and various handles and interlock devices can be combined for use.

### Short Type

It is suitable for plug-in or rear connection.

### Long Type

It is suitable for front connection by using wires, bus bar or lug terminals.

| Type        |             |             |             |             |             | Application                                    | Pitch (mm) |
|-------------|-------------|-------------|-------------|-------------|-------------|--|------------|
| 2P          |             | 3P          |             | 4P          |             |  |            |
| Short       | Long        | Short       | Long        | Short       | Long        |  |            |
| TCF 10GM S2 | TCF 10GM L2 | TCF 10GM S3 | TCF 10GM L3 | TCF 10GM S4 | TCF 10GM L4 | HGM30, 50E/S, 60, 100<br>HGE30, 50E/S, 60, 100 | 25         |
| TCF 12GM S2 | TCF 12GM L2 | TCF 12GM S3 | TCF 12GM L3 | TCF 12GM S4 | TCF 12GM L4 | HGM50H/L, 125<br>HGE50H/L, 125                 | 30         |
| TCF 25GM S3 | TCF 25GM L3 | TCF 25GM S3 | TCF 25GM L3 | TCF 25GM S4 | TCF 25GM L4 | HGM160, 250<br>HGE160, 250                     | 35         |
| TCF 40GM S3 | TCF 40GM L3 | TCF 40GM S3 | TCF 40GM L3 | TCF 40GM S4 | TCF 40GM L4 | HGM400<br>HGE400                               | 44         |
| TCF 80GM S3 | TCF 80GM L3 | TCF 80GM S3 | TCF 80GM L3 | TCF 80GM S4 | TCF 80GM L4 | HGM630, 800<br>HGE630, 800                     | 70         |
| TCF 10HD S2 | -           | TCF 10HD S3 | -           | -           | -           | HDB30, 50, 100<br>HDG30, 50, 100               | 25         |


※ In case of using as front connection,  
please use it after removing the  
indicated part.




Short Type




Long Type



Assembly Diagram



Short Type  
(Plug-in Connection)

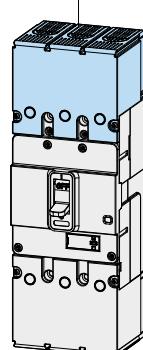

Long Type  
(Front Connection)

## External Accessories (HGM)


### Insulation Barrier

As a part used to prevent accidents with regards to insulation and conductive foreign substance between the circuit breaker terminals, it improves the performance of phase-to-phase insulation by installing it in the groove between the circuit breaker's terminals. It can easily be assembled even if the circuit breaker has already been installed and in case the two circuit breakers have been installed side by side, it can also be assembled in the gap between the two circuit breakers. In addition, it is used in the terminal cover and plug-in base.

※ In case insulation barrier is not mounted between the circuit breaker's terminal, it may cause secondary short-circuit accidents so it must be used.

Insulation barrier must be installed towards the direction of the circuit breaker's line indication part.

| Type       |            |            |    | Application                                    | No. of Parts (EA/Set) |    |    |
|------------|------------|------------|----|--|-----------------------|----|----|
|            | 2P         | 3P         | 4P |  | 2P                    | 3P | 4P |
| TQQ 10GM 2 | TQQ 10GM 3 | TQQ 10GM 4 |    | HGM30, 50E/S, 60, 100<br>HGE30, 50E/S, 60, 100 | 1                     | 2  | 3  |
| TQQ 10GM 2 | TQQ 10GM 3 | TQQ 10GM 4 |    | HGM50H/L, 125<br>HGE50H/L, 125                 | 1                     | 2  | 3  |
| TQQ 25GM 2 | TQQ 25GM 3 | TQQ 25GM 4 |    | HGM160, 250<br>HGE160, 250                     | 1                     | 2  | 3  |
| TQQ 40GM 2 | TQQ 40GM 3 | TQQ 40GM 4 |    | HGM400<br>HGE400                               | 1                     | 2  | 3  |
| TQQ 40GM 2 | TQQ 40GM 3 | TQQ 40GM 4 |    | HGM630, 800<br>HGE630, 800                     | 1                     | 2  | 3  |
| TQQ 10HD 2 | TQQ 10HD 3 | -          |    | HDB30, 50, 100<br>HDG30, 50, 100               | 2                     | 4  | -  |

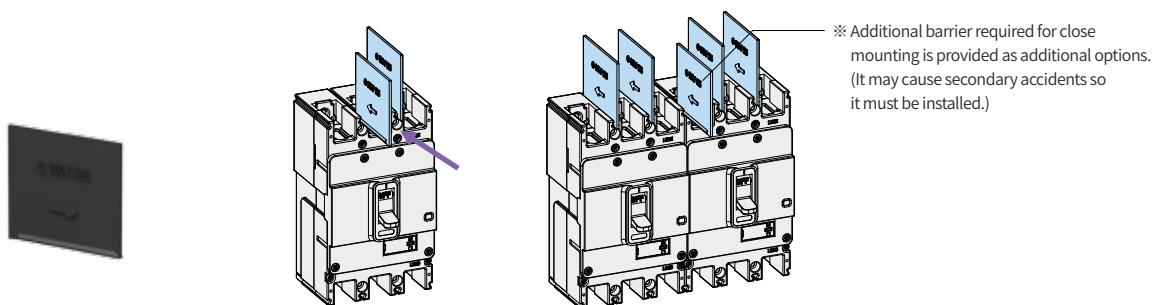

## Rotary Handle

Rotary handle is a product that can check and operate MCCB's ON/OFF/TRIP even when the panel door is closed by installing the circuit breaker in enclosed switchgear or on MCCB panel and others. There are two types of rotary handle, front contact type and extension type and all the rotary handles offer panel door locking function and handle locking function. The rotary handle can be rotated clockwise to turn the circuit breaker "ON" and according to the mounting direction of MCCB, it is categorized into the upper line, the right line and the left line. The IP rating of the handle is IP40.

### Front Contact Rotary Handle

- 32 ~ 250 AF : The handle is attached directly to the circuit breaker.
- 400 ~ 800 AF : The handle attached to the door of the panel.

### Extension Rotary Handle


It is suitable in case the distance between the circuit breaker and the panel door is long. The handle is attached to the door of the panel and there is no trip-button function.

| Type       |            |            | Application               |
|------------|------------|------------|---------------------------|
| Upper Line | Right Line | Left Line  |                           |
| TFG 10GM U | TFG 10GM R | TFG 10GM L | HGM/HGE30, 50E/S, 60, 100 |
| TFG 12GM U | TFG 12GM R | TFG 12GM L | HGM/HGE50H/L, 125         |
| TFG 25GM U | TFG 25GM R | TFG 25GM L | HGM/HGE160, 250           |
| TFG 40GM U | TFG 40GM R | TFG 40GM L | HGM/HGE400                |
| TFG 80GM U | TFG 80GM R | TFG 80GM L | HGM/HGE630, 800           |


| Type     | Application               |
|----------|---------------------------|
| TFH 10GM | HGM/HGE30, 50E/S, 60, 100 |
| TFH 12GM | HGM/HGE50H/L, 125         |
| TFH 25GM | HGM/HGE160, 250           |
| TFH 40GM | HGM/HGE400                |
| TFH 80GM | HGM/HGE630, 800           |



Front Contact Rotary Handle  
(TFG-HGM)




HGM30 ~ HGM250




HGM400 ~ HGM800



Extension Rotary Handle  
(TFH-HGM)



HGM30 ~ HGM250



HGM400 ~ HGM800


※ When installing an extension rotary handle, the eccentric tolerance of the handle drive shaft is 1.5 degrees.

## External Accessories (HGM)

### Rotary Handle

#### Types of Handle Depending on the Circuit Breaker's Installation Type


Rotary handle is divided into the following three types depending on the circuit breaker's direction of power supply.

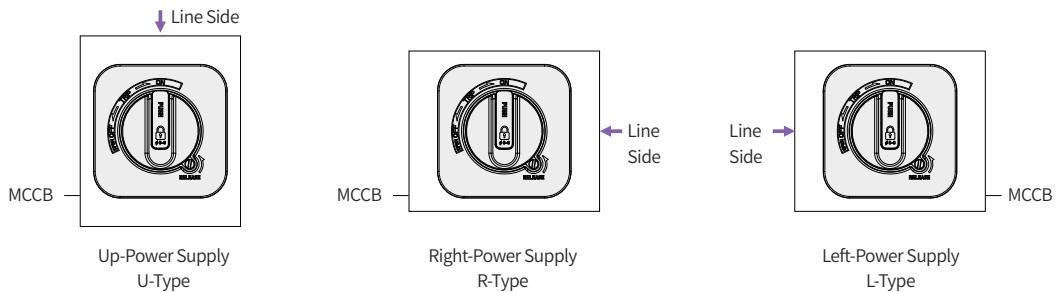

#### How to Operate the Handle


Operating Direction : Turn the handle clockwise to turn the breaker ON.

- Circuit Breaker ON : Rotate the handle to ON position. (Figure 1)
- Circuit Breaker OFF : Rotate the handle to OFF position. (Figure 2)
- Circuit Breaker TRIP : If the circuit breaker is tripped, the handle will automatically return to TRIP position. (Figure 3)
- After the circuit breaker is tripped, rotate the handle to the RESET position first (Figure 4) then rotate to the ON position and the circuit breaker will turn ON (Figure 1).
- If you need to open the door when the handle is in the ON state, rotate the RELEASE screw to the direction of the arrow then open the door (Figure 5).

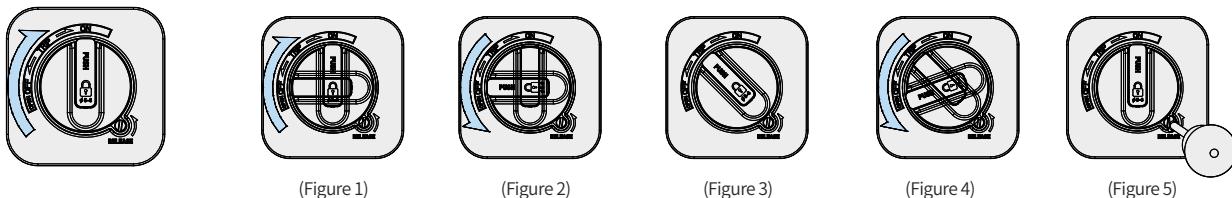

#### Handle Locking Device

| Lock Function            | OFF State Door Lock   | ON State Door Lock  | Reverse Interlock   | Handle Padlock   |
|--------------------------|---|---|---|--|
| Details                  | <ul style="list-style-type: none"> <li>• Impossible to open the panel door when the circuit breaker is in the OFF state.</li> <li>• Possible at RESET position</li> <li>• Possible to open the panel door after rotating the handle to RESET</li> </ul> | <ul style="list-style-type: none"> <li>• Impossible to open the panel door when the circuit breaker is in the ON state</li> <li>• Possible to open the panel door after rotating the RELEASE screw</li> </ul> | <ul style="list-style-type: none"> <li>• Impossible to close the circuit breaker (ON) in case the panel door is open</li> </ul> | <ul style="list-style-type: none"> <li>• Padlocking function which locks using a padlock to prevent handle operation.</li> <li>• Padlock is not provided separately and the number of padlocks depends on the padlock diameter. (Refer to the table below)</li> <li>• As for the specifications of the applicable padlocks, refer to the table below.</li> </ul> |
| Front Contact Type (TFG) | ●   | ●   | ● (100/125/250 AF Only)   | ●  |
| Extension Type (TFH)     | ●   | ●   | -   | ●  |

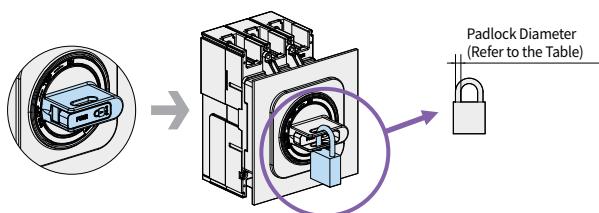

| Application      | Padlock Diameter <sup>1)</sup> | No. of Padlocks that can be Used |
|------------------|--------------------------------|----------------------------------|
| HGM/HGE30 ~ 250  | 6 ~ 8 mm                       | Ø6, Ø7 : 2 EA<br>Ø8 : 1 EA       |
| HGM/HGE400 ~ 800 | 5 ~ 7 mm                       | 3 EA                             |

※ 1) Padlock not included

## Front Connection of Fixed Devices

Straight/spreader bus bar or lug terminal can be selected for use depending on the size specification of the cable or bus bar to be connected to the circuit breaker.

### Insulated Bar Connection


In case the bus bar pitch of the switchgear is equal to the circuit breaker, it can be connected directly to the circuit breaker by using an insulation tube. Refer to the following connection bus bar specification for connection. Interphase barrier and terminal cover must be used.

| Application                   | Connection Bus Bar Dimensions (mm) |      |                                  |          | Applicable Bolt and Tightening Torque |                                 |
|-------------------------------|------------------------------------|------|----------------------------------|----------|---------------------------------------|---------------------------------|
|                               | A                                  | B    | C                                | D        | Bolt Spec.                            | Max. Tightening Torque (kgf×cm) |
| HGM/HGE<br>30, 50E/S, 60, 100 | < 7.5                              | < 17 | $\emptyset \geq 5.5$<br>(≤ 50 A) | A + 7.5  | M5 Screw<br>(≤ 50 A)                  | 28.5                            |
|                               | < 7.5                              | < 17 | $\emptyset \geq 9$<br>(> 50 A)   | A + 7.5  | M8 Screw<br><td>110</td>              | 110                             |
| HGM/HGE50H/L, 125             | < 7.5                              | < 20 | $\emptyset \geq 9$               | A + 7.5  | M8 Screw                              | 110                             |
| HGM/HGE160, 250               | < 10                               | < 27 | $\emptyset \geq 9$               | A + 10   | M8 Hex Socket                         | 110                             |
| HGM/HGE400                    | < 12.5                             | < 30 | $\emptyset \geq 11$              | A + 12.5 | M10 Hex Socket                        | 270                             |
| HGM/HGE630, 800               | < 12.5                             | < 45 | $\emptyset \geq 13$              | A + 12.5 | M12 Hex Socket                        | 470                             |



### Crimp Terminal

The terminal that conforms to the specification (crimped/copper tubing terminal) must be used and the interphase barrier and the terminal cover must be used. Select the terminal that meets the material and specification of the cable according to the circuit breaker's rating. The terminal is not provided separately. Refer to the table below for the wire specifications for the main ratings.

| Application                   | Type | Rated Current | Cu Cable Size (mm <sup>2</sup> ) | Applicable Terminal Dimensions (mm) |      |
|-------------------------------|------|---------------|----------------------------------|-------------------------------------|------|
|                               |      |               |                                  | A                                   | B    |
| HGM/HGE<br>30, 50E/S, 60, 100 | 32   | 6             | $\emptyset \geq 5.5$             | $\emptyset \geq 5.5$                | < 18 |
|                               | 50   | 10            | $\emptyset \geq 5.5$             |                                     |      |
|                               | 63   | 16            | $\emptyset \geq 9$               |                                     |      |
|                               | 100  | 35            | $\emptyset \geq 9$               |                                     |      |
| HGM/HGE50H/L, 125             | 50   | 10            | $\emptyset \geq 9$               | < 21                                | < 21 |
|                               | 125  | 50            |                                  |                                     |      |
| HGM/HGE160, 250               | 160  | 70            | $\emptyset \geq 9$               | < 28                                | < 28 |
|                               | 250  | 120           | $\emptyset \geq 9$               |                                     |      |
| HGM/HGE400                    | 400  | 240           | $\emptyset \geq 11$              | < 30                                | < 30 |
| HGM/HGE630, 800               | 800  | 240×2         | $\emptyset \geq 13$              |                                     |      |

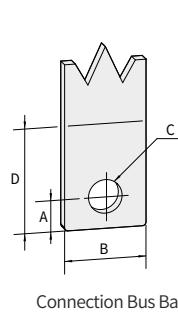

Connection Bus Bar



Crimped Terminal

## External Accessories (HGM)

### Front Connection of Fixed Devices

#### Busbar

##### Straight Busbar

It is used to meet the cable and standards of the switchgear.  
(Pitch between the poles maintained)

##### Spreader Busbar

It is used to extend the internal insulation distance of the switchgear. (Pitch between the poles extended)

| Application         |      | Straight    |       | Spreader      |       | Thickness |
|---------------------|------|-------------|-------|---------------|-------|-----------|
| Type                | Pole | Type        | Pitch | Type          | Pitch |           |
| HGM/HGE<br>160, 250 | 2    | TBB 25GP 2S | 35 mm | -             | 45 mm | 4 mm      |
|                     | 3    | TBB 25GP 3S |       | TBB 25GP 3E45 |       |           |
|                     | 4    | TBB 25GP 4S |       | TBB 25GP 4E45 | -     |           |
| HGM/HGE<br>400      | 2    | TBB 40GM 2S | 44 mm | -             | 59 mm | 8 mm      |
|                     | 3    | TBB 40GM 3S |       | TBB 40GM 3E59 |       |           |
|                     | 4    | TBB 40GM 4S |       | TBB 40GM 4E59 | -     |           |
| HGM/HGE<br>630      | 2    | TBB 63GM 2S | 70 mm | -             | -     | 8 mm      |
|                     | 3    | TBB 63GM 3S |       | -             | -     |           |
|                     | 4    | TBB 63GM 4S |       | -             | -     |           |
| HGM/HGE<br>800      | 2    | TBB 80GM 2S | 70 mm | -             | -     | 10 mm     |
|                     | 3    | TBB 80GM 3S |       | -             | -     |           |
|                     | 4    | TBB 80GM 4S |       | -             | -     |           |

#### LUG Terminal

As a part that connects the cable to the circuit breaker so that the cable can be used without crimp terminal, it must be selected according to the product's rating and size of cable.

| Application                               |      | LUG Terminal   |          | Applicable Cable |          |                      | Tightening Torque<br>(kgf×cm) |     |
|---|------|----------------|----------|------------------|----------|----------------------|-------------------------------|-----|
| Type                                      | Pole | Type           | Material | EA               | Material | S (mm <sup>2</sup> ) | L (mm)                        |     |
| HGM/HGE<br>30, 50E/S, 60, 100<br>(≤ 50 A) | 2    | CTB 10GM 2S50  | Al       | 1                | Cu/Al    | 2.5 ~ 16             | 14                            | 60  |
|   | 3    | CTB 10GM 3S50  |          |                  |          |                      |                               |     |
|   | 4    | CTB 10GM 4S50  |          |                  |          |                      |                               |     |
| HGM/HGE<br>60, 100<br>(> 50 A)            | 2    | CTB 10GM 2S100 | Al       | 1                | Cu/Al    | 16 ~ 50              | 14                            | 60  |
|   | 3    | CTB 10GM 3S100 |          |                  |          |                      |                               |     |
|   | 4    | CTB 10GM 4S100 |          |                  |          |                      |                               |     |
| HGM/HGE<br>50H/L, 125                     | 2    | CTB 12GM 2S    | Al       | 1                | Cu/Al    | 2.5 ~ 70             | 14                            | 60  |
|   | 3    | CTB 12GM 3S    |          |                  |          |                      |                               |     |
|   | 4    | CTB 12GM 4S    |          |                  |          |                      |                               |     |
| HGM/HGE<br>160, 250                       | 2    | CTB 25GM 2S    | Al       | 1                | Cu/Al    | 50 ~ 180             | 19                            | 140 |
|   | 3    | CTB 25GM 3S    |          |                  |          |                      |                               |     |
|   | 4    | CTB 25GM 4S    |          |                  |          |                      |                               |     |
| HGM/HGE<br>400                            | 3    | CTB 40GM 3S1H  | Al       | 1                | Cu/Al    | 60 ~ 240             | 30 ~ 60                       | 353 |
|   | 4    | CTB 40GM 4S1H  |          |                  |          | 60 ~ 125             |                               |     |
| HGM/HGE<br>400                            | 3    | CTB 40GM 3S    | Al       | 2                | Cu/Al    | 60 ~ 240             | 30 ~ 60                       | 353 |
|   | 4    | CTB 40GM 4S    |          |                  |          | 60 ~ 125             |                               |     |
| HGM/HGE<br>630, 800                       | 3    | CTB 80GM 3S    | Al       | 3                | Cu/Al    | 60 ~ 185             | 30 ~ 60                       | 353 |
|   | 4    | CTB 80GM 4S    |          |                  |          | 60 ~ 185             |                               |     |

※ Quantity per Set : 2P - 2 EA, 3P - 3 EA, 4P - 4 EA

This type is inch type. For HGM100~250, ISO type (mm) is also available.



Straight  
Busbar



Spreader  
Busbar

LUG Terminal



HGM/HGE30 ~ 250



HGM400




HGM/HGE630, 800



## Plug-in Connection Devices

If the plug-in connection method is used, the circuit breaker can be replaced quickly and accurately without separating the power cable during a malfunction of a circuit breaker. Therefore, if plug-in type circuit breaker is installed in important electrical facilities such as shipping, broadcast station and others, the circuit breaker can be replaced and maintained quickly and conveniently without disconnecting the bus bar.

- Applicable to 32 ~ 800 AF.
- Offers convenient maintenance of switchgear.
- Convenient and relaxed installation after manufacture of the switchgear.
- Circuit breaker can be removed or replaced quickly without touching the terminal connection area.
- Connection block can be made by connecting the internal accessory to the circuit breaker.
- Type : For switchgear (TDM/TDF), for distribution board (TDA)
- Composition : Plug-in devices, plug-in MCCB, terminal cover or insulation barrier (Option).

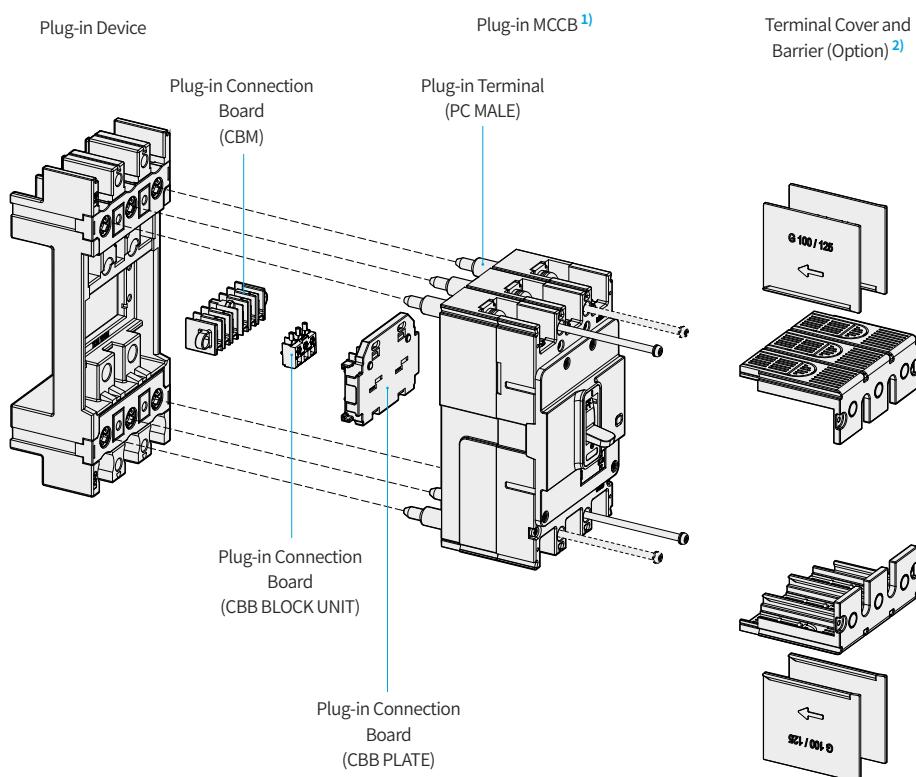

※ 1) Plug-in MCCB must be used to apply plug-in connection method.

2) In case of not using the terminal cover, be sure to install a interphase barrier.

## External Accessories (HGM)

### HG-MCCB Plug-in CBM Wiring Position (TDM Front Side)

| Option   | HGM30,<br>50E/S, 60,<br>100 / 2P | HGM30, 50E/S,<br>60, 100 | HGM50H/L,<br>125, 160, 250         | HGM400,<br>630, 800                                    | HGP50D, 125D,<br>160D           | HGP250                          | HGP630                                    | HGP800                             |
|--|----------------------------------|--------------------------|------------------------------------|--|---------------------------------|---------------------------------|---|------------------------------------|
| AUX  | [12]1110                         | [12]1110                 | [12]1110                           |  | [12]1110                        | [12]1110                        | [10<br>11<br>12]                          | [10<br>11<br>12]                   |
| AUX2   |                                  | [12]1110[22]2120         | [12]1110[22]2120                   |  | [12]1110[22]2120                | [12]1110[22]2120                | [10<br>11<br>12<br>20<br>21<br>22]        | [10<br>11<br>12<br>20<br>21<br>22] |
| AUX3   |                                  |                          | [12]1110<br>[22]2120[23]130        | [30<br>31<br>32<br>20<br>21<br>22]<br>[10<br>11<br>12] |                                 |                                 | [10<br>11<br>12<br>20<br>21<br>22]        | [10<br>11<br>12<br>20<br>21<br>22] |
| ALT  | [9:8:7]                          | [9:8:7]                  | [9:8:7]                            | [7<br>8<br>9<br>10<br>11<br>12]                        | [9:8:7]                         | [9:8:7]                         | [7<br>8<br>9<br>10<br>11<br>12]           | [9:8:7]                            |
| SHT/UVT  |                                  | [b5 - 1/3]               | [b5 - 1/3]                         | [1/3<br>-<br>b5]                                       | [2/5 - 1/3]                     | [2/5 - 1/3]                     | [1/3<br>-<br>2/5]                         | [1/3<br>-<br>2/5]                  |
| AUX+ALT  |                                  | [9:8:7][12]1110          | [9:8:7][12]1110                    | [7<br>8<br>9<br>10<br>11<br>12]                        | [9:8:7][12]1110                 | [9:8:7][12]1110                 | [10<br>11<br>12<br>20<br>21<br>22]        | [10<br>11<br>12]                   |
| AUX2+ALT   |                                  |                          | [9:8:7][22]2120                    | [7<br>8<br>9<br>10<br>11<br>12]                        | [9:8:7][22]2120                 | [9:8:7][22]2120                 | [10<br>11<br>12<br>20<br>21<br>22]        | [10<br>9:8:7]                      |
| AUX3+ALT   |                                  |                          | [9:8:7][23]130<br>[12]1110[22]2120 | [7<br>8<br>9<br>10<br>11<br>12]                        |                                 |                                 | [10<br>11<br>12<br>20<br>21<br>22]        | [10<br>9:8:7]                      |
| AUX+<br>SHT/UVT  |                                  | [12]1110[25 - 1/3]       | [12]1110[25 - 1/3]                 | [1/3<br>-<br>10<br>11<br>12]                           | [12]1110<br>[2/5 - 1/3]         | [2/5 - 1/3][12]1110             | [1/3<br>10<br>11<br>12<br>20<br>21<br>22] | [1/3<br>10<br>11<br>12]            |
| AUX2+<br>SHT/UVT                                       |                                  |                          | [12]1110[25 - 1/3]<br>[22]2120     | [20<br>21<br>22<br>1/3<br>10<br>11<br>12]              | [12]1110<br>[2/5 - 1/3][22]2120 | [2/5 - 1/3][12]1110<br>[22]2120 | [1/3<br>10<br>11<br>12<br>20<br>21<br>22] | [1/3<br>10<br>11<br>12]            |
| AUX3+<br>SHT/UVT                                       |                                  |                          |                                    | [30<br>31<br>32<br>20<br>21<br>22]<br>[10<br>11<br>12] |                                 |                                 | [1/3<br>10<br>11<br>12<br>20<br>21<br>22] | [1/3<br>10<br>11<br>12]            |
| ALT+<br>SHT/UVT  |                                  | [9:8:7][25 - 1/3]        | [9:8:7][25 - 1/3]                  | [7<br>8<br>9<br>1/3<br>-<br>2/5]                       | [9:8:7]<br>[2/5 - 1/3]          | [9:8:7]<br>[2/5 - 1/3]          | [1/3<br>-<br>2/5<br>7<br>8<br>9]          | [1/3<br>-<br>2/5<br>9:8:7]         |
| AUX+ALT+<br>SHT/UVT                                    |                                  |                          |                                    | [7<br>8<br>9<br>1/3<br>-<br>10<br>11<br>12]            | [9:8:7][12]1110<br>[2/5 - 1/3]  | [9:8:7][12]1110<br>[2/5 - 1/3]  | [1/3<br>10<br>11<br>12<br>20<br>21<br>22] | [1/3<br>10<br>9:8:7]               |
| AUX+ALT+<br>SHT/UVT<br>Max.<br>Mounting<br>Combination |                                  |                          |                                    | [7<br>8<br>9<br>10<br>11<br>12]                        | [9:8:7][12]1110<br>[2/5 - 1/3]  | [9:8:7][12]1110<br>[2/5 - 1/3]  | [1/3<br>10<br>11<br>12<br>20<br>21<br>22] | [1/3<br>10<br>9:8:7]               |

## Plug-in Connection Block

It is a connection block enables plug-in connection method, and it can be connected to the internal and external accessory of the circuit breaker.

| Application                   |                      |                  |               |
|-------------------------------|----------------------|------------------|---------------|
| HGM100 ( $\leq 50\text{ A}$ ) |                      |                  |               |
| HGM100 ( $> 50\text{ A}$ )    |                      |                  |               |
| HGM125                        | CBM 10GM 2PUNIT (2P) | CBB BLOCK UNIT   | CBBPLATE 10GM |
| HGM250                        | CBM 10GM UNIT (3P)   | CBB BLOCK UNIT2C |               |
| HGM400                        |                      |                  | CBBPLATE 40GM |
| HGM800                        |                      |                  | CBBPLATE 80GM |
| Quantity per Set              | 1                    | 1                | 1             |

## Plug-in Terminal

It is a part that can implement the plug-in MCCB.

| Application                   |                   |
|-------------------------------|-------------------|
| HGM100 ( $\leq 50\text{ A}$ ) | PCMALE 10GM 50 A  |
| HGM100 ( $> 50\text{ A}$ )    | PCMALE 10GM 100 A |
| HGM125                        | PCMALE 12GM       |
| HGM250                        | PCMALE 25GM       |
| HGM400                        | PCMALE 40GM       |
| HGM800                        | PCMALE 80GM       |
| Quantity per Set              | 6                 |

## External Accessories (HGM)

### Plug-in Devices

It is a connection block for plug-in MCCB installation and it is available according to the applicable panel and usage.

#### TDM Type

- TDM-P : It is comprised of plug-in terminal for both line/load for convenient use of connection block depending on the structure of the switchgear.
- TDM-F : Only plug-in parts of the line terminal are provided in TDM-P products.

#### TDF Type

- Only the line terminal is comprised of plug-in terminal but the plug-in device can be fixed to the switchgear using the same method as TDM-P.


| Applied Panel<br>Type | Switchgear     |             | Distribution Board |                            |
|-----------------------|----------------|-------------|--------------------|----------------------------|
|                       | TDM-P          | TDM-F       | TDF                | TDA (2 row)<br>TDA (1 row) |
| Composition           |                |             |                    |                            |
| Purpose               | Line/Load Side | Line Side   | Line Side          | Duble Base                 |
| HGM/HGE Type          | 32 ~ 800 AF    | 32 ~ 800 AF | 32 ~ 125 AF        | 32 ~ 125 AF                |
| Pole                  | 3P             | 3P          | 3P                 | 2P (100 AF Only), 3P       |
|                       |                |             |                    | Single Base                |
|                       |                |             |                    | 3P                         |

### Specification of Connection Busbar



The bus bar of the switchgear can directly be connected to the plug-in device. The specifications of the applicable bus bar are as below and the insulation barrier or terminal cover must be used.

| Product                   | A      | B    | C                       | D      | Remark |
|---------------------------|--------|------|-------------------------|--------|--------|
| HGM/HGE30, 50E/S, 60, 100 | < 10   | < 21 | $\varnothing \geq 6.5$  | < 17.5 |        |
| HGM/HGE50H/L, 125         | < 10   | < 21 | $\varnothing \geq 6.5$  | < 19.5 |        |
| HGM/HGE160, 250           | < 17.5 | < 25 | $\varnothing \geq 8.5$  | < 27.5 |        |
| HGM/HGE400                | < 22   | < 32 | $\varnothing \geq 10.5$ | < 38   |        |
| HGM/HGE630, 800           | < 30   | < 40 | $\varnothing \geq 17$   | < 48.5 |        |

Unit : mm



| Product                   | A     | B    | C                    | D    | Remark |
|---------------------------|-------|------|----------------------|------|--------|
| HGM/HGE30, 50E/S, 60, 100 | < 7.5 | < 15 | $\varnothing \geq 7$ | < 13 |        |
| HGM/HGE50H/L, 125         | < 7.5 | < 15 | $\varnothing \geq 7$ | < 13 |        |
| HGM/HGE160, 250           | -     | -    | -                    | -    |        |
| HGM/HGE400                | -     | -    | -                    | -    |        |
| HGM/HGE630, 800           | -     | -    | -                    | -    |        |

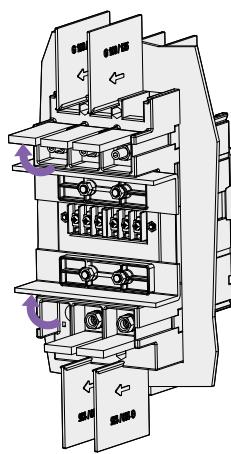


## Rear Connection Terminal

It is a part for rear connection instead of front connection requirement it applies the fixed type of circuit breaker to the switchgear. The bus bar of the switchgear can be wired vertically or horizontally depending on the assembly direction of the connection.

### Flat Type

| Application                               |      | Rear Terminal    |                  | Quantity per Set |               |
|---|------|------------------|------------------|------------------|---------------|
| Type                                      | Pole | Line Side        | Load Side        | Short Terminal   | Long Terminal |
| HGM/HGE<br>30, 50E/S, 60, 100<br>(≤ 50 A) | 2    |                  | RCT 05GM F2      | 1                | 1             |
|   | 3    |                  | RCT 05GM F3      | 2                | 1             |
|   | 4    |                  | RCT 05GM F4      | 2                | 2             |
| HGM/HGE<br>60, 100 (> 50 A)               | 2    |                  | RCT 10GM F2      | 1                | 1             |
|   | 3    |                  | RCT 10GM F3      | 2                | 1             |
|   | 4    |                  | RCT 10GM F4      | 2                | 2             |
| HGM/HGE<br>50H/L, 125                     | 2    |                  | RCT 12GM F2      | 1                | 1             |
|   | 3    |                  | RCT 12GM F3      | 2                | 1             |
|   | 4    |                  | RCT 12GM F4      | 2                | 2             |
| HGM/HGE<br>160, 250                       | 2    |                  | RCT 25GM F2      | 2                | 0             |
|   | 3    |                  | RCT 25GM F3      | 2                | 1             |
|   | 4    |                  | RCT 25GM F4      | 2                | 2             |
| HGM/HGE<br>400                            | 3    | RCT 40GM F3 LINE | RCT 40GM F3 LOAD | 2                | 1             |
|   | 4    | RCT 40GM F4 LINE | RCT 40GM F4 LOAD | 2                | 2             |
| HGM/HGE<br>630, 800                       | 3    | RCT 80GM F3 LINE | RCT 80GM F3 LOAD | 2                | 1             |
|   | 4    | RCT 80GM F4 LINE | RCT 80GM F4 LOAD | 2                | 2             |

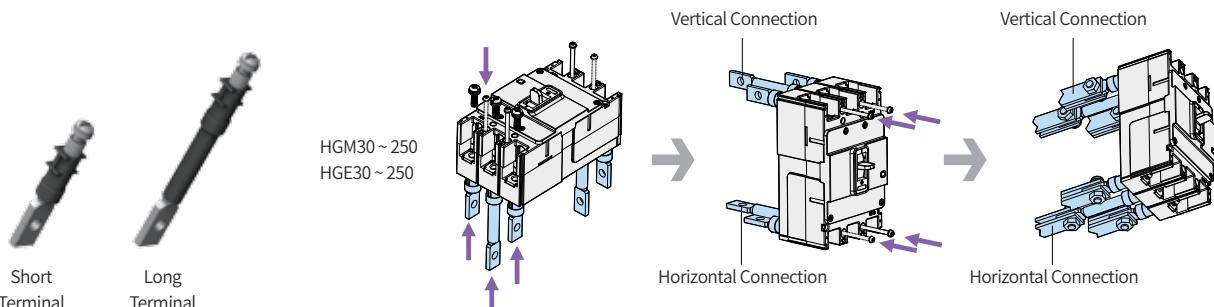


※When assembling the RCT, remove the back barrier in advance.

## DIN Rail Adaptor

This is a part that enables a separate adaptor to be assembled and mounted for rear connection with the circuit breaker when the circuit breaker is mounted on the DIN Rail.  
(HGM/HGE100 Only)

| Application                   |      | Din Rail Adapter | Quantity |
|-------------------------------|------|------------------|----------|
| Type                          | Pole |                  |          |
| HGM/HGE<br>30, 50E/S, 60, 100 | 2    | DRA 10GM         | 1        |
|                               | 3    | DRA 10GM         | 1        |
|                               | 4    | DRA 10GM         | 2        |

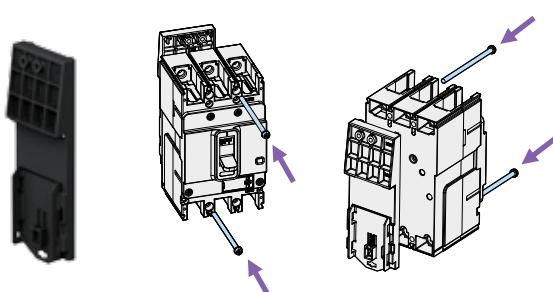

※ When assembling the DRA, remove the back barrier in advance.

## External Accessories (HGM)

### Motor Operator

This device is used for turning the circuit breaker ON/OFF in remote position.


It is convenient for establishing automation system for low-voltage system and for selecting load when operating under emergency power.

| Application           |  | Pole | MOT      | Voltage |
|-----------------------|--|------|----------|---------|
| Type                  |  |      |          |         |
| HGM30, 50E/S, 60, 100 |  | 3, 4 | MOT 10GM |         |
| HGM50H/L, 125         |  | 3, 4 | MOT 12GM |         |
| HGM160, 250           |  | 3, 4 | MOT 25GM |         |
| HGM400                |  | 3, 4 | MOT 40GM |         |
| HGM630, 800           |  | 3, 4 | MOT 80GM |         |



### Rating and Characteristics

| Format   | Mechanical Lifespan | Operational Voltage | Operational Current (A) | Operating Time (ms) |         | Power Consumption (W) |
|----------|---------------------|---------------------|-------------------------|---------------------|---------|-----------------------|
|          |                     |                     |                         | Closing             | Opening |                       |
| MOT 10GM | 10,000              | DC 24 V             | ≤ 2.5                   | 1,000               | 1,000   | 14                    |
|          |                     | AC/DC 110 V         | ≤ 0.5                   |                     |         |                       |
|          |                     | AC/DC 240 V         | ≤ 0.5                   |                     |         |                       |
| MOT 12GM | 10,000              | DC 24 V             | ≤ 2.5                   | 1,000               | 1,000   | 14                    |
|          |                     | AC/DC 110 V         | ≤ 0.5                   |                     |         |                       |
|          |                     | AC/DC 240 V         | ≤ 0.5                   |                     |         |                       |
| MOT 25GM | 8,000               | DC 24 V             | ≤ 2.5                   | 1,000               | 1,000   | 14                    |
|          |                     | AC/DC 110 V         | ≤ 0.5                   |                     |         |                       |
|          |                     | AC/DC 240 V         | ≤ 0.5                   |                     |         |                       |
| MOT 40GM | 5,000               | DC 24 V             | ≤ 6.0                   | 1,200               | 1,200   | 14                    |
|          |                     | AC/DC 110 V         | ≤ 3.0                   |                     |         |                       |
|          |                     | AC/DC 240 V         | ≤ 2.0                   |                     |         |                       |
| MOT 80GM | 5,000               | DC 24 V             | ≤ 6.0                   | 1,200               | 1,200   | 35                    |
|          |                     | AC/DC 110 V         | ≤ 3.0                   |                     |         |                       |
|          |                     | AC/DC 240 V         | ≤ 2.0                   |                     |         |                       |

※ Operating Voltage Range : 85 ~ 110 % (DC 24 V : 95 ~ 110 %)



Circuit and Wiring Drawing

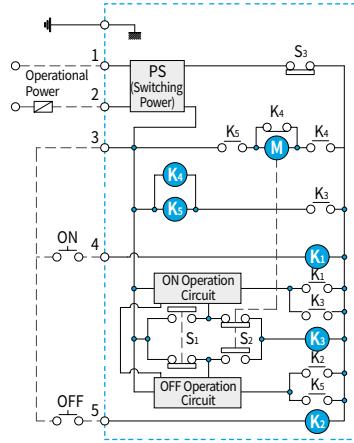

**(M)** : Motor  
**(K1, K2)** : Relay for Motor  
**(K3, K5)** : OFF Relay  
**S1** : ON Limit Switch  
**S2** : OFF Limit Switch  
**S3** : Auto/Manual Limit Switch

※ Precaution for mounting

When mounting the motor operator on MCCB, it must be mounted when the MCCB's handle position is in OFF position.  
Mounting the motor operator in other positions (ON, TRIP) may cause damage to the motor.

## External Accessories (HGP)

### Locking Device

#### Padlock Device (PLD)

This device is used for locking the handle of circuit breaker to the OFF position by using a padlock. Padlock is not provided separately and up to 3 can be used. The applicable specifications of padlocks are as below.

| Type     | Application              | Padlock Diameter <sup>1)</sup> |
|----------|--------------------------|--------------------------------|
| PLD 16GP | HGP50D, HGP125D, HGP160D |                                |
| PLD 25GP | HGP250 (HGP100/MCP)      |                                |
| PLD 63GP | HGP400, HGP630           | 5 ~ 6 mm                       |
| PLD 80GP | HGP800                   |                                |

※ 1) Padlock not included







#### Mechanical Interlock

This device interlocks two circuit breakers by using a mechanical interlock.


#### Key Features

- It prevents two breakers from closing at the same time.
- All circuit breakers are open. The applicable specifications of padlocks are as below.


| Type       | 3P          | 4P | Application              | Padlock Diameter <sup>1)</sup> |
|------------|-------------|----|--------------------------|--------------------------------|
| MIF 16GP 3 | MIF 16GP R4 |    | HGP50D, HGP125D, HGP160D |                                |
| MIF 25GP 3 | MIF 25GP R4 |    | HGP250 (HGP100/MCP)      |                                |
| MIF 63GP 3 | MIF 63GP R4 |    | HGP400, HGP630           | 5 ~ 7 mm                       |
| MIF 80GP 3 | MIF 80GP R4 |    | HGP800                   |                                |

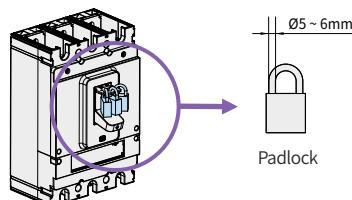

Right Off Lock



Left Off Lock



Double Off Lock

## External Accessories (HGP)

### Terminal Cover / Insulation Barrier

#### Terminal Cover

It is our insulation part of circuit breaker for live and load side of terminal area from the outside and it prevents electric shock and short-circuit accidents that may occur due to direct contact of people's hand or tools with the live current part. When the terminal cover is used, the protection degree of IP40 is applied to the conductor part. Based on the connection method of the circuit breaker, it can be classified into long or short type for use and various handles and interlock devices can be combined for use.

#### Short Type

It is suitable for plug-in or rear connection.

#### Long Type

It is suitable for front connection using wires, bus bar or lug terminals.

| Type               |               |               | Application              | Pitch (mm) | No. of Parts (EA/Set) |
|--------------------|---------------|---------------|--------------------------|------------|-----------------------|
| 3P Short (Plug-in) | 3P Long (3P)  | 4P Long (4P)  |                          |            |                       |
| TCF 16GP S3        | TCF 16GP L3   | TCF 16GP L4   | HGP50D, HGP125D, HGP160D | 30         | 1                     |
| TCF 25GP-G S3      | TCF 25GP-G L3 | TCF 25GP-G L4 | HGP250 (HGP100/MCP)      | 35         | 1                     |
| TCF 63GP S3        | TCF 63GP L3   | TCF 63GF L4   | HGP400, HGP630           | 46.5       | 1                     |
| TCF 80GP S3        | TCF 80GP L3   | TCF 80GF L4   | HGP800                   | 70         | 1                     |




Terminal Cover  
Short Type



Terminal Cover  
Long Type

※ In case of using as front connection,  
please use it after removing the  
indicated part.

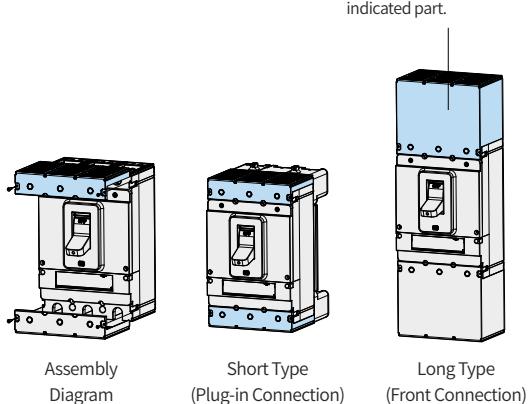

#### Insulation Barrier


As a part used to prevent accidents with regards to insulation and conductive foreign substance between the circuit breaker terminals, it improves the performance of phase-to-phase insulation by installing it in the groove between the circuit breaker's terminals. It can easily be assembled even if the circuit breaker has already been installed and in case the two circuit breakers have been installed side by side, it can also be assembled in the gap between the two circuit breakers. In addition, it is used in the terminal cover and plug-in base. In case insulation barrier is not mounted between the circuit breaker's terminal, it may cause secondary short-circuit accidents so it must be used.

| Type         |              | Application              | No. of Parts (EA/Set) |    |
|--------------|--------------|--------------------------|-----------------------|----|
| 3P           | 4P           |                          | 3P                    | 4P |
| TQQ 16GP 3   | TQQ 16GP 4   | HGP50D, HGP125D, HGP160D | 4                     | 6  |
| TQQ 25GP-G 3 | TQQ 25GP-G 4 | HGP250 (HGP100/MCP)      | 4                     | 6  |
| TQQ 63GP 3   | TQQ 63GP 4   | HGP400, HGP630           | 4                     | 6  |
| TQQ 80GP 3   | TQQ 80GP 4   | HGP800                   | 4                     | 6  |



Insulation Barrier

※ Additional barrier required for close mounting is provided as additional options.  
(It may cause secondary accidents, so it must be installed.)

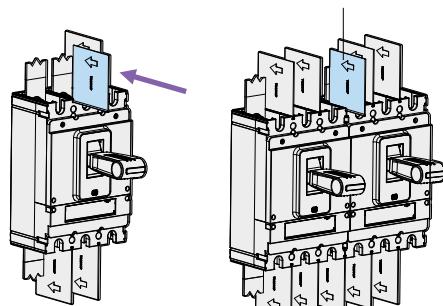

## Rotary Handle

Rotary handle is a product that can check and operate MCCB's ON/OFF/TRIP even when the panel door is closed by installing the circuit breaker in enclosed switchgear or on MCCB panel and others. There are two types of rotary handle, front contact type and extension type and all the rotary handles offer panel door locking function and handle locking function. The rotary handle can be rotated clockwise to turn the circuit breaker "ON" and according to the mounting direction of MCCB, it is categorized into the upper line, the right line and the left line. The IP grade of the handle is IP40.

### Front Contact Rotary Handle


- 160 ~ 250 AF : The handle is installed directly to the circuit breaker.
- 630 ~ 800 AF : The handle is installed to the door of the panel.

### Extension Rotary Handle

It is suitable if the distance between the circuit breaker and the panel door is long. The handle is installed to the door of the panel and there is no trip-button function.

| Type       | Application |            |                          |
|------------|-------------|------------|--------------------------|
| Upper Line | Right Line  | Left Line  |                          |
| TFG 16GP U | TFG 16GP R  | TFG 16GP L | HGP50D, HGP125D, HGP160D |
| TFG 25GP U | TFG 25GP R  | TFG 25GP L | HGP250 (HGP100/MCP)      |
| TFG 63GP U | TFG 63GP R  | TFG 63GP L | HGP400, HGP630           |
| TFG 80GP U | TFG 80GP R  | TFG 80GP L | HGP800                   |

| Type     | Application              |
|----------|--------------------------|
| TFH 16GP | HGP50D, HGP125D, HGP160D |
| TFH 25GP | HGP250 (HGP100/MCP)      |
| TFH 63GP | HGP400, HGP630           |
| TFH 80GP | HGP800                   |

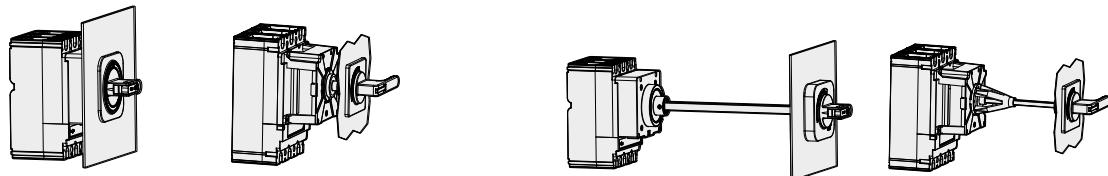

HGP50D, HGP125D  
HGP160D, HGP250

HGP400, HGP630  
HGP800

HGP50D, HGP125D  
HGP160D, HGP250

HGP400, HGP630  
HGP800


※ When installing an extension rotary handle, the eccentric tolerance of the handle drive shaft is 1.5 degrees.

## External Accessories (HGP)

### Rotary Handle

#### Types of Handle by the Circuit Breaker's Installation Type


Rotary handle is divided into the following three types by the circuit breaker's direction of power supply.

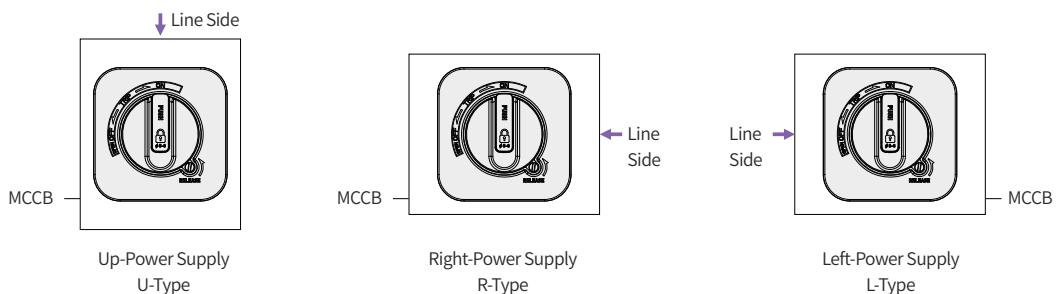

#### How to Operate the Handle

Operating Direction : Turn the handle clockwise to turn the breaker ON.


- Circuit Breaker ON : Rotate the handle to ON position. (Figure 1)
- Circuit Breaker OFF : Rotate the handle to OFF position. (Figure 2)
- Circuit Breaker TRIP : If the circuit breaker is tripped, the handle will automatically return to TRIP position. (Figure 3)
- After the circuit breaker is tripped, rotate the handle to the RESET position first (Figure 4) then rotate to the ON position and the circuit breaker will turn ON (Figure 1).
- If you need to open the door when the handle is in the ON state, rotate the RELEASE screw to the direction of the arrow then open the door (Figure 5).

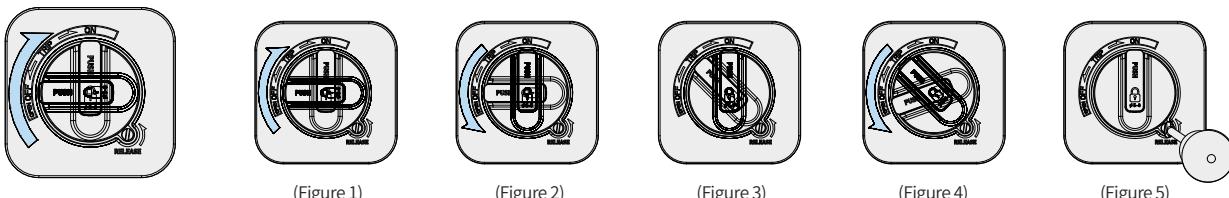

#### Handle Locking Device

| Lock Function            | OFF State Door Lock   | ON State Door Lock  | Reverse Interlock   | Handle Padlock <sup>1)</sup>   |
|--------------------------|---|---|---|--|
| Details                  | <ul style="list-style-type: none"> <li>Impossible to open the panel door when the circuit breaker is in the OFF state.</li> <li>Possible at RESET position</li> <li>Possible to open the panel door after rotating the handle to RESET</li> </ul> | <ul style="list-style-type: none"> <li>Impossible to open the panel door when the circuit breaker is in the ON state</li> <li>Possible to open the panel door after rotating the RELEASE screw</li> </ul> | <ul style="list-style-type: none"> <li>Impossible to close the circuit breaker (ON) in case the panel door is open</li> </ul> | <ul style="list-style-type: none"> <li>Padlocking function which locks using a padlock to prevent handle operation.</li> <li>Padlock is not provided separately and the number of padlocks depends on the padlock diameter. (Refer to the table below)</li> <li>As for the specifications of the applicable padlocks, refer to the table below.</li> </ul> |
| Front Contact Type (TGF) | ●   | ●   | ● (160/250 AF Only)   | ●  |
| Extension Type (TFH)     | ●   | ●   | -   | ●  |

※ 1) For TFG 250 AF or less, The handle remains ON when the circuit breaker is tripped after padlocking in ON position.

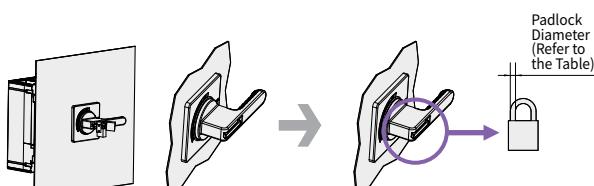

| Application                      | Padlock Diameter <sup>1)</sup> |
|----------------------------------|--------------------------------|
| HGP50D, HGP125D, HGP160D, HGP250 | 6 ~ 8 mm                       |
| HGP400, HGP630, HGP800           | 5 ~ 7 mm                       |

※ 1) Padlock not included

## Front Connection of Fixed Devices

Straight/spreader bus bar or lug terminal can be selected according to the size and specification of the cable or bus bar to be connected to the circuit breaker.

### Insulated Bar Connection


In case the bus bar pitch of the switchgear is equal to the circuit breaker, it can be connected directly to the circuit breaker by using an insulation tube. Refer to the following connection bus bar specification for connection and the insulation barrier between phases and terminal cover must be used.

### Crimped Terminal

Standard terminals (crimped/copper tubing terminal) must be used and the insulation barrier between phases and the terminal cover must be used. Standard terminals must be selected for use according to the rating of the circuit breaker and the terminal is not provided separately. As for the cable specifications with regards to important ratings, refer to the table below.

| Application | Connection Bus Bar Dimensions (mm) |      |       |        | Applicable Bolt and Tightening Torque |                                 |
|-------------|------------------------------------|------|-------|--------|---------------------------------------|---------------------------------|
|             | A                                  | B    | C     | D      | Bolt Spec.                            | Max. Tightening Torque (kgf×cm) |
| 50~160 AF   | < 9                                | < 22 | Ø9    | A+9    | M8 Screw                              | 136                             |
| 250 AF      | < 9                                | < 25 | Ø9    | A+10   | M8 Hex Socket                         | 136                             |
| 400~630 AF  | < 15                               | < 32 | Ø10.5 | A+15   | M10 Hex Socket                        | 270                             |
| 800 AF      | < 15.5                             | < 50 | Ø13   | A+16.5 | M12 Hex Socket                        | 470                             |

| Application | Cu Cable Size (mm <sup>2</sup> ) |               | Applicable Terminal Dimensions (mm) |      |        |
|-------------|----------------------------------|---------------|-------------------------------------|------|--------|
|             | AF                               | Rated Current | A                                   | B    | C      |
| 50~160 AF   | 100 A                            | 35            | Ø9                                  | < 22 | < 9    |
| 250 AF      | 160 A                            | 70            | Ø9                                  | < 25 | < 9    |
| 400~630 AF  | 160 A                            | 70            | Ø10.5                               | < 32 | < 15   |
| 800 AF      | 250 A                            | 120           | Ø10.5                               | < 32 | < 15   |
|             | 400 A                            | 240           | Ø13                                 | < 50 | < 15.5 |
|             | 630 A                            | 185×2         |                                     |      |        |
|             | 800 A                            | 240×2         |                                     |      |        |

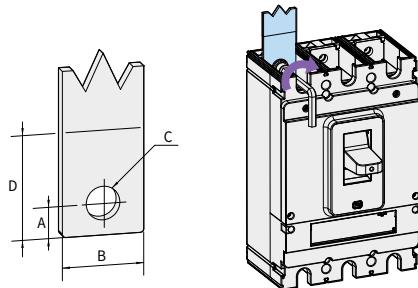

### Busbar

#### Straight Busbar


It is used to meet the cable and standards of the switchgear.  
(Pitch between the poles maintained)

#### Spreader Busbar

It is used to extend the internal insulation distance of the switchgear.  
(Pitch between the poles extended)

#### Series Busbar

Used for serial connection of adjacent phases. (DC only)

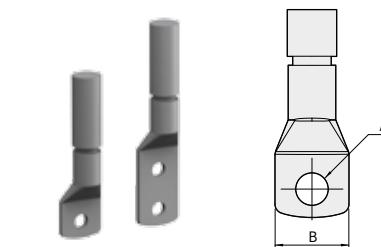

Straight Busbar



Spreader Busbar



Series Busbar

| Application | Straight |      |             | Spreader |                 | Series  |          |
|-------------|----------|------|-------------|----------|-----------------|---------|----------|
|             | Type     | Pole | Type        | Pitch    | Type            | Pitch   | Type     |
| HGP250      | 3        |      | TBB 25GP 3S | 35 mm    | TBB 25GP 3E45   | 45 mm   | SBB 25GP |
|             | 4        |      | TBB 25GP 4S |          | TBB 25GP 4E45   |         |          |
| HGP630      | 3        |      | TBB 63GP 3S | 46.5 mm  | TBB 63GP 3E61.5 | 61.5 mm | SBB 63GP |
|             | 4        |      | TBB 63GP 4S |          | TBB 63GP 4E61.5 |         |          |
| HGP800      | 3        |      | TBB 80GP 3S | 70 mm    | -               | -       | SBB 80GP |
|             | 4        |      | TBB 80GP 4S |          | -               |         |          |

\* Quantity per Set : 3P - 3 EA, 4P - 4 EA, SBB - 1 EA

## External Accessories (HGP)

### LUG Terminals

As a cable connection to the circuit breaker the cable can be used without crimped terminal, it must be selected according to the product's rating and size of cable.

| Application  |      | LUG Terminal |          | Application |          |                      |         | Tightening Torque<br>(kgf×cm) |
|--------------|------|--------------|----------|-------------|----------|----------------------|---------|-------------------------------|
| Type         | Pole | Type         | Material | EA          | Material | S (mm <sup>2</sup> ) | L (mm)  |                               |
| HGP50D       | 3    | CTB 16GP 3   | Steel    | 1           | Cu/Al    | 1.5 ~ 95             | 19      | 140                           |
| HGP125D      |      |              |          |             |          |                      |         |                               |
| HGP160D      | 4    | CTB 16GP 4   |          |             |          |                      |         |                               |
| HGP250       | 3    | CTB 25GP 3   | Al       | 1           | Cu/Al    | 14 ~ 185             | 19      | 140                           |
| (HGP100/MCP) | 4    | CTB 25GP 4   |          |             |          |                      |         |                               |
| HGP400       | 3    | CTB 63GP 3   | Al       | 2           | Cu/Al    | 60 ~ 240             | 30 ~ 60 | 353                           |
| HGP630       | 4    | CTB 63GP 4   |          |             |          |                      |         |                               |
| HGP800       | 3    | CTB 80GP 3   | Al       | 3           | Cu/Al    | 60 ~ 185             | 30 ~ 60 | 353                           |
|              | 4    | CTB 80GP 4   |          |             |          |                      |         |                               |

※ Packaging Quantity per Set : Provided in the composition quantity of line or load side (3P - 3 EA, 4P - 4 EA)



HGP50D  
HGP125D  
HGP160D



HGP250







HGP400  
HGP630



HGP800




Wire

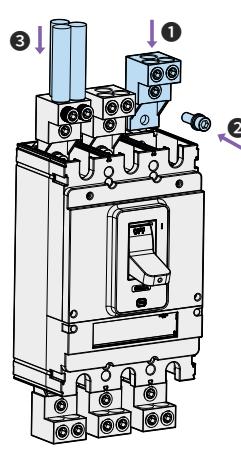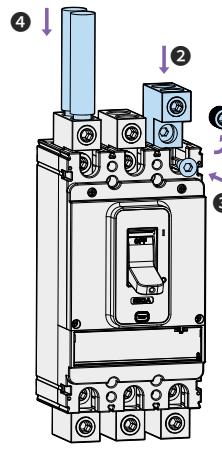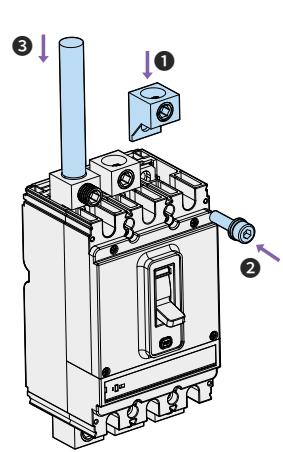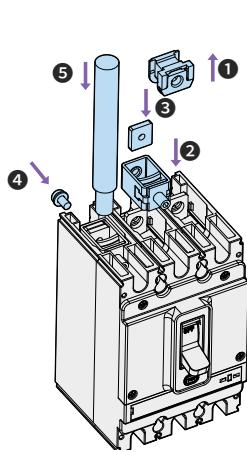

## Plug-in Connection Devices


When the plug-in connection method is used, the circuit breaker can be replaced quickly and accurately without power off during a malfunction of a circuit breaker. Therefore, in case the plug-in method of circuit breaker is installed in important electrical facilities such as shipping, broadcast station and others, the circuit breaker can be replaced and maintained quickly and conveniently without disconnecting the bus bar.

- Applicable to 50 ~ 800 AF, up to 3P.
- Offers convenient maintenance of switchgear.
- Convenient and relaxed installation after manufacture of the switchgear.
- Circuit breaker can be removed or replaced quickly without touching the terminal connection area.
- Type : For switchboard (TDM/TDF)
- Composition : Plug-in devices, plug-in MCCB, terminal cover or insulation barrier (Option)

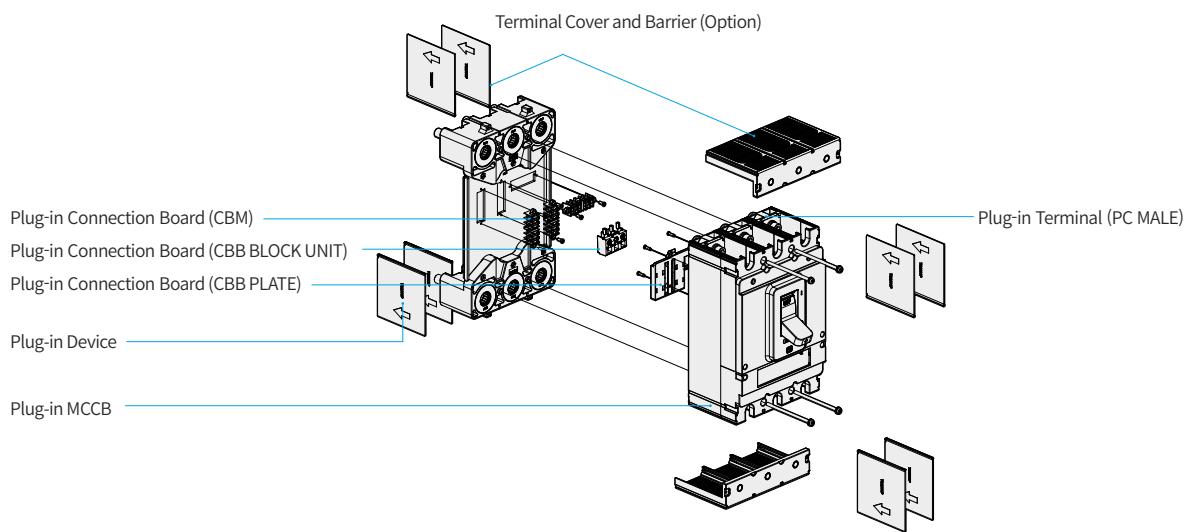

## Plug-in MCCB (For HGP)

In order to apply the plug-in connection method, the plug-in MCCB must be used instead of the general type, even for the MCCB. The product covers various breaking capacity up to the rated current of 800 A so this product conforms to the switchgear standard. Connection board (Connector) can be added to connect internal accessories to the circuit breaker.

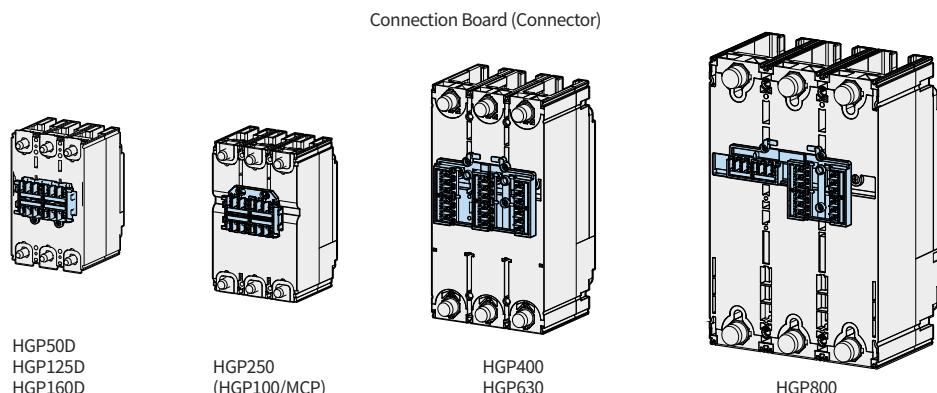

## External Accessories (HGP)



### Plug-in Connection Devices

#### Plug-in Devices

As a connection block in which plug-in MCCB can be installed, it is available according to the applied panel and the purpose.

#### TDM Type

- TDM-P : It is comprised of plug-in terminal for both line/load for convenient use of connection block depending on the structure of the switchgear.
- TDM-F : Only plug-in parts of the line terminal are provided in TDM-P products.

| Applied Panel   | For Switchgear   |   |
|-----------------|--|---|
| Type            | TDM-P  | TDM-F   |
| Composition     |  |  |
| Purpose         | Line/Load Side   | Line Side   |
| Applicable MCCB | HGP50 ~ 800 AF 3P  |   |


#### Specification of Connection Busbar


The bus bar of the switchgear can directly be connected to the plug-in device.


The specifications of the applicable bus bar are as below and the insulation barrier or terminal cover must be used.

There is no separate bus bar for connection.

Unit : mm

| Product      | A    | B    | C                       | D      | Remark  |
|--------------|------|------|-------------------------|--------|---|
| 50 ~ 160 AF  | < 12 | < 21 | $\varnothing \geq 8.5$  | A + 18 |  |
| 250 AF       | < 18 | < 25 | $\varnothing \geq 8.5$  | A + 17 |   |
| 400 ~ 630 AF | < 34 | < 35 | $\varnothing \geq 10.5$ | A + 26 |   |
| 800 AF       | < 30 | < 40 | $\varnothing \geq 16.5$ | A + 30 |   |

| Product      | A    | B    | C                       | D    | Remark  |
|--------------|------|------|-------------------------|------|---|
| 50 ~ 160 AF  | < 12 | < 21 | $\varnothing \geq 8.5$  | < 12 |  |
| 250 AF       | < 18 | < 25 | $\varnothing \geq 8.5$  | < 18 |   |
| 400 ~ 630 AF | < 25 | < 35 | $\varnothing \geq 10.5$ | < 25 |   |
| 800 AF       | < 30 | < 40 | $\varnothing \geq 16.5$ | < 30 |   |

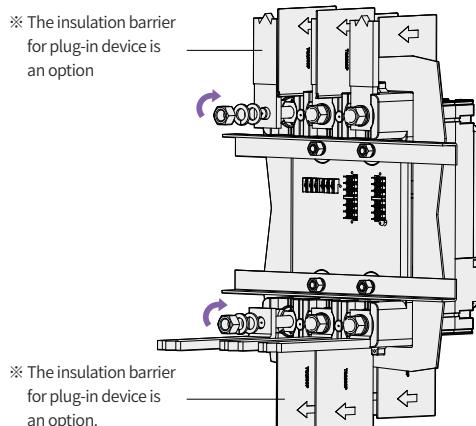




## HG-MCCB Plug-in CBM Wiring Position (TDM Front Side)

| Option                                       | HGP50D, HGP125D,<br>HGP160D | HGP250<br>(HGP100/MCP) | HGP400, HGP630 | HGP800 |
|--|-----------------------------|------------------------|----------------|--------|
| AUX  |                             |                        |                |        |
| AUX2   |                             |                        |                |        |
| AUX3   |                             |                        |                |        |
| ALT  |                             |                        |                |        |
| SHT/UVT                                      |                             |                        |                |        |
| AUX+ALT                                      |                             |                        |                |        |
| AUX2+ALT                                     |                             |                        |                |        |
| AUX3+ALT                                     |                             |                        |                |        |
| AUX+SHT/UVT                                  |                             |                        |                |        |
| AUX2+SHT/UVT                                 |                             |                        |                |        |
| AUX3+SHT/UVT                                 |                             |                        |                |        |
| ALT+SHT/UVT                                  |                             |                        |                |        |
| AUX+ALT+SHT/UVT                              |                             |                        |                |        |
| AUX+ALT+SHT/UVT<br>Max. Mounting Combination |                             |                        |                |        |

## External Accessories (HGP)


### Plug-in Connection Block

In order for the plug-in connection method, it can be connected to the internal and external accessory of the circuit breaker.

| Application      |  |  |  |
|------------------|---|---|---|
| HGP160D          |   |   | CBBPLATE 16GP   |
| HGP250           |   |   | CBBPLATE 25GP   |
| HGP630           |   |   | CBBPLATE 63GP   |
| HGP800           |   |   | CBBPLATE 80GP   |
| Quantity per Set | 1   | 1   | 1   |

### Plug-in Terminal

It is a part that can realize the plug-in MCCB.


| Application      |  |
|------------------|---|
| HGP160D          | PCMALE 16GP   |
| HGP250           | PCMALE 25GP-G   |
| HGP630           | PCMALE 63GP   |
| HGP800           | PCMALE 80GP   |
| Quantity per Set | 6   |

## Rear Connection Terminal

It is a part that is used in case there is a need for rear connection instead of front connection by applying the fixed type of circuit breaker to the switchgear. The bus bar of the switchgear can be wired vertically or horizontally depending on the assembly direction of the connection.


### Flat Type

| Application              | Type | Rear Terminal |                  | Quantity per Set |                |               |
|--------------------------|------|---------------|------------------|------------------|----------------|---------------|
|                          |      | Pole          | Line Side        | Load Side        | Short Terminal | Long Terminal |
| HGP50D, HGP125D, HGP160D | 3    |               | RCT 16GP F3      |                  | 2              | 1             |
|                          | 4    |               | RCT 16GP F4      |                  | 2              | 2             |
| HGP250 (HGP100/MCP)      | 3    |               | RCT 25GP-G F3    |                  | 2              | 1             |
|                          | 4    |               | RCT 25GP-G F4    |                  | 2              | 2             |
| HGP400 HGP630            | 3    |               | RCT 63GP F3 LINE | RCT 63GP F3 LOAD | 2              | 1             |
|                          | 4    |               | RCT 63GP F4 LINE | RCT 63GP F4 LOAD | 2              | 2             |
| HGP800                   | 3    |               | RCT 80GP F3 LINE | RCT 80GP F3 LOAD | 2              | 1             |
|                          | 4    |               | RCT 80GP F4 LINE | RCT 80GP F4 LOAD | 2              | 2             |

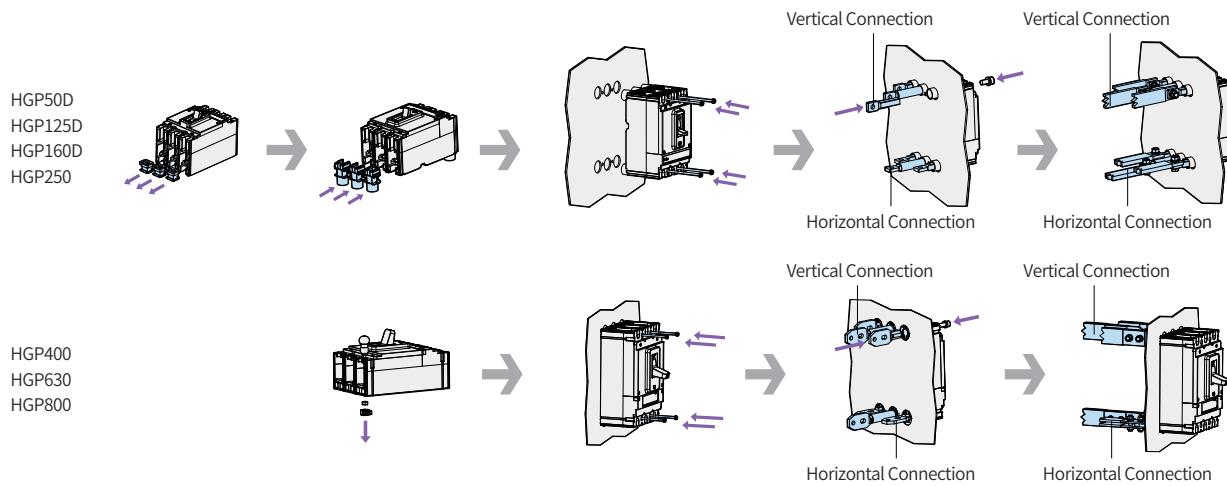

## Auxiliary Handle (THA)

As an auxiliary handle used to reduce the operating force of ON, OFF, RESET in large capacity circuit breaker (400 ~ 800 AF), it is a standard product provided. It comes together with a holder for storing auxiliary handle that can be fixed to the switchboard panel.

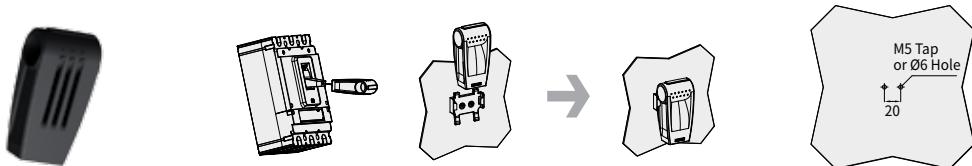

## External Accessories (HGP)

### Motor Operator

This device is used for turning the circuit breaker ON/OFF from remote position. It is convenient for establishing automation system for low-voltage load system and for selecting load when operating under emergency power.



| Application              |      | MOT      | Voltage                               |
|--------------------------|------|----------|---------------------------------------|
| Type                     | Pole |          |                                       |
| HGP50D, HGP125D, HGP160D | 3, 4 | MOT 16GP |                                       |
| HGP250 (HGP100/MCP)      | 3, 4 | MOT 25GP | DC 24 V<br>AC/DC 110 V<br>AC/DC 240 V |
| HGP400, HGP630           | 3, 4 | MOT 63GP |                                       |
| HPG800                   | 3, 4 | MOT 80GP |                                       |

### Rating and Characteristics


| Format   | Operational voltage | Operational Current (A) | Operating Time (ms) |         | Power Consumption (W) | Endurance |
|----------|---------------------|-------------------------|---------------------|---------|-----------------------|-----------|
|          |                     |                         | Closing             | Opening |                       |           |
| MOT 16GP | DC 24 V             | ≤ 2.5                   | 1,000               | 1,000   | 14                    | 10,000    |
|          | AC/DC 110 V         | ≤ 0.5                   |                     |         |                       |           |
|          | AC/DC 240 V         | ≤ 0.5                   |                     |         |                       |           |
| MOT 25GP | DC 24 V             | ≤ 2.5                   | 1,000               | 1,000   | 14                    | 10,000    |
|          | AC/DC 110 V         | ≤ 0.5                   |                     |         |                       |           |
|          | AC/DC 240 V         | ≤ 0.5                   |                     |         |                       |           |
| MOT 63GP | DC 24 V             | ≤ 6.0                   | 1,200               | 1,200   | 35                    | 5,000     |
|          | AC/DC 110 V         | ≤ 3.0                   |                     |         |                       |           |
|          | AC/DC 240 V         | ≤ 2.0                   |                     |         |                       |           |
| MOT 80GP | DC 24 V             | ≤ 6.0                   | 1,200               | 1,200   | 35                    | 5,000     |
|          | AC/DC 110 V         | ≤ 3.0                   |                     |         |                       |           |
|          | AC/DC 240 V         | ≤ 2.0                   |                     |         |                       |           |

※ Range of Operational Voltage : 85 ~ 110 % (DC 24 V : 95 ~ 110 %)

Circuit and Wiring Drawing

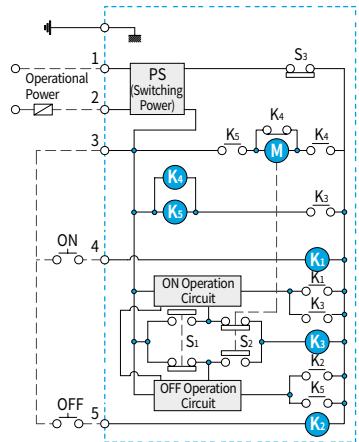

**(M)** : Motor      **(K<sub>1</sub>)** : ON Relay      **(K<sub>2</sub>)** : OFF Relay      **S<sub>1</sub>** : ON Limit Switch  
**(K<sub>3</sub>)** : Relay for Motor      **(K<sub>4</sub>)** : Relay for Motor      **S<sub>2</sub>** : OFF Limit Switch  
**S<sub>3</sub>** : Auto/Manual Limit Switch



※ Precaution for mounting

When mounting the motor operator on MCCB, it must be mounted when the MCCB's handle position is at in position.  
Mounting the motor operator in other positions (ON, TRIP) may cause damage to the motor.



## Technical Data (HGM/HGE)

### Environmental Operating Conditions

#### Temperature Derating


The overcurrent characteristic of MCCB has been set to the ambient temperature of 40 °C. If the ambient temperature is less or more than 40 °C, the overcurrent characteristics may differ.

#### If the Ambient Temperature is lower than 40 °C

In order to ensure that the circuit breaker's overcurrent meet the derating curve at the given ambient temperature, the real current ( $I_r$ ) has to be adjusted. The temperature correction ratio or each MCCB is shown in the circuit breaker's characteristics curve.

#### If the Ambient Temperature is higher than 40 °C

As the internal temperature of MCCB is a sum of increased temperature due to current flow and the ambient temperature, if the ambient temperature exceeds 40 °C, thermal damage of internal insulation material of MCCB may occur causing the circuit breaker to trip at an early stage. When applying ambient temperature higher than 40 °C, the rated current must be adjusted as shown in the following rated current derating table.

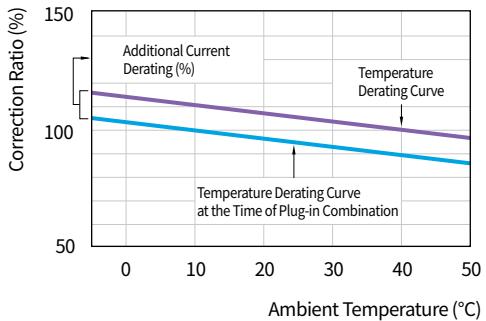

$I_n$  (Rated Current) :

Circuit breaker's rating at ambient temperature of 40 °C

$I_r$  (Real Current) :

Circuit breaker's rating at the given temperature

$$I_r = \text{Correction Ratio (\%)} \times I_n$$

Rated Current Derating Table : HG Type/Standard Mounting

| Model                            | Rated Current (A) | Ambient Temperature (°C) |       |       |     |       |       |       |       |       |       |
|----------------------------------|-------------------|--------------------------|-------|-------|-----|-------|-------|-------|-------|-------|-------|
|                                  |                   | 10                       | 20    | 30    | 40  | 45    | 50    | 55    | 60    | 65    | 70    |
| HGM/HGE<br>30, 50E/S,<br>60, 100 | 16                | 18.9                     | 18.6  | 17.8  | 16  | 15.2  | 14.6  | 14.1  | 13.6  | 13.2  | 12.8  |
|                                  | 20                | 23.58                    | 23.3  | 22.2  | 20  | 19.1  | 18.3  | 17.6  | 17.0  | 16.5  | 16.0  |
|                                  | 25                | 26.8                     | 26.2  | 25.6  | 25  | 24.7  | 24.4  | 24.1  | 23.8  | 23.5  | 23.2  |
|                                  | 32                | 34.3                     | 33.5  | 32.8  | 32  | 31.6  | 31.3  | 30.9  | 30.5  | 30.1  | 29.7  |
|                                  | 40                | 42.9                     | 41.9  | 41.0  | 40  | 39.5  | 39.0  | 38.6  | 38.1  | 37.6  | 37.1  |
|                                  | 50                | 53.6                     | 52.4  | 51.2  | 50  | 49.4  | 48.8  | 48.2  | 47.6  | 47.0  | 46.4  |
|                                  | 63                | 67.5                     | 66.0  | 64.5  | 63  | 62.2  | 61.5  | 60.7  | 60.0  | 59.2  | 58.5  |
|                                  | 75                | 80.4                     | 78.6  | 76.8  | 75  | 74.1  | 73.2  | 72.3  | 71.4  | 70.5  | 69.6  |
|                                  | 80                | 85.8                     | 83.8  | 81.9  | 80  | 79.0  | 78.1  | 77.1  | 76.2  | 75.2  | 74.2  |
|                                  | 100               | 107.2                    | 104.8 | 102.4 | 100 | 98.8  | 97.6  | 96.4  | 95.2  | 94.0  | 92.8  |
| HGM/HGE<br>50H/L, 125            | 16                | 18.9                     | 18.6  | 17.8  | 16  | 15.2  | 14.6  | 14.1  | 13.6  | 13.2  | 12.8  |
|                                  | 20                | 23.6                     | 23.3  | 22.2  | 20  | 19.1  | 18.3  | 17.6  | 17.0  | 16.5  | 16.0  |
|                                  | 25                | 27.3                     | 26.6  | 25.8  | 25  | 24.6  | 24.2  | 23.8  | 23.4  | 23.0  | 22.6  |
|                                  | 32                | 35.0                     | 34.0  | 33.0  | 32  | 31.5  | 31.0  | 30.5  | 30.0  | 29.5  | 29.0  |
|                                  | 40                | 43.8                     | 42.5  | 41.3  | 40  | 39.4  | 38.8  | 38.1  | 37.5  | 36.8  | 36.2  |
|                                  | 50                | 54.7                     | 53.1  | 51.6  | 50  | 49.2  | 48.4  | 47.7  | 46.9  | 46.1  | 45.3  |
|                                  | 63                | 68.9                     | 66.9  | 65.0  | 63  | 62.0  | 61.0  | 60.1  | 59.1  | 58.0  | 57.0  |
|                                  | 75                | 82.0                     | 79.7  | 77.3  | 75  | 73.8  | 72.7  | 71.5  | 70.3  | 69.1  | 67.9  |
|                                  | 80                | 87.5                     | 85.0  | 82.5  | 80  | 78.8  | 77.5  | 76.3  | 75.0  | 73.7  | 72.4  |
|                                  | 100               | 109.4                    | 106.3 | 103.1 | 100 | 98.4  | 96.9  | 95.3  | 93.8  | 92.1  | 90.5  |
| HGM/HGE<br>160, 250              | 125               | 136.7                    | 132.8 | 128.9 | 125 | 123.1 | 121.1 | 119.1 | 117.2 | 115.1 | 113.1 |
|                                  | 100               | 107.8                    | 105.2 | 102.6 | 100 | 96.0  | 94.0  | 92.0  | 88.0  | 85.5  | 83.0  |
|                                  | 125               | 134.8                    | 131.5 | 128.3 | 125 | 120.0 | 117.5 | 115.0 | 110.0 | 106.9 | 103.8 |
|                                  | 150               | 161.7                    | 157.8 | 153.9 | 150 | 144.0 | 141.0 | 138.0 | 132.0 | 128.3 | 124.5 |
|                                  | 160               | 172.5                    | 168.3 | 164.2 | 160 | 153.6 | 150.4 | 147.2 | 140.8 | 136.8 | 132.8 |
|                                  | 175               | 188.7                    | 184.1 | 179.6 | 175 | 168.0 | 164.5 | 161.0 | 154.0 | 149.6 | 145.3 |
|                                  | 200               | 215.6                    | 210.4 | 205.2 | 200 | 192.0 | 188.0 | 184.0 | 176.0 | 171.0 | 166.0 |
|                                  | 225               | 242.6                    | 236.7 | 230.9 | 225 | 216.0 | 211.5 | 207.0 | 198.0 | 192.4 | 186.8 |
|                                  | 250               | 269.5                    | 263.0 | 256.5 | 250 | 240.0 | 235.0 | 230.0 | 220.0 | 213.8 | 207.5 |

Rated Current Derating Table : HG Type/Standard Mounting

| Model           | Rated Current (A) | Ambient Temperature (°C) |        |       |     |       |       |       |       |       |       |
|-----------------|-------------------|--------------------------|--------|-------|-----|-------|-------|-------|-------|-------|-------|
|                 |                   | 10                       | 20     | 30    | 40  | 45    | 50    | 55    | 60    | 65    | 70    |
| HGM/HGE 400     | 250               | 269.5                    | 263.0  | 256.5 | 250 | 246.8 | 243.5 | 240.2 | 237.0 | 233.6 | 230.3 |
|                 | 300               | 324                      | 316.5  | 309   | 300 | 291   | 282   | 273   | 264   | 255   | 246   |
|                 | 350               | 378                      | 369.25 | 360.5 | 350 | 340   | 330   | 320   | 310   | 300   | 290   |
|                 | 400               | 432                      | 422    | 412   | 400 | 388   | 376   | 364   | 352   | 340   | 328   |
| HGM/HGE 630,800 | 500               | 540                      | 527.5  | 515   | 500 | 485   | 470   | 455   | 440   | 425   | 410   |
|                 | 630               | 680.4                    | 664.65 | 648.9 | 630 | 611   | 592   | 573   | 554   | 535   | 516   |
|                 | 700               | 756                      | 738.5  | 721   | 700 | 679   | 658   | 637   | 616   | 595   | 574   |
|                 | 800               | 864                      | 844    | 824   | 800 | 776   | 752   | 728   | 704   | 680   | 656   |

Rated Current Derating Table : HG Type/Plug-in Method

| Model                    | Rated Current (A) | Ambient Temperature (°C) |       |       |       |       |       |       |       |       |       |
|--------------------------|-------------------|--------------------------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
|                          |                   | 10                       | 20    | 30    | 40    | 45    | 50    | 55    | 60    | 65    | 70    |
| HGM/HGE 30,50E/S, 60,100 | 16                | 18.5                     | 18.3  | 17.4  | 16    | 14.9  | 14.3  | 13.8  | 13.3  | 12.9  | 12.5  |
|                          | 20                | 23.1                     | 22.8  | 21.8  | 20    | 18.7  | 17.9  | 17.2  | 16.7  | 16.1  | 15.7  |
|                          | 25                | 26.3                     | 25.7  | 25.1  | 25    | 24.2  | 23.9  | 23.6  | 23.3  | 23.0  | 22.7  |
|                          | 32                | 33.6                     | 32.9  | 32.1  | 31    | 31.0  | 30.6  | 30.2  | 29.9  | 29.5  | 29.1  |
|                          | 40                | 42.0                     | 41.1  | 40.1  | 39    | 38.7  | 38.3  | 37.8  | 37.3  | 36.8  | 36.4  |
|                          | 50                | 52.5                     | 51.4  | 50.2  | 49    | 48.4  | 47.8  | 47.2  | 46.6  | 46.1  | 45.5  |
|                          | 63                | 66.2                     | 64.7  | 63.2  | 62    | 61.0  | 60.3  | 59.5  | 58.8  | 58.0  | 57.3  |
|                          | 75                | 78.8                     | 77.0  | 75.3  | 74    | 72.6  | 71.7  | 70.9  | 70.0  | 69.1  | 68.2  |
|                          | 80                | 84.0                     | 82.2  | 80.3  | 78    | 77.5  | 76.5  | 75.6  | 74.6  | 73.7  | 72.8  |
|                          | 100               | 105.1                    | 102.7 | 100.4 | 98    | 96.8  | 95.6  | 94.5  | 93.3  | 92.1  | 90.9  |
|                          | 16                | 18.5                     | 18.2  | 17.4  | 16    | 14.9  | 14.3  | 13.8  | 13.3  | 12.9  | 12.5  |
| HGM/HGE 50H/L, 125       | 20                | 23.1                     | 22.8  | 21.8  | 20    | 18.7  | 17.9  | 17.2  | 16.7  | 16.1  | 15.7  |
|                          | 25                | 26.8                     | 26.0  | 25.3  | 25    | 24.1  | 23.7  | 23.4  | 23.0  | 22.6  | 22.2  |
|                          | 32                | 34.3                     | 33.3  | 32.3  | 31    | 30.9  | 30.4  | 29.9  | 29.4  | 28.9  | 28.4  |
|                          | 40                | 42.9                     | 41.7  | 40.4  | 39    | 38.6  | 38.0  | 37.4  | 36.8  | 36.1  | 35.5  |
|                          | 50                | 53.6                     | 52.0  | 50.5  | 49    | 48.2  | 47.5  | 46.7  | 45.9  | 45.1  | 44.4  |
|                          | 63                | 67.5                     | 65.6  | 63.7  | 62    | 60.8  | 59.8  | 58.8  | 57.9  | 56.9  | 55.9  |
|                          | 75                | 80.4                     | 78.1  | 75.8  | 74    | 72.4  | 71.2  | 70.1  | 68.9  | 67.7  | 66.5  |
|                          | 80                | 85.8                     | 83.3  | 80.9  | 78    | 77.2  | 76.0  | 74.7  | 73.5  | 72.2  | 71.0  |
|                          | 100               | 107.2                    | 104.1 | 101.1 | 98    | 96.5  | 94.9  | 93.4  | 91.9  | 90.2  | 88.7  |
|                          | 125               | 134.0                    | 130.2 | 126.3 | 123   | 120.6 | 118.7 | 116.8 | 114.8 | 112.8 | 110.9 |
|                          | 100               | 103.5                    | 101.0 | 98.5  | 96    | 92.2  | 90.2  | 88.3  | 84.5  | 82.1  | 79.7  |
| HGM/HGE 160,250          | 125               | 129.4                    | 126.2 | 123.1 | 120   | 115.2 | 112.8 | 110.4 | 105.6 | 102.6 | 99.6  |
|                          | 150               | 155.3                    | 151.5 | 147.8 | 144   | 138.2 | 135.4 | 132.5 | 126.7 | 123.1 | 119.5 |
|                          | 160               | 165.6                    | 161.6 | 157.6 | 154   | 147.5 | 144.4 | 141.3 | 135.2 | 131.3 | 127.5 |
|                          | 175               | 181.1                    | 176.7 | 172.4 | 168   | 161.3 | 157.9 | 154.6 | 147.8 | 143.6 | 139.4 |
|                          | 200               | 207.0                    | 202.0 | 197.0 | 192   | 184.3 | 180.5 | 176.6 | 169.0 | 164.2 | 159.4 |
|                          | 225               | 232.9                    | 227.3 | 221.6 | 216   | 207.4 | 203.0 | 198.7 | 190.1 | 184.7 | 179.3 |
|                          | 250               | 258.7                    | 252.5 | 246.2 | 240   | 230.4 | 225.6 | 220.8 | 211.2 | 205.2 | 199.2 |
|                          | 250               | 261.4                    | 255.1 | 248.8 | 242.5 | 239.3 | 236.2 | 233.0 | 229.9 | 226.6 | 223.4 |
| HGM/HGE 400              | 300               | 314.3                    | 307.0 | 299.7 | 291.0 | 282.3 | 273.5 | 264.8 | 256.1 | 247.4 | 238.6 |
|                          | 350               | 366.7                    | 358.2 | 349.7 | 339.5 | 329.8 | 320.1 | 310.4 | 300.7 | 291.0 | 281.3 |
|                          | 400               | 405.2                    | 395.8 | 387.6 | 378   | 373.7 | 367.9 | 363.2 | 357.9 | 352.6 | 347.3 |
|                          | 500               | 523.8                    | 511.7 | 499.6 | 485.0 | 470.5 | 455.9 | 441.4 | 426.8 | 412.3 | 397.7 |
| HGM/HGE 630,800          | 630               | 660.0                    | 644.7 | 629.4 | 611.1 | 592.7 | 574.2 | 555.8 | 537.4 | 519.0 | 500.5 |
|                          | 700               | 725.8                    | 709.0 | 692.2 | 672.0 | 651.8 | 631.7 | 611.5 | 591.4 | 571.2 | 551.0 |
|                          | 800               | 777.8                    | 759.7 | 744.1 | 726   | 717.4 | 706.3 | 697.3 | 687   | 676.9 | 666.7 |

## Technical Data (HGM/HGE)

### Environmental Operating Conditions

#### Altitude Derating

The characteristics of the circuit breaker is not affected at an altitude of less than 2,000 m. Characteristics of insulation and air cooling of the circuit breaker are reduced at an altitude of more than 2,000 m and the rated current and rated voltage must be adjusted as shown in the table below. However, there is no change in the characteristics of breaking capacity.

| Circuit Breaker              | Altitude  | 2,000 m | 3,000 m | 4,000 m | 5,000 m |
|------------------------------|---|---------|---------|---------|---------|
| HGM Type MCCB<br>32 ~ 800 AF | Withstand Voltage (V)                           | 3,000   | 2,500   | 2,100   | 1,800   |
|                              | Insulation Voltage (V) $U_i$                    | 1,000   | 850     | 750     | 600     |
|                              | Maximum Operational Voltage (V) $U_e$           | 690     | 590     | 520     | 460     |
|                              | Average Through-Current (A), at 40 °C $I_{n,x}$ | 1       | 0.96    | 0.93    | 0.9     |
| HGE Type ELCB<br>32 ~ 800 AF | Withstand Voltage (V)                           | 3,000   | 2,500   | 2,100   | 1,800   |
|                              | Maximum Operational Voltage (V) $U_e$           | 460     | 390     | 345     | 275     |
|                              | Average Through-Current (A), at 40 °C $I_{n,x}$ | 1       | 0.96    | 0.93    | 0.9     |

#### Vibrations

The excessive vibration may cause problems such as decrease of breaking capacity, lower dynamic strength, reduction of electric current conductivity or compromising safety of operating characteristics. Therefore, proper consideration is required with regards to these environmental stresses when it comes to designating the circuit breakers. These stresses are generated by the vibration during transportation, magnetic impact during opening and closing operation and influence of adjacent devices. Our circuit breaker has been verified in accordance with the standards with regards to vibration resistance.

##### Vibration test

Vibration test is verified with the standard requested by the shipping certification institute in compliance with IEC 60068-2-6. Out of the vibration test items, resonance test and vibration Endurance test were verified based on the following standard.

##### Resonance test

It confirms whether vibration is generated in the characteristics part of MCCB by slowly changing the frequency in the frequency sector of the following sinusoidal wave.

- 5 ~ 13.2 Hz : 1 mm Displacement
- 13.2 ~ 100 Hz : 0.7 g Acceleration

##### Vibration Endurance test

A sinusoidal wave with frequency of 30 Hz is applied for 90 minutes to check for abnormalities.





- 30 Hz : 0.7 g Acceleration

#### Seismic Performance and Shock Tolerance Table

| Item           | Seismic   |
|----------------|---|
| Test Condition | <p>Mounting Posture<br/>Direction of Vibration, Shock</p> <ul style="list-style-type: none"> <li>• Vertical mounting</li> <li>• Up-down, left-right, front-back</li> </ul>  |
| Status of MCCB | <ul style="list-style-type: none"> <li>• Non-conduction (ON or OFF status)</li> <li>• Status where rated current has been conducted on until the temperature of MCCB becomes constant and continuous</li> </ul>   |
| Test Result    | <ul style="list-style-type: none"> <li>• If it is ON, it should not turn OFF</li> <li>• If it is OFF, it should not turn ON</li> <li>• No abnormal status such as damage, deformation or loosened screw part</li> <li>• The characteristics of switch and trip after the test must be normal</li> </ul> |

## Degree of Protection

The MCCB's IP rating is defined based on IEC 60529. The IP rating also depends on product conditions.
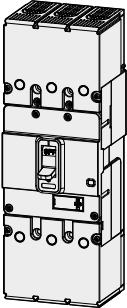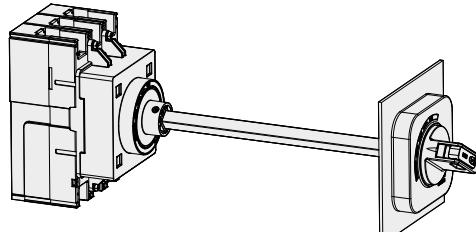
| Condition         | Circuit Breaker  | Circuit Breaker + Terminal Cover   | Circuit Breaker + Terminal Cover + Rotary Handle (Front Contact Type)             | Circuit Breaker + Terminal Cover + Rotary Handle (Extension Type)                  |
|-------------------|--|--|---|--|
| Appearance        |  |  |  |  |
| Protection Degree | IP20   | IP40   | IP40  | IP54   |

## Technical Data (HGM/HGE)

### Power Loss / Resistance

#### HGM Type MCCB

| Type        | Rated Current (A) | HGM30, 50E/S, 60, 100 |            | HGM50H/L, 125 |            | HGM160, 250 |            | HGM400      |            | HGM630, 800 |            |
|-------------|-------------------|-----------------------|------------|---------------|------------|-------------|------------|-------------|------------|-------------|------------|
|             |                   | R/Pole (mΩ)           | P/Pole (W) | R/Pole (mΩ)   | P/Pole (W) | R/Pole (mΩ) | P/Pole (W) | R/Pole (mΩ) | P/Pole (W) | R/Pole (mΩ) | P/Pole (W) |
| Fixed / Adj | 16                | 16.0                  | 4.10       | 17.0          | 4.35       |             |            |             |            |             |            |
|             | 20                | 16.0                  | 6.40       | 17.0          | 6.80       |             |            |             |            |             |            |
|             | 25                | 4.0                   | 2.50       | 4.3           | 2.69       |             |            |             |            |             |            |
|             | 32                | 4.0                   | 4.10       | 3.0           | 3.07       |             |            |             |            |             |            |
|             | 40                | 2.9                   | 4.64       | 1.9           | 3.06       |             |            |             |            |             |            |
|             | 50                | 2.3                   | 5.75       | 1.6           | 3.90       |             |            |             |            |             |            |
|             | 63                | 1.2                   | 4.88       | 0.9           | 3.37       |             |            |             |            |             |            |
|             | 75                | 0.7                   | 4.11       | 0.6           | 3.38       |             |            |             |            |             |            |
|             | 80                | 0.9                   | 5.76       | 0.6           | 3.84       |             |            |             |            |             |            |
|             | 100               | 0.7                   | 7.30       | 0.6           | 5.60       | 0.6         | 5.60       |             |            |             |            |
|             | 125               |                       |            | 0.5           | 7.97       | 0.4         | 6.72       |             |            |             |            |
|             | 150               |                       |            |               |            | 0.4         | 8.55       |             |            |             |            |
|             | 160               |                       |            |               |            | 0.3         | 8.70       |             |            |             |            |
|             | 175               |                       |            |               |            | 0.3         | 9.80       |             |            |             |            |
|             | 200               |                       |            |               |            | 0.3         | 10.80      |             |            |             |            |
|             | 225               |                       |            |               |            | 0.3         | 13.67      |             |            |             |            |
|             | 250               |                       |            |               |            | 0.2         | 13.75      | 0.2         | 14.38      |             |            |
|             | 300               |                       |            |               |            |             |            | 0.2         | 18.90      |             |            |
|             | 350               |                       |            |               |            |             |            | 0.2         | 23.28      |             |            |
|             | 400               |                       |            |               |            |             |            | 0.2         | 27.20      |             |            |
|             | 500               |                       |            |               |            |             |            |             |            | 0.1         | 30.00      |
|             | 630               |                       |            |               |            |             |            |             |            | 0.1         | 39.60      |
|             | 700               |                       |            |               |            |             |            |             |            | 0.1         | 53.90      |
|             | 800               |                       |            |               |            |             |            |             |            | 0.1         | 64.00      |
| Plug-in     | 16                | 16.1                  | 4.12       | 17.1          | 4.37       |             |            |             |            |             |            |
|             | 20                | 16.1                  | 6.43       | 17.1          | 6.83       |             |            |             |            |             |            |
|             | 25                | 4.1                   | 2.55       | 4.4           | 2.74       |             |            |             |            |             |            |
|             | 32                | 4.1                   | 4.18       | 3.1           | 3.15       |             |            |             |            |             |            |
|             | 40                | 3.0                   | 4.77       | 2.0           | 3.18       |             |            |             |            |             |            |
|             | 50                | 2.4                   | 5.95       | 1.6           | 4.10       |             |            |             |            |             |            |
|             | 63                | 1.3                   | 5.20       | 0.9           | 3.69       |             |            |             |            |             |            |
|             | 75                | 0.8                   | 4.56       | 0.7           | 3.83       |             |            |             |            |             |            |
|             | 80                | 1.0                   | 6.27       | 0.7           | 4.35       |             |            |             |            |             |            |
|             | 100               | 0.8                   | 8.10       | 0.6           | 6.40       | 0.6         | 6.40       |             |            |             |            |
|             | 125               |                       |            | 0.6           | 9.22       | 0.5         | 7.97       |             |            |             |            |
|             | 150               |                       |            |               |            | 0.5         | 10.35      |             |            |             |            |
|             | 160               |                       |            |               |            | 0.4         | 10.75      |             |            |             |            |
|             | 175               |                       |            |               |            | 0.4         | 12.25      |             |            |             |            |
|             | 200               |                       |            |               |            | 0.4         | 14.00      |             |            |             |            |
|             | 225               |                       |            |               |            | 0.4         | 17.72      |             |            |             |            |
|             | 250               |                       |            |               |            | 0.3         | 18.75      | 0.3         | 19.38      |             |            |
|             | 300               |                       |            |               |            |             |            | 0.3         | 26.10      |             |            |
|             | 350               |                       |            |               |            |             |            | 0.3         | 33.08      |             |            |
|             | 400               |                       |            |               |            |             |            | 0.3         | 40.00      |             |            |
|             | 500               |                       |            |               |            |             |            |             |            | 0.2         | 50.00      |
|             | 630               |                       |            |               |            |             |            |             |            | 0.2         | 68.40      |
|             | 700               |                       |            |               |            |             |            |             |            | 0.2         | 93.10      |
|             | 800               |                       |            |               |            |             |            |             |            | 0.2         | 115.20     |

**HGE Type ELCB**

| Type    | Rated Current (A) | HGE30, 50E/S, 60, 100 |            | HGE50H/L, 125 |            | HGE160, 250 |            | HGE400      |            | HGE630, 800 |            |
|---------|-------------------|-----------------------|------------|---------------|------------|-------------|------------|-------------|------------|-------------|------------|
|         |                   | R/Pole (mΩ)           | P/Pole (W) | R/Pole (mΩ)   | P/Pole (W) | R/Pole (mΩ) | P/Pole (W) | R/Pole (mΩ) | P/Pole (W) | R/Pole (mΩ) | P/Pole (W) |
| Fixed   | 16                | 14.3                  | 3.66       | 12.9          | 3.30       |             |            |             |            |             |            |
|         | 20                | 14.3                  | 5.72       | 12.9          | 5.16       |             |            |             |            |             |            |
|         | 25                | 4.9                   | 3.04       | 4.2           | 2.63       |             |            |             |            |             |            |
|         | 32                | 4.9                   | 4.98       | 3.9           | 4.00       |             |            |             |            |             |            |
|         | 40                | 2.9                   | 4.64       | 2.3           | 3.75       |             |            |             |            |             |            |
|         | 50                | 2.4                   | 6.03       | 1.7           | 4.14       |             |            |             |            |             |            |
|         | 63                | 1.7                   | 6.62       | 1.2           | 4.80       |             |            |             |            |             |            |
|         | 75                | 0.8                   | 4.49       | 0.7           | 4.15       |             |            |             |            |             |            |
|         | 80                | 1.0                   | 6.65       | 0.7           | 4.72       |             |            |             |            |             |            |
|         | 100               | 0.8                   | 8.07       | 0.8           | 7.52       | 0.5         | 5.44       |             |            |             |            |
|         | 125               |                       |            | 0.7           | 10.16      | 0.5         | 7.32       |             |            |             |            |
|         | 150               |                       |            |               |            | 0.4         | 8.10       |             |            |             |            |
|         | 160               |                       |            |               |            | 0.3         | 8.67       |             |            |             |            |
|         | 175               |                       |            |               |            | 0.3         | 10.06      |             |            |             |            |
|         | 200               |                       |            |               |            | 0.3         | 11.37      |             |            |             |            |
|         | 225               |                       |            |               |            | 0.3         | 14.65      |             |            |             |            |
| Plug-in | 250               |                       |            |               |            | 0.2         | 15.13      | 0.3         | 16.25      |             |            |
|         | 300               |                       |            |               |            |             |            | 0.2         | 21.60      |             |            |
|         | 350               |                       |            |               |            |             |            | 0.2         | 26.95      |             |            |
|         | 400               |                       |            |               |            |             |            | 0.2         | 32.00      |             |            |
|         | 500               |                       |            |               |            |             |            |             |            | 0.2         | 40.00      |
|         | 630               |                       |            |               |            |             |            |             |            | 0.2         | 54.00      |
|         | 700               |                       |            |               |            |             |            |             |            | 0.1         | 68.60      |
|         | 800               |                       |            |               |            |             |            |             |            | 0.1         | 83.20      |
|         | 16                | 14.3                  | 3.66       | 12.9          | 3.30       |             |            |             |            |             |            |
|         | 20                | 14.3                  | 5.72       | 12.9          | 5.16       |             |            |             |            |             |            |
|         | 25                | 4.9                   | 3.04       | 4.4           | 2.75       |             |            |             |            |             |            |
|         | 32                | 4.9                   | 4.98       | 3.9           | 4.00       |             |            |             |            |             |            |
|         | 40                | 2.9                   | 4.64       | 3.0           | 4.85       |             |            |             |            |             |            |
|         | 50                | 2.4                   | 6.03       | 1.8           | 4.49       |             |            |             |            |             |            |
|         | 63                | 2.1                   | 8.49       | 1.7           | 6.59       |             |            |             |            |             |            |
|         | 75                | 1.3                   | 7.14       | 1.1           | 6.40       |             |            |             |            |             |            |
|         | 80                | 1.0                   | 6.65       | 1.1           | 7.28       |             |            |             |            |             |            |
|         | 100               | 1.0                   | 9.77       | 0.8           | 8.42       | 0.5         | 5.44       |             |            |             |            |
|         | 125               |                       |            | 0.7           | 11.56      | 0.5         | 7.32       |             |            |             |            |
|         | 150               |                       |            |               |            | 0.4         | 8.10       |             |            |             |            |
|         | 160               |                       |            |               |            | 0.3         | 8.67       |             |            |             |            |
|         | 175               |                       |            |               |            | 0.3         | 10.06      |             |            |             |            |
|         | 200               |                       |            |               |            | 0.3         | 11.37      |             |            |             |            |
|         | 225               |                       |            |               |            | 0.3         | 14.65      |             |            |             |            |
|         | 250               |                       |            |               |            | 0.2         | 15.13      | 0.3         | 21.25      |             |            |
|         | 300               |                       |            |               |            |             |            | 0.3         | 28.80      |             |            |
|         | 350               |                       |            |               |            |             |            | 0.3         | 36.75      |             |            |
|         | 400               |                       |            |               |            |             |            | 0.3         | 44.80      |             |            |
|         | 500               |                       |            |               |            |             |            |             |            | 0.2         | 60.00      |
|         | 630               |                       |            |               |            |             |            |             |            | 0.2         | 82.80      |
|         | 700               |                       |            |               |            |             |            |             |            | 0.2         | 107.80     |
|         | 800               |                       |            |               |            |             |            |             |            | 0.2         | 134.40     |



## Technical Data (HGM/HGE)

### Cascading Table

#### AC 220/240 V

Upstream Circuit Breaker : HGM30, HGM50, HGM60, HGM100, HGM125, HGM160, HGM250, HGM400

Downstream Circuit Breaker : HGD63, HGD125, HGM30, HGM50, HGM60, HGM100

| Upstream Circuit Breaker                              | HGM30  |    |    |     | HGM50  |     |     |     | HGM60  |    |    |     | HGM100 |    |    |     |     |    |    |
|---|--------|----|----|-----|--------|-----|-----|-----|--------|----|----|-----|--------|----|----|-----|-----|----|----|
|   | E      | S  | E  | S   | H      | L   | E   | S   | H      | L  | E  | S   | H      | L  | E  | S   | H   | L  |    |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 35     | 50 | 35 | 50  | 85     | 100 | 35  | 50  | 50     | 50 | 35 | 50  | 50     | 50 | 35 | 50  | 50  | 50 |    |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |    |    |     |        |     |     |     |        |    |    |     |        |    |    |     |     |    |    |
| HGD63E  | 10     | 15 | 15 | 15  | 15     | 15  | 15  | 15  | 15     | 15 | 15 | 15  | 15     | 15 | 15 | 15  | 15  |    |    |
| HGD63S  | 15     | 20 | 20 | 20  | 20     | 20  | 20  | 20  | 20     | 20 | 20 | 20  | 20     | 20 | 20 | 20  | 20  |    |    |
| HGD63N/M  | 20     |    | 35 | 40  | 40     | 40  | 35  | 40  | 40     | 40 | 40 | 35  | 40     | 40 | 40 | 40  | 40  |    |    |
| HGD63H/P  | 25     |    | 35 | 50  | 50     | 50  | 35  | 40  | 40     | 40 | 40 | 35  | 40     | 40 | 40 | 40  | 40  |    |    |
| Upstream Circuit Breaker                              | HGM125 |    |    |     | HGM160 |     |     |     | HGM250 |    |    |     | HGM400 |    |    |     |     |    |    |
|   | E      | S  | H  | L   | E      | S   | H   | L   | E      | S  | H  | L   | E      | S  | H  | L   |     |    |    |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 50     | 65 | 85 | 100 | 50     | 65  | 85  | 100 | 50     | 65 | 85 | 100 | 50     | 65 | 85 | 100 |     |    |    |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |    |    |     |        |     |     |     |        |    |    |     |        |    |    |     |     |    |    |
| HGD63E  | 10     | 15 | 15 | 15  | 15     | 15  | 15  | 15  | 15     | 15 | 15 | 15  | 15     | 15 | 15 | 15  | 15  |    |    |
| HGD63S  | 15     | 20 | 20 | 20  | 20     | 20  | 20  | 20  | 20     | 20 | 20 | 20  | 20     | 20 | 20 | 20  | 20  |    |    |
| HGD63N/M  | 20     | 40 | 40 | 40  | 40     | 40  | 40  | 40  | 40     | 40 | 40 | 40  | 40     | 40 | 40 | 40  | 40  |    |    |
| HGD63H/P  | 25     | 40 | 50 | 50  | 50     | 40  | 50  | 50  | 50     | 50 | 50 | 40  | 50     | 50 | 50 | 50  | 50  |    |    |
| HGD100S/125   | 25     | 40 | 40 | 40  | 40     | 40  | 40  | 40  | 40     | 40 | 40 | 40  | 40     | 40 | 40 | 40  | 40  |    |    |
| Upstream Circuit Breaker                              | HGM30  |    |    |     | HGM50  |     |     |     | HGM60  |    |    |     | HGM100 |    |    |     |     |    |    |
|   | E      | S  | E  | S   | H      | L   | E   | S   | H      | L  | E  | S   | H      | L  | E  | S   | H   | L  |    |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 35     | 50 | 35 | 50  | 85     | 100 | 35  | 50  | 50     | 50 | 50 | 35  | 50     | 50 | 50 | 35  | 50  | 50 | 50 |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |    |    |     |        |     |     |     |        |    |    |     |        |    |    |     |     |    |    |
| HGM30E  | 35     |    | 50 |     | 50     | 65  | 65  |     | 50     | 50 | 50 |     | 50     |    | 50 | 50  | 50  | 50 |    |
| HGM50E  | 35     |    |    |     | 50     | 65  | 70  |     | 50     | 50 | 50 |     | 50     |    | 50 | 50  | 50  | 50 |    |
| HGM50S  | 50     |    |    |     |        | 70  | 85  |     |        |    |    |     |        |    |    |     |     |    |    |
| HGM50H  | 85     |    |    |     |        |     | 100 |     |        |    |    |     |        |    |    |     |     |    |    |
| HGM60E  | 35     |    |    |     |        |     |     |     | 50     | 50 | 50 |     | 50     |    | 50 | 50  | 50  | 50 |    |
| HGM100E   | 35     |    |    |     |        |     |     |     |        |    |    |     | 50     | 50 |    | 50  | 50  | 50 |    |
| Upstream Circuit Breaker                              | HGM125 |    |    |     | HGM160 |     |     |     | HGM250 |    |    |     | HGM400 |    |    |     |     |    |    |
|   | E      | S  | H  | L   | E      | S   | H   | L   | E      | S  | H  | L   | E      | S  | H  | L   |     |    |    |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 50     | 65 | 85 | 100 | 50     | 65  | 85  | 100 | 50     | 65 | 85 | 100 | 50     | 65 | 85 | 100 | 125 |    |    |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |    |    |     |        |     |     |     |        |    |    |     |        |    |    |     |     |    |    |
| HGM30E  | 35     | 50 | 65 | 65  | 50     | 65  | 65  | 65  | 50     | 65 | 65 | 65  | 50     | 65 | 65 | 65  | 65  |    |    |
| HGM30S  | 50     |    | 65 | 65  | 50     | 65  | 65  | 65  | 50     | 65 | 65 | 65  | 50     | 65 | 65 | 65  | 65  |    |    |
| HGM50E  | 35     | 50 | 65 | 70  | 50     | 65  | 65  | 70  | 50     | 65 | 65 | 70  | 50     | 65 | 65 | 70  | 70  |    |    |
| HGM50S  | 50     |    | 65 | 70  | 85     |     | 65  | 70  | 85     |    | 65 | 70  | 85     |    | 65 | 70  | 85  |    |    |
| HGM50H  | 85     |    |    |     | 100    |     |     |     | 100    |    |    |     | 100    |    |    |     | 100 |    |    |
| HGM60E  | 35     | 50 | 65 | 70  | 50     | 65  | 70  | 70  | 50     | 65 | 70 | 70  | 50     | 65 | 70 | 70  |     |    |    |
| HGM60S  | 50     |    | 65 | 70  | 70     |     | 65  | 70  | 70     |    | 65 | 70  | 70     |    | 65 | 70  | 70  |    |    |
| HGM60H  | 50     |    | 65 | 70  | 70     |     | 65  | 70  | 70     |    | 65 | 70  | 70     |    | 65 | 70  | 70  |    |    |
| HGM60L  | 50     |    | 65 | 70  | 70     |     | 65  | 70  | 70     |    | 65 | 70  | 70     |    | 65 | 70  | 70  |    |    |
| HGM100E   | 35     | 50 | 65 | 70  | 50     | 65  | 70  | 70  | 50     | 65 | 70 | 70  | 50     | 65 | 70 | 70  |     |    |    |

Upstream Circuit Breaker : HGM125, HGM160, HGM250, HGM400, HGM630, HGM800

Downstream Circuit Breaker : HGM100, HGM160, HGM250, HGM400, HGM630, HGM800

| Upstream Circuit Breaker                              | HGM125 |    |    |     | HGM160 |    |    |     | HGM250 |    |     |     | HGM400 |     |     |     |     |
|---|--------|----|----|-----|--------|----|----|-----|--------|----|-----|-----|--------|-----|-----|-----|-----|
|   | E      | S  | H  | L   | E      | S  | H  | L   | E      | S  | H   | L   | E      | S   | H   | L   |     |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 50     | 65 | 85 | 100 | 50     | 65 | 85 | 100 | 50     | 65 | 85  | 100 | 50     | 75  | 100 | 125 |     |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |    |    |     |        |    |    |     |        |    |     |     |        |     |     |     |     |
| HGM100S   | 50     |    | 65 | 70  | 70     |    | 65 | 70  | 70     |    | 65  | 70  | 70     |     | 65  | 70  | 70  |
| HGM100H   | 50     |    | 65 | 70  | 70     |    | 65 | 70  | 70     |    | 65  | 70  | 70     |     | 65  | 70  | 70  |
| HGM100L   | 50     |    | 65 | 70  | 70     |    | 65 | 70  | 70     |    | 65  | 70  | 70     |     | 65  | 70  | 70  |
| HGM125E   | 50     |    | 65 | 85  | 100    |    | 65 | 85  | 100    |    | 65  | 85  | 100    |     | 65  | 85  | 100 |
| HGM125S   | 65     |    |    | 85  | 100    |    |    | 85  | 100    |    |     | 85  | 100    |     |     | 85  | 100 |
| HGM125H   | 85     |    |    |     | 100    |    |    | 100 |        |    | 100 |     |        | 100 |     |     | 100 |

| Upstream Circuit Breaker                              | HGM160 |    |    |     | HGM250 |    |    |     | HGM400 |    |     |     |     |
|---|--------|----|----|-----|--------|----|----|-----|--------|----|-----|-----|-----|
|   | E      | S  | H  | L   | E      | S  | H  | L   | E      | S  | H   | L   |     |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 50     | 65 | 85 | 100 | 50     | 65 | 85 | 100 | 50     | 75 | 100 | 125 |     |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |    |    |     |        |    |    |     |        |    |     |     |     |
| HGM160E   | 50     |    | 65 | 85  | 100    |    | 65 | 85  | 100    |    | 75  | 85  | 100 |
| HGM160S   | 65     |    |    | 85  | 100    |    |    | 85  | 100    |    |     | 85  | 100 |
| HGM160H   | 85     |    |    |     | 100    |    |    |     | 100    |    |     | 100 | 125 |
| HGM160L   | 100    |    |    |     |        |    |    |     |        |    |     |     | 125 |
| HGM250E   | 50     |    |    |     |        | 65 | 85 | 100 |        | 75 | 85  | 100 |     |
| HGM250S   | 65     |    |    |     |        |    | 85 | 100 |        |    | 85  | 100 |     |
| HGM250H   | 85     |    |    |     |        |    |    | 100 |        |    | 100 | 125 |     |
| HGM250L   | 100    |    |    |     |        |    |    |     |        |    |     | 125 |     |

| Upstream Circuit Breaker                              | HGM630 |    |     |     |     |     | HGM800 |     |     |
|---|--------|----|-----|-----|-----|-----|--------|-----|-----|
|   | E      | S  | H   | L   | S   | H   | L      |     |     |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 50     | 75 | 100 | 125 | 75  | 100 | 125    |     |     |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |    |     |     |     |     |        |     |     |
| <b>Enhanced Breaking Capacity</b>                     |        |    |     |     |     |     |        |     |     |
| HGM250E   | 50     |    | 75  | 85  | 100 | 75  | 85     | 100 |     |
| HGM250S   | 65     |    |     | 85  | 100 |     |        | 85  | 100 |
| HGM250H   | 85     |    |     | 100 | 125 |     |        | 100 | 125 |
| HGM250L   | 100    |    |     |     | 125 |     |        |     | 125 |
| HGM400E   | 50     |    | 75  | 85  | 100 | 75  | 85     | 100 |     |
| HGM400S   | 75     |    |     | 85  | 100 |     |        | 85  | 100 |
| HGM400H   | 100    |    |     |     | 125 |     |        |     | 125 |
| HGM630E   | 50     |    | 75  | 85  | 100 | 75  | 85     | 100 |     |
| HGM630S   | 75     |    |     | 85  | 100 |     |        | 85  | 100 |
| HGM630H   | 100    |    |     |     | 125 |     |        |     | 125 |
| HGM800S   | 75     |    |     |     |     |     |        | 70  | 85  |
| HGM800H   | 100    |    |     |     |     |     |        |     | 85  |

## Technical Data (HGM/HGE)

### Cascading Table

#### AC 440/460 V

Upstream Circuit Breaker : HGM30, HGM50, HGM60, HGM100, HGM125, HGM160, HGM250, HGM400

Downstream Circuit Breaker : HGD63, HGD125, HGM30, HGM50, HGM60, HGM100

| Upstream Circuit Breaker  | HGM30 |    |    |    | HGM50 |    |    |    | HGM60 |    |    |    | HGM100 |    |    |    |    |    |
|---|-------|----|----|----|-------|----|----|----|-------|----|----|----|--------|----|----|----|----|----|
|   | E     | S  | E  | S  | H     | L  | E  | S  | H     | L  | E  | S  | H      | L  | E  | S  | H  | L  |
| Breaking Capacity [Icu] (kA r.m.s.)                                       | 16    | 20 | 16 | 20 | 38    | 55 | 16 | 20 | 26    | 30 | 16 | 20 | 26     | 30 | 16 | 20 | 26 | 30 |
| Downstream Breaking Capacity [Icu] (kA r.m.s.) Enhanced Breaking Capacity |       |    |    |    |       |    |    |    |       |    |    |    |        |    |    |    |    |    |
| HGD63E  | 6     | 10 | 10 | 10 | 10    | 10 | 10 | 10 | 10    | 10 | 10 | 10 | 10     | 10 | 10 | 10 | 10 |    |
| HGD63S  | 7.5   | 14 | 14 | 14 | 14    | 14 | 14 | 14 | 14    | 14 | 14 | 14 | 14     | 14 | 14 | 14 | 14 |    |
| HGD63N/M  | 10    |    |    | 16 | 20    | 20 | 20 | 16 | 20    | 20 | 20 | 16 | 20     | 20 | 20 | 20 | 20 |    |
| HGD63H/P  | 15    |    |    | 16 | 20    | 26 | 26 | 16 | 20    | 20 | 20 | 16 | 20     | 20 | 20 | 20 | 20 |    |

| Upstream Circuit Breaker  | HGM125 |    |    |    | HGM160 |    |    |    | HGM250 |    |    |    |
|---|--------|----|----|----|--------|----|----|----|--------|----|----|----|
|   | E      | S  | H  | L  | E      | S  | H  | L  | E      | S  | H  | L  |
| Breaking Capacity [Icu] (kA r.m.s.)                                       | 20     | 26 | 38 | 55 | 20     | 26 | 38 | 55 | 20     | 26 | 38 | 55 |
| Downstream Breaking Capacity [Icu] (kA r.m.s.) Enhanced Breaking Capacity |        |    |    |    |        |    |    |    |        |    |    |    |
| HGD63E  | 6      | 10 | 10 | 10 | 10     | 10 | 10 | 10 | 10     | 10 | 10 | 10 |
| HGD63S  | 7.5    | 14 | 14 | 14 | 14     | 14 | 14 | 14 | 14     | 14 | 14 | 14 |
| HGD63N/M  | 10     | 16 | 20 | 20 | 20     | 16 | 20 | 20 | 16     | 20 | 20 | 20 |
| HGD63H/P  | 15     | 16 | 20 | 26 | 26     | 16 | 20 | 26 | 16     | 20 | 26 | 26 |
| HGD100S/125   | 15     | 16 | 20 | 26 | 26     | 16 | 20 | 26 | 16     | 20 | 26 | 26 |

| Upstream Circuit Breaker  | HGM30 |    |    |    | HGM50 |    |    |    | HGM60 |    |    |    | HGM100 |    |    |    |    |    |
|---|-------|----|----|----|-------|----|----|----|-------|----|----|----|--------|----|----|----|----|----|
|   | E     | S  | E  | S  | H     | L  | E  | S  | H     | L  | E  | S  | H      | L  | E  | S  | H  | L  |
| Breaking Capacity [Icu] (kA r.m.s.)                                       | 16    | 20 | 16 | 20 | 38    | 55 | 16 | 20 | 26    | 30 | 16 | 20 | 26     | 30 | 16 | 20 | 26 | 30 |
| Downstream Breaking Capacity [Icu] (kA r.m.s.) Enhanced Breaking Capacity |       |    |    |    |       |    |    |    |       |    |    |    |        |    |    |    |    |    |
| HGM30E  | 16    |    | 20 |    | 20    | 26 | 30 |    | 20    | 20 | 20 |    | 20     | 20 | 20 | 20 | 20 | 20 |
| HGM30S  | 20    |    |    |    | 30    | 30 |    |    | 26    | 26 |    |    | 26     | 26 |    | 26 | 26 | 26 |
| HGM50E  | 16    |    |    | 20 | 26    | 30 |    | 20 | 20    | 20 |    | 20 | 20     | 20 |    | 20 | 20 | 20 |
| HGM50S  | 20    |    |    | 30 | 38    |    |    | 26 | 26    |    |    | 26 | 26     |    | 26 | 26 | 26 | 26 |
| HGM50H  | 38    |    |    |    | 55    |    |    |    |       |    |    |    |        |    |    |    |    |    |
| HGM60E  | 16    |    |    |    |       |    |    | 20 | 20    | 20 |    | 20 | 20     | 20 |    | 20 | 20 | 20 |
| HGM60S  | 20    |    |    |    |       |    |    |    | 26    | 26 |    |    | 26     | 26 |    | 26 | 26 | 26 |
| HGM60H  | 26    |    |    |    |       |    |    |    |       | 30 |    |    | 30     |    |    | 30 | 30 | 30 |
| HGM100E   | 16    |    |    |    |       |    |    |    |       |    |    |    | 20     | 20 |    | 20 | 20 | 20 |
| HGM100S   | 20    |    |    |    |       |    |    |    |       |    |    |    |        | 26 |    | 26 | 26 | 26 |
| HGM100H   | 26    |    |    |    |       |    |    |    |       |    |    |    |        |    |    | 30 | 30 | 30 |

| Upstream Circuit Breaker  | HGM125 |    |    |    | HGM160 |    |    |    | HGM250 |    |    |    | HGM400 |    |    |    |    |
|---|--------|----|----|----|--------|----|----|----|--------|----|----|----|--------|----|----|----|----|
|   | E      | S  | H  | L  | E      | S  | H  | L  | E      | S  | H  | L  | E      | S  | H  | L  |    |
| Breaking Capacity [Icu] (kA r.m.s.)                                       | 20     | 26 | 38 | 55 | 20     | 26 | 38 | 55 | 20     | 26 | 38 | 55 | 38     | 50 | 70 | 85 |    |
| Downstream Breaking Capacity [Icu] (kA r.m.s.) Enhanced Breaking Capacity |        |    |    |    |        |    |    |    |        |    |    |    |        |    |    |    |    |
| HGM30E  | 16     | 20 | 26 | 30 | 20     | 26 | 26 | 30 | 20     | 26 | 26 | 30 | 26     | 26 | 30 | 30 |    |
| HGM30S  | 20     | 26 | 30 | 30 | 26     | 30 | 30 | 30 | 26     | 30 | 30 | 30 | 30     | 30 | 30 | 30 |    |
| HGM50E  | 16     | 20 | 26 | 30 | 20     | 26 | 30 | 30 | 20     | 26 | 30 | 30 | 20     | 26 | 30 | 30 |    |
| HGM50S  | 20     | 26 | 30 | 38 | 26     | 30 | 38 |    | 26     | 30 | 38 | 20 | 30     | 38 | 38 | 38 |    |
| HGM50H  | 38     |    |    | 55 |        |    |    |    | 55     |    |    |    | 55     |    | 50 | 70 | 70 |
| HGM50L  | 55     |    |    |    |        |    |    |    |        |    |    |    |        |    |    | 70 | 70 |
| HGM60E  | 16     | 20 | 26 | 30 | 20     | 26 | 26 | 30 | 20     | 26 | 26 | 30 | 26     | 26 | 30 | 30 |    |
| HGM60S  | 20     | 26 | 30 | 30 | 26     | 30 | 30 | 30 | 26     | 30 | 30 | 30 | 26     | 30 | 30 | 30 |    |
| HGM60H  | 26     |    | 30 | 38 |        |    | 30 | 38 |        |    |    | 30 | 38     | 30 | 38 | 38 |    |
| HGM60L  | 30     |    |    | 38 |        |    |    | 38 |        |    |    | 38 |        | 38 | 38 | 38 |    |
| HGM100E   | 16     | 20 | 26 | 30 | 20     | 26 | 26 | 30 | 20     | 26 | 26 | 30 | 26     | 26 | 30 | 30 |    |
| HGM100S   | 20     | 26 | 30 | 30 | 26     | 30 | 30 | 30 | 26     | 30 | 30 | 30 | 26     | 30 | 30 | 30 |    |
| HGM100H   | 26     |    | 30 | 38 |        |    | 30 | 38 |        |    |    | 30 | 38     | 30 | 38 | 38 |    |
| HGM100L   | 26     |    |    | 38 |        |    |    | 38 |        |    |    | 38 |        | 38 | 38 | 38 |    |

Upstream Circuit Breaker : HGM125, HGM160, HGM250, HGM400, HGM630, HGM800

Downstream Circuit Breaker : HGM100, HGM160, HGM250, HGM400, HGM630, HGM800

| Upstream Circuit Breaker                              | HGM125 |    |    |    | HGM160 |    |    |    | HGM250 |    |    |    | HGM400 |    |    |    |    |
|---|--------|----|----|----|--------|----|----|----|--------|----|----|----|--------|----|----|----|----|
|   | E      | S  | H  | L  | E      | S  | H  | L  | E      | S  | H  | L  | E      | S  | H  | L  |    |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 20     | 26 | 38 | 55 | 20     | 26 | 38 | 55 | 20     | 26 | 38 | 55 | 38     | 50 | 70 | 85 |    |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |    |    |    |        |    |    |    |        |    |    |    |        |    |    |    |    |
| HGM125E   | 20     |    | 26 | 30 | 38     |    | 26 | 30 | 38     |    | 26 | 30 | 38     | 26 | 30 | 38 | 38 |
| HGM125S   | 26     |    |    | 38 | 38     |    | 38 | 38 |        | 38 | 38 |    | 38     | 50 | 50 | 50 |    |
| HGM125H   | 38     |    |    |    | 55     |    |    | 55 |        |    |    | 55 |        | 50 | 70 | 70 | 70 |
| HGM125L   | 55     |    |    |    |        |    |    |    |        |    |    |    |        |    | 70 | 70 | 70 |
| HGM160E   | 20     |    |    |    |        | 26 | 30 | 38 |        | 26 | 30 | 38 | 26     | 30 | 38 | 38 | 38 |
| HGM160S   | 26     |    |    |    |        |    | 38 | 50 |        | 38 | 50 |    | 30     | 38 | 50 | 50 | 50 |
| HGM160H   | 38     |    |    |    |        |    |    | 55 |        |    |    | 55 |        | 50 | 70 | 70 | 70 |
| HGM160L   | 55     |    |    |    |        |    |    |    |        |    |    |    |        |    | 70 | 70 | 70 |

| Upstream Circuit Breaker                              | HGM250 |    |    |    | HGM400 |    |    |    | HGM630 |    |    |    | HGM800 |    |    |    |    |
|---|--------|----|----|----|--------|----|----|----|--------|----|----|----|--------|----|----|----|----|
|   | E      | S  | H  | L  | E      | S  | H  | L  | E      | S  | H  | L  | S      | H  | L  |    |    |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 20     | 26 | 38 | 55 | 38     | 50 | 70 | 85 | 38     | 50 | 70 | 85 | 50     | 70 | 85 | 85 |    |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |    |    |    |        |    |    |    |        |    |    |    |        |    |    |    |    |
| HGM250E   | 20     |    | 26 | 30 | 38     | 26 | 30 | 38 | 38     | 26 | 30 | 38 | 38     | 30 | 38 | 38 | 38 |
| HGM250S   | 26     |    |    | 38 | 50     | 30 | 38 | 50 | 50     | 30 | 38 | 50 | 50     | 38 | 50 | 50 | 50 |
| HGM250H   | 38     |    |    |    | 55     |    | 50 | 70 | 70     |    | 50 | 70 | 70     | 50 | 70 | 70 | 70 |
| HGM250L   | 55     |    |    |    |        |    | 70 | 70 |        |    | 70 | 70 |        | 70 | 70 | 70 | 70 |
| HGM400E   | 38     |    |    |    |        | 50 | 70 | 70 |        | 50 | 70 | 70 | 50     | 70 | 70 | 70 | 70 |
| HGM400S   | 50     |    |    |    |        |    | 70 | 85 |        |    | 70 | 85 |        | 70 | 85 | 70 | 85 |
| HGM400H   | 70     |    |    |    |        |    |    | 85 |        |    |    |    |        | 85 |    |    | 85 |
| HGM630E   | 38     |    |    |    |        |    |    |    |        | 50 | 70 | 70 | 50     | 70 | 70 | 70 | 70 |
| HGM630S   | 50     |    |    |    |        |    |    |    |        |    | 70 | 85 |        | 70 | 85 | 70 | 85 |
| HGM630H   | 70     |    |    |    |        |    |    |    |        |    |    |    |        | 85 |    |    | 85 |
| HGM800S   | 50     |    |    |    |        |    |    |    |        |    |    |    |        |    | 70 | 85 | 85 |
| HGM800H   | 70     |    |    |    |        |    |    |    |        |    |    |    |        |    |    |    | 85 |

## Technical Data (HGM/HGE)

### Installation


#### Insulation Distance (Safety Clearance)

For safety, insulation distance must be secured at installation. In case of installing a circuit breaker, safety clearances must be secured between breakers or between the circuit breaker and panel, bus bar and other adjacent devices. When the circuit breaker interrupts a short circuit, high temperature ionized gas is generated and the gas is discharged through the discharge outlet from the circuit breaker. As this gas can cause short-circuit accidents and grounding accidents, sufficient insulation distance is required between the circuit breaker and the panel.


※ In case insulation barrier is not installed between the circuit breaker terminals, secondary short-circuit accident may occur so it must be used.

The insulation barrier must be installed towards the direction of the circuit breaker's line indication part.


Separation distance in case the circuit breaker is installed side by side




Up/down/left/right distance in case of metallic panel

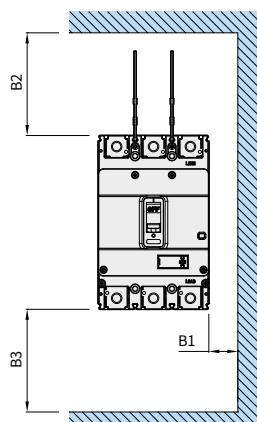

Front/back distance in case of metallic panel

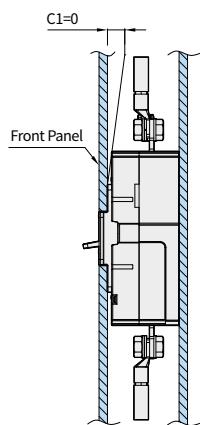

Distance with circuit breaker in case the live part is exposed

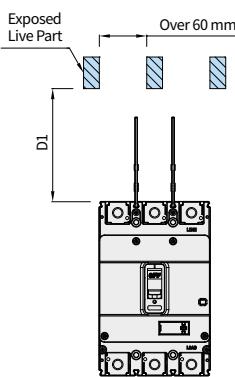

※ In case of using the minimum separation distance ( $A1 = 0$ ), terminal cover and phase to phase barrier must be assembled between the product. And pay attention to the tolerances of the enclosure dimensions.


※ If the distance between the live parts is less than 60 mm, the exposed part must be insulated.

#### HGM/HGE Type's Minimum Insulation Distance

| Type           | Minimum Clearance (mm) |    |     |       |    |     |    |    |     |    |    |     |
|----------------|------------------------|----|-----|-------|----|-----|----|----|-----|----|----|-----|
|                | 460 V                  |    |     | 240 V |    |     |    |    |     |    |    |     |
|                | A1                     | B1 | B2  | B3    | C1 | D1  | A1 | B1 | B2  | B3 | C1 | D1  |
| HGM30 E/S      | 0                      | 25 | 50  | 25    | 0  | 85  | 0  | 15 | 50  | 25 | 0  | 70  |
| HGM50 E/S      | 0                      | 25 | 50  | 25    | 0  | 85  | 0  | 15 | 50  | 25 | 0  | 70  |
| HGM100 E/S/H/L | 0                      | 25 | 50  | 25    | 0  | 85  | 0  | 15 | 50  | 25 | 0  | 70  |
| HGM50 H/L      | 0                      | 25 | 50  | 25    | 0  | 85  | 0  | 15 | 50  | 25 | 0  | 70  |
| HGM125 E/S/H/L | 0                      | 25 | 50  | 25    | 0  | 85  | 0  | 15 | 50  | 25 | 0  | 70  |
| HGM160 E/S     | 0                      | 25 | 80  | 40    | 0  | 140 | 0  | 15 | 80  | 40 | 0  | 110 |
| HGM160 H/L     | 0                      | 40 | 80  | 40    | 0  | 140 | 0  | 20 | 80  | 40 | 0  | 110 |
| HGM250 E/S     | 0                      | 25 | 80  | 40    | 0  | 140 | 0  | 15 | 80  | 40 | 0  | 110 |
| HGM250 H/L     | 0                      | 40 | 80  | 40    | 0  | 140 | 0  | 20 | 80  | 40 | 0  | 110 |
| HGE30 E/S      | 0                      | 25 | 50  | 25    | 0  | 85  | 0  | 15 | 50  | 25 | 0  | 70  |
| HGE50 E/S      | 0                      | 25 | 50  | 25    | 0  | 85  | 0  | 15 | 50  | 25 | 0  | 70  |
| HGE100 E/S/H/L | 0                      | 25 | 50  | 25    | 0  | 85  | 0  | 15 | 50  | 25 | 0  | 70  |
| HGE50 H/L      | 0                      | 25 | 50  | 25    | 0  | 85  | 0  | 15 | 50  | 25 | 0  | 70  |
| HGE125 E/S/H/L | 0                      | 25 | 50  | 25    | 0  | 85  | 0  | 15 | 50  | 25 | 0  | 70  |
| HGE160 E/S     | 0                      | 25 | 80  | 40    | 0  | 140 | 0  | 15 | 80  | 40 | 0  | 110 |
| HGE160 H/L     | 0                      | 40 | 80  | 40    | 0  | 140 | 0  | 20 | 80  | 40 | 0  | 110 |
| HGE250 E/S     | 0                      | 25 | 80  | 40    | 0  | 140 | 0  | 15 | 80  | 40 | 0  | 110 |
| HGE250 H/L     | 0                      | 40 | 80  | 40    | 0  | 140 | 0  | 20 | 80  | 40 | 0  | 110 |
| HGM400 E/S     | 0                      | 60 | 120 | 60    | 0  | 200 | 0  | 30 | 120 | 60 | 0  | 160 |
| HGM400 H/L     | 0                      | 80 | 120 | 60    | 0  | 200 | 0  | 40 | 120 | 60 | 0  | 160 |
| HGM630,800 E/S | 0                      | 60 | 120 | 60    | 0  | 200 | 0  | 30 | 120 | 60 | 0  | 160 |
| HGM630,800 H/L | 0                      | 80 | 120 | 60    | 0  | 200 | 0  | 40 | 120 | 60 | 0  | 160 |
| HGE400 E/S     | 0                      | 60 | 120 | 60    | 0  | 200 | 0  | 30 | 120 | 60 | 0  | 160 |
| HGE400 H/L     | 0                      | 80 | 120 | 60    | 0  | 200 | 0  | 40 | 120 | 60 | 0  | 160 |
| HGE630,800 E/S | 0                      | 60 | 120 | 60    | 0  | 200 | 0  | 30 | 120 | 60 | 0  | 160 |
| HGE630,800 H/L | 0                      | 80 | 120 | 60    | 0  | 200 | 0  | 40 | 120 | 60 | 0  | 160 |

### Installation Angle


It can be installed vertically or horizontally without changing any characteristics of the HGM/HGE Type of circuit breakers and as for the detailed installation direction, please refer to the figure below.

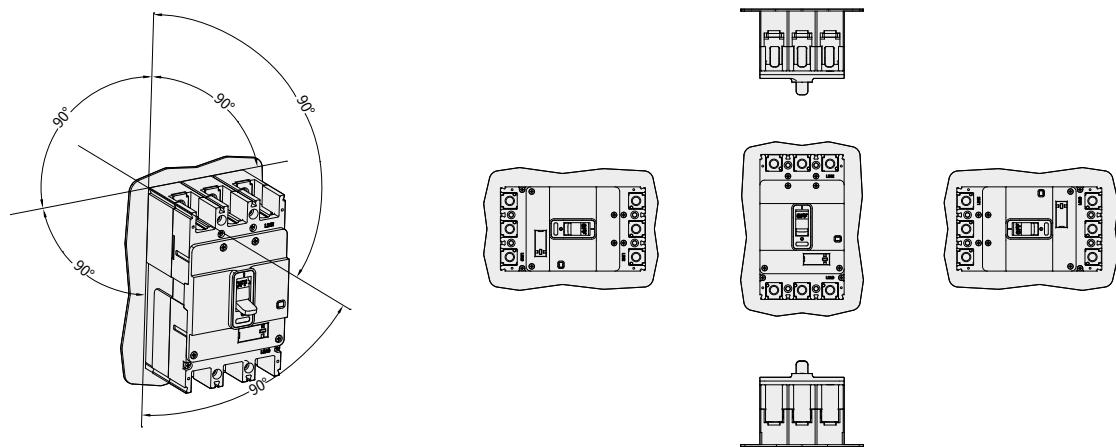

### Direction of Power Supply

#### HGM/HGE Type

When wiring the terminal between breakers, the LINE, LOAD mark in front of the product's cover must be checked.

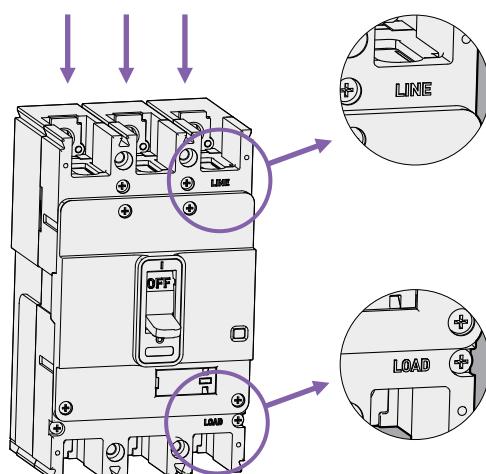


## Technical Data (HGM/HGE)

### Standard Configuration


#### HGM/HGE Type

HGM/HGE30 ~ 250

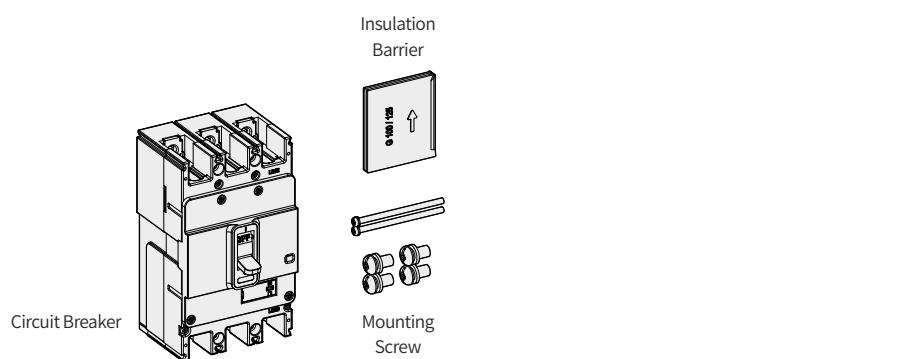

| Type                          | Part |               |      |                          |      |
|-------------------------------|------|---------------|------|--------------------------|------|
| HGM/HGE<br>30, 50E/S, 60, 100 | 2P   | 2 EA (M4×L70) | 4 EA | (M5×L15)<br>(15 ~ 50 A)  | 1 EA |
|                               | 3P   | 2 EA (M4×L70) | 6 EA |                          | 2 EA |
|                               | 4P   | 4 EA (M4×L70) | 8 EA |                          | 3 EA |
| HGM/HGE<br>50H/L, 125         | 2P   | 2 EA (M4×L70) |      | 4 EA (M8×L15)            | 1 EA |
|                               | 3P   | 2 EA (M4×L70) |      | 6 EA (M8×L15)            | 2 EA |
|                               | 4P   | 4 EA (M4×L70) |      | 8 EA (M8×L15)            | 3 EA |
| HGM/HGE<br>160, 250           | 2P   | 2 EA (M4×L70) |      | 4 EA (Hex Socket M8×L18) | 1 EA |
|                               | 3P   | 2 EA (M4×L70) |      | 6 EA (Hex Socket M8×L18) | 2 EA |
|                               | 4P   | 4 EA (M4×L70) |      | 8 EA (Hex Socket M8×L18) | 3 EA |


HGM/HGE400 ~ 800

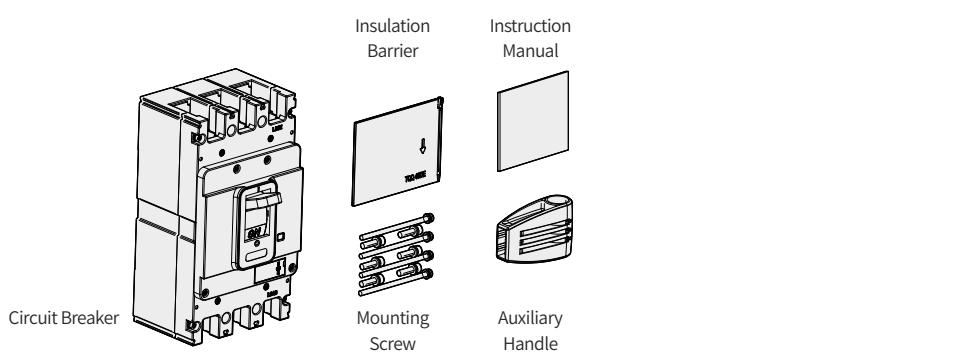

| Type                | Part |                |                |      |      |
|---------------------|------|----------------|----------------|------|------|
| HGM/HGE<br>400      | 2P   | 4 EA (M6×L103) | 4 EA (M10×L30) | 1 EA | 1 EA |
|                     | 3P   | 4 EA (M6×L103) | 6 EA (M10×L30) | 2 EA | 1 EA |
|                     | 4P   | 6 EA (M6×L103) | 8 EA (M10×L30) | 3 EA | 1 EA |
| HGM/HGE<br>630, 800 | 2P   | 4 EA (M6×L103) | 4 EA (M12×L30) | 1 EA | 1 EA |
|                     | 3P   | 4 EA (M6×L103) | 6 EA (M12×L30) | 2 EA | 1 EA |
|                     | 4P   | 6 EA (M6×L103) | 8 EA (M12×L30) | 3 EA | 1 EA |

## MCCB/ELCB Assembly and Terminal Mounting Specification

### HGM/HGE Type

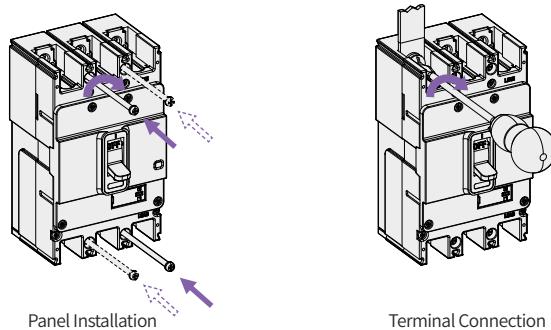

| No | Type                       | Panel Mounting      |  | Connection Terminal  |   |
|----|----------------------------|---------------------|--|----------------------|---|
|    |                            | Screw Specification | Terminal Connection Method and Dimensions (mm) | Conductor Processing | Tightening Torque                       |
| 1  | HGM/HGE 30, 50E/S, 60, 100 | M4 : 13 kgf.cm      |  |                      | <br>M5 : 28.5 kgf.cm<br>M8 : 110 kgf.cm |
| 2  | HGM/HGE 50H/L, 125         | M4 : 13 kgf.cm      |  |                      | <br>M8 : 110 kgf.cm                     |
| 3  | HGM/HGE 160, 250           | M4 : 13 kgf.cm      |  |                      | <br>Hex M8 : 110 kgf.cm                 |
| 4  | HGM/HGE 400                | M6 : 45 kgf.cm      |  |                      | <br>Hex M10 : 270 kgf.cm                |
| 5  | HGM/HGE 630, 800           | M6 : 45 kgf.cm      |  |                      | <br>Hex M12 : 470 kgf.cm                |

## Technical Data (HGP)

### Environmental Operating Conditions

#### Temperature Derating


The overcurrent characteristic of MCCB has been set to the ambient temperature of 40°C. If the ambient temperature is less or more than 40°C, the overcurrent characteristics may differ.

#### If the Ambient Temperature is less than 40 °C

In order to ensure that the circuit breaker's overcurrent meet the derating curve at the given ambient temperature, the real current ( $I_r$ ) has to be adjusted. The temperature correction ratio or each MCCB is shown in the circuit breaker's characteristics curve.

#### If the Ambient Temperature is more than 40 °C

As the internal temperature of MCCB is a sum of increased temperature due to current flow and the ambient temperature, if the ambient temperature exceeds 40 °C, thermal damage of internal insulation material of MCCB may occur causing the circuit breaker to trip at an early stage. When applying ambient temperature higher than 40 °C, the rated current must be adjusted as shown in the following rated current derating table.

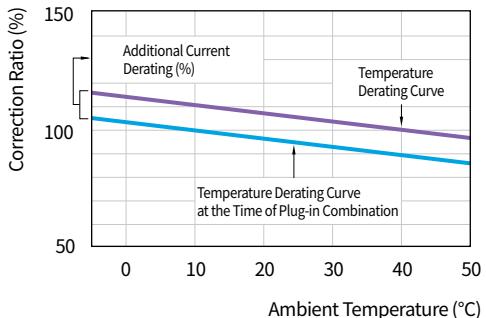

In (Rated Current) : Circuit breaker's rating at ambient temperature of 40 °C

$I_r$  (Real Current) :

Circuit breaker's rating at the given temperature

$$I_r = \text{Correction Ratio (\%)} \times I_n$$

Rated Current Derating Table : HGP Type/Standard Mounting (Fixed Type)

| Model            | Rated Current (A) | Ambient Temperature (°C) |     |     |     |     |     |     |     |     |     |
|------------------|-------------------|--------------------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|
|                  |                   | 10                       | 20  | 30  | 40  | 45  | 50  | 55  | 60  | 65  | 70  |
| HGP160D          | 16                | 18                       | 17  | 17  | 16  | 16  | 15  | 15  | 14  | 14  | 13  |
|                  | 20                | 22                       | 22  | 21  | 20  | 19  | 19  | 18  | 18  | 17  | 16  |
|                  | 25                | 28                       | 27  | 26  | 25  | 24  | 24  | 23  | 22  | 22  | 21  |
|                  | 32                | 36                       | 35  | 33  | 32  | 31  | 30  | 29  | 28  | 27  | 26  |
|                  | 40                | 45                       | 43  | 42  | 40  | 39  | 38  | 36  | 35  | 34  | 33  |
|                  | 50                | 56                       | 54  | 52  | 50  | 49  | 47  | 46  | 44  | 43  | 41  |
|                  | 63                | 71                       | 68  | 66  | 63  | 61  | 59  | 57  | 55  | 53  | 51  |
|                  | 80                | 90                       | 87  | 83  | 80  | 78  | 75  | 73  | 70  | 68  | 65  |
|                  | 100               | 112                      | 108 | 104 | 100 | 97  | 94  | 91  | 88  | 85  | 82  |
|                  | 125               | 141                      | 135 | 130 | 125 | 121 | 117 | 113 | 109 | 105 | 101 |
|                  | 150               | 169                      | 162 | 156 | 150 | 145 | 140 | 135 | 130 | 125 | 120 |
|                  | 160               | 180                      | 173 | 166 | 160 | 155 | 150 | 145 | 140 | 135 | 130 |
| HGP250           | 40                | 46                       | 44  | 42  | 40  | 39  | 38  | 37  | 36  | 35  | 34  |
|                  | 50                | 58                       | 55  | 53  | 50  | 49  | 48  | 46  | 45  | 44  | 43  |
|                  | 63                | 72                       | 69  | 66  | 63  | 61  | 60  | 58  | 57  | 55  | 54  |
|                  | 80                | 92                       | 88  | 84  | 80  | 78  | 76  | 74  | 72  | 70  | 68  |
|                  | 100               | 115                      | 110 | 105 | 100 | 98  | 95  | 93  | 90  | 88  | 85  |
|                  | 125               | 144                      | 138 | 131 | 125 | 122 | 119 | 116 | 113 | 109 | 106 |
|                  | 150               | 173                      | 165 | 158 | 150 | 146 | 143 | 139 | 135 | 131 | 128 |
|                  | 160               | 184                      | 176 | 168 | 160 | 156 | 152 | 148 | 144 | 140 | 136 |
|                  | 175               | 201                      | 193 | 184 | 175 | 171 | 166 | 162 | 158 | 153 | 149 |
|                  | 200               | 230                      | 220 | 210 | 200 | 195 | 190 | 185 | 180 | 175 | 170 |
|                  | 225               | 259                      | 248 | 236 | 225 | 219 | 214 | 208 | 203 | 197 | 191 |
|                  | 250               | 288                      | 275 | 263 | 250 | 244 | 238 | 231 | 225 | 219 | 213 |
| HGP400<br>HGP630 | 300               | 323                      | 315 | 308 | 300 | 291 | 282 | 273 | 264 | 255 | 246 |
|                  | 350               | 376                      | 368 | 359 | 350 | 340 | 330 | 320 | 310 | 300 | 290 |
|                  | 400               | 430                      | 420 | 410 | 400 | 388 | 376 | 364 | 352 | 340 | 328 |
|                  | 500               | 538                      | 525 | 513 | 500 | 485 | 470 | 455 | 440 | 425 | 410 |
| HPG800           | 630               | 677                      | 662 | 646 | 630 | 611 | 592 | 573 | 554 | 535 | 516 |
|                  | 700               | 753                      | 735 | 718 | 700 | 679 | 658 | 637 | 616 | 595 | 574 |
|                  | 800               | 860                      | 840 | 820 | 800 | 776 | 752 | 728 | 704 | 680 | 656 |

Rated Current Derating Table : HGP Type/Plug-in Method

| Model            | Rated Current(A) | Ambient Temperature (°C) |     |     |     |     |     |     |     |     |     |
|------------------|------------------|--------------------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|
|                  |                  | 10                       | 20  | 30  | 40  | 45  | 50  | 55  | 60  | 65  | 70  |
| HGP 160D         | 16               | 16                       | 16  | 15  | 14  | 14  | 14  | 13  | 13  | 12  | 12  |
|                  | 20               | 20                       | 19  | 19  | 18  | 17  | 17  | 16  | 16  | 15  | 15  |
|                  | 25               | 25                       | 24  | 23  | 23  | 22  | 21  | 21  | 20  | 19  | 19  |
|                  | 32               | 32                       | 31  | 30  | 29  | 28  | 27  | 26  | 25  | 24  | 23  |
|                  | 40               | 40                       | 39  | 37  | 36  | 35  | 34  | 33  | 32  | 31  | 30  |
|                  | 50               | 51                       | 49  | 47  | 45  | 44  | 42  | 41  | 40  | 38  | 37  |
|                  | 63               | 64                       | 61  | 59  | 57  | 55  | 53  | 51  | 50  | 48  | 46  |
|                  | 80               | 81                       | 78  | 75  | 72  | 70  | 68  | 65  | 63  | 61  | 59  |
|                  | 100              | 101                      | 97  | 94  | 90  | 87  | 85  | 82  | 79  | 77  | 74  |
|                  | 125              | 126                      | 122 | 117 | 113 | 109 | 105 | 102 | 98  | 95  | 91  |
|                  | 150              | 152                      | 146 | 140 | 135 | 131 | 126 | 122 | 117 | 113 | 108 |
|                  | 160              | 162                      | 156 | 150 | 144 | 140 | 135 | 131 | 126 | 122 | 117 |
|                  | 40               | 40                       | 38  | 36  | 34  | 33  | 32  | 31  | 30  | 29  | 28  |
|                  | 50               | 50                       | 48  | 45  | 43  | 41  | 40  | 39  | 38  | 36  | 35  |
| HGP250           | 63               | 63                       | 60  | 57  | 54  | 52  | 50  | 49  | 47  | 46  | 44  |
|                  | 80               | 80                       | 76  | 72  | 68  | 66  | 64  | 62  | 60  | 58  | 56  |
|                  | 100              | 105                      | 100 | 95  | 90  | 88  | 85  | 83  | 80  | 78  | 75  |
|                  | 125              | 131                      | 125 | 119 | 113 | 109 | 106 | 103 | 100 | 97  | 94  |
|                  | 150              | 158                      | 150 | 143 | 135 | 131 | 128 | 124 | 120 | 116 | 113 |
|                  | 160              | 168                      | 160 | 152 | 144 | 140 | 136 | 132 | 128 | 124 | 120 |
|                  | 175              | 184                      | 175 | 166 | 158 | 153 | 149 | 144 | 140 | 136 | 131 |
|                  | 200              | 210                      | 200 | 190 | 180 | 175 | 170 | 165 | 160 | 155 | 150 |
|                  | 225              | 236                      | 225 | 214 | 203 | 197 | 191 | 186 | 180 | 174 | 169 |
|                  | 250              | 263                      | 250 | 238 | 225 | 219 | 213 | 206 | 200 | 194 | 188 |
| HGP400<br>HGP630 | 300              | 284                      | 277 | 271 | 264 | 256 | 248 | 240 | 232 | 224 | 216 |
|                  | 350              | 331                      | 323 | 316 | 308 | 299 | 290 | 282 | 273 | 264 | 255 |
|                  | 400              | 378                      | 370 | 361 | 352 | 341 | 331 | 320 | 310 | 299 | 289 |
|                  | 500              | 473                      | 462 | 451 | 440 | 427 | 414 | 400 | 387 | 374 | 361 |
|                  | 630              | 596                      | 582 | 568 | 554 | 538 | 521 | 504 | 488 | 471 | 454 |
| HGP800           | 700              | 696                      | 680 | 664 | 648 | 628 | 609 | 589 | 570 | 550 | 531 |
|                  | 800              | 796                      | 777 | 759 | 740 | 718 | 696 | 673 | 651 | 629 | 607 |

## Technical Data (HGP)

### Environmental Operating Conditions

#### Altitude Derating

The characteristics of the circuit breaker is not affected at an altitude of less than 2,000 m. Characteristics of insulation and air cooling of the circuit breaker are reduced at an altitude of more than 2,000 m and the rated current and rated voltage must be adjusted as shown in the table below. However, there is no change in the characteristics of breaking capacity.

| Circuit breaker | Altitude  | 2,000 m | 3,000 m | 4,000 m | 5,000 m |
|-----------------|---|---------|---------|---------|---------|
| HGP Type MCCB   | Withstand Voltage (V)                           | 3,000   | 2,500   | 2,100   | 1,800   |
| HGP160D         | Insulation Voltage (V) $U_i$                    | 1,000   | 850     | 750     | 650     |
| HGP250 ~ 800    | Maximum Operational Voltage (V) $U_e$           | 690     | 590     | 520     | 460     |
|                 | Average Through-Current (A), at 40 °C $I_{n,x}$ | 1       | 0.96    | 0.93    | 0.9     |

#### Vibrations

The excessive vibration may cause problems such as decrease of breaking capacity, lower dynamic strength, reduction of electric current conductivity or compromising safety of operating characteristics. Therefore, proper consideration is required with regards to these environmental stresses when it comes to designating the circuit breakers. These stresses are generated by the vibration during transportation, magnetic impact during opening and closing operation and influence of adjacent devices. Our circuit breaker has been verified in accordance with the standards with regards to vibration resistance.

#### Vibration Test

Vibration test is verified with the standard requested by the shipping certification institute in compliance with IEC 60068-2-6. Out of the vibration test items, resonance test and vibration Endurance test were verified based on the following standard.

#### Vibration Endurance Test

A sinusoidal wave with frequency of 30 Hz is applied for 90 minutes to check for abnormalities.


- 30 Hz : 0.7 g Acceleration

#### Resonance Test

It confirms whether vibration is generated in the characteristics part of MCCB by slowly changing the frequency in the frequency sector of the following sinusoidal wave.





- 5 ~ 13.2 Hz : 1 mm Displacement
- 13.2 ~ 100 Hz : 0.7 g Acceleration

#### Seismic Performance and Shock Tolerance Table

| Item           | Seismic   |
|----------------|---|
| Test Condition | <p>Mounting Posture<br/>Direction of Vibration, Shock</p> <ul style="list-style-type: none"> <li>• Vertical mounting</li> <li>• Up-down, left-right, front-back</li> </ul>   |
| Status of MCCB | <ul style="list-style-type: none"> <li>• Non-conduction (ON or OFF status)</li> <li>• Status where rated current has been conducted on until the temperature of MCCB becomes constant and continuous</li> </ul>   |
| Test Result    | <p>Judgment Condition</p> <ul style="list-style-type: none"> <li>• If it is ON, it should not turn OFF</li> <li>• If it is OFF, it should not turn ON</li> <li>• No abnormal status such as damage, deformation or loosened screw part</li> <li>• The characteristics of switch and trip after the test must be normal</li> </ul> |

## Degree of Protection

The MCCB's IP rating is defined based on IEC 60529. The IP rating also depends on product conditions.
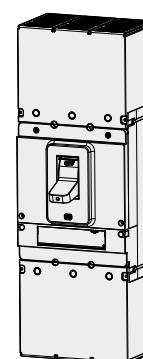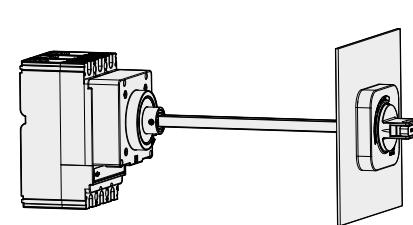
| Condition         | Circuit Breaker   | Circuit Breaker + Terminal Cover   | Circuit Breaker + Terminal Cover + Rotary Handle (Front Contact Type)             | Circuit Breaker + Terminal Cover + Rotary Handle (Extension Type)                   |
|-------------------|---|--|---|---|
| Appearance        |  |  |  |  |
| Protection Degree | IP20  | IP40   | IP40  | IP54  |

## Technical Data (HGP)

### Power Loss / Resistance

#### HGP Type MCCB

| Type  | 정격전류<br>(A) | HGP50D         |               | HGP125D        |               | HGP160D        |               | HGP100         |               | HGP160         |               | HGP250         |               |
|-------|-------------|----------------|---------------|----------------|---------------|----------------|---------------|----------------|---------------|----------------|---------------|----------------|---------------|
|       |             | R/Pole<br>(mΩ) | P/Pole<br>(W) |
| Fixed | 16          | 14.4           | 3.69          | 14.4           | 3.69          | 14.4           | 3.69          |                |               |                |               |                |               |
|       | 20          | 14.4           | 5.76          | 14.4           | 5.76          | 14.4           | 5.76          |                |               |                |               |                |               |
|       | 25          | 6.372          | 3.98          | 6.372          | 3.98          | 6.372          | 3.98          |                |               |                |               |                |               |
|       | 32          | 4.056          | 4.15          | 4.056          | 4.15          | 4.056          | 4.15          |                |               |                |               |                |               |
|       | 40          | 2.544          | 4.07          | 2.544          | 4.07          | 2.544          | 4.07          | 2.40           | 3.84          |                |               |                |               |
|       | 50          | 2.544          | 6.36          | 2.544          | 6.36          | 2.544          | 6.36          | 1.80           | 4.50          |                |               |                |               |
|       | 63          |                |               | 1.488          | 5.91          | 1.488          | 5.91          | 1.30           | 5.16          |                |               |                |               |
|       | 80          |                |               | 1.188          | 7.60          | 1.188          | 7.60          | 0.84           | 5.37          |                |               |                |               |
|       | 100         |                |               | 1.044          | 10.44         | 1.044          | 10.44         | 0.88           | 8.80          | 0.88           | 8.80          |                |               |
|       | 125         |                |               | 0.924          | 14.44         | 0.924          | 14.44         |                |               | 0.61           | 9.53          | 0.61           | 9.53          |
|       | 150         |                |               |                |               | 0.792          | 17.82         |                |               | 0.46           | 10.35         | 0.46           | 10.35         |
|       | 160         |                |               |                |               | 0.792          | 20.28         |                |               | 0.46           | 11.78         | 0.46           | 11.78         |
|       | 175         |                |               |                |               |                |               |                |               |                |               | 0.39           | 11.94         |
|       | 200         |                |               |                |               |                |               |                |               |                |               | 0.39           | 15.60         |
|       | 225         |                |               |                |               |                |               |                |               |                |               | 0.3            | 15.19         |
|       | 250         |                |               |                |               |                |               |                |               |                |               | 0.3            | 18.75         |

| Type  | 정격전류<br>(A) | HGP400         |               | HGP630         |               | HGP800         |               |
|-------|-------------|----------------|---------------|----------------|---------------|----------------|---------------|
|       |             | R/Pole<br>(mΩ) | P/Pole<br>(W) | R/Pole<br>(mΩ) | P/Pole<br>(W) | R/Pole<br>(mΩ) | P/Pole<br>(W) |
| Fixed | 300         | 0.215          | 19.35         |                |               |                |               |
|       | 350         | 0.215          | 26.34         |                |               |                |               |
|       | 400         | 0.185          | 29.60         |                |               |                |               |
|       | 500         |                | 0.155         | 38.75          |               |                |               |
|       | 630         |                | 0.125         | 49.61          |               |                |               |
|       | 700         |                |               |                | 0.11          | 53.90          |               |
|       | 800         |                |               |                | 0.08          | 51.20          |               |

| Type  | 정격전류<br>(A) | HGP100 MP      |               |
|-------|-------------|----------------|---------------|
|       |             | R/Pole<br>(mΩ) | P/Pole<br>(W) |
| Fixed | 2.5         | 160.7          | 1             |
|       | 3.2         | 67.20          | 0.69          |
|       | 6.3         | 14.85          | 0.59          |
|       | 12.5        | 4.29           | 0.67          |
|       | 20          | 2.53           | 1.01          |
|       | 32          | 0.96           | 0.98          |
|       | 50          | 0.59           | 1.49          |
|       | 63          | 0.59           | 2.35          |
|       | 80          | 0.52           | 3.34          |
|       | 100         | 0.48           | 4.78          |

| Type  | 정격전류<br>(A) | HGP100 ETU     |               | HGP160 ETU     |               | HGP250 ETU     |               | HGP400 ETU     |               | HGP630 ETU     |               | HGP800 ETU     |               |
|-------|-------------|----------------|---------------|----------------|---------------|----------------|---------------|----------------|---------------|----------------|---------------|----------------|---------------|
|       |             | R/Pole<br>(mΩ) | P/Pole<br>(W) |
| Fixed | 40          | 0.6            | 0.96          |                |               |                |               |                |               |                |               |                |               |
|       | 100         | 0.3            | 3.00          | 0.3            | 3.00          |                |               |                |               |                |               |                |               |
|       | 160         |                |               | 0.3            | 7.68          | 0.3            | 7.68          |                |               |                |               |                |               |
|       | 250         |                |               |                | 0.3           | 18.75          | 0.125         | 7.81           |               |                |               |                |               |
|       | 400         |                |               |                |               |                | 0.125         | 20.00          |               |                |               |                |               |
|       | 630         |                |               |                |               |                |               |                | 0.125         | 49.61          |               |                |               |
|       | 800         |                |               |                |               |                |               |                |               | 0.08           | 51.20         |                |               |

| Type    | 정격전류<br>(A) | HGP50D         |               | HGP125D        |               | HGP160D        |               | HGP100         |               | HGP160         |               | HGP250         |               |
|---------|-------------|----------------|---------------|----------------|---------------|----------------|---------------|----------------|---------------|----------------|---------------|----------------|---------------|
|         |             | R/Pole<br>(mΩ) | P/Pole<br>(W) |
| Plug-in | 16          | 14.48          | 3.71          | 14.48          | 3.71          | 14.48          | 3.71          |                |               |                |               |                |               |
|         | 20          | 14.48          | 5.79          | 14.48          | 5.79          | 14.48          | 5.79          |                |               |                |               |                |               |
|         | 25          | 6.452          | 4.03          | 6.452          | 4.03          | 6.452          | 4.03          |                |               |                |               |                |               |
|         | 32          | 4.136          | 4.24          | 4.136          | 4.24          | 4.136          | 4.24          |                |               |                |               |                |               |
|         | 40          | 2.624          | 4.20          | 2.624          | 4.20          | 2.624          | 4.20          | 2.46           | 3.94          |                |               |                |               |
|         | 50          | 2.624          | 6.56          | 2.624          | 6.56          | 2.624          | 6.56          | 1.86           | 4.65          |                |               |                |               |
|         | 63          |                |               | 1.568          | 6.22          | 1.568          | 6.22          | 1.36           | 5.40          |                |               |                |               |
|         | 80          |                |               | 1.268          | 8.12          | 1.268          | 8.12          | 0.899          | 5.75          |                |               |                |               |
|         | 100         |                |               | 1.124          | 11.24         | 1.124          | 11.24         | 0.94           | 9.40          | 0.94           | 9.40          |                |               |
|         | 125         |                |               | 1.004          | 15.69         | 1.004          | 15.69         | 0.872          | 19.62         |                |               | 0.67           | 10.47         |
|         | 150         |                |               |                |               | 0.872          | 19.62         |                |               | 0.52           | 11.70         | 0.52           | 11.70         |
|         | 160         |                |               |                |               | 0.872          | 22.32         |                |               | 0.52           | 13.31         | 0.52           | 13.31         |
|         | 175         |                |               |                |               |                |               |                |               |                |               | 0.45           | 13.78         |
|         | 200         |                |               |                |               |                |               |                |               |                |               | 0.45           | 18.00         |
|         | 225         |                |               |                |               |                |               |                |               |                |               | 0.36           | 18.23         |
|         | 250         |                |               |                |               |                |               |                |               |                |               | 0.36           | 22.50         |

| Type    | 정격전류<br>(A) | HGP400         |               | HGP630         |               | HGP800         |               |
|---------|-------------|----------------|---------------|----------------|---------------|----------------|---------------|
|         |             | R/Pole<br>(mΩ) | P/Pole<br>(W) | R/Pole<br>(mΩ) | P/Pole<br>(W) | R/Pole<br>(mΩ) | P/Pole<br>(W) |
| Plug-in | 300         | 0.255          | 22.95         |                |               |                |               |
|         | 350         | 0.255          | 31.24         |                |               |                |               |
|         | 400         | 0.225          | 36.00         |                |               |                |               |
|         | 500         |                |               | 0.195          | 48.75         |                |               |
|         | 630         |                |               | 0.165          | 65.49         |                |               |
|         | 700         |                |               |                |               | 0.13           | 63.70         |
|         | 800         |                |               |                |               | 0.1            | 64.00         |

| Type    | 정격전류<br>(A) | HGP100 MP      |               |
|---------|-------------|----------------|---------------|
|         |             | R/Pole<br>(mΩ) | P/Pole<br>(W) |
| Plug-in | 2.5         | 160.76         | 1             |
|         | 3.2         | 67.26          | 0.69          |
|         | 6.3         | 14.91          | 0.59          |
|         | 12.5        | 4.35           | 0.68          |
|         | 20          | 2.59           | 1.04          |
|         | 32          | 1.015          | 1.04          |
|         | 50          | 0.654          | 1.64          |
|         | 63          | 0.651          | 2.58          |
|         | 80          | 0.582          | 3.72          |
|         | 100         | 0.538          | 5.38          |

| Type    | 정격전류<br>(A) | HGP100 ETU     |               | HGP160 ETU     |               | HGP250 ETU     |               | HGP400 ETU     |               | HGP630 ETU     |               | HGP800 ETU     |               |
|---------|-------------|----------------|---------------|----------------|---------------|----------------|---------------|----------------|---------------|----------------|---------------|----------------|---------------|
|         |             | R/Pole<br>(mΩ) | P/Pole<br>(W) |
| Plug-in | 40          | 0.66           | 1.06          |                |               |                |               |                |               |                |               |                |               |
|         | 100         | 0.36           | 3.60          | 0.36           | 3.60          |                |               |                |               |                |               |                |               |
|         | 160         |                |               | 0.36           | 9.22          | 0.36           | 9.22          |                |               |                |               |                |               |
|         | 250         |                |               |                |               | 0.36           | 22.50         | 0.165          | 10.31         |                |               |                |               |
|         | 400         |                |               |                |               |                |               | 0.165          | 26.40         |                |               |                |               |
|         | 630         |                |               |                |               |                |               |                |               | 0.165          | 65.49         |                |               |
|         | 800         |                |               |                |               |                |               |                |               |                |               | 0.1            | 64.00         |

## Technical Data (HGP)

### Cascading Table

#### AC 220/240 V

Upstream : HGP50D, HGP125D, HGP160D, HGP250, HGP400, HGP630

Downstream : HGD63\*, HGD125\*, HGM30, HGM50

| Upstream Circuit Breaker            | HGP50D |     |     |     | HGP125D |     |     |     | HGP160D |     |     |     |
|-------------------------------------|--------|-----|-----|-----|---------|-----|-----|-----|---------|-----|-----|-----|
|                                     | F*     | S   | H   | X   | F*      | S   | H   | X   | F*      | S   | H   | X   |
| Breaking Capacity [Icu] (kA r.m.s.) | 65     | 100 | 130 | 200 | 65      | 100 | 130 | 200 | 65      | 100 | 130 | 200 |
| Enhanced Breaking Capacity          |        |     |     |     |         |     |     |     |         |     |     |     |
| HGD63E*                             | 10     | 20  | 20  | 20  | 20      | 20  | 20  | 20  | 20      | 20  | 20  | 20  |
| HGD63S*                             | 15     | 30  | 30  | 30  | 30      | 30  | 30  | 30  | 30      | 30  | 30  | 30  |
| HGD63N/M*                           | 20     | 40  | 60  | 60  | 40      | 60  | 60  | 60  | 40      | 60  | 60  | 60  |
| HGD63H/P*                           | 25     | 40  | 60  | 60  | 40      | 60  | 60  | 60  | 40      | 60  | 60  | 60  |
| HGD100S/125*                        | 25     | 40  | 60  | 60  | 40      | 60  | 60  | 60  | 40      | 60  | 60  | 60  |

| Upstream Circuit Breaker            | HGP100 |     |     |     | HGP160 |     |     |     | HGP250 |     |     |     |
|-------------------------------------|--------|-----|-----|-----|--------|-----|-----|-----|--------|-----|-----|-----|
|                                     | F*     | S   | H   | X   | F*     | S   | H   | X   | F*     | S   | H   | X   |
| Breaking Capacity [Icu] (kA r.m.s.) | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 |
| Enhanced Breaking Capacity          |        |     |     |     |        |     |     |     |        |     |     |     |
| HGD63E*                             | 10     | 20  | 20  | 20  | 20     | 20  | 20  | 20  | 20     | 20  | 20  | 20  |
| HGD63S*                             | 15     | 30  | 30  | 30  | 30     | 30  | 30  | 30  | 30     | 30  | 30  | 30  |
| HGD63N/M*                           | 20     | 40  | 60  | 60  | 40     | 60  | 60  | 60  | 40     | 60  | 60  | 60  |
| HGD63H/P*                           | 25     | 40  | 60  | 60  | 40     | 60  | 60  | 60  | 40     | 60  | 60  | 60  |
| HGD100S/125*                        | 25     |     |     |     | 40     | 60  | 60  | 60  | 40     | 60  | 60  | 60  |

| Upstream Circuit Breaker            | HGP50D |     |     |     | HGP125D |     |     |     | HGP160D |     |     |     |
|-------------------------------------|--------|-----|-----|-----|---------|-----|-----|-----|---------|-----|-----|-----|
|                                     | F*     | S   | H   | X   | F*      | S   | H   | X   | F*      | S   | H   | X   |
| Breaking Capacity [Icu] (kA r.m.s.) | 65     | 100 | 130 | 200 | 65      | 100 | 130 | 200 | 65      | 100 | 130 | 200 |
| Enhanced Breaking Capacity          |        |     |     |     |         |     |     |     |         |     |     |     |
| HGM30E                              | 35     | 65  | 70  | 70  | 70      | 65  | 70  | 70  | 70      | 65  | 70  | 70  |
| HGM30S                              | 50     | 65  | 70  | 70  | 70      | 65  | 70  | 70  | 70      | 65  | 70  | 70  |
| HGM50E                              | 35     | 65  | 85  | 100 | 100     | 65  | 85  | 100 | 100     | 65  | 85  | 100 |
| HGM50S                              | 50     | 65  | 100 | 130 | 130     | 65  | 100 | 130 | 130     | 65  | 100 | 130 |
| HGM50H                              | 85     |     | 100 | 130 | 150     |     | 100 | 130 | 150     |     | 100 | 130 |
| HGM50L                              | 100    |     |     | 130 | 150     |     |     | 130 | 150     |     |     | 130 |

| Upstream Circuit Breaker            | HGP100 |     |     |     | HGP160 |     |     |     |
|-------------------------------------|--------|-----|-----|-----|--------|-----|-----|-----|
|                                     | F*     | S   | H   | X   | F*     | S   | H   | X   |
| Breaking Capacity [Icu] (kA r.m.s.) | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 |
| Enhanced Breaking Capacity          |        |     |     |     |        |     |     |     |
| HGM30E                              | 35     | 65  | 70  | 70  | 70     | 65  | 70  | 70  |
| HGM30S                              | 50     | 65  | 70  | 70  | 70     | 65  | 70  | 70  |
| HGM50E                              | 35     | 65  | 85  | 100 | 100    | 65  | 85  | 100 |
| HGM50S                              | 50     | 65  | 100 | 130 | 130    | 65  | 100 | 130 |
| HGM50H                              | 85     |     | 100 | 130 | 150    |     | 100 | 130 |
| HGM50L                              | 100    |     |     | 130 | 150    |     |     | 130 |

| Upstream Circuit Breaker            | HGP250 |     |     |     | HGP400 |     |     |     | HGP630 |     |     |     |
|-------------------------------------|--------|-----|-----|-----|--------|-----|-----|-----|--------|-----|-----|-----|
|                                     | F*     | S   | H   | X   | F*     | S   | H   | X   | F*     | S   | H   | X   |
| Breaking Capacity [Icu] (kA r.m.s.) | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 |
| Enhanced Breaking Capacity          |        |     |     |     |        |     |     |     |        |     |     |     |
| HGM30E                              | 35     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 70     | 65  | 70  | 70  |
| HGM30S                              | 50     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 70     | 65  | 70  | 70  |
| HGM50E                              | 35     | 65  | 85  | 100 | 100    | 65  | 85  | 100 | 100    | 65  | 85  | 100 |
| HGM50S                              | 50     | 65  | 100 | 130 | 130    | 65  | 100 | 130 | 130    | 65  | 100 | 130 |
| HGM50H                              | 85     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 |
| HGM50L                              | 100    |     |     | 130 | 150    |     |     | 130 | 150    |     |     | 130 |

\* F type is for overseas sales.

Upstream : HGP125D, HGP160D, HGP250, HGP400, HGP630

Downstream : HGM60, HGM100, HGM125, HGM160, HGM250

| Upstream Circuit Breaker                              | HGP125D |     |     |     | HGP160D |     |     |     | HGP100 |     |     |     |
|---|---------|-----|-----|-----|---------|-----|-----|-----|--------|-----|-----|-----|
|   | F*      | S   | H   | X   | F*      | S   | H   | X   | F*     | S   | H   | X   |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 65      | 100 | 130 | 200 | 65      | 100 | 130 | 200 | 65     | 100 | 130 | 200 |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |         |     |     |     |         |     |     |     |        |     |     |     |
| HGM60E  | 35      | 65  | 70  | 70  | 70      | 65  | 70  | 70  | 70     | 65  | 70  | 70  |
| HGM60S  | 50      | 65  | 70  | 70  | 70      | 65  | 70  | 70  | 70     | 65  | 70  | 70  |
| HGM60H  | 50      | 65  | 70  | 70  | 70      | 65  | 70  | 70  | 70     | 65  | 70  | 70  |
| HGM60L  | 50      | 65  | 70  | 70  | 70      | 65  | 70  | 70  | 70     | 65  | 70  | 70  |
| HGM100E   | 35      | 65  | 70  | 70  | 70      | 65  | 70  | 70  | 70     | 65  | 70  | 70  |
| HGM100S   | 50      | 65  | 70  | 70  | 70      | 65  | 70  | 70  | 70     | 65  | 70  | 70  |
| HGM100H   | 50      | 65  | 70  | 70  | 70      | 65  | 70  | 70  | 70     | 65  | 70  | 70  |
| HGM100L   | 50      | 65  | 70  | 70  | 70      | 65  | 70  | 70  | 70     | 65  | 70  | 70  |
| HGM125E   | 50      | 65  | 85  | 100 | 100     | 65  | 85  | 100 | 100    |     |     |     |
| HGM125S   | 65      |     | 100 | 130 | 130     |     | 100 | 130 | 130    |     |     |     |
| HGM125H   | 85      |     | 100 | 130 | 150     |     | 100 | 130 | 150    |     |     |     |
| HGM125L   | 100     |     |     | 130 | 150     |     |     | 130 | 150    |     |     |     |

| Upstream Circuit Breaker                              | HGP160 |     |     |     | HGP250 |     |     |     | HGP400 |     |     |     | HGP630 |     |     |     |
|---|--------|-----|-----|-----|--------|-----|-----|-----|--------|-----|-----|-----|--------|-----|-----|-----|
|   | F*     | S   | H   | X   |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |     |     |     |        |     |     |     |        |     |     |     |        |     |     |     |
| HGM60E  | 35     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 65     | 70  | 70  | 70  |
| HGM60S  | 50     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 65     | 70  | 70  | 70  |
| HGM60H  | 50     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 65     | 70  | 70  | 70  |
| HGM60L  | 50     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 65     | 70  | 70  | 70  |
| HGM100E   | 35     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 65     | 70  | 70  | 70  |
| HGM100S   | 50     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 65     | 70  | 70  | 70  |
| HGM100H   | 50     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 65     | 70  | 70  | 70  |
| HGM100L   | 50     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 70     | 65  | 70  | 70  | 65     | 70  | 70  | 70  |
| HGM125E   | 50     | 65  | 85  | 100 | 100    | 65  | 85  | 100 | 100    | 65  | 85  | 100 | 65     | 85  | 100 | 100 |
| HGM125S   | 65     |     | 100 | 130 | 130    |     | 100 | 130 | 130    |     | 100 | 130 |        | 100 | 130 | 130 |
| HGM125H   | 85     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 |        | 100 | 130 | 150 |
| HGM125L   | 100    |     |     | 130 | 150    |     |     | 130 | 150    |     |     | 130 |        | 130 |     | 150 |

| Upstream Circuit Breaker                              | HGP160D |     |     |     | HGP160 |     |     |     | HGP250 |     |     |     |
|---|---------|-----|-----|-----|--------|-----|-----|-----|--------|-----|-----|-----|
|   | F*      | S   | H   | X   | F*     | S   | H   | X   | F*     | S   | H   | X   |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 65      | 100 | 130 | 200 | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |         |     |     |     |        |     |     |     |        |     |     |     |
| HGM160E   | 50      | 65  | 85  | 100 | 100    | 65  | 85  | 100 | 100    | 65  | 85  | 100 |
| HGM160S   | 65      |     | 100 | 130 | 130    |     | 100 | 130 | 130    |     | 100 | 130 |
| HGM160H   | 85      |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 |
| HGM160L   | 100     |     |     | 130 | 150    |     |     | 130 | 150    |     |     | 130 |
| HGM250E   | 50      |     |     |     |        |     |     |     |        | 65  | 85  | 100 |
| HGM250S   | 65      |     |     |     |        |     |     |     |        |     | 100 | 130 |
| HGM250H   | 85      |     |     |     |        |     |     |     |        |     | 100 | 130 |
| HGM250L   | 100     |     |     |     |        |     |     |     |        |     |     | 130 |

※ \* F type is for overseas sales.

## Technical Data (HGP)

### Cascading Table

#### AC 220/240 V

Upstream : HGP400, HGP630, HGP800

Downstream : HGM160, HGM250, HGM400, HGM600, HGM800

| Upstream Circuit Breaker                       | HGP400 |     |     |     | HGP630 |     |     |     | HGP800 |     |     |     |
|--|--------|-----|-----|-----|--------|-----|-----|-----|--------|-----|-----|-----|
|  | F*     | S   | H   | X   | F*     | S   | H   | X   | F*     | S   | H   | X   |
| Breaking Capacity [Icu] (kA r.m.s.)            | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 |
| Downstream Breaking Capacity [Icu] (kA r.m.s.) |        |     |     |     |        |     |     |     |        |     |     |     |
| HGM160E  | 50     | 65  | 85  | 100 | 100    | 65  | 85  | 100 | 100    |     |     |     |
| HGM160S  | 65     |     | 100 | 130 | 130    |     | 100 | 130 | 130    |     |     |     |
| HGM160H  | 85     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     |     |     |
| HGM160L  | 100    |     |     | 130 | 150    |     |     | 130 | 150    |     |     |     |
| HGM250E  | 50     | 65  | 85  | 100 | 100    | 65  | 85  | 100 | 100    | 65  | 85  | 100 |
| HGM250S  | 65     |     | 100 | 130 | 130    |     | 100 | 130 | 130    |     | 100 | 130 |
| HGM250H  | 85     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 |
| HGM250L  | 100    |     |     | 130 | 150    |     |     | 130 | 150    |     |     | 130 |

| Upstream Circuit Breaker                       | HGP400 |     |     |     | HGP630 |     |     |     | HGP800 |     |     |     |
|--|--------|-----|-----|-----|--------|-----|-----|-----|--------|-----|-----|-----|
|  | F*     | S   | H   | X   | F*     | S   | H   | X   | F*     | S   | H   | X   |
| Breaking Capacity [Icu] (kA r.m.s.)            | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 |
| Downstream Breaking Capacity [Icu] (kA r.m.s.) |        |     |     |     |        |     |     |     |        |     |     |     |
| HGM400E  | 50     | 65  | 100 | 130 | 150    | 65  | 100 | 130 | 150    | 65  | 100 | 130 |
| HGM400S  | 75     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 |
| HGM400H  | 100    |     |     | 130 | 200    |     |     | 130 | 200    |     |     | 130 |
| HGM400L  | 125    |     |     | 130 | 200    |     |     | 130 | 200    |     |     | 130 |
| HGM600E  | 50     |     |     |     |        | 65  | 100 | 130 | 150    | 65  | 100 | 130 |
| HGM600S  | 75     |     |     |     |        |     | 100 | 130 | 150    |     | 100 | 130 |
| HGM600H  | 100    |     |     |     |        |     |     | 130 | 200    |     |     | 130 |
| HGM600L  | 125    |     |     |     |        |     |     | 130 | 200    |     |     | 130 |
| HGM800S  | 75     |     |     |     |        |     |     |     |        |     | 100 | 130 |
| HGM800H  | 100    |     |     |     |        |     |     |     |        |     |     | 130 |
| HGM800L  | 125    |     |     |     |        |     |     |     |        |     |     | 130 |

※ \* F type is for overseas sales.

Upstream : HGP50D, HGP125D, HGP160D, HGP250, HGP400, HGP630, HGP800  
 Downstream : HGP50D, HGP125D, HGP160D, HGP250, HGP400, HGP630, HGP800

| Upstream Circuit Breaker                       | HGP50D |     |     |     | HGP125D |     |     |     | HGP160D |     |     |     |     |
|--|--------|-----|-----|-----|---------|-----|-----|-----|---------|-----|-----|-----|-----|
|  | F*     | S   | H   | X   | F*      | S   | H   | X   | F*      | S   | H   | X   |     |
| Breaking Capacity [Icu] (kA r.m.s.)            | 65     | 100 | 130 | 200 | 65      | 100 | 130 | 200 | 65      | 100 | 130 | 200 |     |
| Downstream Breaking Capacity [Icu] (kA r.m.s.) |        |     |     |     |         |     |     |     |         |     |     |     |     |
| HGP50D/125D/160D F*                            | 65     |     | 100 | 130 | 150     |     | 100 | 130 | 150     |     | 100 | 130 | 150 |
| HGP50D/125D/160D S                             | 100    |     | 130 | 200 |         |     | 130 | 200 |         |     | 130 | 200 |     |
| HGP50D/125D/160D H                             | 130    |     |     | 200 |         |     |     | 200 |         |     |     | 200 |     |

| Upstream Circuit Breaker                       | HGP100 |     |     |     | HGP160 |     |     |     | HGP250 |     |     |     |     |
|--|--------|-----|-----|-----|--------|-----|-----|-----|--------|-----|-----|-----|-----|
|  | F*     | S   | H   | X   | F*     | S   | H   | X   | F*     | S   | H   | X   |     |
| Breaking Capacity [Icu] (kA r.m.s.)            | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 |     |
| Downstream Breaking Capacity [Icu] (kA r.m.s.) |        |     |     |     |        |     |     |     |        |     |     |     |     |
| HGP50D F*                                      | 65     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 | 150 |
| HGP50D S                                       | 100    |     | 130 | 200 |        |     | 130 | 200 |        |     | 130 | 200 |     |
| HGP50D H                                       | 130    |     |     | 200 |        |     |     | 200 |        |     |     | 200 |     |
| HGP125D F*                                     | 65     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 | 150 |
| HGP125D S                                      | 100    |     | 130 | 200 |        |     | 130 | 200 |        |     | 130 | 200 |     |
| HGP125D H                                      | 130    |     |     | 200 |        |     |     | 200 |        |     |     | 200 |     |
| HGP160D F*                                     | 65     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 | 150 |
| HGP160D S                                      | 100    |     | 130 | 200 |        |     | 130 | 200 |        |     | 130 | 200 |     |
| HGP160D H                                      | 130    |     |     | 200 |        |     |     | 200 |        |     |     | 200 |     |
| HGP100 F*                                      | 65     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 | 150 |
| HGP100 S                                       | 100    |     | 130 | 200 |        |     | 130 | 200 |        |     | 130 | 200 |     |
| HGP100 H                                       | 130    |     |     | 200 |        |     |     | 200 |        |     |     | 200 |     |
| HGP160 F*                                      | 65     |     |     |     |        |     | 100 | 130 | 150    |     | 100 | 130 | 150 |
| HGP160 S                                       | 100    |     |     |     |        |     | 130 | 200 |        |     | 130 | 200 |     |
| HGP160 H                                       | 130    |     |     |     |        |     |     | 200 |        |     |     | 200 |     |
| HGP250 F*                                      | 65     |     |     |     |        |     |     |     |        |     | 100 | 130 | 150 |
| HGP250 S                                       | 100    |     |     |     |        |     |     |     |        |     | 130 | 200 |     |
| HGP250 H                                       | 130    |     |     |     |        |     |     |     |        |     |     | 200 |     |

| Upstream Circuit Breaker                       | HGP400 |     |     |     | HGP630 |     |     |     | HGP800 |     |     |     |     |
|--|--------|-----|-----|-----|--------|-----|-----|-----|--------|-----|-----|-----|-----|
|  | F*     | S   | H   | X   | F*     | S   | H   | X   | F*     | S   | H   | X   |     |
| Breaking Capacity [Icu] (kA r.m.s.)            | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 | 65     | 100 | 130 | 200 |     |
| Downstream Breaking Capacity [Icu] (kA r.m.s.) |        |     |     |     |        |     |     |     |        |     |     |     |     |
| HGP50D/125D/160DF*                             | 65     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 | 150 |
| HGP50D/125D/160DS                              | 100    |     | 130 | 200 |        |     | 130 | 200 |        |     | 130 | 200 |     |
| HGP50D/125D/160DH                              | 130    |     |     | 200 |        |     |     | 200 |        |     |     | 200 |     |
| HGP100 F*                                      | 65     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 | 150 |
| HGP100 S                                       | 100    |     | 130 | 200 |        |     | 130 | 200 |        |     | 130 | 200 |     |
| HGP100 H                                       | 130    |     |     | 200 |        |     |     | 200 |        |     |     | 200 |     |
| HGP160 F*                                      | 65     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 | 150 |
| HGP160 S                                       | 100    |     | 130 | 200 |        |     | 130 | 200 |        |     | 130 | 200 |     |
| HGP160 H                                       | 130    |     |     | 200 |        |     |     | 200 |        |     |     | 200 |     |
| HGP250 F*                                      | 65     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 | 150 |
| HGP250 S                                       | 100    |     | 130 | 200 |        |     | 130 | 200 |        |     | 130 | 200 |     |
| HGP250 H                                       | 130    |     |     | 200 |        |     |     | 200 |        |     |     | 200 |     |
| HGP400/630 F*                                  | 65     |     | 100 | 130 | 150    |     | 100 | 130 | 150    |     | 100 | 130 | 150 |
| HGP400/630 S                                   | 100    |     | 130 | 200 |        |     | 130 | 200 |        |     | 130 | 200 |     |
| HGP400/630 H                                   | 130    |     |     | 200 |        |     |     | 200 |        |     |     | 200 |     |
| HGP800 F*                                      | 65     |     |     |     |        |     |     |     |        |     | 100 | 130 | 150 |
| HGP800 S                                       | 100    |     |     |     |        |     |     |     |        |     | 130 | 200 |     |
| HGP800 H                                       | 130    |     |     |     |        |     |     |     |        |     |     | 200 |     |

\* F type is for overseas sales.

## Technical Data (HGP)

### Cascading Table

#### AC 440/460 V

Upstream : HGP50D, HGP125D, HGP160D, HGP250, HGP400, HGP630

Downstream : HGD63\*, HGD125\*, HGM30, HGM50

| Upstream Circuit Breaker            | HGP50D |    |    |     | HGP125D |    |    |     | HGP160D |    |    |     |
|-------------------------------------|--------|----|----|-----|---------|----|----|-----|---------|----|----|-----|
|                                     | F*     | S  | H  | X   | F*      | S  | H  | X   | F*      | S  | H  | X   |
| Breaking Capacity [Icu] (kA r.m.s.) | 36     | 65 | 85 | 150 | 36      | 65 | 85 | 150 | 36      | 65 | 85 | 150 |
| Enhanced Breaking Capacity          |        |    |    |     |         |    |    |     |         |    |    |     |
| HGD63E*                             | 6      | 10 | 15 | 15  | 15      | 10 | 15 | 15  | 15      | 10 | 15 | 15  |
| HGD63S*                             | 7.5    | 14 | 15 | 20  | 20      | 15 | 20 | 20  | 20      | 15 | 20 | 20  |
| HGD63N/M*                           | 10     | 20 | 26 | 26  | 26      | 20 | 26 | 26  | 26      | 20 | 26 | 26  |
| HGD63H/P*                           | 15     | 20 | 30 | 30  | 30      | 20 | 30 | 30  | 30      | 20 | 30 | 30  |
| HGD100S/125*                        | 15     | 20 | 30 | 30  | 30      | 20 | 30 | 30  | 30      | 20 | 30 | 30  |

| Upstream Circuit Breaker            | HGP100 |    |    |     | HGP160 |    |    |     | HGP250 |    |    |     |
|-------------------------------------|--------|----|----|-----|--------|----|----|-----|--------|----|----|-----|
|                                     | F*     | S  | H  | X   | F*     | S  | H  | X   | F*     | S  | H  | X   |
| Breaking Capacity [Icu] (kA r.m.s.) | 36     | 65 | 85 | 150 | 36     | 65 | 85 | 150 | 36     | 65 | 85 | 150 |
| Enhanced Breaking Capacity          |        |    |    |     |        |    |    |     |        |    |    |     |
| HGD63E*                             | 6      | 10 | 15 | 15  | 15     | 10 | 15 | 15  | 15     | 10 | 15 | 15  |
| HGD63S*                             | 7.5    | 15 | 20 | 20  | 20     | 15 | 20 | 20  | 20     | 15 | 20 | 20  |
| HGD63N/M*                           | 10     | 20 | 26 | 26  | 26     | 20 | 26 | 26  | 26     | 20 | 26 | 26  |
| HGD63H/P*                           | 15     | 20 | 30 | 30  | 30     | 20 | 30 | 30  | 30     | 20 | 30 | 30  |
| HGD100S/125*                        | 15     |    |    |     | 20     | 30 | 30 | 30  | 20     | 30 | 30 | 30  |

| Upstream Circuit Breaker            | HGP50D |    |    |     | HGP125D |    |    |     | HGP160D |    |    |     |
|-------------------------------------|--------|----|----|-----|---------|----|----|-----|---------|----|----|-----|
|                                     | F*     | S  | H  | X   | F*      | S  | H  | X   | F*      | S  | H  | X   |
| Breaking Capacity [Icu] (kA r.m.s.) | 36     | 65 | 85 | 150 | 36      | 65 | 85 | 150 | 36      | 65 | 85 | 150 |
| Enhanced Breaking Capacity          |        |    |    |     |         |    |    |     |         |    |    |     |
| HGM30 E                             | 16     | 26 | 38 | 38  | 38      | 26 | 38 | 38  | 38      | 26 | 38 | 38  |
| HGM30 S                             | 20     | 30 | 38 | 38  | 38      | 30 | 38 | 38  | 38      | 30 | 38 | 38  |
| HGM50 E                             | 16     | 26 | 38 | 38  | 38      | 26 | 38 | 38  | 38      | 26 | 38 | 38  |
| HGM50 S                             | 20     | 30 | 38 | 38  | 38      | 30 | 38 | 38  | 38      | 30 | 38 | 38  |
| HGM50 H                             | 38     |    | 50 | 70  | 85      |    | 50 | 70  | 85      |    | 50 | 70  |
| HGM50 L                             | 55     |    | 65 | 70  | 85      |    | 65 | 70  | 85      |    | 65 | 70  |

| Upstream Circuit Breaker            | HGP100 |    |    |     | HGP160 |    |    |     |
|-------------------------------------|--------|----|----|-----|--------|----|----|-----|
|                                     | F*     | S  | H  | X   | F*     | S  | H  | X   |
| Breaking Capacity [Icu] (kA r.m.s.) | 36     | 65 | 85 | 150 | 36     | 70 | 85 | 150 |
| Enhanced Breaking Capacity          |        |    |    |     |        |    |    |     |
| HGM30 E                             | 16     | 26 | 38 | 38  | 38     | 26 | 38 | 38  |
| HGM30 S                             | 20     | 30 | 38 | 38  | 38     | 30 | 38 | 38  |
| HGM50 E                             | 16     | 26 | 38 | 38  | 38     | 26 | 38 | 38  |
| HGM50 S                             | 20     | 30 | 38 | 38  | 38     | 30 | 38 | 38  |
| HGM50 H                             | 38     |    | 50 | 70  | 85     |    | 50 | 70  |
| HGM50 L                             | 55     |    | 65 | 70  | 85     |    | 65 | 70  |

| Upstream Circuit Breaker            | HGP250 |    |    |     | HGP400 |    |    |     | HGP630 |    |    |     |
|-------------------------------------|--------|----|----|-----|--------|----|----|-----|--------|----|----|-----|
|                                     | F*     | S  | H  | X   | F*     | S  | H  | X   | F*     | S  | H  | X   |
| Breaking Capacity [Icu] (kA r.m.s.) | 36     | 65 | 85 | 150 | 36     | 70 | 85 | 150 | 36     | 70 | 85 | 150 |
| Enhanced Breaking Capacity          |        |    |    |     |        |    |    |     |        |    |    |     |
| HGM30 E                             | 16     | 26 | 38 | 38  | 38     | 26 | 38 | 38  | 38     | 26 | 38 | 38  |
| HGM30 S                             | 20     | 30 | 38 | 38  | 38     | 30 | 38 | 38  | 38     | 30 | 38 | 38  |
| HGM50 E                             | 16     | 26 | 38 | 38  | 38     | 26 | 38 | 38  | 38     | 26 | 38 | 38  |
| HGM50 S                             | 20     | 30 | 38 | 38  | 38     | 30 | 38 | 38  | 38     | 30 | 38 | 38  |
| HGM50 H                             | 38     |    | 50 | 70  | 85     |    | 50 | 70  | 85     |    | 50 | 70  |
| HGM50 L                             | 55     |    | 65 | 70  | 85     |    | 65 | 70  | 85     |    | 65 | 70  |

\* F type is for overseas sales.

Upstream : HGP125D, HGP160D, HGP250, HGP400, HGP630

Downstream : HGM60, HGM100, HGM125, HGM160, HGM250

| Upstream Circuit Breaker                              | HGP125D |    |    |     | HGP160D |    |    |     | HGP100 |    |    |     |
|---|---------|----|----|-----|---------|----|----|-----|--------|----|----|-----|
|   | F*      | S  | H  | X   | F*      | S  | H  | X   | F*     | S  | H  | X   |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 36      | 65 | 85 | 150 | 36      | 65 | 85 | 150 | 36     | 65 | 85 | 150 |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |         |    |    |     |         |    |    |     |        |    |    |     |
| HGM60 E   | 16      | 26 | 38 | 38  | 38      | 26 | 38 | 38  | 38     | 26 | 38 | 38  |
| HGM60 S   | 20      | 30 | 38 | 38  | 38      | 30 | 38 | 38  | 38     | 30 | 38 | 38  |
| HGM60 H   | 26      | 36 | 50 | 50  | 55      | 36 | 50 | 50  | 55     | 36 | 50 | 55  |
| HGM60 L   | 30      | 36 | 50 | 50  | 55      | 36 | 50 | 50  | 55     | 36 | 50 | 55  |
| HGM100 E  | 16      | 26 | 38 | 38  | 38      | 26 | 38 | 38  | 38     | 26 | 38 | 38  |
| HGM100 S  | 20      | 30 | 38 | 38  | 38      | 30 | 38 | 38  | 38     | 30 | 38 | 38  |
| HGM100 H  | 26      | 36 | 50 | 50  | 55      | 36 | 50 | 50  | 55     | 36 | 50 | 55  |
| HGM100 L  | 30      | 36 | 50 | 50  | 55      | 36 | 50 | 50  | 55     | 36 | 50 | 55  |
| HGM125 E  | 20      | 36 | 50 | 50  | 50      | 36 | 50 | 50  | 50     |    |    |     |
| HGM125 S  | 26      | 36 | 50 | 50  | 50      | 36 | 50 | 50  | 50     |    |    |     |
| HGM125 H  | 38      |    | 50 | 70  | 85      |    | 50 | 70  | 85     |    |    |     |
| HGM125 L  | 55      |    | 65 | 70  | 85      |    | 65 | 70  | 85     |    |    |     |

| Upstream Circuit Breaker                              | HGP160 |    |    |     | HGP250 |    |    |     | HGP400 |    |    |     | HGP630 |    |    |     |    |
|---|--------|----|----|-----|--------|----|----|-----|--------|----|----|-----|--------|----|----|-----|----|
|   | F*     | S  | H  | X   |    |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 36     | 65 | 85 | 150 | 36     | 65 | 85 | 150 | 36     | 70 | 85 | 150 | 36     | 70 | 85 | 150 |    |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |    |    |     |        |    |    |     |        |    |    |     |        |    |    |     |    |
| HGM60 E   | 16     | 26 | 38 | 38  | 38     | 26 | 38 | 38  | 26     | 38 | 38 | 38  | 26     | 38 | 38 | 38  |    |
| HGM60 S   | 20     | 30 | 38 | 38  | 38     | 30 | 38 | 38  | 30     | 38 | 38 | 38  | 30     | 38 | 38 | 38  |    |
| HGM60 H   | 26     | 36 | 50 | 50  | 55     | 36 | 50 | 50  | 55     | 36 | 50 | 50  | 55     | 36 | 50 | 50  | 55 |
| HGM60 L   | 30     | 36 | 50 | 50  | 55     | 36 | 50 | 50  | 55     | 36 | 50 | 50  | 55     | 36 | 50 | 50  | 55 |
| HGM100 E  | 16     | 26 | 38 | 38  | 38     | 26 | 38 | 38  | 26     | 38 | 38 | 38  | 26     | 38 | 38 | 38  |    |
| HGM100 S  | 20     | 30 | 38 | 38  | 38     | 30 | 38 | 38  | 30     | 38 | 38 | 38  | 30     | 38 | 38 | 38  |    |
| HGM100 H  | 26     | 36 | 50 | 50  | 55     | 36 | 50 | 50  | 55     | 36 | 50 | 50  | 55     | 36 | 50 | 50  | 55 |
| HGM100 L  | 30     | 36 | 50 | 50  | 55     | 36 | 50 | 50  | 55     | 36 | 50 | 50  | 55     | 36 | 50 | 50  | 55 |
| HGM125 E  | 20     | 36 | 50 | 50  | 50     | 36 | 50 | 50  | 36     | 50 | 50 | 50  | 36     | 50 | 50 | 50  |    |
| HGM125 S  | 26     | 36 | 50 | 50  | 50     | 36 | 50 | 50  | 36     | 50 | 50 | 50  | 36     | 50 | 50 | 50  |    |
| HGM125 H  | 38     |    | 50 | 70  | 85     |    | 50 | 70  | 85     |    | 50 | 70  | 85     |    | 50 | 70  | 85 |
| HGM125 L  | 55     |    | 65 | 70  | 85     |    | 65 | 70  | 85     |    | 65 | 70  | 85     |    | 65 | 70  | 85 |

| Upstream Circuit Breaker                              | HGP160D |    |    |     | HGP100 |    |    |     | HGP160 |    |    |     | HGP250 |    |    |     |
|---|---------|----|----|-----|--------|----|----|-----|--------|----|----|-----|--------|----|----|-----|
|   | F*      | S  | H  | X   | F*     | S  | H  | X   | F*     | S  | H  | X   | F*     | S  | H  | X   |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 36      | 65 | 85 | 150 | 36     | 65 | 85 | 150 | 36     | 65 | 85 | 150 | 36     | 65 | 85 | 150 |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |         |    |    |     |        |    |    |     |        |    |    |     |        |    |    |     |
| HGM160 E  | 20      | 36 | 50 | 50  | 50     |    |    |     | 36     | 50 | 50 | 50  | 36     | 50 | 50 | 50  |
| HGM160 S  | 26      | 36 | 50 | 50  | 50     |    |    |     | 36     | 50 | 50 | 50  | 36     | 50 | 50 | 50  |
| HGM160 H  | 38      |    | 50 | 70  | 85     |    |    |     | 50     | 70 | 85 |     | 50     | 70 | 85 |     |
| HGM160 L  | 55      |    | 65 | 70  | 85     |    |    |     | 65     | 70 | 85 |     | 65     | 70 | 85 |     |
| HGM250 E  | 20      |    |    |     |        |    |    |     |        |    |    |     | 36     | 50 | 50 | 50  |
| HGM250 S  | 26      |    |    |     |        |    |    |     |        |    |    |     | 36     | 50 | 50 | 50  |
| HGM250 H  | 38      |    |    |     |        |    |    |     |        |    |    |     | 50     | 70 | 85 |     |
| HGM250 L  | 55      |    |    |     |        |    |    |     |        |    |    |     | 65     | 70 | 85 |     |

※ \* F type is for overseas sales.

## Technical Data (HGP)

### Cascading Table

#### AC 440/460 V

Upstream : HGP400, HGP630, HGP800

Downstream : HGM160, HGM250, HGM400, HGM600, HGM800

| Upstream Circuit Breaker                              | HGP400 |    |    |     | HGP630 |    |    |     | HGP800 |    |    |     |
|---|--------|----|----|-----|--------|----|----|-----|--------|----|----|-----|
|   | F*     | S  | H  | X   | F*     | S  | H  | X   | F*     | S  | H  | X   |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 36     | 70 | 85 | 150 | 36     | 70 | 85 | 150 | 36     | 70 | 85 | 150 |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |    |    |     |        |    |    |     |        |    |    |     |
| HGM160 E  | 20     | 36 | 50 | 50  | 50     | 36 | 50 | 50  | 50     |    |    |     |
| HGM160 S  | 26     | 36 | 50 | 50  | 50     | 36 | 50 | 50  | 50     |    |    |     |
| HGM160 H  | 38     |    | 50 | 70  | 85     |    | 50 | 70  | 85     |    |    |     |
| HGM160 L  | 55     |    | 65 | 70  | 85     |    | 65 | 70  | 85     |    |    |     |
| HGM250 E  | 20     | 36 | 50 | 50  | 50     | 36 | 50 | 50  | 50     | 36 | 50 | 50  |
| HGM250 S  | 26     | 36 | 50 | 50  | 50     | 36 | 50 | 50  | 50     | 36 | 50 | 50  |
| HGM250 H  | 38     |    | 50 | 70  | 85     |    | 50 | 70  | 85     |    | 50 | 70  |
| HGM250 L  | 55     |    | 65 | 70  | 85     |    | 65 | 70  | 85     |    | 65 | 70  |

| Upstream Circuit Breaker                              | HGP400 |    |    |     | HGP630 |    |    |     | HGP800 |    |    |     |
|---|--------|----|----|-----|--------|----|----|-----|--------|----|----|-----|
|   | F*     | S  | H  | X   | F*     | S  | H  | X   | F*     | S  | H  | X   |
| Breaking Capacity [Icu] (kA r.m.s.)                   | 36     | 70 | 85 | 150 | 36     | 70 | 85 | 150 | 36     | 70 | 85 | 150 |
| <b>Downstream Breaking Capacity [Icu] (kA r.m.s.)</b> |        |    |    |     |        |    |    |     |        |    |    |     |
| HGM400 E  | 38     |    | 70 | 85  | 100    |    | 70 | 85  | 100    |    | 70 | 85  |
| HGM400 S  | 50     |    | 70 | 85  | 100    |    | 70 | 85  | 100    |    | 70 | 85  |
| HGM400 H  | 70     |    |    | 85  | 100    |    |    | 85  | 100    |    |    | 85  |
| HGM400 L  | 85     |    |    |     | 100    |    |    |     | 100    |    |    | 100 |
| HGM600 E  | 38     |    |    |     |        |    | 70 | 85  | 100    |    | 70 | 85  |
| HGM600 S  | 50     |    |    |     |        |    | 70 | 85  | 100    |    | 70 | 85  |
| HGM600 H  | 70     |    |    |     |        |    |    | 85  | 100    |    |    | 85  |
| HGM600 L  | 85     |    |    |     |        |    |    |     | 100    |    |    | 100 |
| HGM800 S  | 50     |    |    |     |        |    |    |     |        |    | 70 | 85  |
| HGM800 H  | 70     |    |    |     |        |    |    |     |        |    |    | 85  |
| HGM800 L  | 85     |    |    |     |        |    |    |     |        |    |    | 100 |

※ \* F type is for overseas sales.

Upstream : HGP50D, HGP125D, HGP160D, HGP250, HGP400, HGP630, HGP800  
 Downstream : HGP50D, HGP125D, HGP160D, HGP250, HGP400, HGP630, HGP800

| Upstream Circuit Breaker                       | HGP50D |    |    |     | HGP125D |    |    |     | HGP160D |    |    |     |     |
|--|--------|----|----|-----|---------|----|----|-----|---------|----|----|-----|-----|
|  | F*     | S  | H  | X   | F*      | S  | H  | X   | F*      | S  | H  | X   |     |
| Breaking Capacity [Icu] (kA r.m.s.)            | 36     | 65 | 85 | 150 | 36      | 65 | 85 | 150 | 36      | 65 | 85 | 150 |     |
| Downstream Breaking Capacity [Icu] (kA r.m.s.) |        |    |    |     |         |    |    |     |         |    |    |     |     |
| HGP50D/125D/160D F*                            | 38     |    | 65 | 85  | 100     |    | 65 | 85  | 100     |    | 65 | 85  | 100 |
| HGP50D/125D/160D S                             | 70     |    |    | 85  | 150     |    |    | 85  | 150     |    |    | 85  | 150 |
| HGP50D/125D/160D H                             | 85     |    |    |     | 150     |    |    |     | 150     |    |    |     | 150 |

| Upstream Circuit Breaker                       | HGP100 |    |    |     | HGP160 |    |    |     | HGP250 |    |    |     |     |
|--|--------|----|----|-----|--------|----|----|-----|--------|----|----|-----|-----|
|  | F*     | S  | H  | X   | F*     | S  | H  | X   | F*     | S  | H  | X   |     |
| Breaking Capacity [Icu] (kA r.m.s.)            | 36     | 65 | 85 | 150 | 36     | 65 | 85 | 150 | 36     | 65 | 85 | 150 |     |
| Downstream Breaking Capacity [Icu] (kA r.m.s.) |        |    |    |     |        |    |    |     |        |    |    |     |     |
| HGP50D F*                                      | 36     |    | 65 | 85  | 100    |    | 65 | 85  | 100    |    | 65 | 85  | 100 |
| HGP50D S                                       | 65     |    |    | 85  | 150    |    |    | 85  | 150    |    |    | 85  | 150 |
| HGP50D H                                       | 85     |    |    |     | 150    |    |    |     | 150    |    |    |     | 150 |
| HGP125D F*                                     | 36     |    |    |     |        |    | 65 | 85  | 100    |    | 65 | 85  | 100 |
| HGP125D S                                      | 65     |    |    |     |        |    |    | 85  | 150    |    |    | 85  | 150 |
| HGP125D H                                      | 85     |    |    |     |        |    |    |     | 150    |    |    |     | 150 |
| HGP160D F*                                     | 36     |    |    |     |        |    | 65 | 85  | 100    |    | 65 | 85  | 100 |
| HGP160D S                                      | 65     |    |    |     |        |    |    | 85  | 150    |    |    | 85  | 150 |
| HGP160D H                                      | 85     |    |    |     |        |    |    |     | 150    |    |    |     | 150 |
| HGP100 F*                                      | 36     |    | 65 | 85  | 100    |    | 65 | 85  | 100    |    | 65 | 85  | 100 |
| HGP100 S                                       | 65     |    |    | 85  | 150    |    |    | 85  | 150    |    |    | 85  | 150 |
| HGP100 H                                       | 85     |    |    |     | 150    |    |    |     | 150    |    |    |     | 150 |
| HGP160 F*                                      | 36     |    |    |     |        |    | 65 | 85  | 100    |    | 65 | 85  | 100 |
| HGP160 S                                       | 65     |    |    |     |        |    |    | 85  | 150    |    |    | 85  | 150 |
| HGP160 H                                       | 85     |    |    |     |        |    |    |     | 150    |    |    |     | 150 |
| HGP250 F*                                      | 36     |    |    |     |        |    |    |     |        |    | 65 | 85  | 100 |
| HGP250 S                                       | 65     |    |    |     |        |    |    |     |        |    |    | 85  | 150 |
| HGP250 H                                       | 85     |    |    |     |        |    |    |     |        |    |    |     | 150 |

| Upstream Circuit Breaker                       | HGP400 |    |    |     | HGP630 |    |    |     | HGP800 |    |    |     |     |
|--|--------|----|----|-----|--------|----|----|-----|--------|----|----|-----|-----|
|  | F*     | S  | H  | X   | F*     | S  | H  | X   | F*     | S  | H  | X   |     |
| Breaking Capacity [Icu] (kA r.m.s.)            | 36     | 70 | 85 | 150 | 36     | 70 | 85 | 150 | 36     | 70 | 85 | 150 |     |
| Downstream Breaking Capacity [Icu] (kA r.m.s.) |        |    |    |     |        |    |    |     |        |    |    |     |     |
| HGP50D/125D/160D F*                            | 36     |    | 65 | 85  | 100    |    | 65 | 85  | 100    |    | 65 | 85  | 100 |
| HGP50D/125D/160D S                             | 65     |    |    | 85  | 150    |    |    | 85  | 150    |    |    | 85  | 150 |
| HGP50D/125D/160D H                             | 85     |    |    |     | 150    |    |    |     | 150    |    |    |     | 150 |
| HGP100 F*                                      | 36     |    | 65 | 85  | 100    |    | 65 | 85  | 100    |    | 65 | 85  | 100 |
| HGP100 S                                       | 65     |    |    | 85  | 150    |    |    | 85  | 150    |    |    | 85  | 150 |
| HGP100 H                                       | 85     |    |    |     | 150    |    |    |     | 150    |    |    |     | 150 |
| HGP160 F*                                      | 36     |    | 65 | 85  | 100    |    | 65 | 85  | 100    |    | 65 | 85  | 100 |
| HGP160 S                                       | 65     |    |    | 85  | 150    |    |    | 85  | 150    |    |    | 85  | 150 |
| HGP160 H                                       | 85     |    |    |     | 150    |    |    |     | 150    |    |    |     | 150 |
| HGP250 F*                                      | 36     |    | 65 | 85  | 100    |    | 65 | 85  | 100    |    | 65 | 85  | 100 |
| HGP250 S                                       | 65     |    |    | 85  | 150    |    |    | 85  | 150    |    |    | 85  | 150 |
| HGP250 H                                       | 85     |    |    |     | 150    |    |    |     | 150    |    |    |     | 150 |
| HGP400/630 F*                                  | 36     |    | 65 | 85  | 100    |    | 65 | 85  | 100    |    | 65 | 85  | 100 |
| HGP400/630 S                                   | 70     |    |    | 85  | 150    |    |    | 85  | 150    |    |    | 85  | 150 |
| HGP400/630 H                                   | 85     |    |    |     | 150    |    |    |     | 150    |    |    |     | 150 |
| HGP800 F*                                      | 36     |    |    |     |        |    |    |     |        |    | 65 | 85  | 100 |
| HGP800 S                                       | 70     |    |    |     |        |    |    |     |        |    |    | 85  | 150 |
| HGP800 H                                       | 85     |    |    |     |        |    |    |     |        |    |    |     | 150 |

※ \* F type is for overseas sales.

## Technical Data (HGP)

### Discrimination Table

**Ue < AC 460 V**

Upstream : HGP50D ~ HGP800

Downstream : HGD32, HGD63, HGD125

| Model                       | Trip Unit | HGP160D F*/S/H/X  |      |      |      |      |      |     |     |      |      |     |     |     |     |
|-----------------------------|-----------|-------------------|------|------|------|------|------|-----|-----|------|------|-----|-----|-----|-----|
|                             |           | Thermal Magnetic  |      |      |      |      |      |     |     |      |      |     |     |     |     |
|                             |           | Rated Current (A) | 16   | 20   | 25   | 32   | 40   | 50  | 63  | 75   | 80   | 100 | 125 | 150 | 160 |
| HGD32 -<br>B, C, D<br>Curve | 1         | 0.19              | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 3         | 0.19              | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 5         | 0.19              | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 6         | 0.19              | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 10        | 0.19              | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 16        |                   | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 20        |                   |      | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 25        |                   |      |      | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 32        |                   |      |      |      | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 40        |                   |      |      |      |      | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
| HGD63 -<br>B, C, D<br>Curve | 1         | 0.19              | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 2         | 0.19              | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 3         | 0.19              | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 4         | 0.19              | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 5         | 0.19              | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 6         | 0.19              | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 10        | 0.19              | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 13        |                   | 0.32 | 0.32 | 0.32 | 0.32 | 0.4  | 0.5 | 0.6 | 0.64 | 0.8  | 1   | T   | T   |     |
|                             | 15        |                   |      | 0.32 | 0.32 | 0.32 | 0.32 | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | 1   | T   | T   |
|                             | 16        |                   |      | 0.32 | 0.32 | 0.32 | 0.32 | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | 1   | T   | T   |
|                             | 20        |                   |      |      | 0.32 | 0.32 | 0.32 | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | 1   | T   | T   |
|                             | 25        |                   |      |      |      | 0.32 | 0.32 | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | 1   | T   | T   |
|                             | 32        |                   |      |      |      |      | 0.32 | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | 1   | T   | T   |
|                             | 40        |                   |      |      |      |      |      | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | 1   | T   | T   |
| HGD125<br>B, C, D<br>Curve  | 50        |                   |      |      |      |      |      |     | 0.5 | 0.6  | 0.64 | 0.8 | 1   | T   | T   |
|                             | 63        |                   |      |      |      |      |      |     |     | 0.6  | 0.64 | 0.8 | 1   | T   | T   |
|                             | 63        |                   |      |      |      |      |      |     |     |      | 0.64 | 0.8 | 2.4 | 2.4 | 2.4 |
|                             | 80        |                   |      |      |      |      |      |     |     |      |      | 0.8 | 2.4 | 2.4 | 2.4 |
| B, C, D<br>Curve            | 100       |                   |      |      |      |      |      |     |     |      |      |     | 2.4 | 2.4 | 2.4 |
|                             | 125       |                   |      |      |      |      |      |     |     |      |      |     | 2.4 | 2.4 | 2.4 |

T Total Discrimination, Up to the Breaking Capacity of the Downstream Circuit Breaker

4 Discrimination Limit = 4 kA

No Discrimination

※ \* F type is for overseas sales.

Upstream : HGP50D ~ HGP800

Downstream : HGD32, HGD63, HGD125

| Model                 | Trip Unit | HGP250 F*/S/H/X               |     |     |      |      |     |     |     |     |     |     |     |     |     |     |     | HGP400 F*/S/H/X |     | HGP630 F*/S/H/X |     | HGP800 F*/S/H/X |   |   |   |   |
|-----------------------|-----------|-------------------------------|-----|-----|------|------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----------------|-----|-----------------|-----|-----------------|---|---|---|---|
|                       |           | Thermal Magnetic & Electronic |     |     |      |      |     |     |     |     |     |     |     |     |     |     |     |                 |     |                 |     |                 |   |   |   |   |
|                       |           | Rated Current (A)             | 40  | 50  | 63   | 75   | 80  | 100 | 125 | 150 | 160 | 175 | 200 | 225 | 250 | 300 | 350 | 400             | 500 | 630             | 700 | 800             |   |   |   |   |
| HGD32 - B, C, D Curve | 1         | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T | T |
|                       | 3         | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 5         | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 6         | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 10        | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 16        | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 20        | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 25        | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 32        | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 40        | 0.4                           | 0.5 | 0.6 | 0.64 | 0.8  | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
| HGD63 - B, C, D Curve | 1         | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 2         | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 3         | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 4         | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 5         | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 6         | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 10        | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 13        | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 15        | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 16        | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 20        | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 25        | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 32        | 0.32                          | 0.4 | 0.5 | 0.6  | 0.64 | 0.8 | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 40        | 0.4                           | 0.5 | 0.6 | 0.64 | 0.8  | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 50        |                               | 0.5 | 0.6 | 0.64 | 0.8  | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
| HGD125 B, C, D Curve  | 63        |                               |     | 0.6 | 0.64 | 0.8  | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 63        |                               |     |     | 0.64 | 0.8  | 2.4 | 2.4 | 2.4 | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 80        |                               |     |     |      | 0.8  | 2.4 | 2.4 | 2.4 | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 100       |                               |     |     |      |      | 2.4 | 2.4 | 2.4 | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |
|                       | 125       |                               |     |     |      |      | 2.4 | 2.4 | 2.4 | T   | T   | T   | T   | T   | T   | T   | T   | T               | T   | T               | T   | T               | T | T | T |   |

T Total Discrimination, Up to the Breaking Capacity of the Downstream Circuit Breaker

4 Discrimination Limit = 4 kA

No Discrimination

※ \*F type is for overseas sales.

## Technical Data (HGP)

### Discrimination Table

**Ue < AC 460 V**

Upstream : HGP50D ~ HGP800

Downstream : HGM30 ~ HGM800

| Model   | Trip Unit | HGP160D F*/S/H/X  |    |    |    |    |    |    |     |     |      |     |      |      |      |
|---|-----------|-------------------|----|----|----|----|----|----|-----|-----|------|-----|------|------|------|
|   |           | Thermal Magnetic  |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   |           | Rated Current (A) | 16 | 20 | 25 | 32 | 40 | 50 | 63  | 75  | 80   | 100 | 125  | 150  | 160  |
| HGM30 E/S<br>HGM50 E/S<br>HGM60<br>E/S/H/L<br>HGM100<br>E/S/H/L | 16        |                   |    |    |    |    |    |    | 0.5 | 0.6 | 0.64 | 0.8 | 1    | 1.25 | 1.25 |
|   | 20        |                   |    |    |    |    |    |    | 0.5 | 0.6 | 0.64 | 0.8 | 1    | 1.25 | 1.25 |
|   | 25        |                   |    |    |    |    |    |    | 0.5 | 0.6 | 0.64 | 0.8 | 1    | 1.25 | 1.25 |
|   | 32        |                   |    |    |    |    |    |    | 0.5 | 0.6 | 0.64 | 0.8 | 1    | 1.25 | 1.25 |
|   | 40        |                   |    |    |    |    |    |    |     |     | 0.64 | 0.8 | 1    | 1.25 | 1.25 |
|   | 50        |                   |    |    |    |    |    |    |     |     | 0.64 | 0.8 | 1    | 1.25 | 1.25 |
|   | 63        |                   |    |    |    |    |    |    |     |     | 0.8  | 1   | 1.25 | 1.25 |      |
|   | 75        |                   |    |    |    |    |    |    |     |     |      | 1   | 1.25 | 1.25 |      |
|   | 80        |                   |    |    |    |    |    |    |     |     |      | 1   | 1.25 | 1.25 |      |
|   | 100       |                   |    |    |    |    |    |    |     |     |      |     |      | 1.25 |      |
| HGM125<br>E/S/H/L   | 16        |                   |    |    |    |    |    |    | 0.5 | 0.6 | 0.64 | 0.8 | 1    | 1.25 | 1.25 |
|   | 20        |                   |    |    |    |    |    |    | 0.5 | 0.6 | 0.64 | 0.8 | 1    | 1.25 | 1.25 |
|   | 25        |                   |    |    |    |    |    |    | 0.5 | 0.6 | 0.64 | 0.8 | 1    | 1.25 | 1.25 |
|   | 32        |                   |    |    |    |    |    |    | 0.5 | 0.6 | 0.64 | 0.8 | 1    | 1.25 | 1.25 |
|   | 40        |                   |    |    |    |    |    |    |     |     | 0.64 | 0.8 | 1    | 1.25 | 1.25 |
|   | 50        |                   |    |    |    |    |    |    |     |     | 0.64 | 0.8 | 1    | 1.25 | 1.25 |
|   | 63        |                   |    |    |    |    |    |    |     |     | 0.8  | 1   | 1.25 | 1.25 |      |
|   | 75        |                   |    |    |    |    |    |    |     |     |      | 1   | 1.25 | 1.25 |      |
|   | 80        |                   |    |    |    |    |    |    |     |     |      | 1   | 1.25 | 1.25 |      |
|   | 100       |                   |    |    |    |    |    |    |     |     |      |     |      | 1.25 |      |
| HGM160<br>E/S/H/L<br>HGM250<br>E/S/H/L                          | 125       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 100       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 125       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 150       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 160       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 175       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 200       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 225       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 250       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 250       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
| HGM400<br>E/S/H/L   | 300       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 350       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
| HGM630<br>E/S/H/L<br>HGM800<br>S/H/L                            | 400       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 500       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 630       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 700       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |
|   | 800       |                   |    |    |    |    |    |    |     |     |      |     |      |      |      |

T

Total Discrimination, Up to the Breaking Capacity of the Downstream Circuit Breaker

4

Discrimination Limit = 4 kA

No Discrimination

Upstream : HGP50D ~ HGP800  
 Downstream : HGM30 ~ HGM800

| Model   | Trip Unit | HGP250 F*/S/H/X               |    |    |     |      |      |     |      |      |      |     |     |     |     |     | HGP400 F*/S/H/X |     | HGP630 F*/S/H/X |     | HGP800 F*/S/H/X |     |  |
|---|-----------|-------------------------------|----|----|-----|------|------|-----|------|------|------|-----|-----|-----|-----|-----|-----------------|-----|-----------------|-----|-----------------|-----|--|
|   |           | Thermal Magnetic & Electronic |    |    |     |      |      |     |      |      |      |     |     |     |     |     |                 |     |                 |     |                 |     |  |
|   |           | Rated Current (A)             | 40 | 50 | 63  | 75   | 80   | 100 | 125  | 150  | 160  | 175 | 200 | 225 | 250 | 300 | 350             | 400 | 500             | 630 | 700             | 800 |  |
| HGM30 E/S<br>HGM50 E/S<br>HGM60 E/S/H/L<br>HGM100 E/S/H/L | 16        |                               |    |    | 0.5 | 0.6  | 0.64 | 0.8 | 1    | 1.25 | 1.25 | 1.4 | 1.6 | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   |  |
|   | 20        |                               |    |    | 0.5 | 0.6  | 0.64 | 0.8 | 1    | 1.25 | 1.25 | 1.4 | 1.6 | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   |  |
|   | 25        |                               |    |    | 0.5 | 0.6  | 0.64 | 0.8 | 1    | 1.25 | 1.25 | 1.4 | 1.6 | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   |  |
|   | 32        |                               |    |    | 0.5 | 0.6  | 0.64 | 0.8 | 1    | 1.25 | 1.25 | 1.4 | 1.6 | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   |  |
|   | 40        |                               |    |    | 0.6 | 0.64 | 0.8  | 1   | 1.25 | 1.25 | 1.4  | 1.6 | 1.8 | 2   | T   | T   | T               | T   | T               | T   | T               |     |  |
|   | 50        |                               |    |    |     | 0.64 | 0.8  | 1   | 1.25 | 1.25 | 1.4  | 1.6 | 1.8 | 2   | T   | T   | T               | T   | T               | T   | T               |     |  |
|   | 63        |                               |    |    |     |      | 0.8  | 1   | 1.25 | 1.25 | 1.4  | 1.6 | 1.8 | 2   | T   | T   | T               | T   | T               | T   | T               |     |  |
|   | 75        |                               |    |    |     |      |      | 1   | 1.25 | 1.25 | 1.4  | 1.6 | 1.8 | 2   | T   | T   | T               | T   | T               | T   | T               |     |  |
|   | 80        |                               |    |    |     |      |      | 1   | 1.25 | 1.25 | 1.4  | 1.6 | 1.8 | 2   | T   | T   | T               | T   | T               | T   | T               |     |  |
|   | 100       |                               |    |    |     |      |      |     |      | 1.25 | 1.4  | 1.6 | 1.8 | 2   | T   | T   | T               | T   | T               | T   | T               |     |  |
| HGM125 E/S/H/L  | 16        |                               |    |    | 0.5 | 0.6  | 0.64 | 0.8 | 1    | 1.25 | 1.25 | 1.4 | 1.6 | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   |  |
|   | 20        |                               |    |    | 0.5 | 0.6  | 0.64 | 0.8 | 1    | 1.25 | 1.25 | 1.4 | 1.6 | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   |  |
|   | 25        |                               |    |    | 0.5 | 0.6  | 0.64 | 0.8 | 1    | 1.25 | 1.25 | 1.4 | 1.6 | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   |  |
|   | 32        |                               |    |    | 0.5 | 0.6  | 0.64 | 0.8 | 1    | 1.25 | 1.25 | 1.4 | 1.6 | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   |  |
|   | 40        |                               |    |    |     | 0.6  | 0.64 | 0.8 | 1    | 1.25 | 1.25 | 1.4 | 1.6 | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   |  |
|   | 50        |                               |    |    |     |      | 0.64 | 0.8 | 1    | 1.25 | 1.25 | 1.4 | 1.6 | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   |  |
|   | 63        |                               |    |    |     |      |      | 0.8 | 1    | 1.25 | 1.25 | 1.4 | 1.6 | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   |  |
|   | 75        |                               |    |    |     |      |      | 1   | 1.25 | 1.25 | 1.4  | 1.6 | 1.8 | 2   | T   | T   | T               | T   | T               | T   | T               |     |  |
|   | 80        |                               |    |    |     |      |      | 1   | 1.25 | 1.25 | 1.4  | 1.6 | 1.8 | 2   | T   | T   | T               | T   | T               | T   | T               |     |  |
|   | 100       |                               |    |    |     |      |      |     |      | 1.25 | 1.4  | 1.6 | 1.8 | 2   | T   | T   | T               | T   | T               | T   | T               |     |  |
| HGM160 E/S/H/L<br>HGM250 E/S/H/L                          | 125       |                               |    |    |     |      |      |     |      |      | 1.4  | 1.6 | 1.8 | 2   | T   | T   | T               | T   | T               | T   | T               | T   |  |
|   | 100       |                               |    |    |     |      |      |     |      |      | 1.25 | 1.4 | 1.6 | 1.8 | 2   | 2.4 | 2.8             | 3.8 | 4               | 5   | T               | T   |  |
|   | 125       |                               |    |    |     |      |      |     |      |      | 1.4  | 1.6 | 1.8 | 2   | 2.4 | 2.8 | 3.8             | 4   | 5               | T   | T               | T   |  |
|   | 150       |                               |    |    |     |      |      |     |      |      |      | 1.6 | 1.8 | 2   | 2.4 | 2.8 | 3.8             | 4   | 5               | T   | T               | T   |  |
|   | 160       |                               |    |    |     |      |      |     |      |      |      |     | 2   | 2.4 | 2.8 | 3.8 | 4               | 5   | T               | T   | T               | T   |  |
|   | 175       |                               |    |    |     |      |      |     |      |      |      |     | 2.4 | 2.8 | 3.8 | 4   | 5               | T   | T               | T   | T               | T   |  |
|   | 200       |                               |    |    |     |      |      |     |      |      |      |     | 2.4 | 2.8 | 3.8 | 4   | 5               | T   | T               | T   | T               | T   |  |
|   | 225       |                               |    |    |     |      |      |     |      |      |      |     |     | 2.8 | 3.8 | 4   | 5               | T   | T               | T   | T               | T   |  |
|   | 250       |                               |    |    |     |      |      |     |      |      |      |     |     |     | 3.8 | 4   | 5               | T   | T               | T   | T               | T   |  |
|   | 250       |                               |    |    |     |      |      |     |      |      |      |     |     |     |     |     |                 | 4   | 5               | 5.6 | 6.4             |     |  |
| HGM400 E/S/H/L  | 300       |                               |    |    |     |      |      |     |      |      |      |     |     |     |     |     |                 |     | 4               | 5   | 5.6             | 6.4 |  |
|   | 350       |                               |    |    |     |      |      |     |      |      |      |     |     |     |     |     |                 |     |                 | 5   | 5.6             | 6.4 |  |
|   | 400       |                               |    |    |     |      |      |     |      |      |      |     |     |     |     |     |                 |     |                 | 5   | 5.6             | 6.4 |  |
| HGM630 E/S/H/L<br>HGM800 S/H/L                            | 500       |                               |    |    |     |      |      |     |      |      |      |     |     |     |     |     |                 |     |                 |     | 5.6             | 6.4 |  |
|   | 630       |                               |    |    |     |      |      |     |      |      |      |     |     |     |     |     |                 |     |                 |     |                 | 6.4 |  |
|   | 700       |                               |    |    |     |      |      |     |      |      |      |     |     |     |     |     |                 |     |                 |     |                 |     |  |
|   | 800       |                               |    |    |     |      |      |     |      |      |      |     |     |     |     |     |                 |     |                 |     |                 |     |  |

※ \* F type is for overseas sales.

## Technical Data (HGP)

### Discrimination Table

**Ue < AC 460 V**

Upstream : HGP50D ~ HGP800

Downstream : HGP50D ~ HGP800

| Model    | Trip Unit | HGP160D F*/S/H/X  |    |    |    |    |    |    |     |     |      |     |     |      |      |
|----------|-----------|-------------------|----|----|----|----|----|----|-----|-----|------|-----|-----|------|------|
|          |           | Thermal Magnetic  |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | Rated Current (A) | 16 | 20 | 25 | 32 | 40 | 50 | 63  | 75  | 80   | 100 | 125 | 150  | 160  |
| HGP50D   |           | 16                |    |    |    |    |    |    | 0.5 | 0.6 | 0.64 | 0.8 | 1   | 1.25 | 1.25 |
| F*/S/H/X |           | 20                |    |    |    |    |    |    | 0.5 | 0.6 | 0.64 | 0.8 | 1   | 1.25 | 1.25 |
| HGP125D  |           | 25                |    |    |    |    |    |    | 0.5 | 0.6 | 0.64 | 0.8 | 1   | 1.25 | 1.25 |
| F*/S/H/X |           | 32                |    |    |    |    |    |    | 0.5 | 0.6 | 0.64 | 0.8 | 1   | 1.25 | 1.25 |
| HGP160D  |           | 40                |    |    |    |    |    |    |     |     | 0.64 | 0.8 | 1   | 1.25 | 1.25 |
| F*/S/H/X |           | 50                |    |    |    |    |    |    |     |     | 0.64 | 0.8 | 1   | 1.25 | 1.25 |
| HGP250   |           | 63                |    |    |    |    |    |    |     |     |      | 0.8 | 1   | 1.25 | 1.25 |
| F*/S/H/X |           | 75                |    |    |    |    |    |    |     |     |      |     | 1   | 1.25 | 1.25 |
| HGP400   |           | 80                |    |    |    |    |    |    |     |     |      |     | 1   | 1.25 | 1.25 |
| F*/S/H/X |           | 100               |    |    |    |    |    |    |     |     |      |     |     | 1.25 |      |
| HGP630   |           | 125               |    |    |    |    |    |    |     |     |      |     |     |      |      |
| F*/S/H/X |           | 150               |    |    |    |    |    |    |     |     |      |     |     |      |      |
| HGP800   |           | 160               |    |    |    |    |    |    |     |     |      |     |     |      |      |
| F*/S/H/X |           | 100               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 125               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 150               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 160               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 100               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 125               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 150               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 160               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 175               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 200               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 225               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 250               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 300               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 350               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 400               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 500               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 630               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 700               |    |    |    |    |    |    |     |     |      |     |     |      |      |
|          |           | 800               |    |    |    |    |    |    |     |     |      |     |     |      |      |

**T** Total Discrimination, Up to the Breaking Capacity of the Downstream Circuit Breaker

**4** Discrimination Limit = 4 kA

No Discrimination

※ \* F type is for overseas sales.

Upstream : HGP50D ~ HGP800

Downstream : HGP50D ~ HGP800

| Model              | Trip Unit           | HGP250 F*/S/H/X               |    |    |     |     |      |      |     |      |      |      |      |     |     |     | HGP400 F*/S/H/X |     | HGP630 F*/S/H/X |     | HGP800 F*/S/H/X |     |   |   |   |
|--------------------|---------------------|-------------------------------|----|----|-----|-----|------|------|-----|------|------|------|------|-----|-----|-----|-----------------|-----|-----------------|-----|-----------------|-----|---|---|---|
|                    |                     | Thermal Magnetic & Electronic |    |    |     |     |      |      |     |      |      |      |      |     |     |     |                 |     |                 |     |                 |     |   |   |   |
|                    |                     | Rated Current (A)             | 40 | 50 | 63  | 75  | 80   | 100  | 125 | 150  | 160  | 175  | 200  | 225 | 250 | 300 | 350             | 400 | 500             | 630 | 700             | 800 |   |   |   |
| HGP50D<br>F*/S/H/X | 16                  |                               |    |    | 0.5 | 0.6 | 0.64 | 0.8  | 1   | 1.25 | 36   | 36   | 36   | 36  | T   | T   | T               | T   | T               | T   | T               | T   |   |   |   |
|                    | 20                  |                               |    |    | 0.5 | 0.6 | 0.64 | 0.8  | 1   | 1.25 | 1.25 | 36   | 36   | 36  | T   | T   | T               | T   | T               | T   | T               | T   |   |   |   |
|                    | 25                  |                               |    |    | 0.5 | 0.6 | 0.64 | 0.8  | 1   | 1.25 | 1.25 | 1.4  | 36   | 36  | T   | T   | T               | T   | T               | T   | T               | T   |   |   |   |
|                    | 32                  |                               |    |    | 0.5 | 0.6 | 0.64 | 0.8  | 1   | 1.25 | 1.25 | 1.4  | 36   | 36  | T   | T   | T               | T   | T               | T   | T               | T   |   |   |   |
|                    | 40                  |                               |    |    |     |     | 0.64 | 0.8  | 1   | 1.25 | 1.25 | 1.4  | 36   | 36  | T   | T   | T               | T   | T               | T   | T               | T   |   |   |   |
|                    | 50                  |                               |    |    |     |     |      | 0.64 | 0.8 | 1    | 1.25 | 1.25 | 1.4  | 36  | 36  | T   | T               | T   | T               | T   | T               | T   | T |   |   |
|                    | HGP125D<br>F*/S/H/X |                               |    |    |     |     |      |      |     |      |      |      |      |     |     |     |                 |     |                 |     |                 |     |   |   |   |
|                    | 63                  |                               |    |    |     |     |      |      | 0.8 | 1    | 1.25 | 1.25 | 1.4  | 36  | 36  | T   | T               | T   | T               | T   | T               | T   | T |   |   |
|                    | HGP160D<br>F*/S/H/X |                               |    |    |     |     |      |      |     |      |      |      |      |     |     |     |                 |     |                 |     |                 |     |   |   |   |
|                    | 75                  |                               |    |    |     |     |      |      |     | 1    | 1.25 | 1.25 | 1.4  | 36  | 36  | T   | T               | T   | T               | T   | T               | T   | T |   |   |
|                    | 80                  |                               |    |    |     |     |      |      |     |      | 1    | 1.25 | 1.25 | 1.4 | 36  | 36  | T               | T   | T               | T   | T               | T   | T | T |   |
|                    | 100                 |                               |    |    |     |     |      |      |     |      |      | 1.25 | 1.4  | 1.6 | 36  | 36  | T               | T   | T               | T   | T               | T   | T | T |   |
|                    | 125                 |                               |    |    |     |     |      |      |     |      |      |      | 1.6  | 1.8 | 36  | T   | T               | T   | T               | T   | T               | T   | T | T |   |
|                    | 150                 |                               |    |    |     |     |      |      |     |      |      |      |      | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   | T | T |   |
|                    | 160                 |                               |    |    |     |     |      |      |     |      |      |      |      |     | 2   | T   | T               | T   | T               | T   | T               | T   | T | T |   |
| HGP250<br>F*/S/H/X | 40                  |                               |    |    |     |     | 0.64 | 0.8  | 1   | 1.25 | 1.25 | 1.4  | 1.6  | 1.8 | 2   | 36  | 36              | 36  | T               | T   | T               | T   | T |   |   |
|                    | 50                  |                               |    |    |     |     |      | 0.64 | 0.8 | 1    | 1.25 | 1.25 | 1.4  | 1.6 | 1.8 | 2   | 36              | 36  | 36              | T   | T               | T   | T | T |   |
|                    | 63                  |                               |    |    |     |     |      |      | 0.8 | 1    | 1.25 | 1.25 | 1.4  | 1.6 | 1.8 | 2   | 36              | 36  | 36              | T   | T               | T   | T | T |   |
|                    | 75                  |                               |    |    |     |     |      |      |     | 1    | 1.25 | 1.25 | 1.4  | 1.6 | 1.8 | 2   | 36              | 36  | 36              | T   | T               | T   | T | T |   |
|                    | 80                  |                               |    |    |     |     |      |      |     |      | 1    | 1.25 | 1.25 | 1.4 | 1.6 | 1.8 | 2               | 36  | 36              | 36  | T               | T   | T | T | T |
|                    | 100                 |                               |    |    |     |     |      |      |     |      |      | 1.25 | 1.4  | 1.6 | 1.8 | 2   | 36              | 36  | 36              | T   | T               | T   | T | T |   |
|                    | 125                 |                               |    |    |     |     |      |      |     |      |      |      | 1.6  | 1.8 | 36  | T   | T               | T   | T               | T   | T               | T   | T | T |   |
|                    | 150                 |                               |    |    |     |     |      |      |     |      |      |      |      | 1.8 | 2   | T   | T               | T   | T               | T   | T               | T   | T | T |   |
|                    | 160                 |                               |    |    |     |     |      |      |     |      |      |      |      |     | 2   | T   | T               | T   | T               | T   | T               | T   | T | T |   |
|                    | 175                 |                               |    |    |     |     |      |      |     |      |      |      |      |     |     | 2.4 | 2.8             | 36  | 36              | 36  | T               | T   | T | T |   |
|                    | 200                 |                               |    |    |     |     |      |      |     |      |      |      |      |     |     | 2.4 | 2.8             | 3.8 | 36              | 36  | T               | T   | T | T |   |
|                    | 225                 |                               |    |    |     |     |      |      |     |      |      |      |      |     |     | 2.8 | 3.8             | 36  | 36              | 36  | T               | T   | T | T |   |
|                    | 250                 |                               |    |    |     |     |      |      |     |      |      |      |      |     |     |     | 3.8             | 4   | 36              | T   | T               |     |   |   |   |
|                    | 300                 |                               |    |    |     |     |      |      |     |      |      |      |      |     |     |     |                 | 4   | 5               | 36  | 36              |     |   |   |   |
| HGP400<br>F*/S/H/X | 350                 |                               |    |    |     |     |      |      |     |      |      |      |      |     |     |     |                 |     | 5               | 36  | 36              |     |   |   |   |
|                    | 400                 |                               |    |    |     |     |      |      |     |      |      |      |      |     |     |     |                 |     | 5               | 5.6 | 36              |     |   |   |   |
|                    | 500                 |                               |    |    |     |     |      |      |     |      |      |      |      |     |     |     |                 |     |                 | 5.6 | 6.4             |     |   |   |   |
|                    | 630                 |                               |    |    |     |     |      |      |     |      |      |      |      |     |     |     |                 |     |                 |     | 6.4             |     |   |   |   |
| HGP800<br>F*/S/H/X | 700                 |                               |    |    |     |     |      |      |     |      |      |      |      |     |     |     |                 |     |                 |     |                 |     |   |   |   |
|                    | 800                 |                               |    |    |     |     |      |      |     |      |      |      |      |     |     |     |                 |     |                 |     |                 |     |   |   |   |

T Total Discrimination, Up to the Breaking Capacity of the Downstream Circuit Breaker

4 Discrimination Limit = 4 kA

No Discrimination

※ \* F type is for overseas sales.


## Technical Data (HGP)

### Type 2 Coordination (IEC 60947-4-1)

#### AC 440 V

Performance : Ue = 440 V

| Circuit breakers | F * | S  | H  |
|------------------|-----|----|----|
| HGP100/250       | 36  | 65 | 85 |
| HGP400/630       | 36  | 65 | 85 |
| HGP800           | 36  | 65 | 85 |



| Motor | Circuit Breakers |                    |                    | Contactors |            | Thermal o/l relays |                         |                         |
|-------|------------------|--------------------|--------------------|------------|------------|--------------------|-------------------------|-------------------------|
|       | P (kW)           | I (A) 440V         | Ie Max (A)         | Type       | Rating (A) | Ii (A)             | Type                    |                         |
| 0.37  | 1.1              | 1.6                | 1.6                | HGP100     | 2.5        | 32.5               | HGT18 <sup>1)</sup>     | 0.8 ~ 1.2               |
| 0.55  | 1.4              | 1.6                | 1.6                | HGP100     | 2.5        | 32.5               | HGT18 <sup>1)</sup>     | 1.1 ~ 1.6               |
| 0.75  | 1.7              | 2.5 <sup>2)</sup>  | 2.5 <sup>2)</sup>  | HGP100     | 2.5        | 32.5               | HGT18 <sup>1)</sup>     | 1.5 ~ 2.1 <sup>2)</sup> |
| 1.1   | 2.4              | 2.5                | 2.5                | HGP100     | 3.2        | 41.6               | HGT18 <sup>1)</sup>     | 2 ~ 3                   |
| 1.5   | 3.1              | 4                  | 4                  | HGP100     | 6.3        | 81.9               | HGT18 <sup>1), 4)</sup> | 2.8 ~ 4.2               |
| 2.2   | 4.5              | 6                  | 6                  | HGP100     | 6.3        | 81.9               | HGT18 <sup>1), 4)</sup> | 4 ~ 6                   |
| 3     | 5.8              | 6                  | 6                  | HGP100     | 6.3        | 81.9               | HGT18 <sup>1), 4)</sup> | 5.6 ~ 8                 |
| 4     | 8                | 8                  | 8                  | HGP100     | 12.5       | 163                | HGT65 <sup>1), 4)</sup> | 6 ~ 9                   |
| 5.5   | 10.5             | 12.5 <sup>3)</sup> | 12.5 <sup>3)</sup> | HGP100     | 12.5       | 163                | HGT65 <sup>1), 4)</sup> | 8 ~ 12 <sup>3)</sup>    |
| 7.5   | 13.7             | 18                 | 18                 | HGP100     | 32         | 416                | HGT65 <sup>1)</sup>     | 12 ~ 18                 |
| 10    | 19               | 25                 | 25                 | HGP100     | 32         | 416                | HGT100 <sup>1)</sup>    | 17 ~ 25                 |
| 11    | 20               | 25                 | 25                 | HGP100     | 32         | 320                | HGT100 <sup>1)</sup>    | 17 ~ 25                 |
| 15    | 26.5             | 32                 | 32                 | HGP100     | 50         | 650                | HGT100                  | 22 ~ 32                 |
| 18.5  | 33               | 40                 | 40                 | HGP100     | 50         | 650                | HGT100                  | 28 ~ 40                 |
| 22    | 39               | 40                 | 40                 | HGP100     | 50         | 650                | HGT100                  | 34 ~ 50                 |
| 30    | 52               | 63                 | 63                 | HGP100     | 100        | 1300               | HGT150                  | 48 ~ 80                 |
| 37    | 63               | 63                 | 63                 | HGP100     | 100        | 1300               | HGT150                  | 48 ~ 80                 |
| 45    | 76               | 80                 | 80                 | HGP250     | 125        | 1250               | HGT150                  | 48 ~ 80                 |
| 55    | 90               | 100                | 100                | HGP250     | 160        | 1600               | HGT150                  | 69 ~ 115                |
| 75    | 125              | 150                | 150                | HGP250     | 200        | 2000               | HGT150                  | 90 ~ 150                |
| 90    | 140              | 150                | 150                | HGP250     | 200        | 2000               | HGT150                  | 111 ~ 185               |
| 110   | 178              | 185                | 185                | HGP250     | 250        | 2500               | HGT265                  | 135 ~ 225               |
| 132   | 210              | 265                | 265                | HGP400     | 350        | 3500               | HGT265                  | 180 ~ 300               |
| 160   | 256              | 265                | 265                | HGP400     | 350        | 3500               | HGT265                  | 180 ~ 300               |
| 200   | 310              | 320                | 320                | HGP630     | 400        | 4000               | HGT500                  | 240 ~ 400               |
| 220   | 353              | 400                | 400                | HGP630     | 630        | 6300               | HGT500                  | 300 ~ 500               |
| 250   | 400              | 500                | 500                | HGP630     | 700        | 7000               | HGT500                  | 300 ~ 500               |
|       |                  | 500                |                    | HGP800     | 700        | 7000               | HGT800                  | 378 ~ 630               |
| 300   | 460              | 630                | 630                | HGP800     | 800        | 8000               | HGT800                  | 378 ~ 630               |
| 335   | 540              | 630                | 630                | HGP800     | 800        | 8000               | HGT800                  | 378 ~ 630               |
| 375   | 575              | 630                | 630                | HGP800     | 800        | 8000               | HGT800                  | 378 ~ 630               |

※ 1) Iq < 50 kA

2) TOR Thermal Maximum Rating 2.1 A

3) TOR Thermal Maximum Rating 12 A

4) Type 1 Only for Thermal Relay

\* F type is for overseas sales.

## Installation


### Insulation Distance (Safety Clearance)

For safety, insulation distance must be secured at installation. In case of installing a circuit breaker, safety clearances must be secured between breakers or between the circuit breaker and panel, bus bar and other adjacent devices. When the circuit breaker interrupts a short circuit, high temperature ionized gas is generated and the gas is discharged through the discharge outlet from the circuit breaker. As this gas can cause short-circuit accidents and grounding accidents, sufficient insulation distance is required between the circuit breaker and the panel.


※ In case insulation barrier is not installed between the circuit breaker terminals, secondary short-circuit accident may occur so it must be used.

The insulation barrier must be installed towards the both directions of the circuit breaker's line / load indication part.


Separation distance in case the circuit breaker is installed side by side

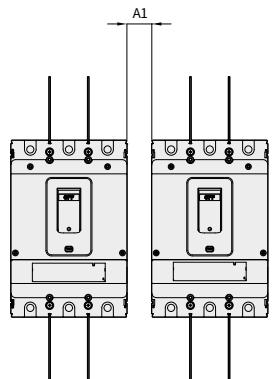


Up/down/left/right distance in case of metallic panel

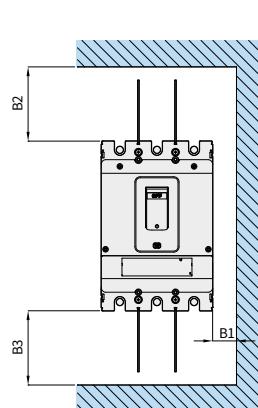

Front/back distance in case of metallic panel

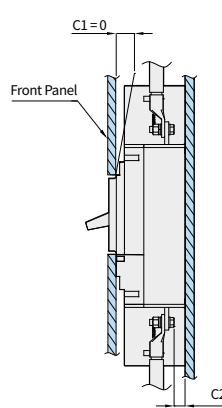

Distance with circuit breaker in case the live part is exposed

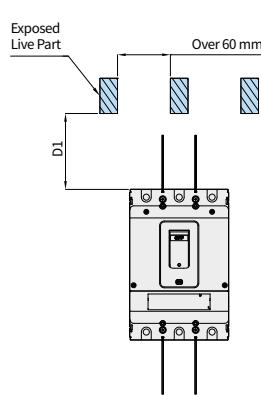

※ In case of using the minimum separation distance(A1 = 0), terminal cover and phase to phase barrier must be assembled between the product. And pay attention to the tolerances of the enclosure dimensions.

※ If the distance between the live parts is less than 60 mm, the exposed part must be insulated.

### HGP Type's Minimum Insulation Distance

| Type         | Minimum Clearance (mm) |    |     |     |    |    |       |      |    |     |     |    |    |     |
|--------------|------------------------|----|-----|-----|----|----|-------|------|----|-----|-----|----|----|-----|
|              | 460 V                  |    |     |     |    |    | 240 V |      |    |     |     |    |    |     |
|              | A1                     | B1 | B2  | B3  | C1 | C2 | D1    | A1   | B1 | B2  | B3  | C1 | C2 | D1  |
| HGP50D F*/S  | 0                      | 10 | 50  | 50  | 0  | 8  | 350   | 0/50 | 10 | 50  | 50  | 0  | 8  | 350 |
| HGP50D H/X   | 0                      | 10 | 50  | 50  | 0  | 8  | 350   | 0/50 | 10 | 50  | 50  | 0  | 8  | 350 |
| HGP125D F*/S | 0                      | 10 | 50  | 50  | 0  | 8  | 350   | 0/50 | 10 | 50  | 50  | 0  | 8  | 350 |
| HGP125D H/X  | 0                      | 10 | 50  | 50  | 0  | 8  | 350   | 0/50 | 10 | 50  | 50  | 0  | 8  | 350 |
| HGP160D F*/S | 0                      | 10 | 50  | 50  | 0  | 8  | 350   | 0/50 | 10 | 50  | 50  | 0  | 8  | 350 |
| HGP160D H/X  | 0                      | 10 | 50  | 50  | 0  | 8  | 350   | 0/50 | 10 | 50  | 50  | 0  | 8  | 350 |
| HGP100 F*/S  | 0                      | 10 | 100 | 100 | 0  | 8  | 350   | 0/50 | 10 | 100 | 100 | 0  | 8  | 350 |
| HGP100 H/X   | 0                      | 10 | 100 | 100 | 0  | 8  | 350   | 0/50 | 10 | 100 | 100 | 0  | 8  | 350 |
| HGP160 F*/S  | 0                      | 10 | 100 | 100 | 0  | 8  | 350   | 0/50 | 10 | 100 | 100 | 0  | 8  | 350 |
| HGP160 H/X   | 0                      | 10 | 100 | 100 | 0  | 8  | 350   | 0/50 | 10 | 100 | 100 | 0  | 8  | 350 |
| HGP250 F*/S  | 0                      | 10 | 100 | 100 | 0  | 8  | 350   | 0/50 | 10 | 100 | 100 | 0  | 8  | 350 |
| HGP250 H/X   | 0                      | 10 | 100 | 100 | 0  | 8  | 350   | 0/50 | 10 | 100 | 100 | 0  | 8  | 350 |
| HGP400 F*/S  | 0                      | 40 | 116 | 116 | 0  | 8  | 350   | 0/50 | 15 | 116 | 116 | 0  | 8  | 350 |
| HGP400 H/X   | 0                      | 40 | 116 | 116 | 0  | 8  | 350   | 0/50 | 15 | 116 | 116 | 0  | 8  | 350 |
| HGP630 F*/S  | 0                      | 40 | 116 | 116 | 0  | 8  | 350   | 0/50 | 15 | 116 | 116 | 0  | 8  | 350 |
| HGP630 H/X   | 0                      | 40 | 116 | 116 | 0  | 8  | 350   | 0/50 | 15 | 116 | 116 | 0  | 8  | 350 |
| HGP800 F*/S  | 0                      | 45 | 115 | 115 | 0  | 8  | 350   | 0/50 | 20 | 115 | 115 | 0  | 8  | 350 |
| HGP800 H/X   | 0                      | 45 | 115 | 115 | 0  | 8  | 350   | 0/50 | 20 | 115 | 115 | 0  | 8  | 350 |


※ \* F type is for overseas sales.

## Technical Data (HGP)

### Installation


#### Installation Angle

The HGP Type of circuit breakers can be installed vertically or horizontally without changing any characteristics and as for the detailed installation direction, please refer to the figure below.

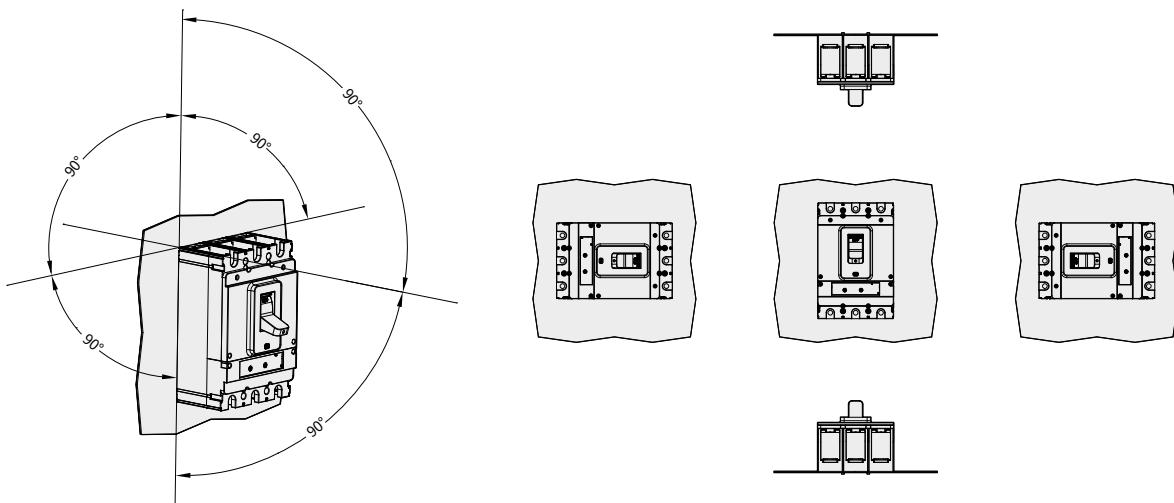

#### Direction of Power Supply


As for the HGP Type circuit breaker, the breaking power of circuit breaker does not drop even if power is supplied to the load side. So, power can be supplied to any direction regardless of the line side/load side for use. With regards to the use in reverse connection, HGP got DEKRA Certificate under IEC 60947-2.

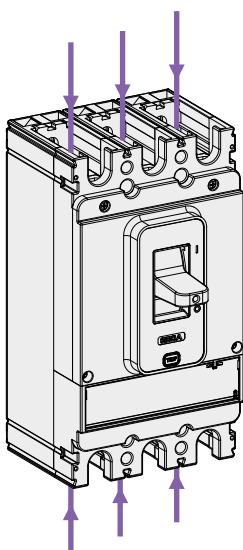

## Standard Configuration


### HGP Type

**HGP50D, HGP125D, HGP160D, HGP100, HGP160, HGP250**

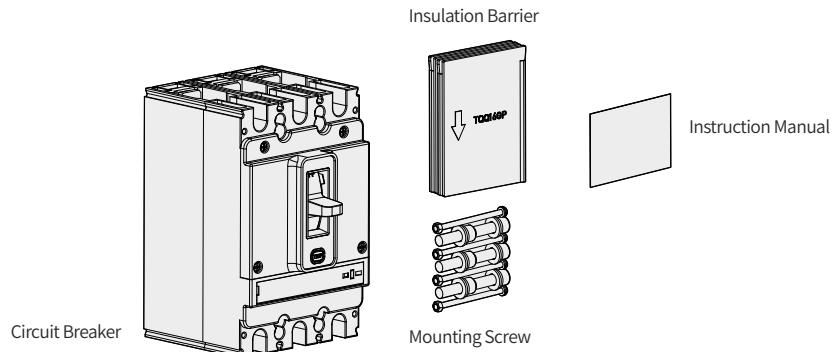

| MCCB                        | Part |               |                                |      |
|-----------------------------|------|---------------|--------------------------------|------|
| HGP50D, HGP125D,<br>HGP160D | 3P   | 4 EA (M4×L85) | 6 EA (PH Screw P·S/W M8×L18)   | 4 EA |
|                             | 4P   | 5 EA (M4×L85) | 8 EA (PH Screw P·S/W M8×L18)   | 6 EA |
| HGP100, HGP160,<br>HGP250   | 3P   | 4 EA (M4×L85) | 6 EA (Hex Socket P·S/W M8×L20) | 4 EA |
|                             | 4P   | 6 EA (M4×L85) | 8 EA (Hex Socket P·S/W M8×L20) | 6 EA |

**HGP400, HGP630, HGP800**

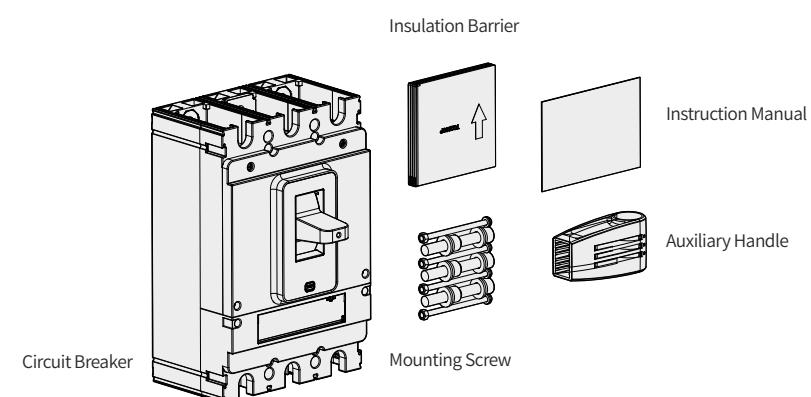


| MCCB           | Part |                |                                 |      |
|----------------|------|----------------|---------------------------------|------|
| HGP400, HGP630 | 3P   | 4 EA (M5×L98)  | 6 EA (Hex Socket P·S/W M10×L30) | 4 EA |
|                | 4P   | 5 EA (M5×L98)  | 8 EA (Hex Socket P·S/W M10×L30) | 6 EA |
| HGP800         | 3P   | 4 EA (M6×L110) | 6 EA (Hex Socket P·S/W M12×L35) | 4 EA |
|                | 4P   | 6 EA (M6×L110) | 8 EA (Hex Socket P·S/W M12×L35) | 6 EA |

## Technical Data (HGP)


### MCCB Assembly and Terminal Mounting Specification

#### HGP Type

HGP Type circuit breaker can be mounted directly on the panel by using a screw. In case there is a bus bar or terminal at the back of the panel, insulation distance requires your attention. The wire and bus bar have to be wired according to the terminal part's specification for power supply of circuit breaker and fastened according to the specified tightening torque.

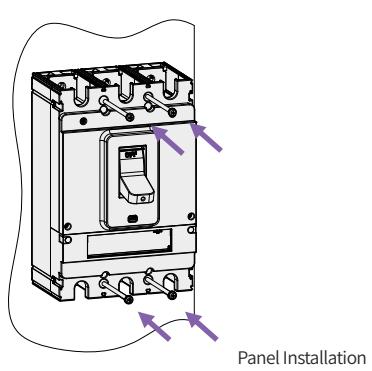

Panel Installation

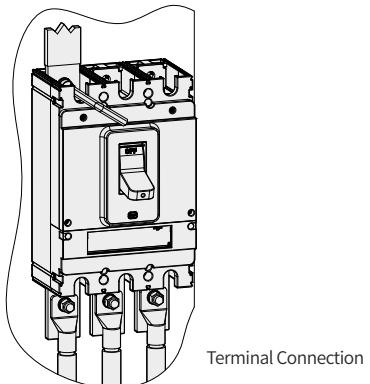


Terminal Connection

| No | Type                         | Panel Mounting      |  | Connection Terminal  |                        |
|----|------------------------------|---------------------|--|----------------------|------------------------|
|    |                              | Screw Specification | Terminal Connection Method and Dimensions (mm) | Conductor Processing | Tightening Torque      |
| 1  | HGP50D<br>HGP125D<br>HGP160D | M4 : 13 kgf.cm      |  |                      | M8 : 50 ~ 70 kgf·cm    |
| 2  | HGP100<br>HGP160<br>HGP250   | M4 : 13 kgf.cm      |  |                      | M8 : 80 ~ 130 kgf·cm   |
| 3  | HGP400<br>HGP630             | M5 : 28.5 kgf·cm    |  |                      | M10 : 140 ~ 270 kgf.cm |
| 4  | HGP800                       | M6 : 45 kgf.cm      |  |                      | M12 : 350 ~ 470 kgf.cm |


## Operation Characteristic Curve

HGM/HGE100 (16 ~ 32 A)

• HGM/HGE30, 50E/S, 60, 100

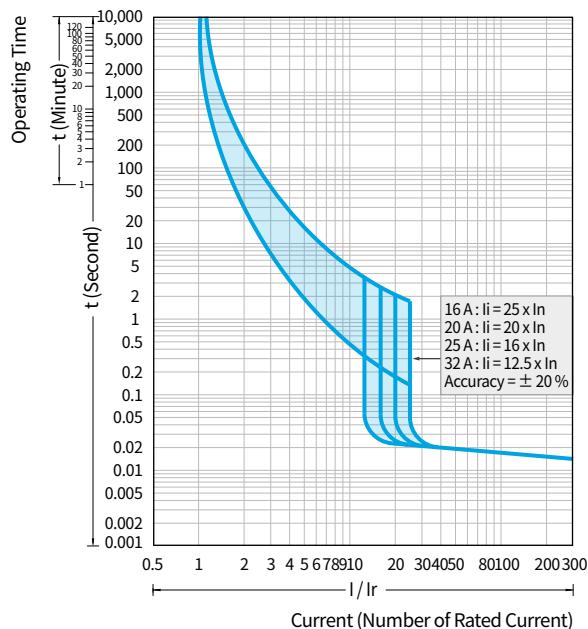


Ambient Temperature Derating Curve

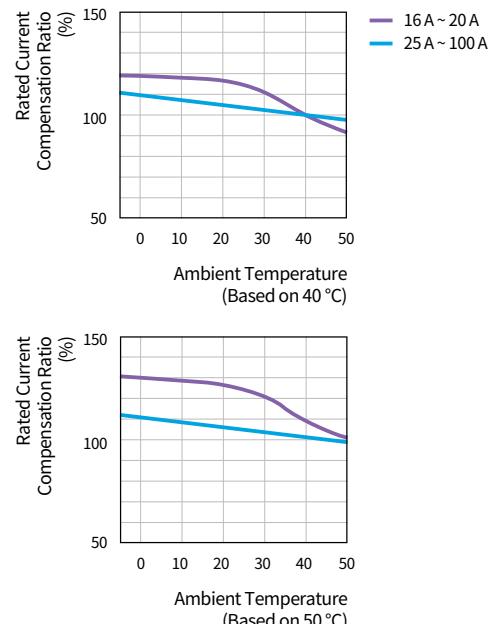


HGM/HGE100 (40 ~ 100 A)

• HGM/HGE50E/S, 60, 100

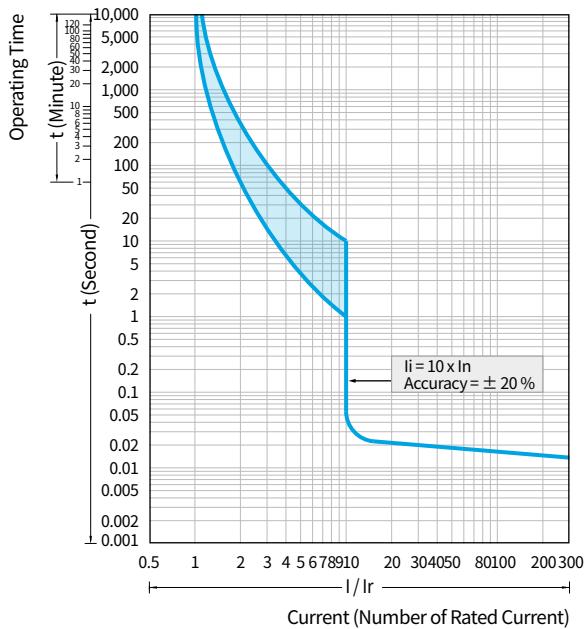


Ambient Temperature Derating Curve

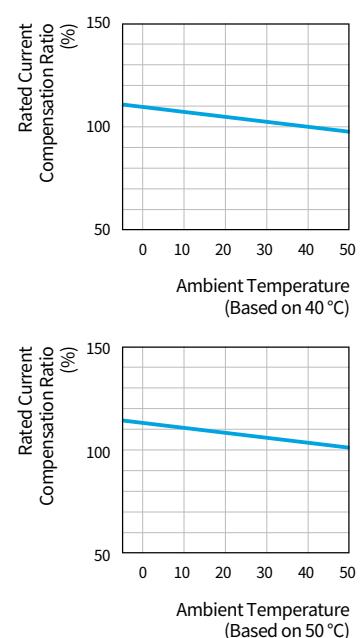


## Operation Characteristic Curve

HGM/HGE125 (16 ~ 32 A)

• HGM/HGE50H/L, 125

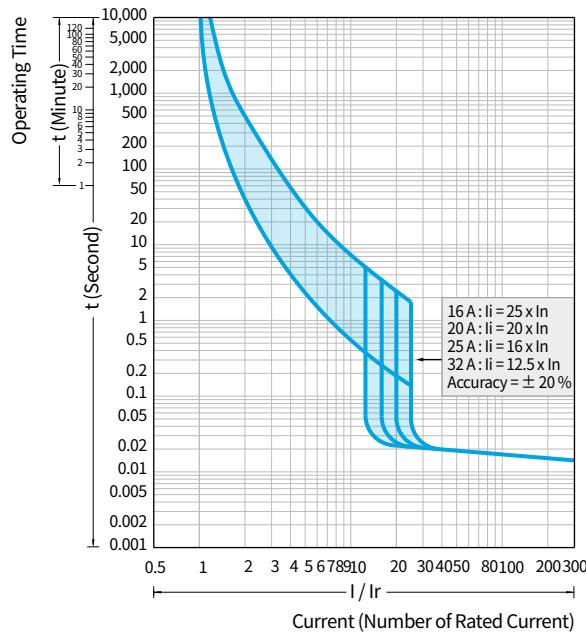


Ambient Temperature Derating Curve

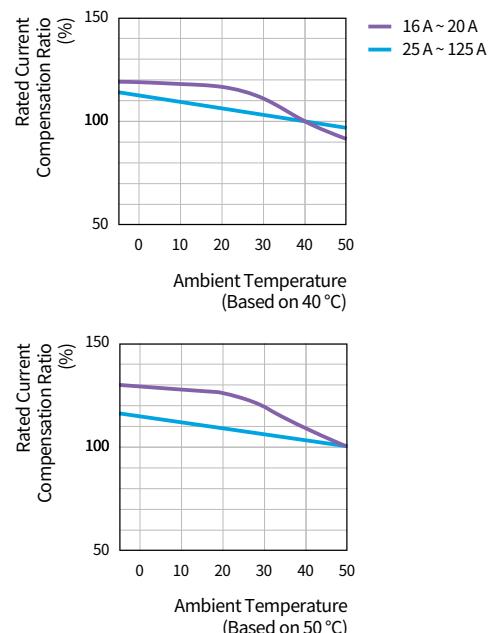


HGM/HGE125 (40 ~ 125 A)

• HGM/HGE50H/L, 125

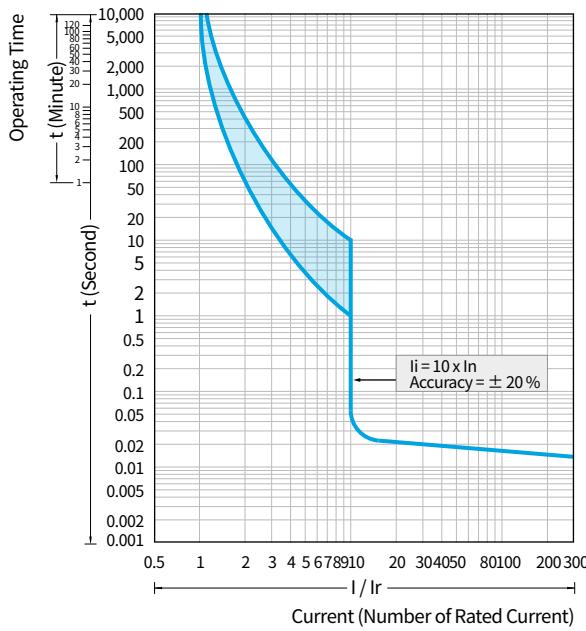


Ambient Temperature Derating Curve

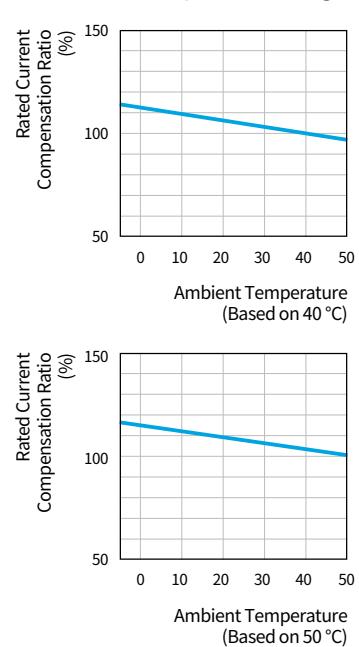


**HGM/HGE250 (100 ~ 250 A)**


• HGM/HGE160, 250

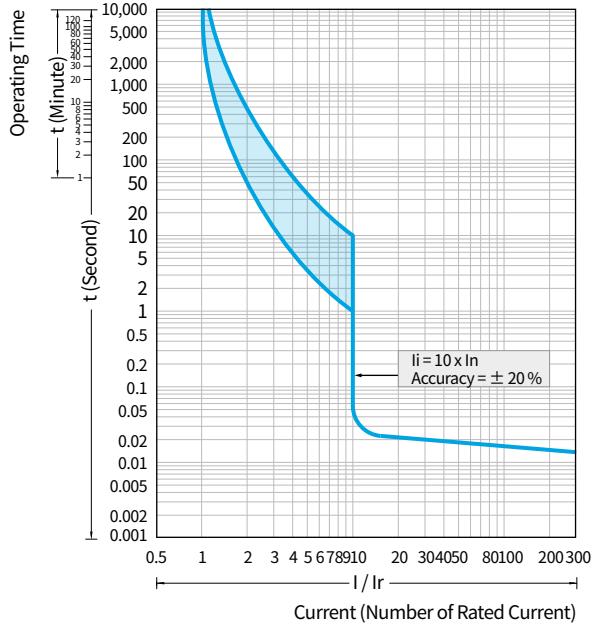


Ambient Temperature Derating Curve

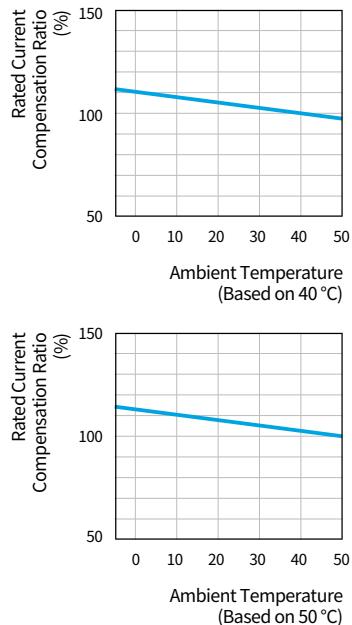**HGM400**

• HGM400

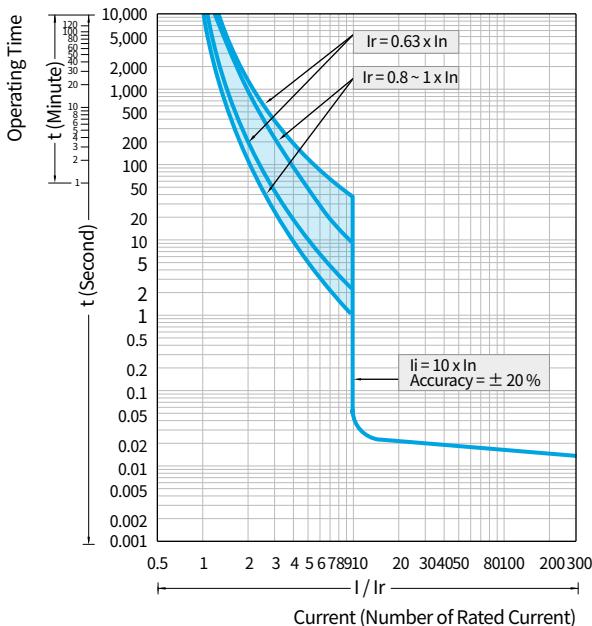



Ambient Temperature Derating Curve

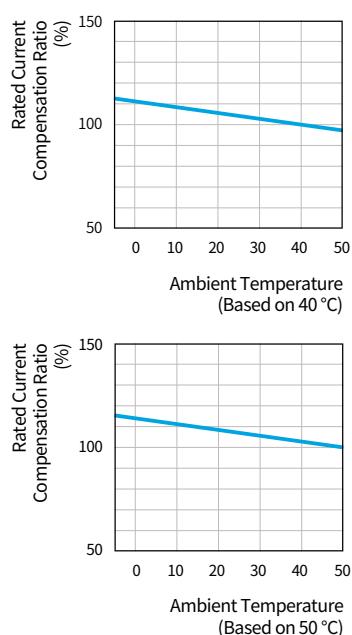

## Operation Characteristic Curve



HGM800 (500 ~ 800 A)

• HGM630, 800

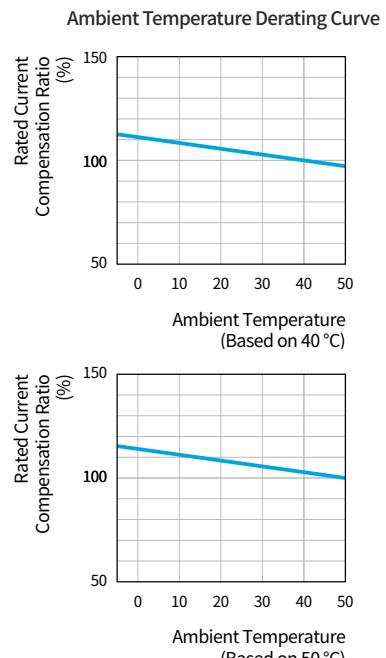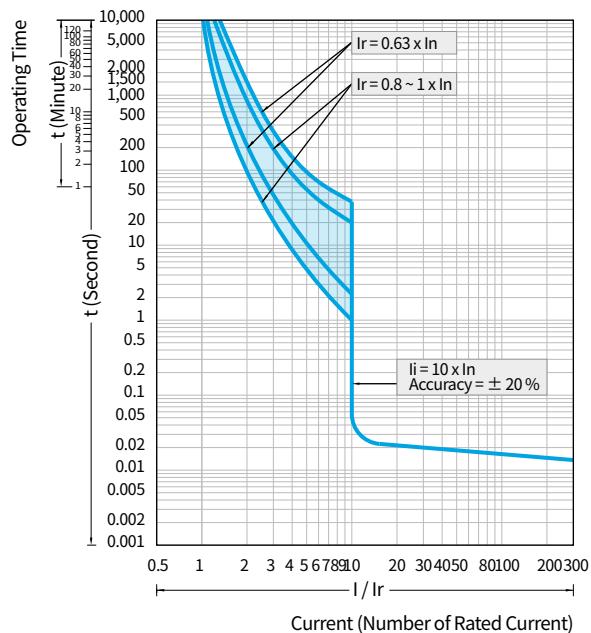


HGE400

• HGE400

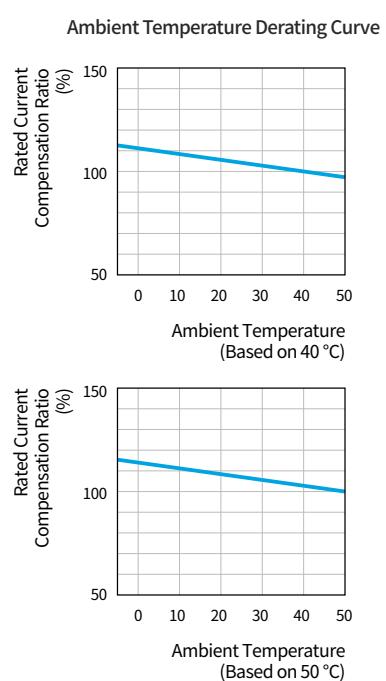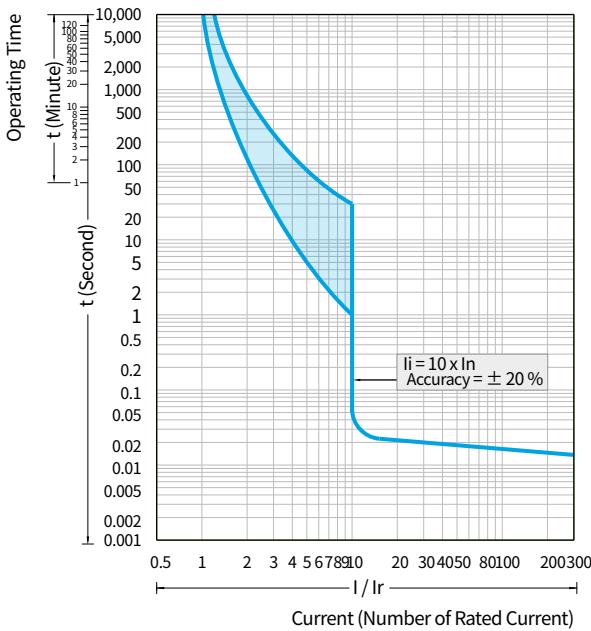


**HGE800 (630 ~ 800 A)**

• HGE630, 800

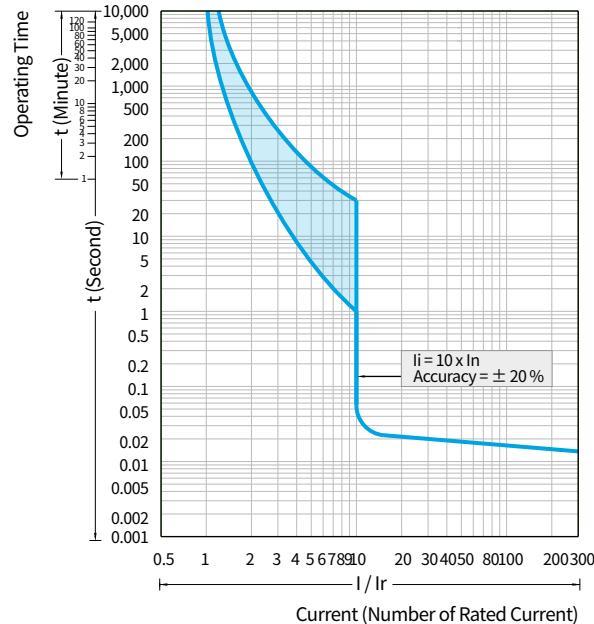


Ambient Temperature Derating Curve

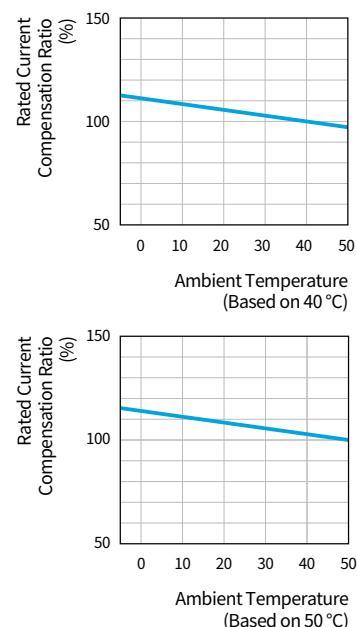

## Current & Energy-Limiting Characteristic Curve


### Current-Limiting Characteristic Curve

• Based on 400/460 V

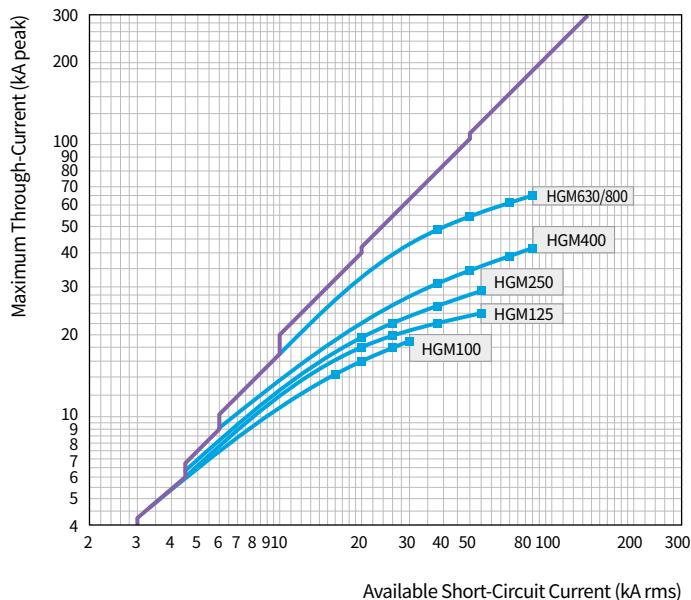

### Energy-Limiting Characteristic Curve

• Based on 400/460 V


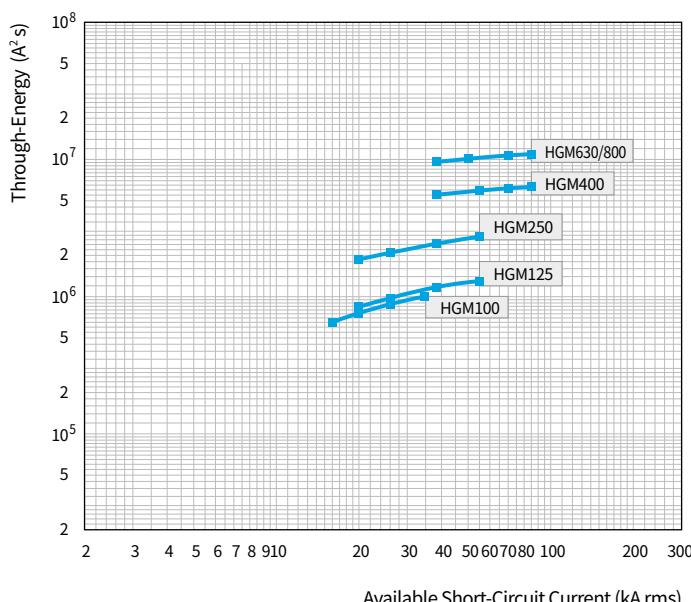




## Operation Characteristic Curve (HGP Thermal Magnetic Type)



HGP160D (16 ~ 32 A)

• HGP50D, 125D

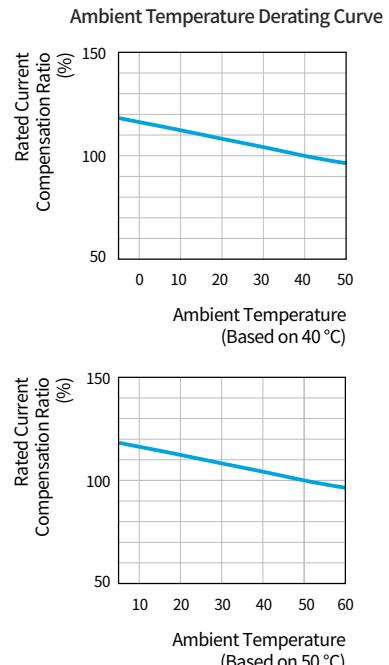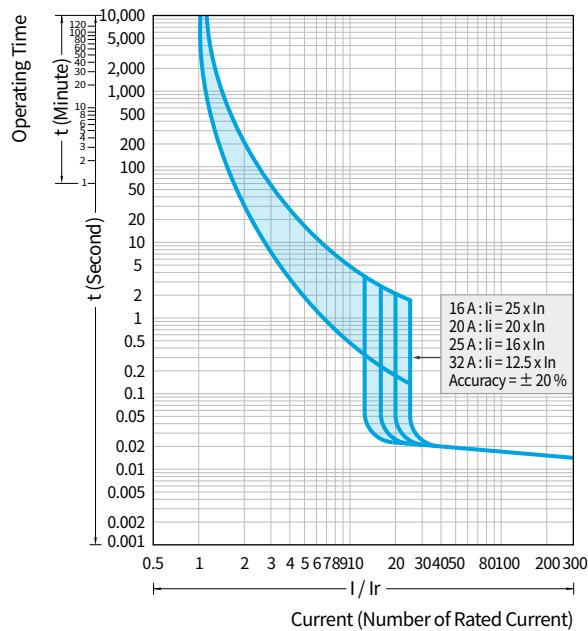


HGP160D (40 ~ 160 A)

• HGP50D, 125D, 160D

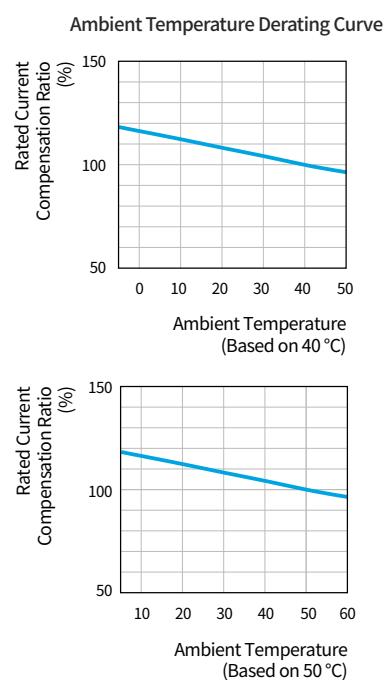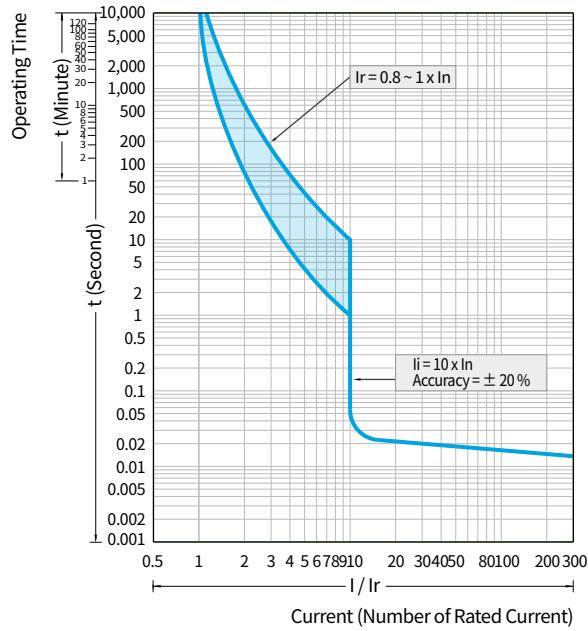


**HGP250**

• HGP100, 160, 250

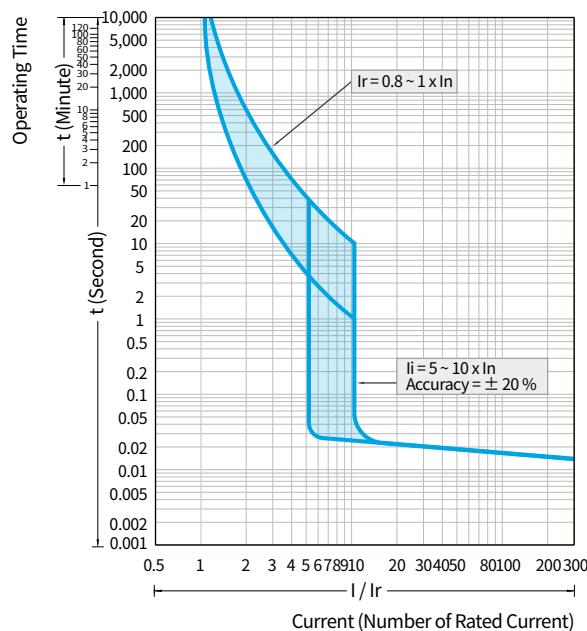



Ambient Temperature Derating Curve

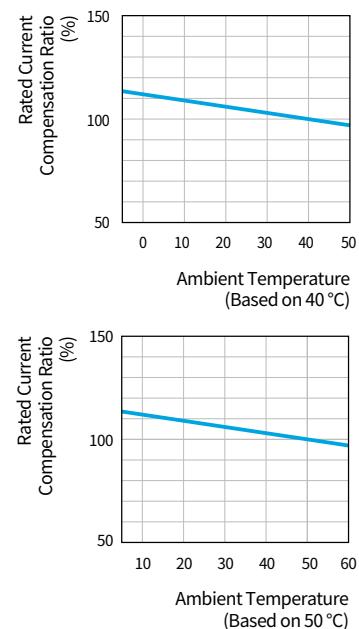

## Operation Characteristic Curve (HGP Thermal Magnetic Type)



HGP630 (300 ~ 630 A)

• HGP400, 630

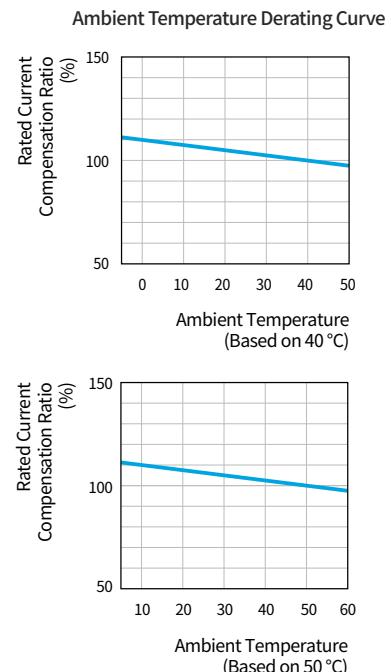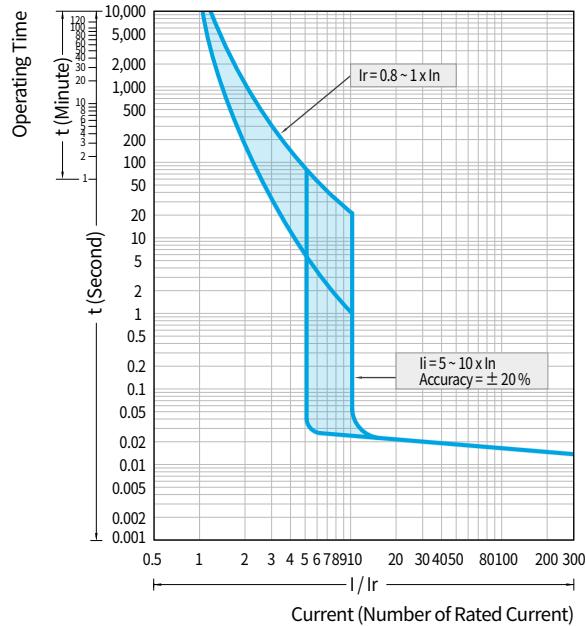

HGP800 (700 ~ 800 A)


• HGP800

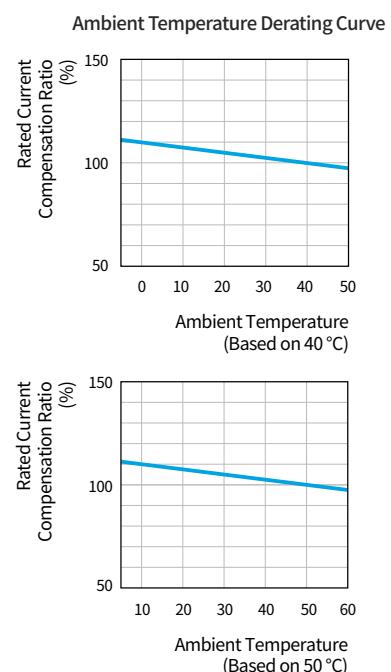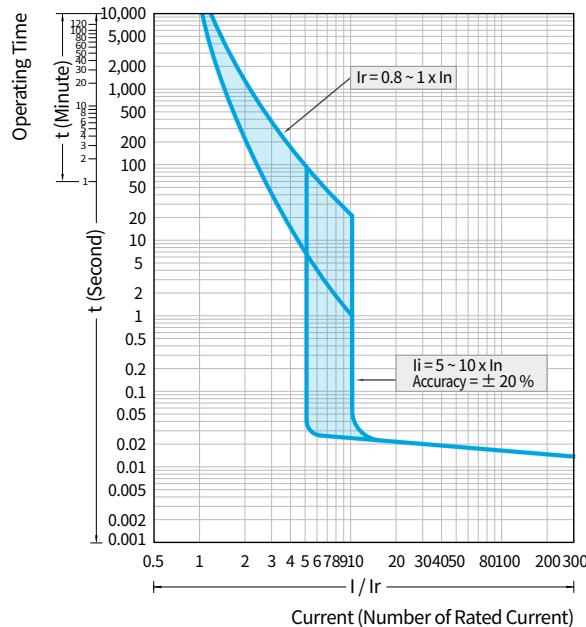

## Operation Characteristic Curve (HGP for Motor Protection)


HGP100 (2.5 ~ 100 A)

• HGP100

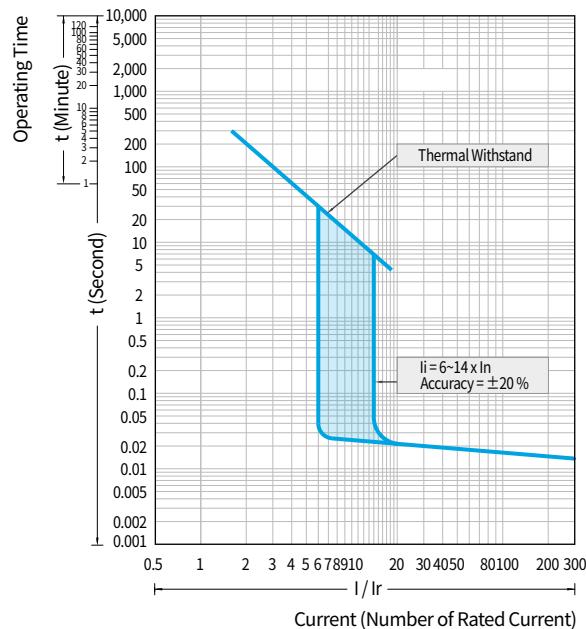

HGP250 (125 ~ 250 A)


• HGP250

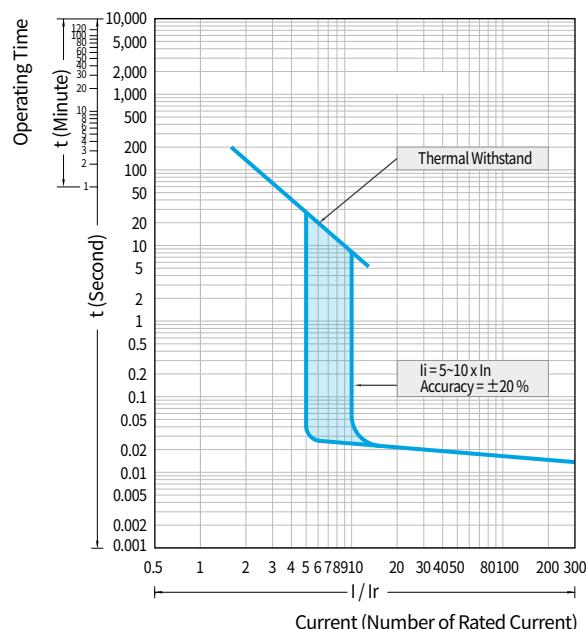

## Operation Characteristic Curve (HGP for Motor Protection)


HGP630 (300 ~ 630 A)

• HGP400, 630

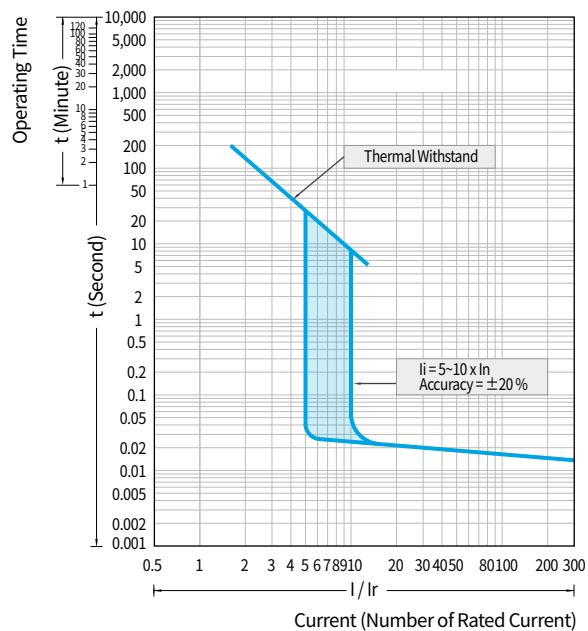

HGP800 (700 ~ 800 A)

• HGP800

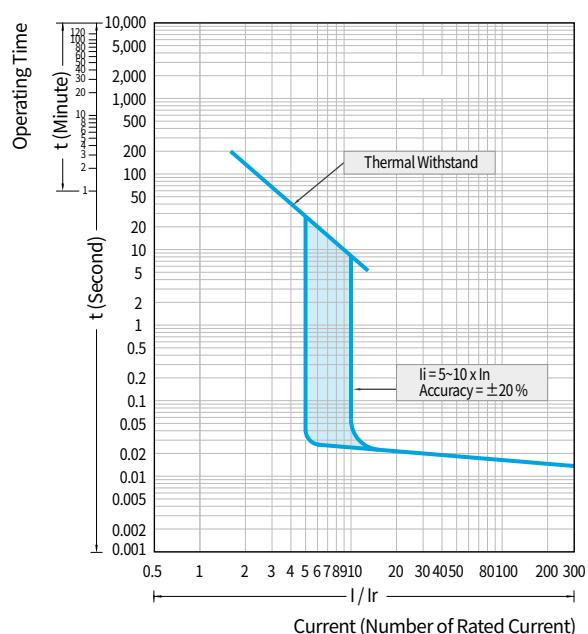


## Operation Characteristic Curve (HGP for Electronic)

### ETU-N Type

• HGP100, 160, 250, 400, 630, 800

- Long-Time Protection [L]
- Short-Time Protection [S]
- Instantaneous Protection [I]

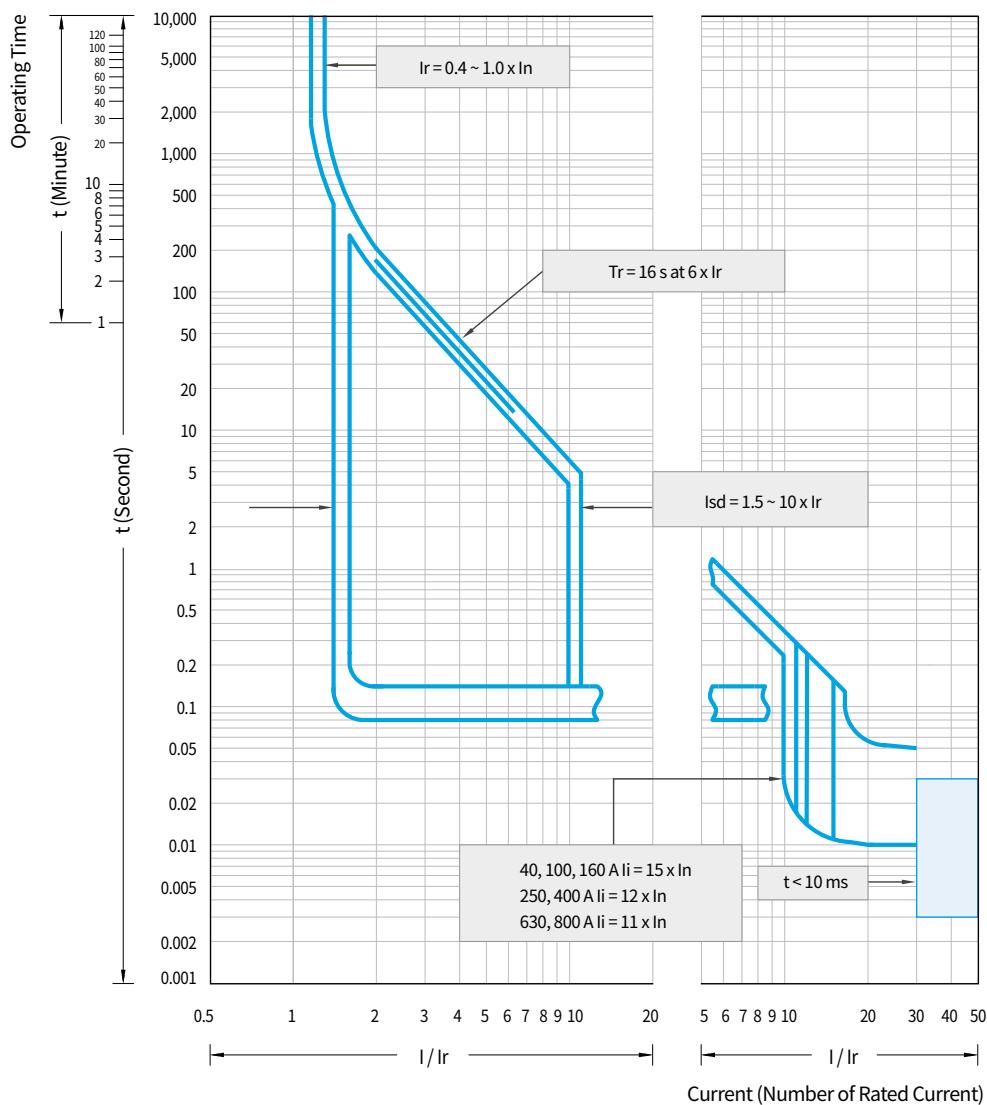


## Operation Characteristic Curve (HGP for Electronic)

**ETU-D/A/E Type (L,S,I)**

• HGP100, 160, 250, 400, 630, 800


- Long-Time Protection [L]
- Short-Time Protection [S]
- Instantaneous Protection [I]

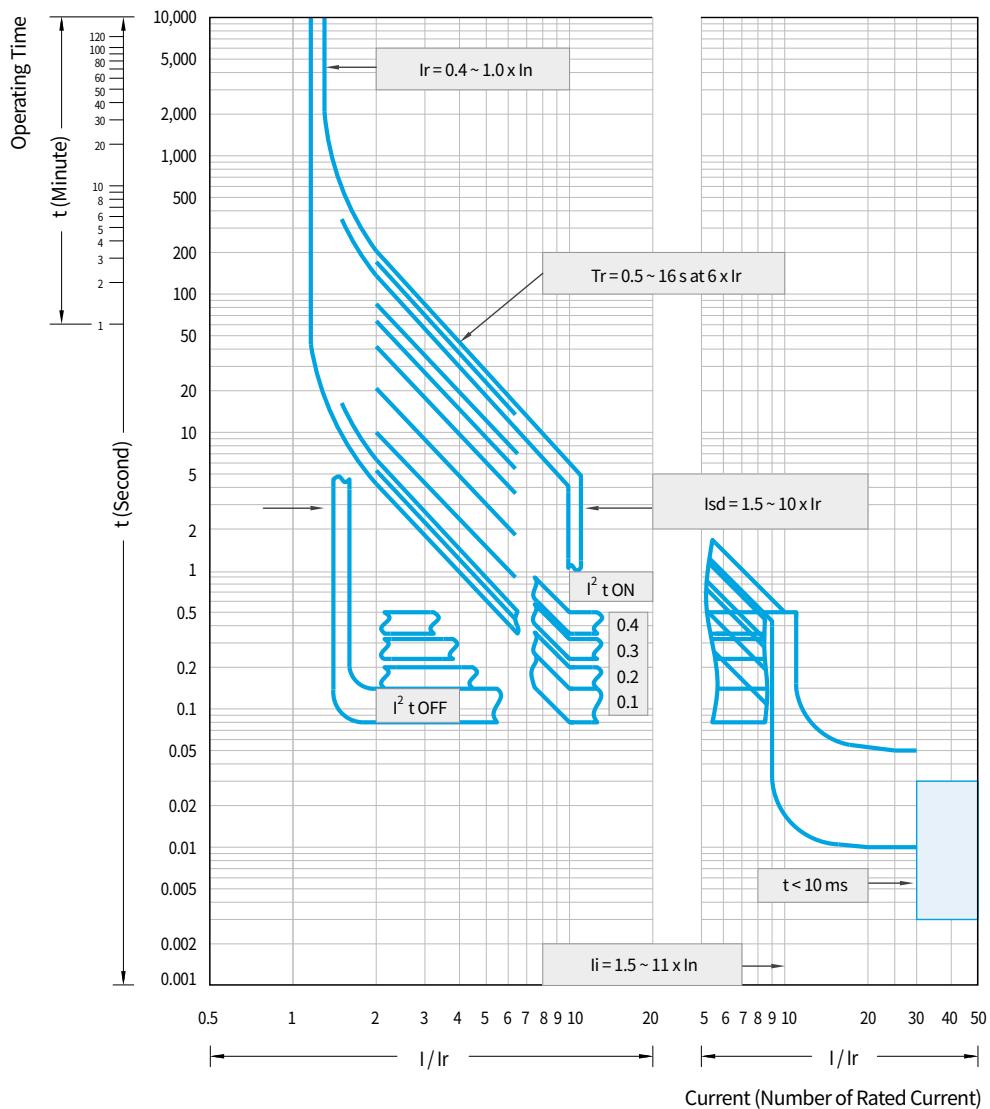

## ETU-D/A/E Type (G)

• HGP100, 160, 250, 400, 630, 800


- Ground-Fault Protection [G]

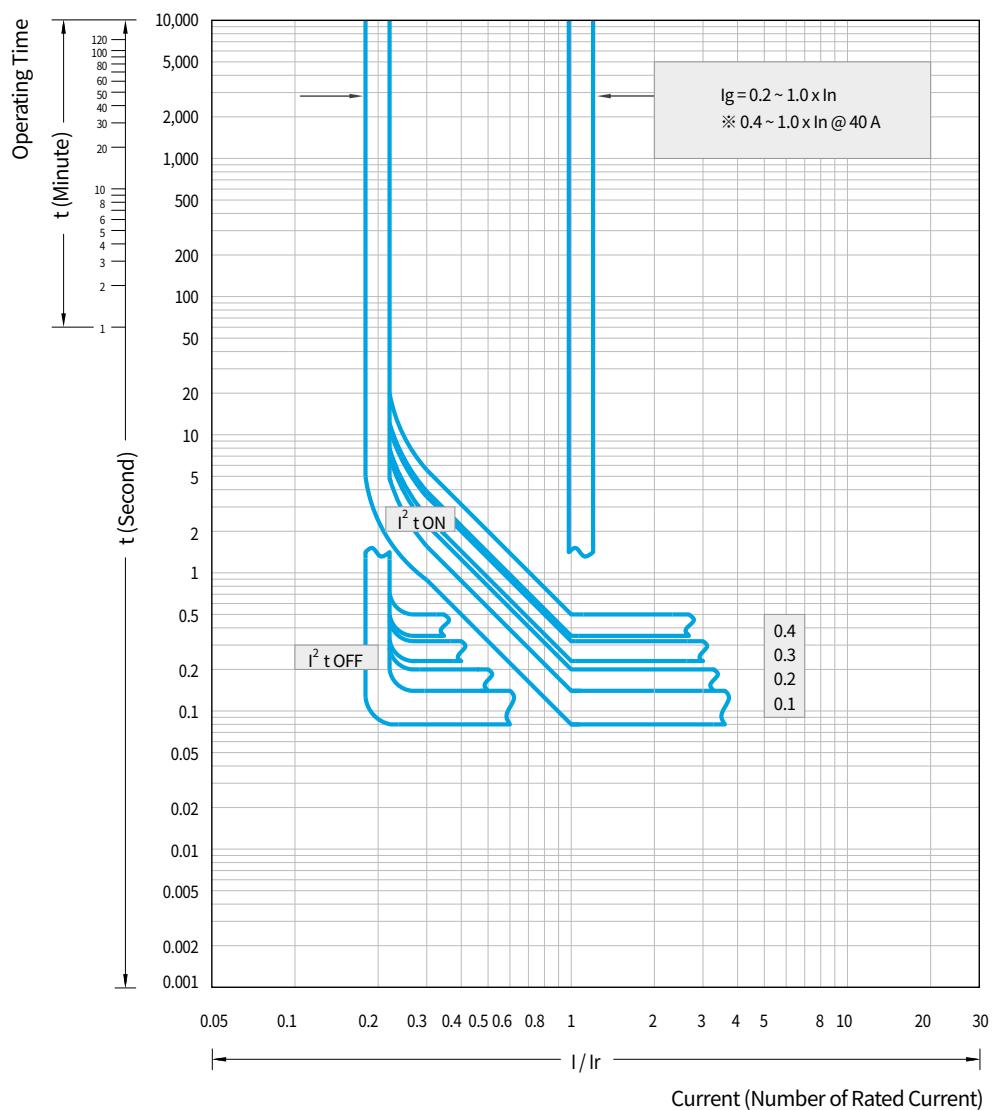

## Current & Energy-Limiting Characteristic Curve (HGP)


### Current-Limiting Characteristic Curve

• Based on 400/460 V

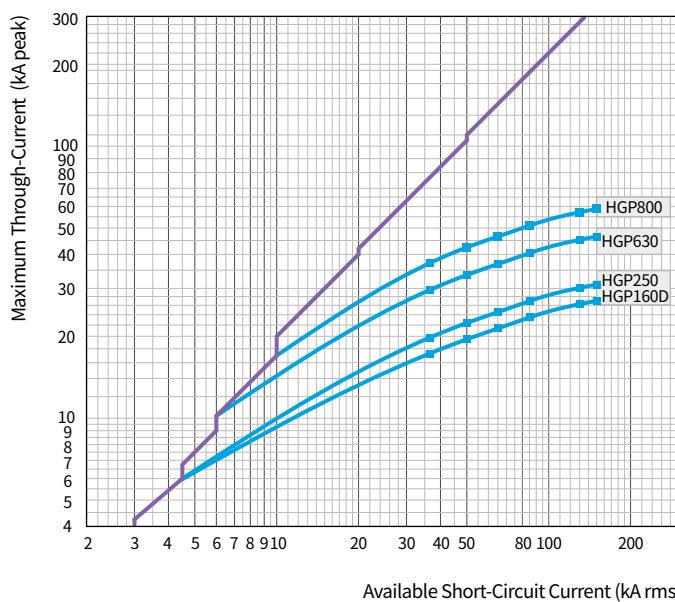


### Energy-Limiting Characteristic Curve

• Based on 400/460 V

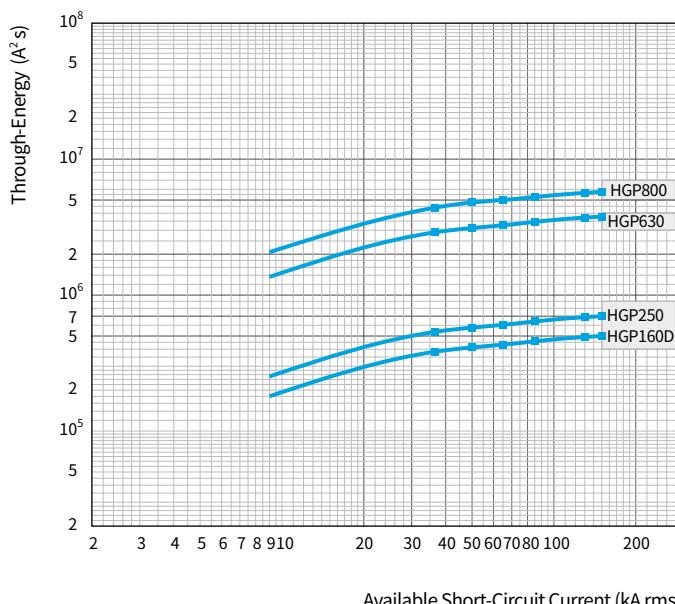


**Current-Limiting Characteristic Curve**

Based on 480/500 V

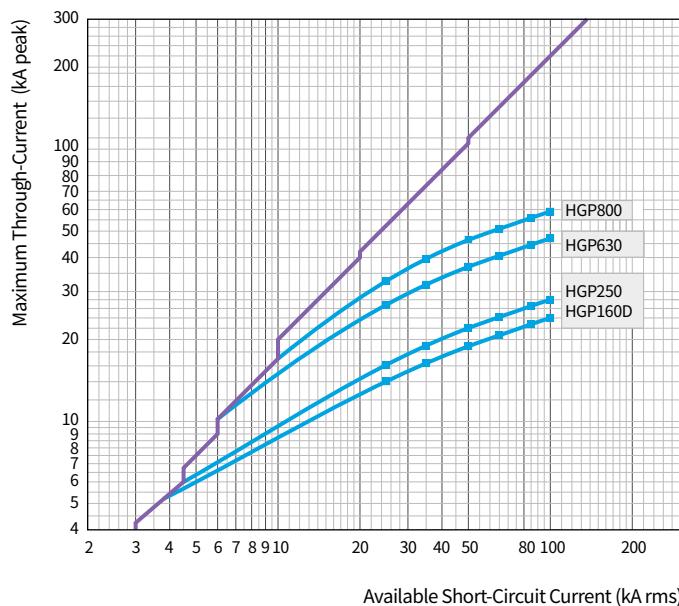**Energy-Limiting Characteristic Curve**

Based on 480/500 V

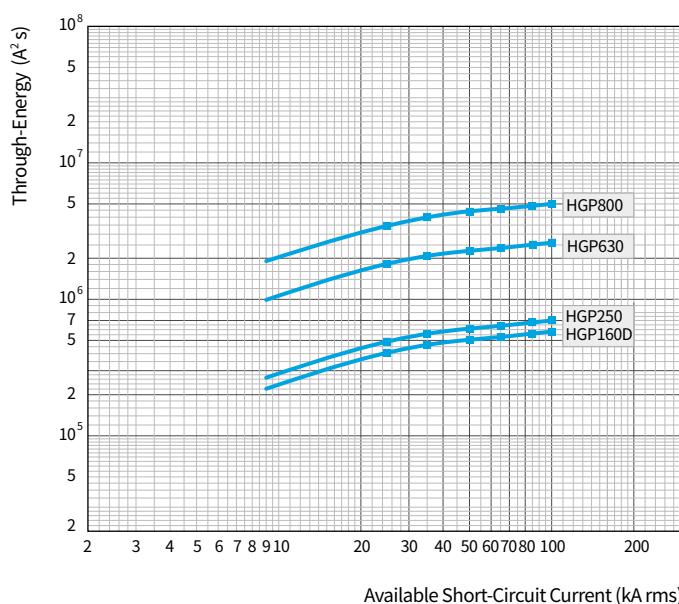


## Dimensions

### Front Connection HGM100

• HGM30, 50E/S, 60, 100


#### External Dimension

Unit : mm

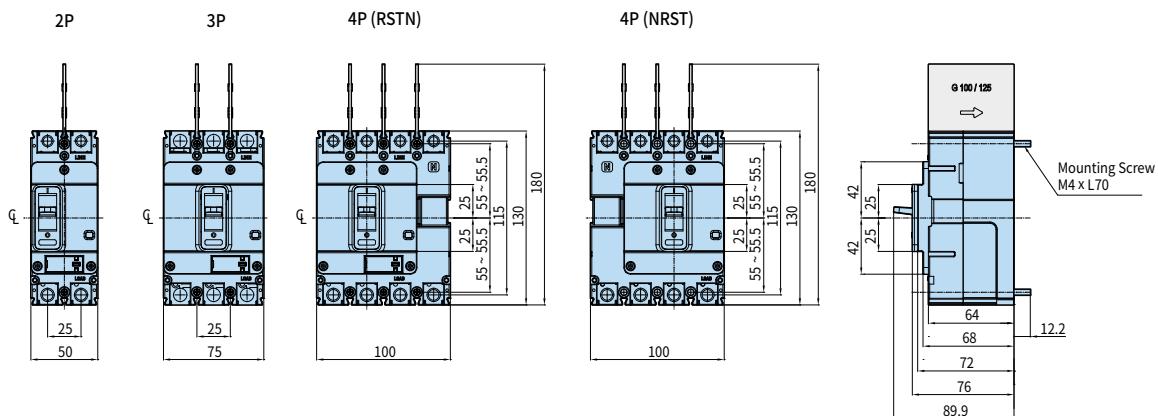


※ The insulation barrier at the line side is provided as default.


#### Panel Installation Dimension

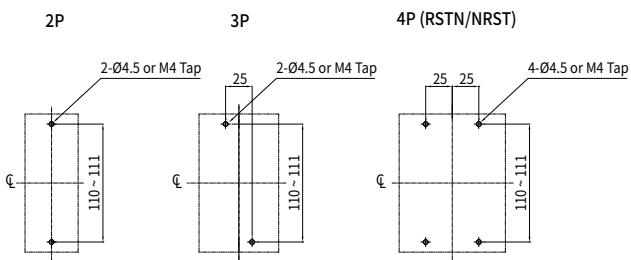


#### Detail Drawing of Terminal Part/ Connecting Conductor

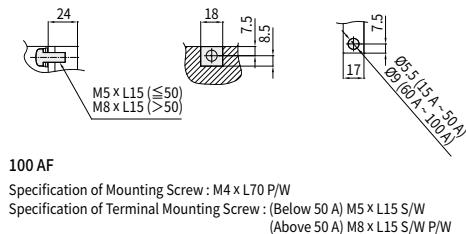

#### Dimension of Panel Cover Cutting - Handle Exposure

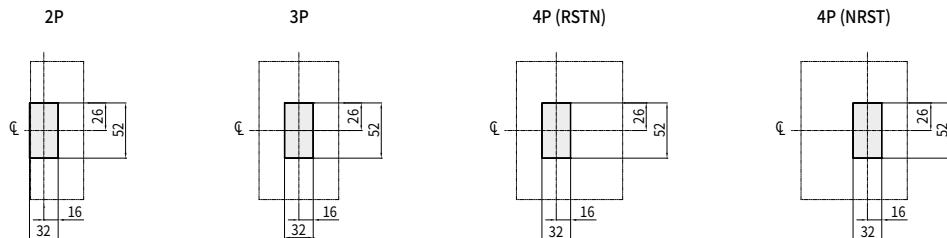

#### Dimension of Panel Cover Cutting - Handle/Test Button Exposure

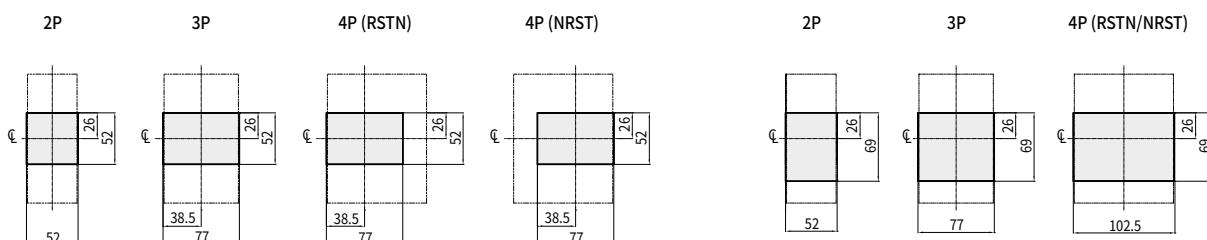

#### Dimension of Panel Cover Cutting - Handle/Trip Unit Exposure


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Front Connection HGM125

• HGM50H/L, 125


### External Dimension

Unit : mm

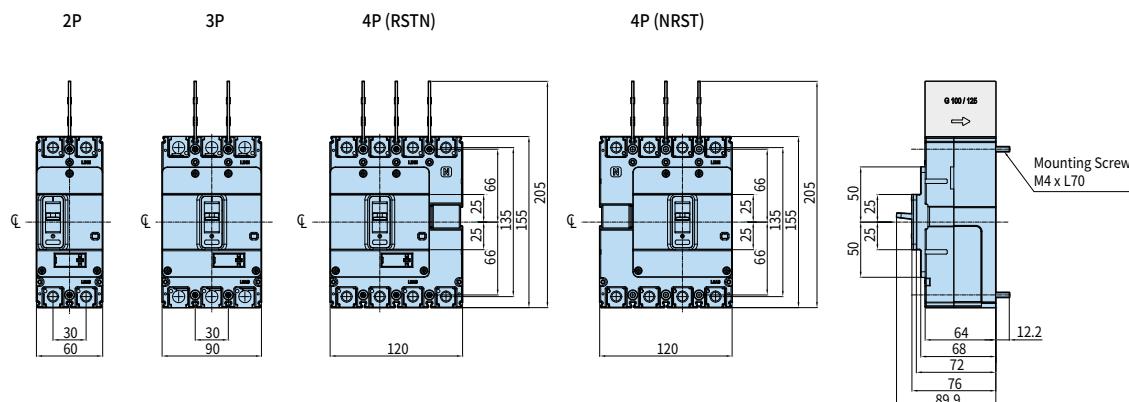


※ The insulation barrier at the line side is provided as default.

### Panel Installation Dimension

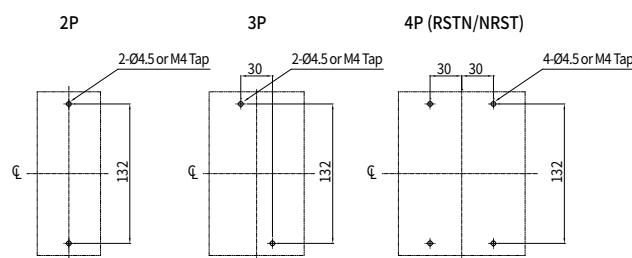

### Detail Drawing of Terminal Part/ Connecting Conductor




125 AF


Specification of Mounting Screw : M4 x L70 P/W

Specification of Terminal Mounting Screw : M8 x L15 S/W P/W

### Dimension of Panel Cover Cutting - Handle Exposure

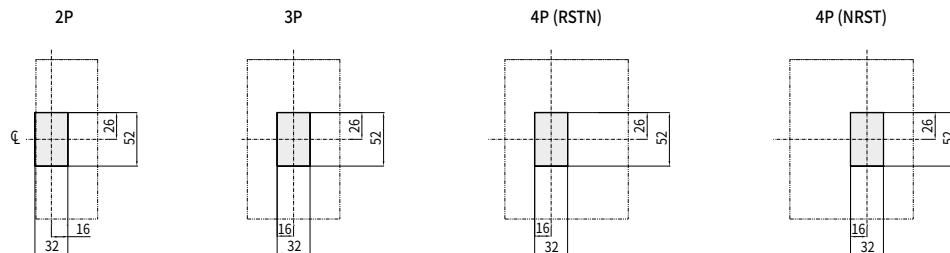

### Dimension of Panel Cover Cutting - Handle/Test Button Exposure

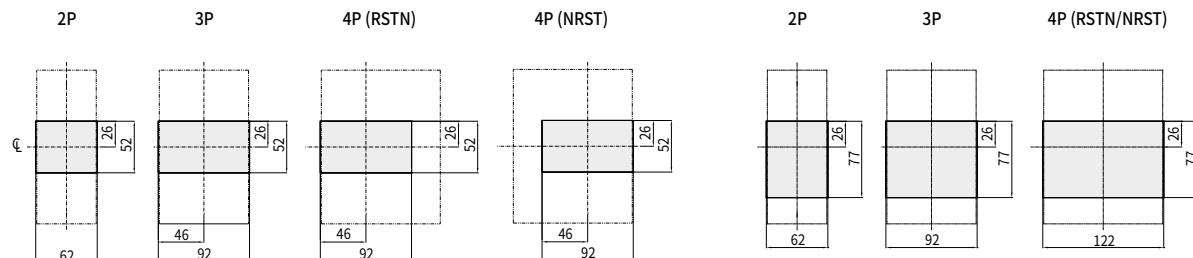

### Dimension of Panel Cover Cutting - Handle/Trip Unit Exposure

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Front Connection HGM250

• HGM160, 250


#### External Dimension

Unit : mm

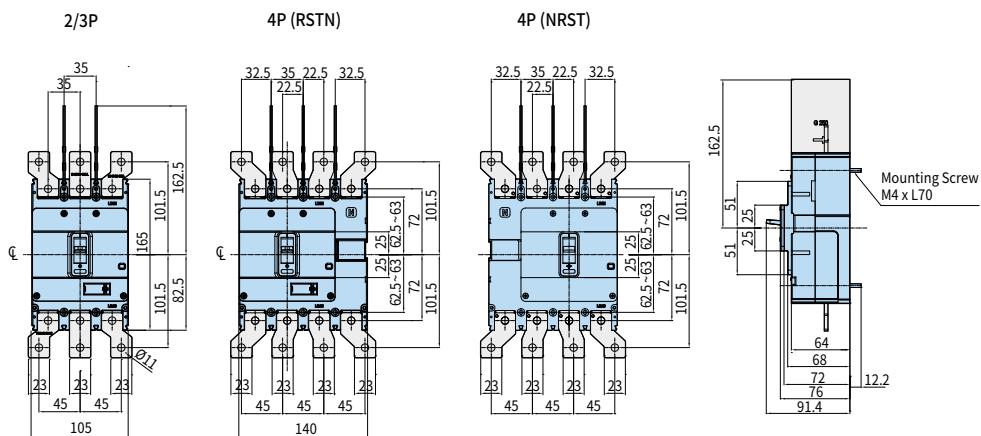


※ The insulation barrier at the line side is provided as default.

#### Panel Installation Dimension

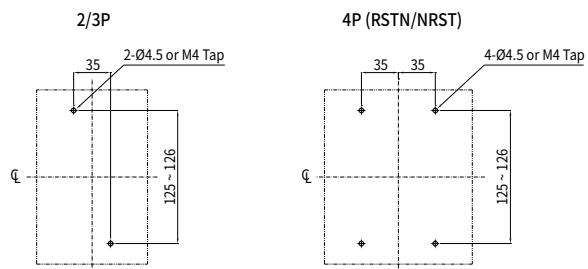

#### Detail Drawing of Terminal Part/ Connecting Conductor

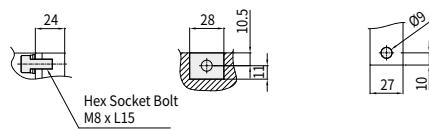


250 AF


Specification of Mounting Screw : M4 x L70 P/W

Specification of Terminal Mounting Screw : Hex Socket Bolt M8 x L18 W/W


#### Dimension of Panel Cover Cutting - Handle Exposure

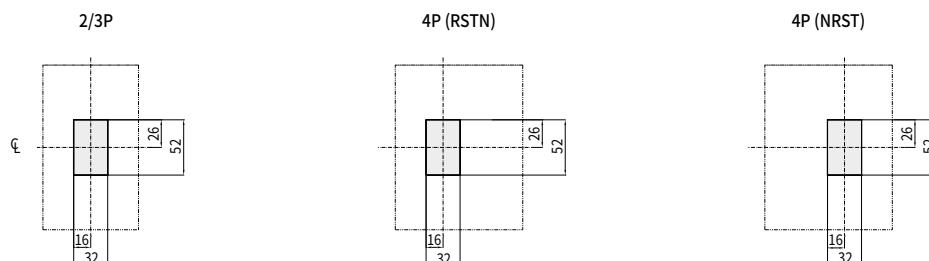

#### Dimension of Panel Cover Cutting - Handle/Test Button Exposure

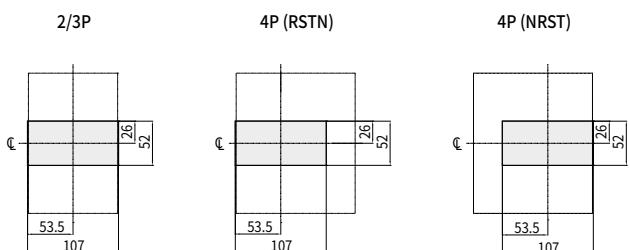

#### Dimension of Panel Cover Cutting - Handle/Trip Unit Exposure

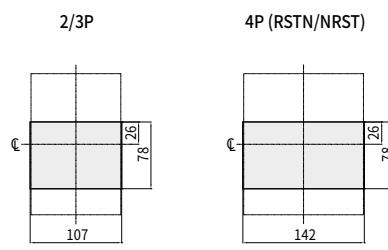


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Front Connection HGM400

- HGM400

## External Dimension


Unit: mm

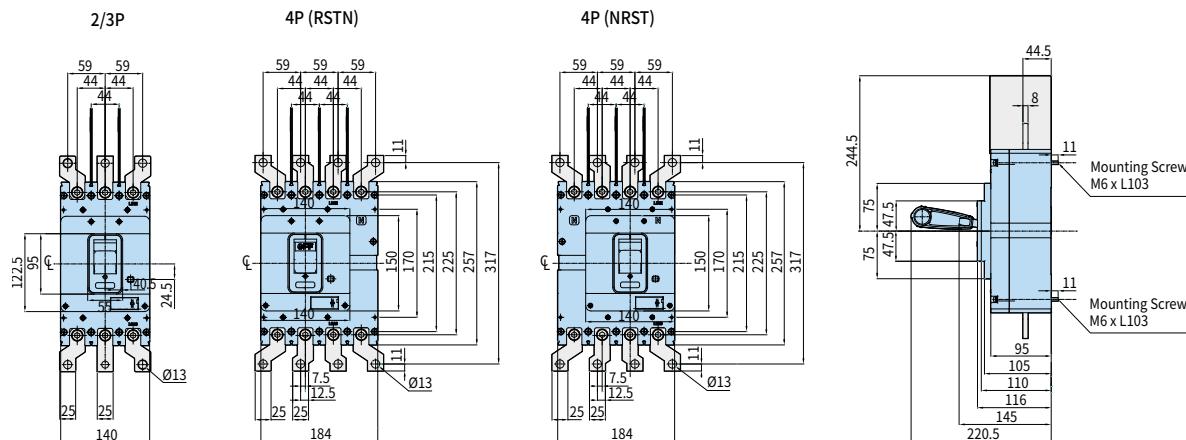


※ The insulation barrier at the line side is provided as default.

#### Panel Installation Dimension

## Detail Drawing of Terminal Part/Connecting Conductor

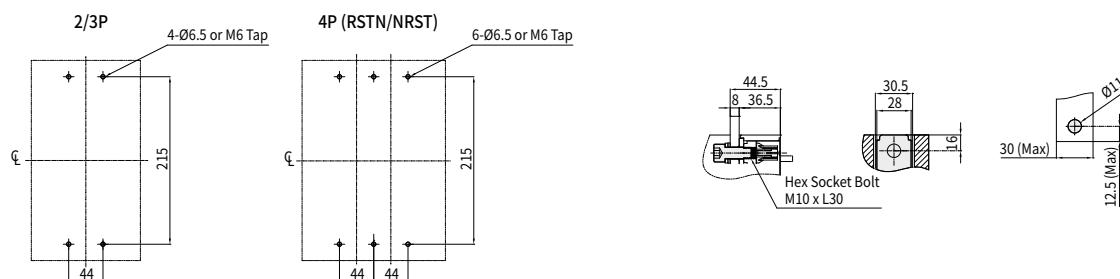


## Dimension of Panel Cover Cutting - Handle Exposure

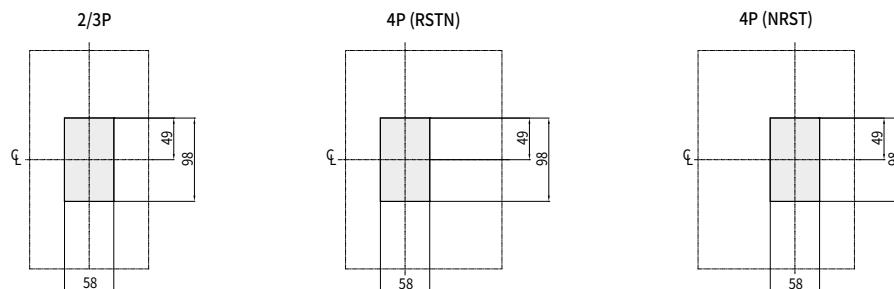

## Dimension of Panel Cover Cutting - Handle/Test Button Exposure

## Dimension of Panel Cover Cutting - Handle/Trip Unit Exposure

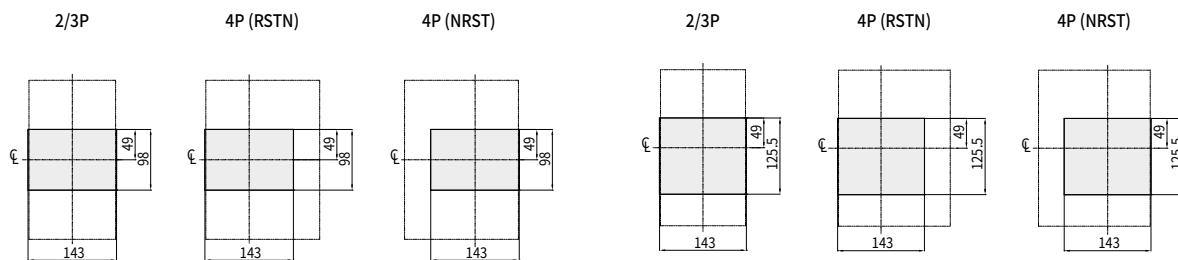

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Front Connection HGM800

• HGM630, 800

#### External Dimension


Unit : mm

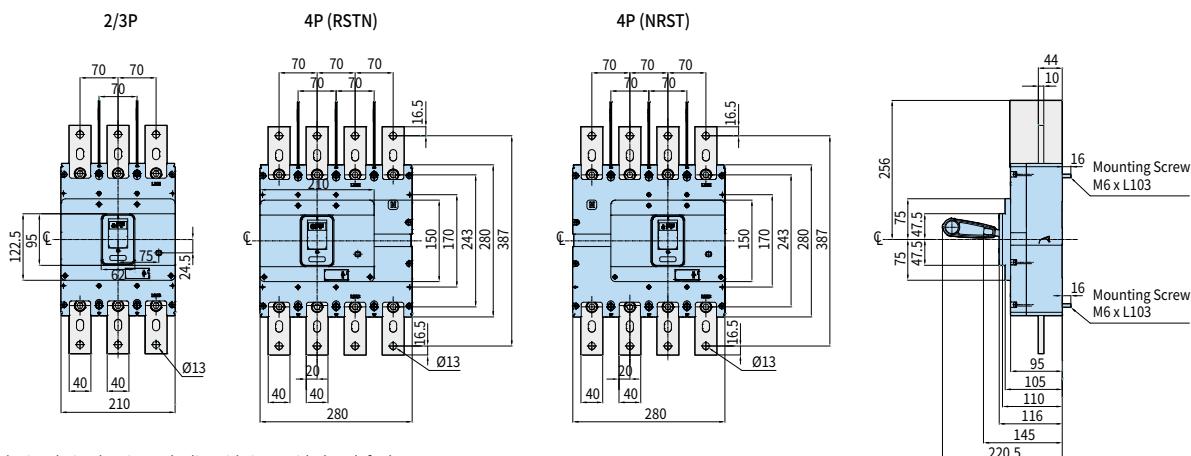

※ The insulation barrier at the line side is provided as default.


#### Panel Installation Dimension

#### Detail Drawing of Terminal Part/Connecting Conductor

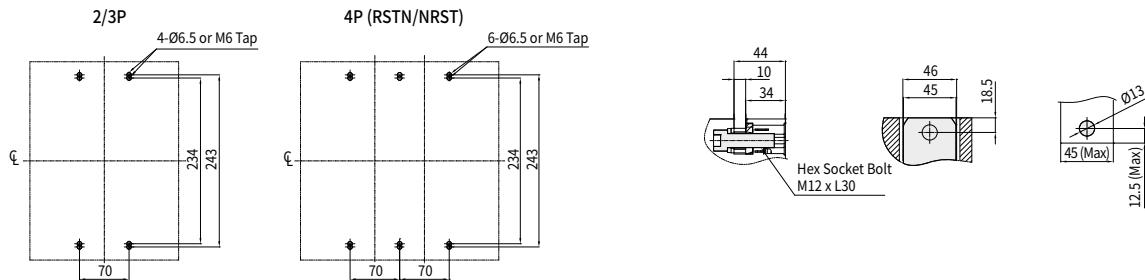


#### Dimension of Panel Cover Cutting - Handle Exposure

2/3P                          4P (RSTN)                          4P (NRST)

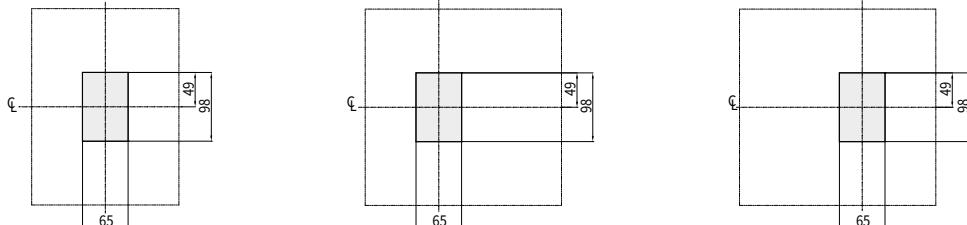

#### Dimension of Panel Cover Cutting - Handle/Test Button Exposure

2/3P                          4P (RSTN)                          4P (NRST)

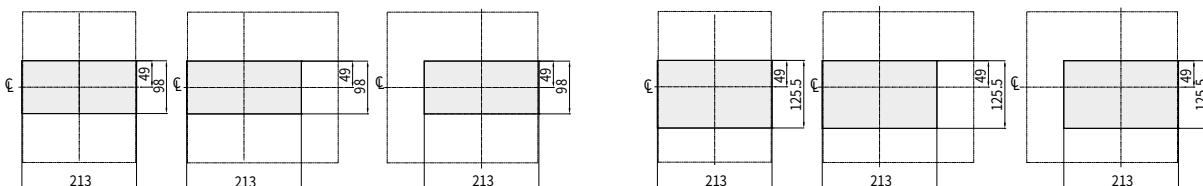


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Front Connection HGE100

• HGE30, 50E/S, 60, 100

### External Dimension


Unit : mm

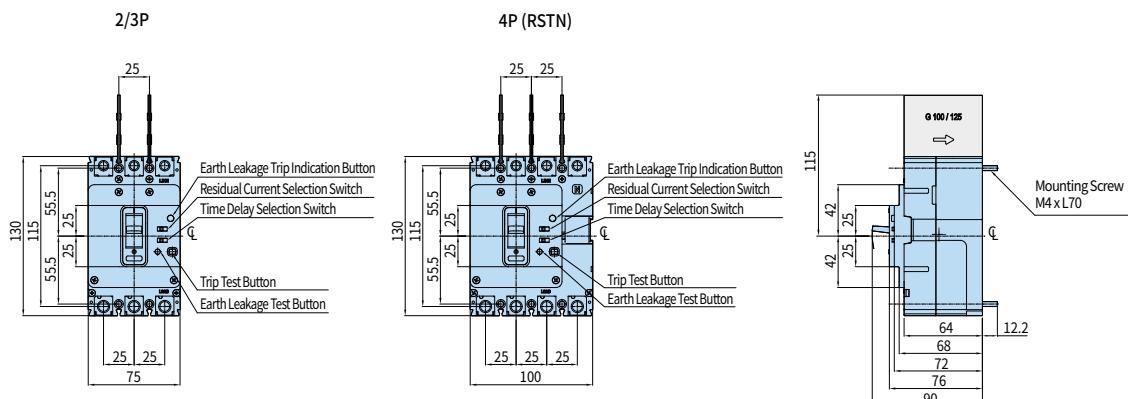



※ The insulation barrier at the line side is provided as default.

### Panel Installation Dimension



### Detail Drawing of Terminal Part/Connecting Conductor

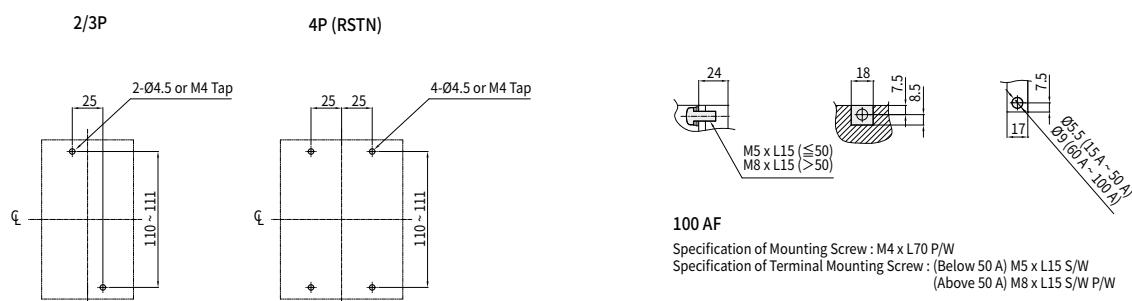

### Dimension of Panel Cover Cutting - Handle Exposure

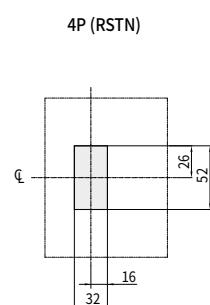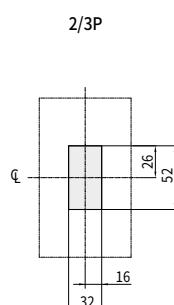

### Dimension of Panel Cover Cutting - Handle/Test Button Exposure

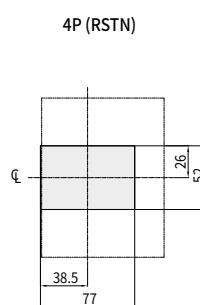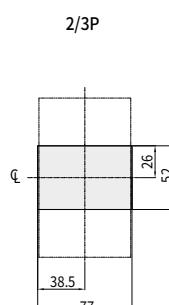

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Front Connection HGE125

• HGE50H/L, 125

#### External Dimension


Unit : mm

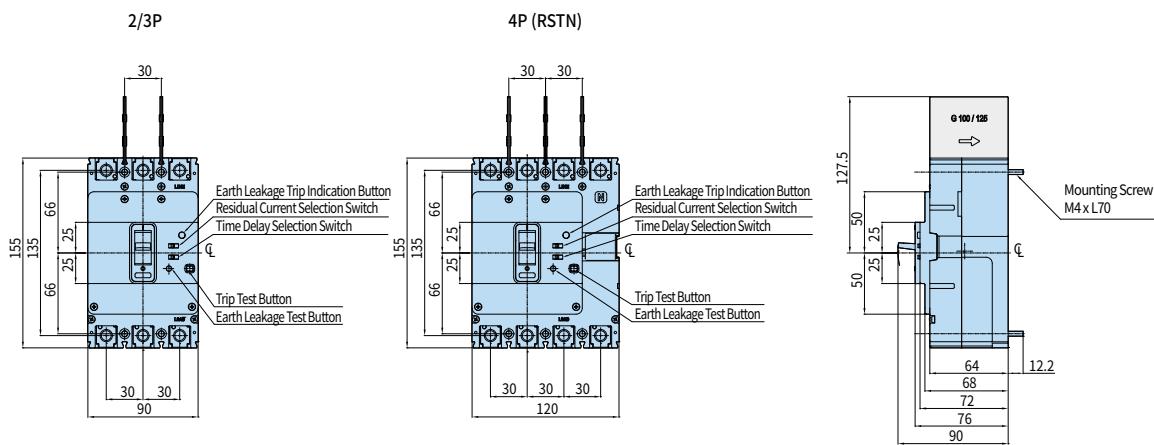


※ The insulation barrier at the line side is provided as default.

#### Panel Installation Dimension


#### Detail Drawing of Terminal Part/Connecting Conductor

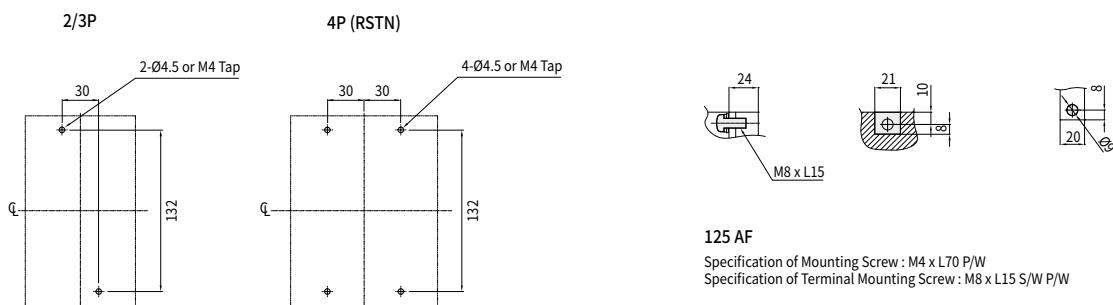

#### Dimension of Panel Cover Cutting - Handle Exposure

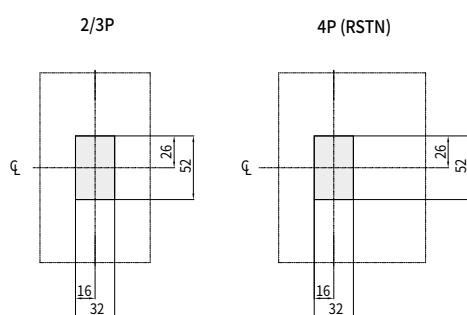

#### Dimension of Panel Cover Cutting - Handle/Test Button Exposure

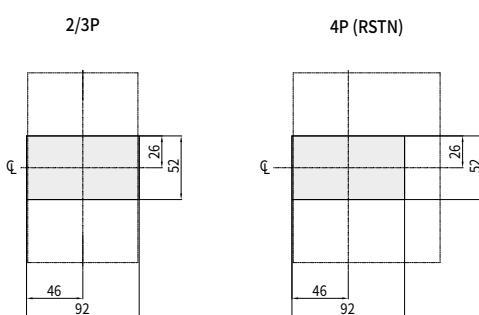


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Front Connection HGE250

• HGE160, 250

### External Dimension


Unit : mm

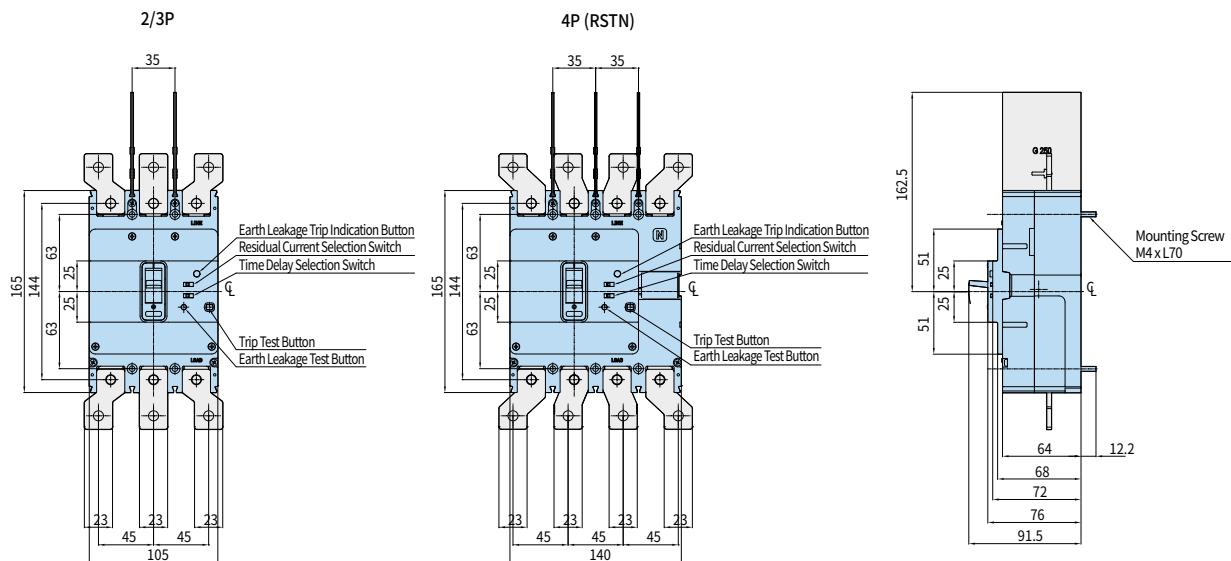



※ The insulation barrier at the line side is provided as default.

### Panel Installation Dimension



### Detail Drawing of Terminal Part/Connecting Conductor

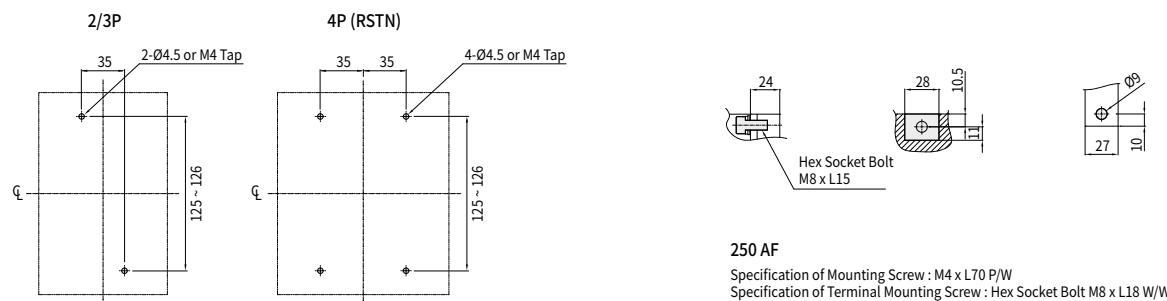

### Dimension of Panel Cover Cutting - Handle Exposure

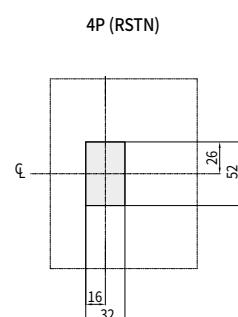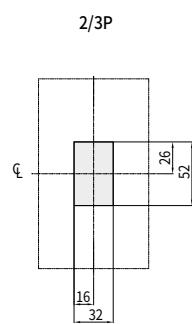

### Dimension of Panel Cover Cutting - Handle/Test Button Exposure

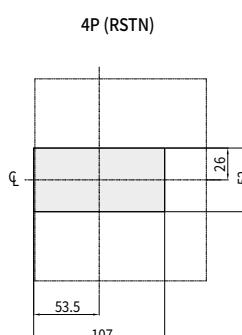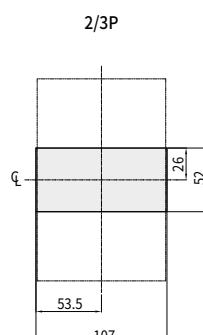

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Front Connection HGE400

• HGE400

#### External Dimension


Unit : mm

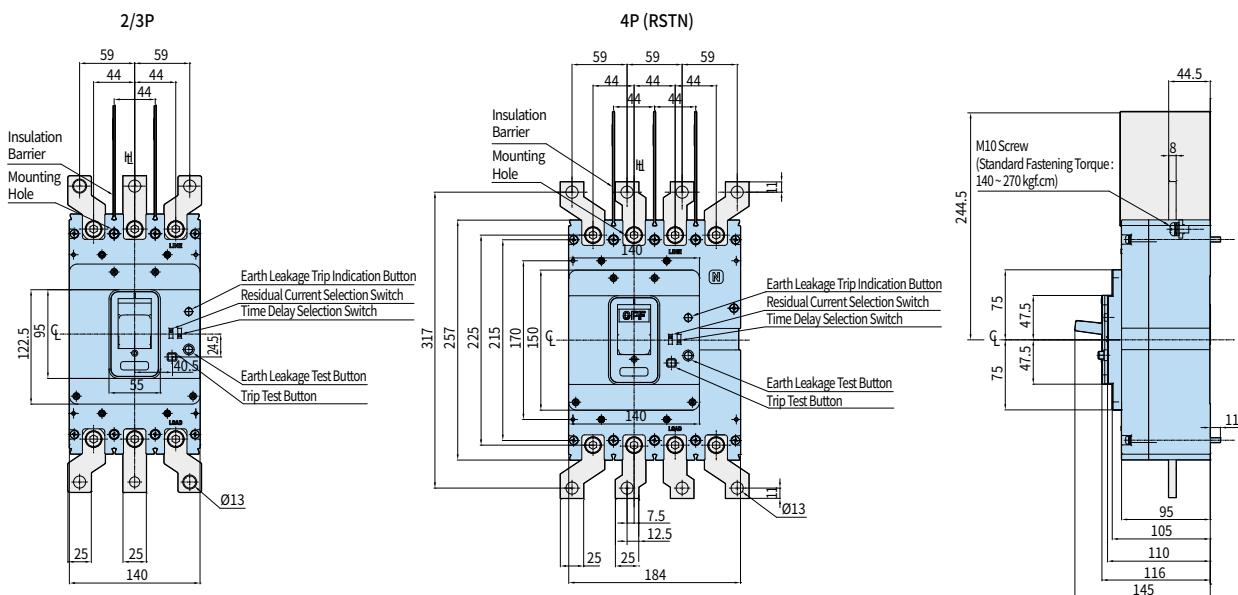


※ The insulation barrier at the line side is provided as standard product.

#### Panel Installation Dimension

#### Detail Drawing of Terminal Part/Connecting Conductor

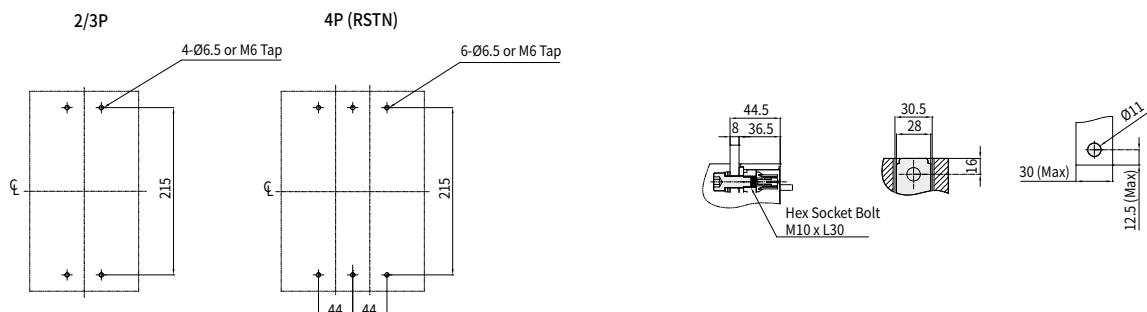

#### Dimension of Panel Cover Cutting

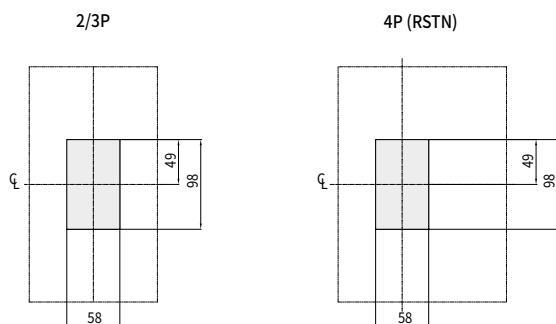


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Front Connection HGE800

- HGE630, 800

## External Dimension


Unit: mm

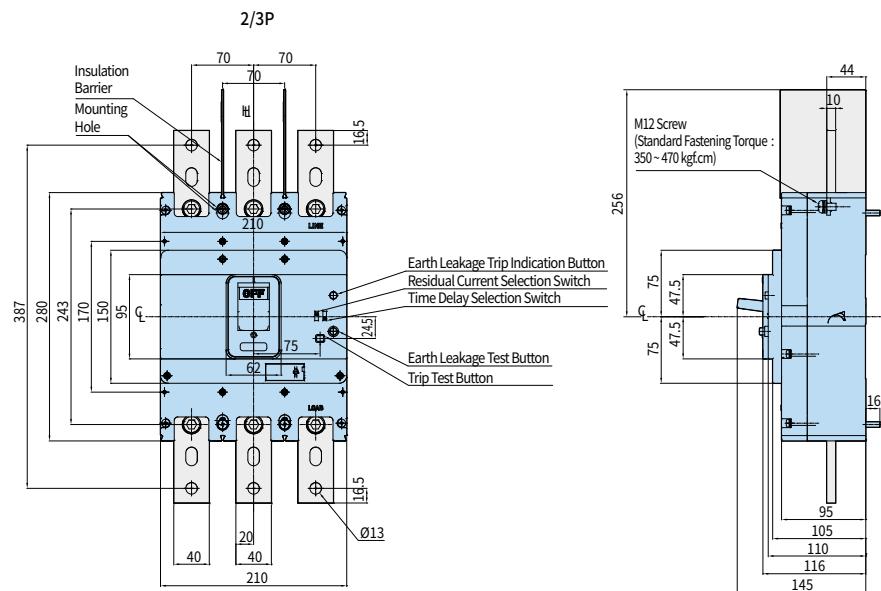


※ The insulation barrier at the line side is provided as standard product.

## Panel Installation Dimension

## Detail Drawing of Terminal Part/Connecting Conductor

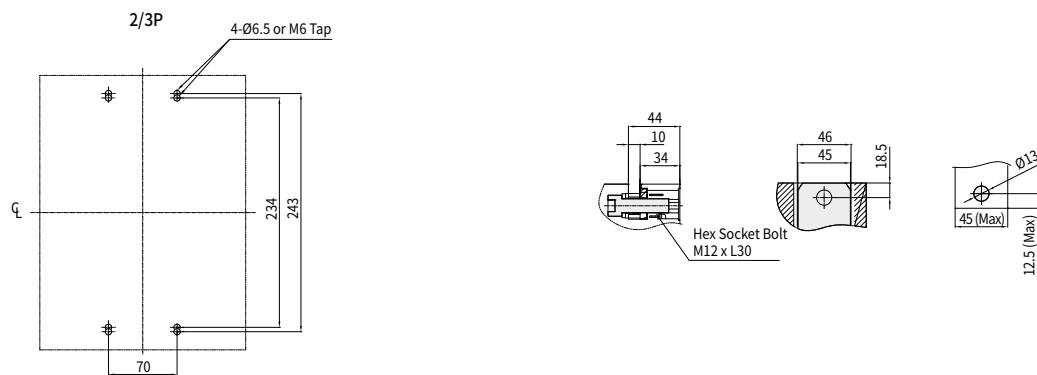

## Dimension of Panel Cover Cutting

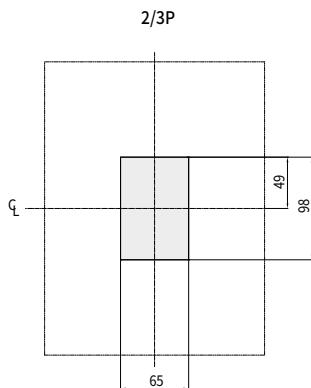


## Dimensions

### Front Connection HGP160D


• HGP50D, 125D, 160D

#### External Dimension


Unit: mm

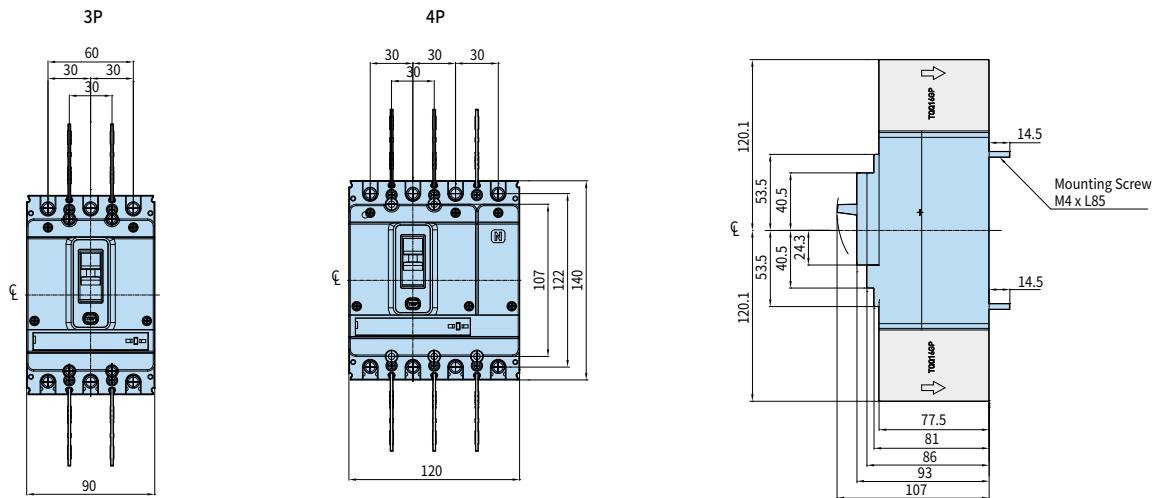

#### Panel Installation Dimension

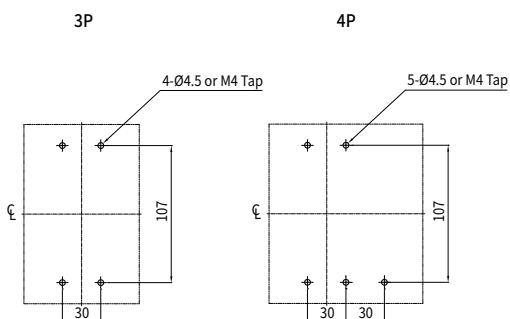


#### Detail Drawing of Terminal Part/Connecting Conductor

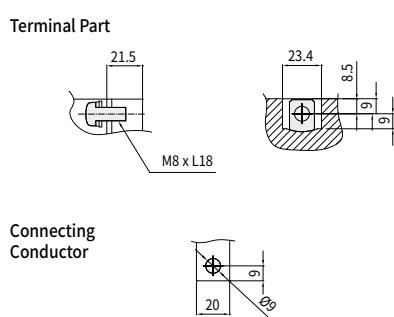


#### Dimension of Panel Cover Cutting


##### Handle/Test Button Exposure



##### Handle/Trip Unit Exposure



##### 3P



##### 4P


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Front Connection HGP250

• HGP100, 160, 250


### External Dimension

Unit : mm

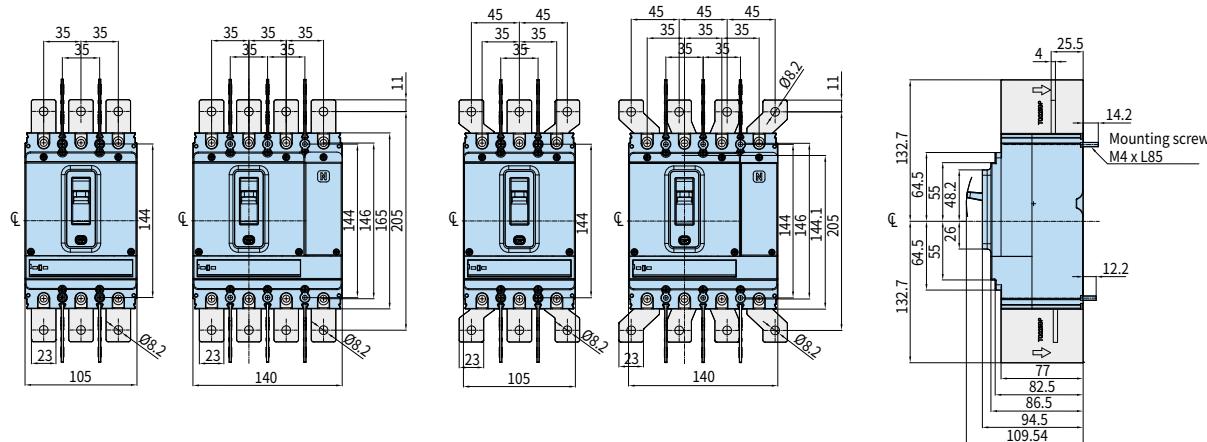

### Panel Installation Dimension


### Detail Drawing of Terminal Part/Connecting Conductor

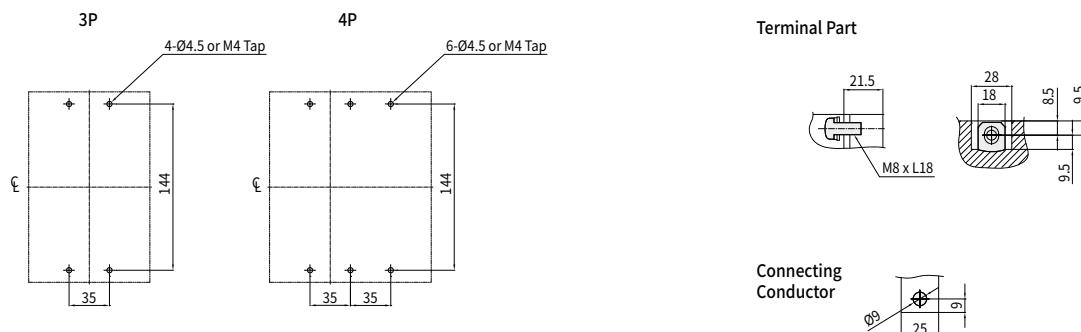



※ Screw Applied : M4×L85 S/W (For Circuit Breaker Mounting),  
M8×L18 S/W P/W (For Terminal Mounting)

### Dimension of Panel Cover Cutting

Handle/Test Button Exposure



Handle/Trip Unit Exposure



※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Front Connection HGP630

• HGP400, 630


#### External Dimension

Unit : mm

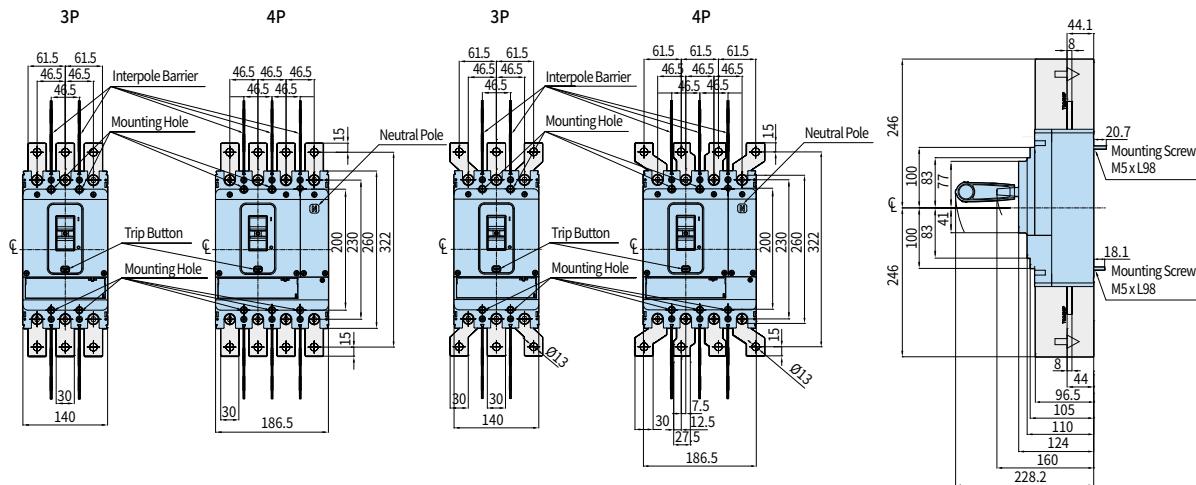


#### Panel Installation Dimension


#### Detail Drawing of Terminal Part/Connecting Conductor

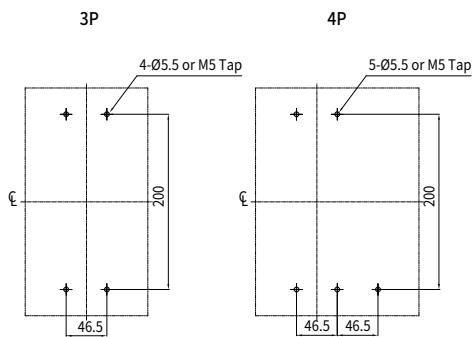

Terminal Part




Connecting Conductor





#### Dimension of Panel Cover Cutting

Handle/Test Button Exposure



Handle/Trip Unit Exposure

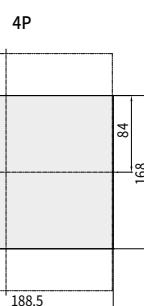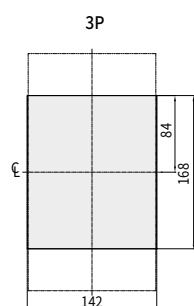


## Front Connection HGP800


• HGP800

### External Dimension


Unit : mm

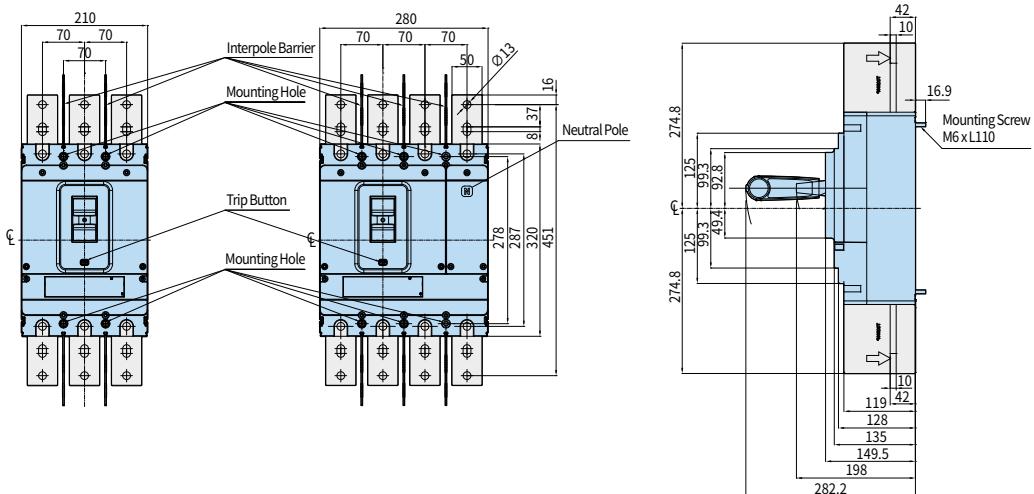

### Panel Installation Dimension

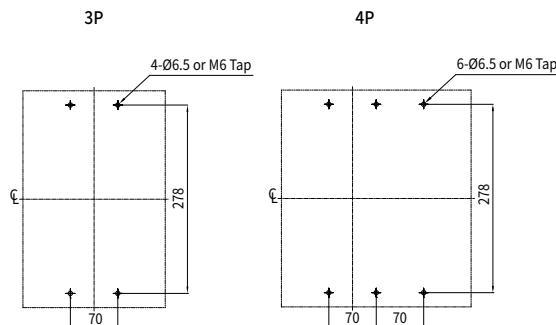


### Detail Drawing of Terminal Part/Connecting Conductor

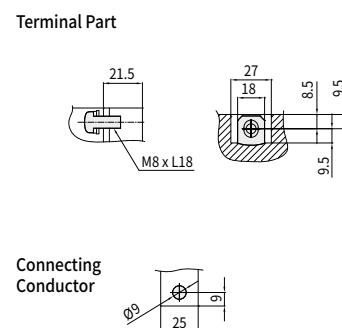


### Dimension of Panel Cover Cutting

Handle/Test Button Exposure



Handle/Trip Unit Exposure

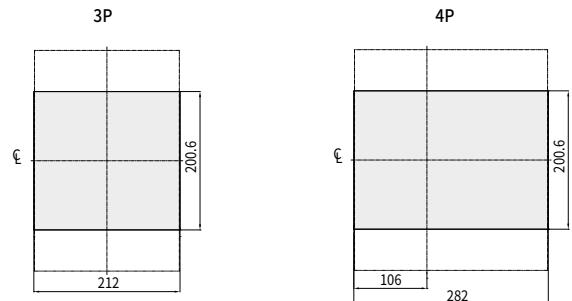


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Dimensions

### Rear Connection (Flat Type) HGM100


• HGM30, 50E/S, 60, 100

#### External Dimension

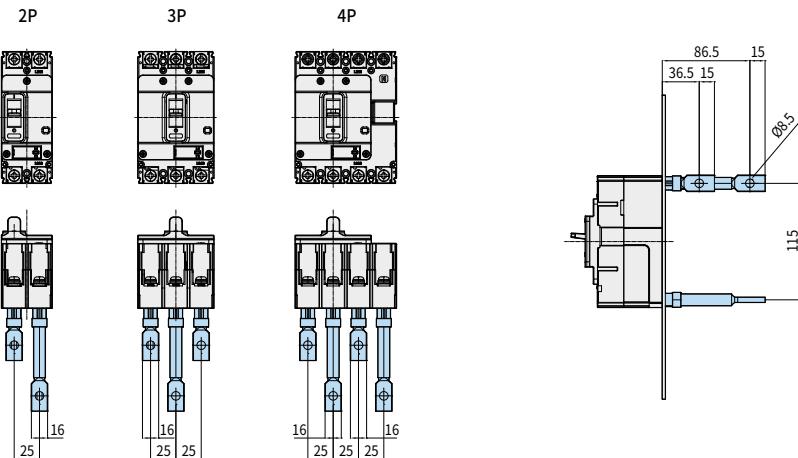


Unit: mm


#### Panel Installation Dimension

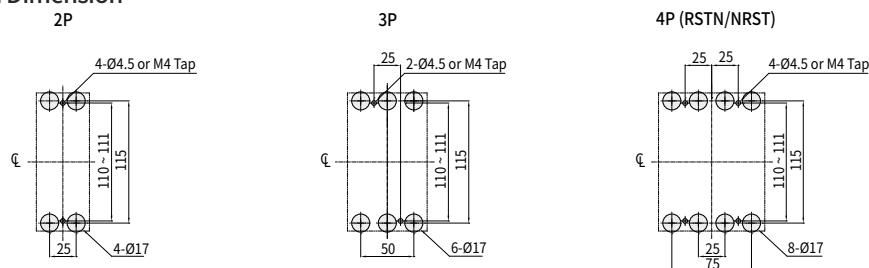

#### Dimension of Panel Cover Cutting - Handle/Test Button Exposure

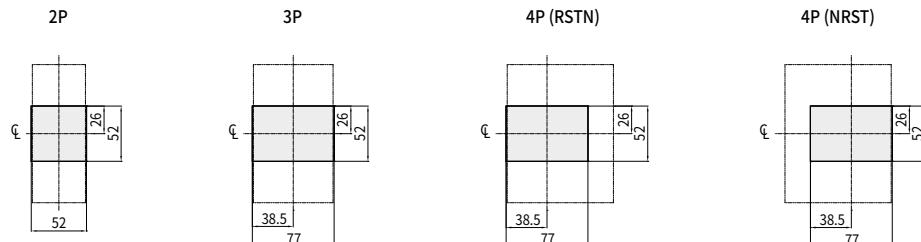

#### Dimension of Panel Cover Cutting - Handle/Trip Unit Exposure




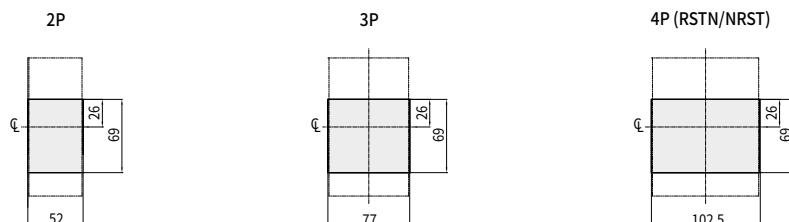


※ When assembling the RCT, remove the back barrier beforehand.

※ When installing the product in close contact, please consider tolerances for external dimensions.

**Rear Connection (Flat Type) HGM125**

• HGM50H/L, 125

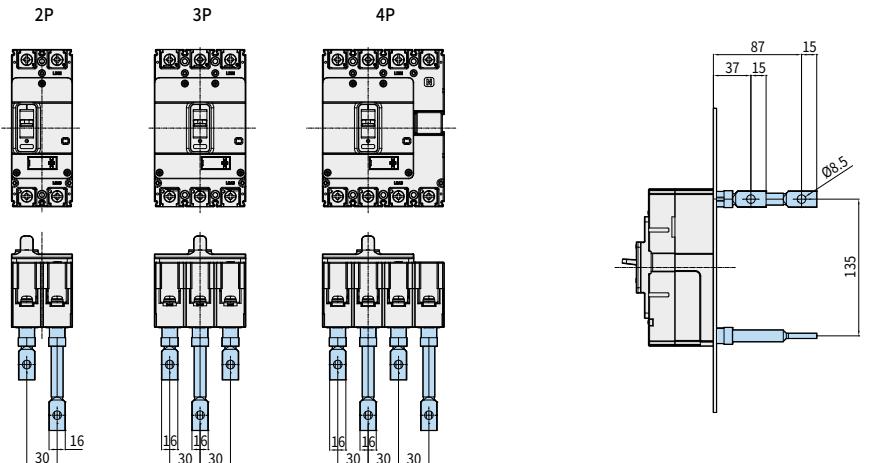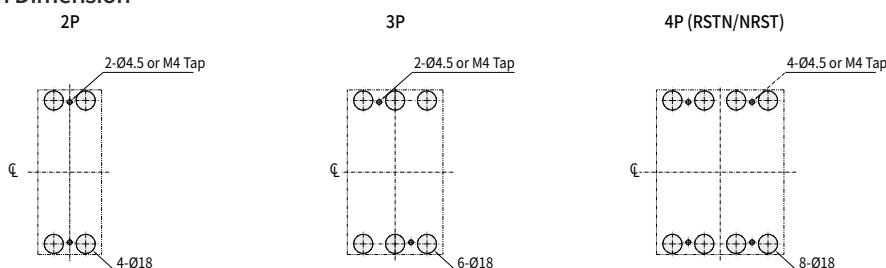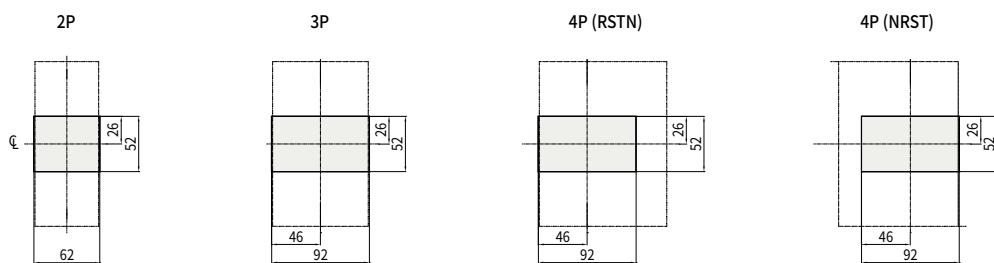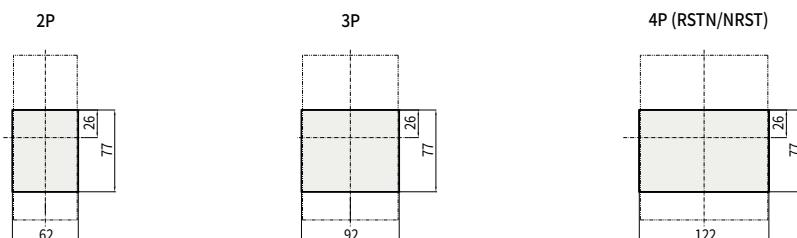**External Dimension****Panel Installation Dimension****Dimension of Panel Cover Cutting - Handle/Test Button Exposure****Dimension of Panel Cover Cutting - Handle/Trip Unit Exposure**

※ When assembling the RCT, remove the back barrier beforehand.


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Dimensions

### Rear Connection (Flat Type) HGM250


• HGM160, 250

#### External Dimension

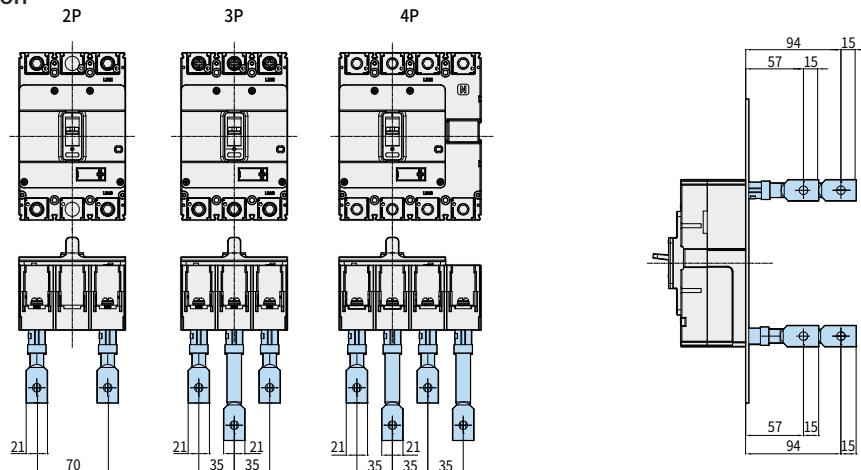


Unit: mm


#### Panel Installation Dimension

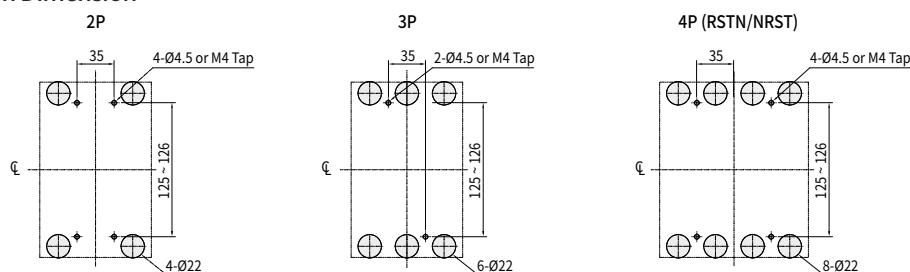

#### Dimension of Panel Cover Cutting - Handle/Test Button Exposure

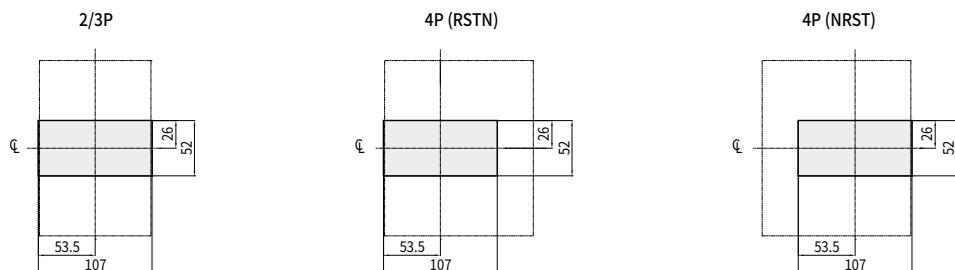

#### Dimension of Panel Cover Cutting - Handle/Trip Unit Exposure

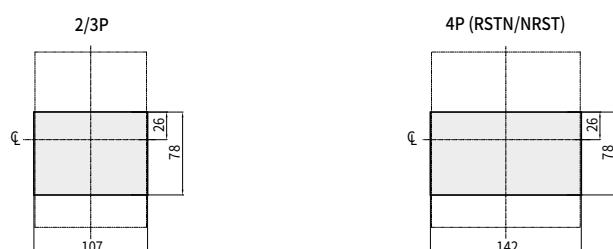


※ When assembling the RCT, remove the back barrier beforehand.

※ When installing the product in close contact, please consider tolerances for external dimensions.

## Rear Connection (Flat Type) HGM400


• HGM400

### External Dimension

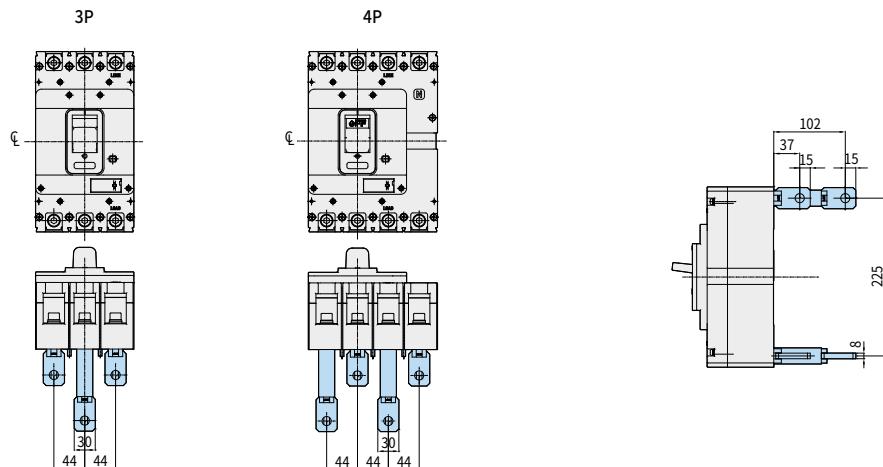


Unit : mm


### Panel Installation Dimension

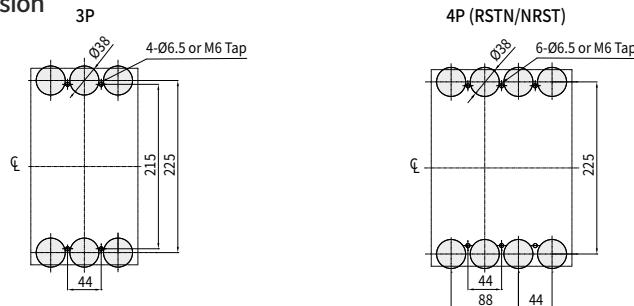

### Dimension of Panel Cover Cutting - Handle/Test Button Exposure

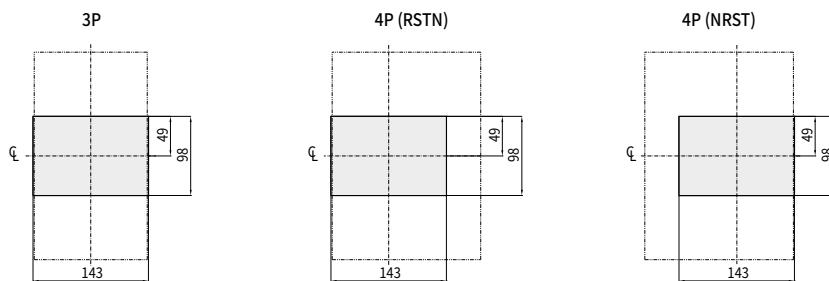

### Dimension of Panel Cover Cutting - Handle/Trip Unit Exposure

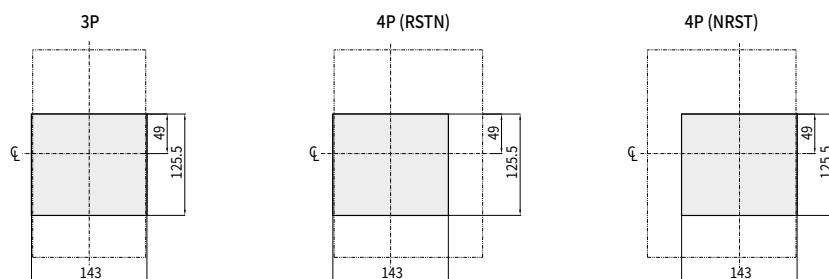

※ When assembling the RCT, remove the back barrier beforehand.

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Rear Connection (Flat Type) HGM800


• HGM630, 800

#### External Dimension


Unit : mm

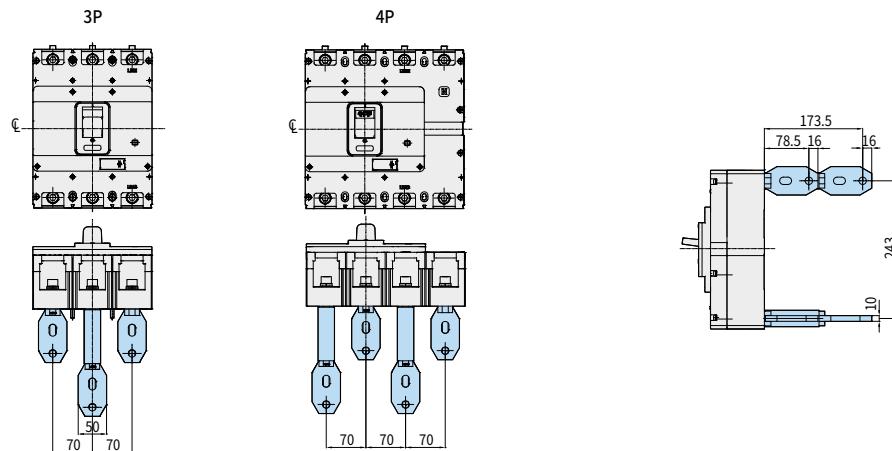


#### Panel Installation Dimension

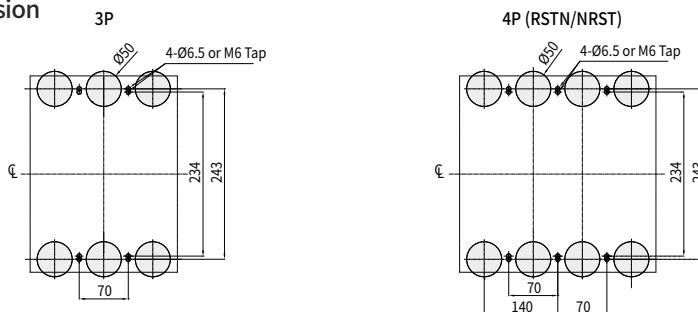

#### Dimension of Panel Cover Cutting - Handle/Test Button Exposure

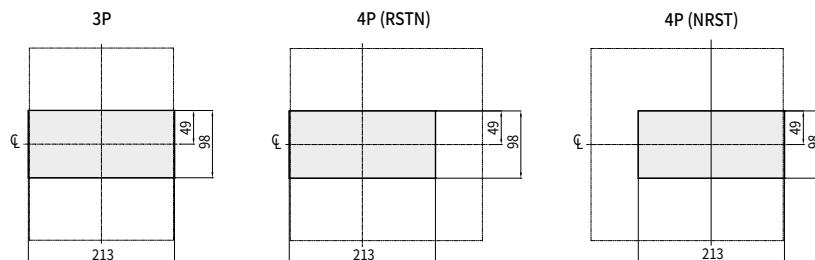

#### Dimension of Panel Cover Cutting - Handle/Trip Unit Exposure

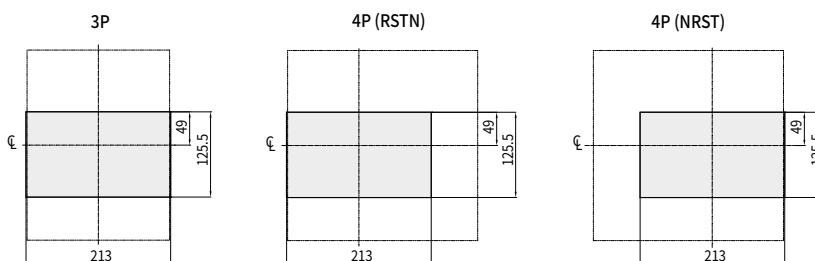

※ When assembling the RCT, remove the back barrier beforehand.


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Plug-in Type HGM100

• HGM30, 50E/S, 60, 100


### External Dimension (TDM Type)

Unit : mm

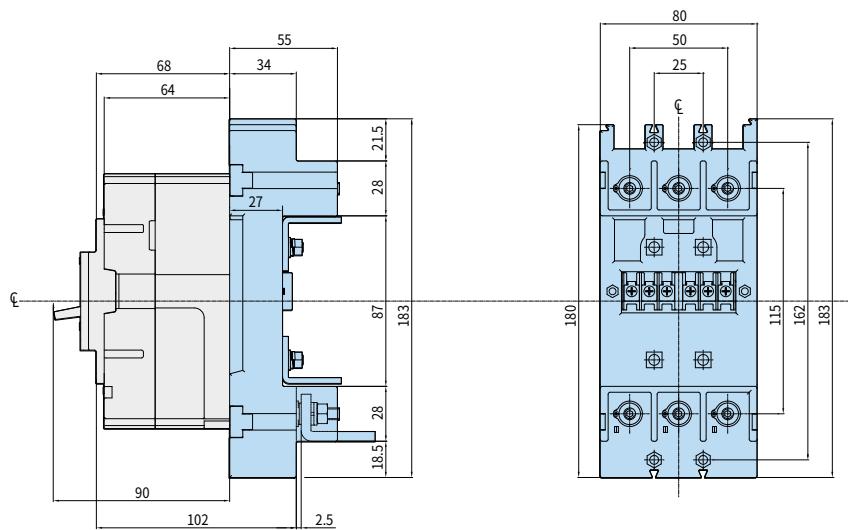


### Panel Installation Dimension and Cover Cutting Dimension


Detailed Drawing of Connection

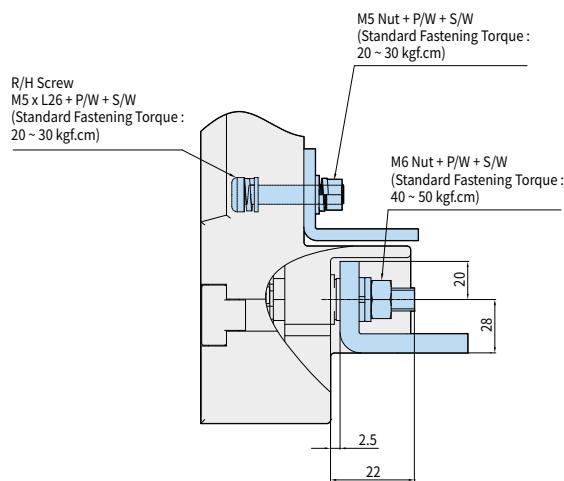

Mounting Drawing

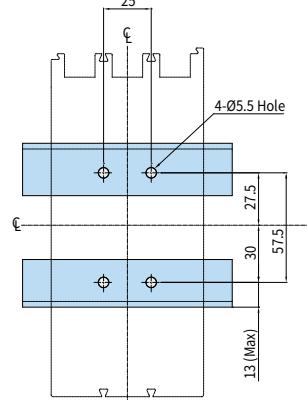

Process Criterion of Connecting Conductor



※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

# Plug-in Type HGM100

- HGM30, 50E/S, 60, 100


## External Dimension (TDA D Type)

Unit : mm

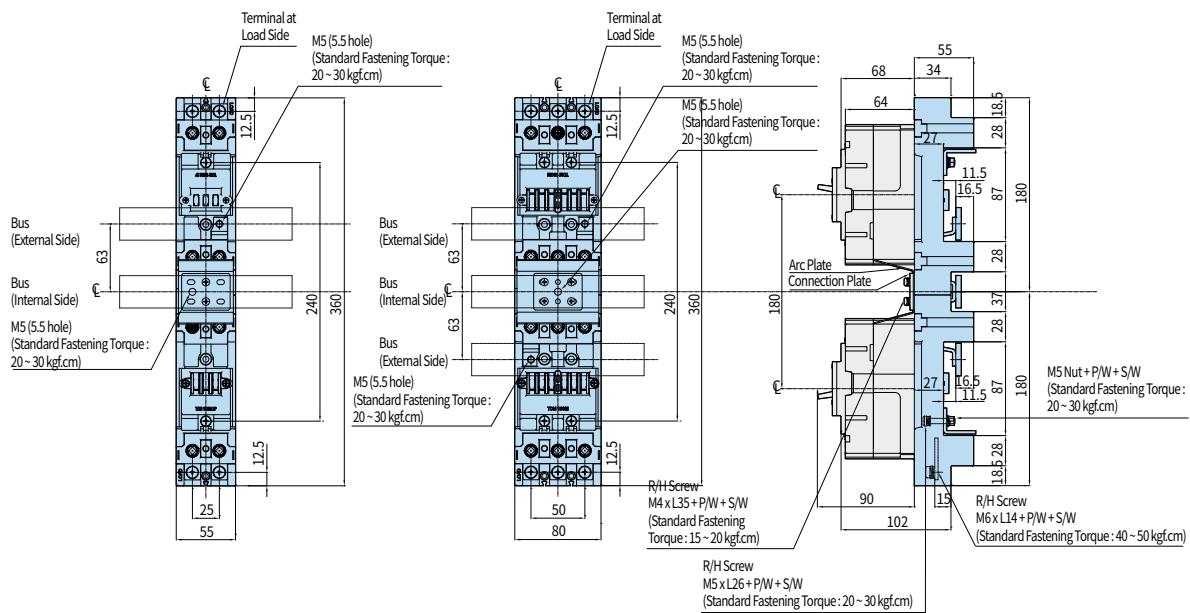


#### **Panel Installation Dimension and Cover Cutting Dimension**


## Mounting Drawing

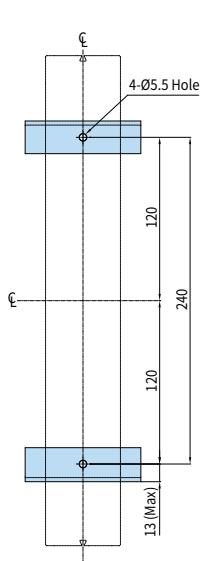

## Mounting Drawing

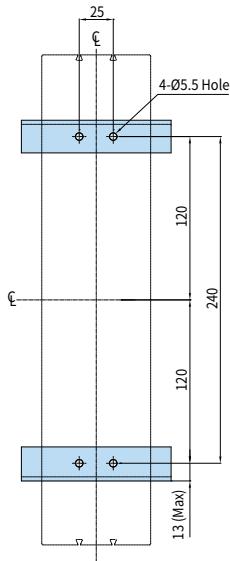

#### Process Criterion of Connecting Conductor




## Plug-in Type HGM100

• HGM30, 50E/S, 60, 100


### External Dimension (TDA S Type)

Unit : mm

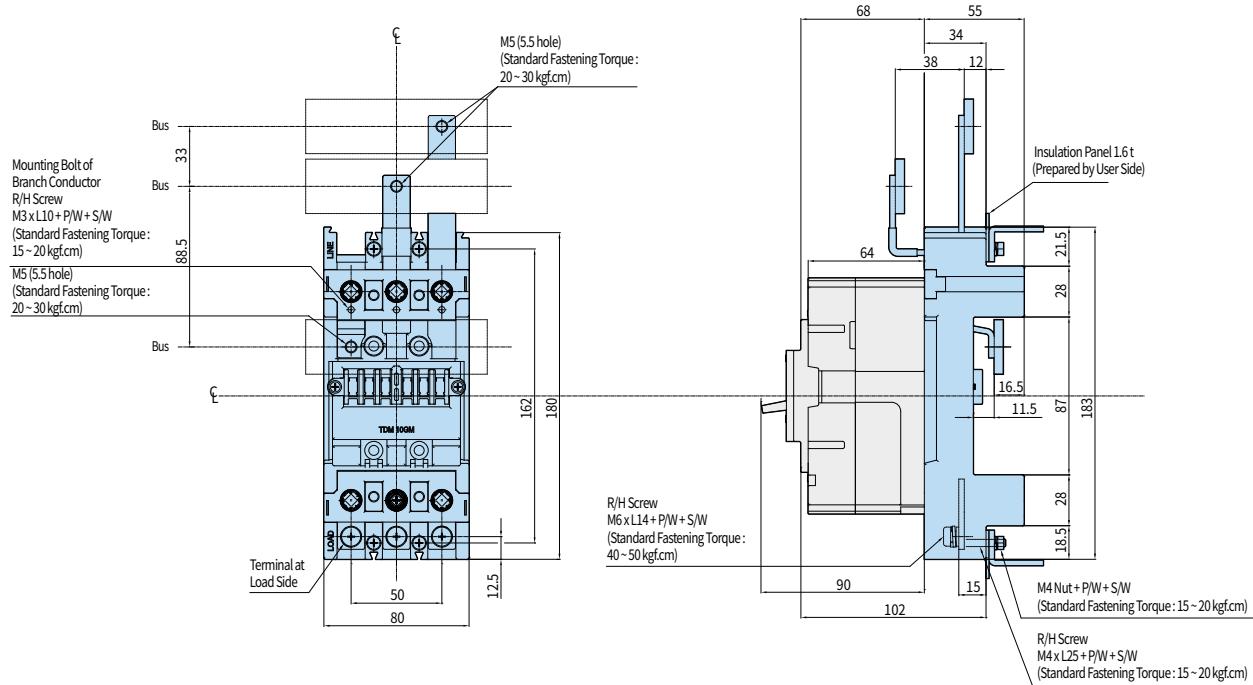

### Panel Installation Dimension and Cover Cutting Dimension

#### Mounting Drawing

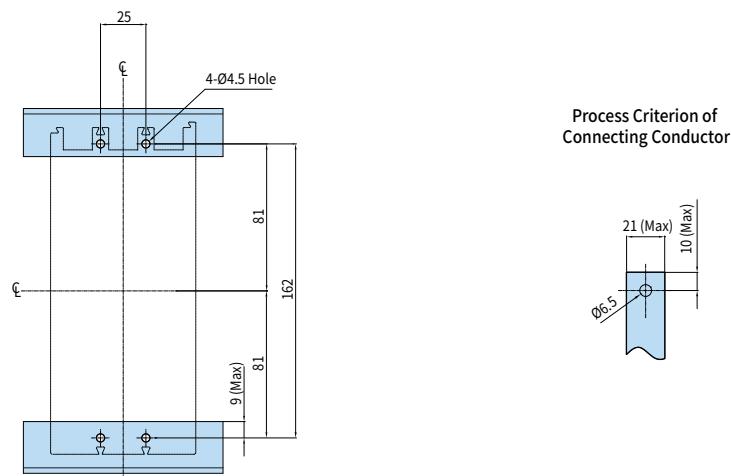

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Plug-in Type HGM100

• HGM30, 50E/S, 60, 100


External Dimension (TDF Type)

Unit: mm

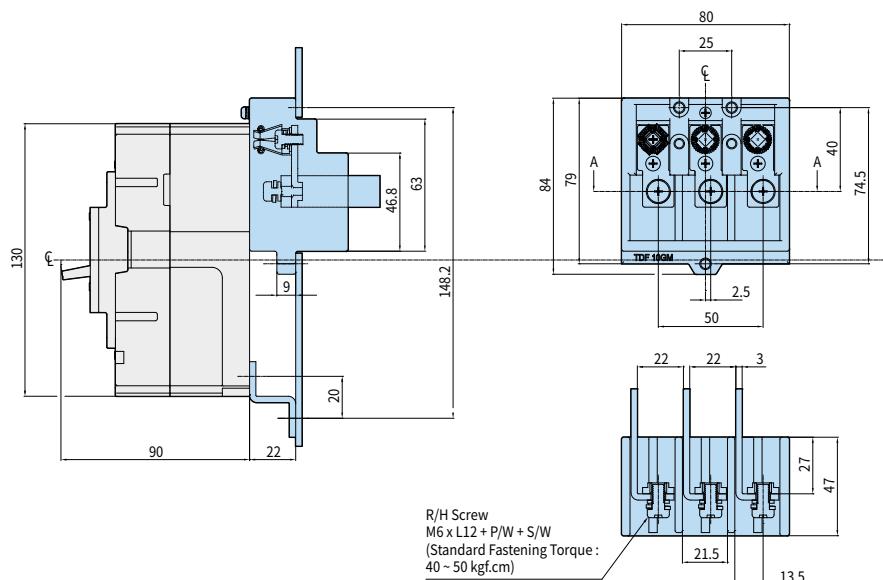


### Panel Installation Dimension and Cover Cutting Dimension

Mounting Drawing

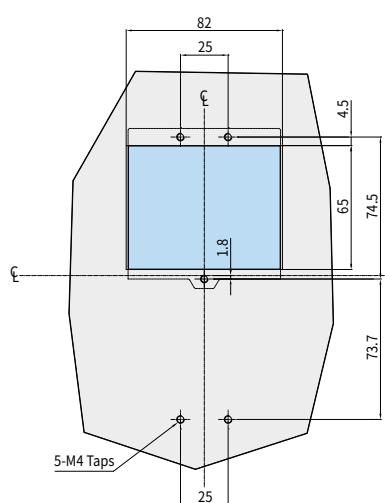

Process Criterion of  
Connecting Conductor

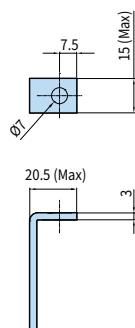


## Plug-in Type HGM125

• HGM50H/L, 125


### External Dimension (TDM Type)

Unit : mm

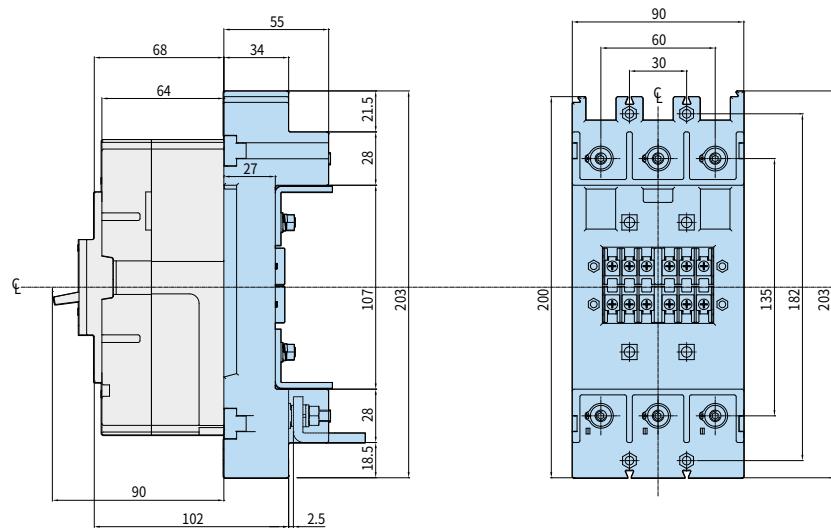


### Panel Installation Dimension and Cover Cutting Dimension


Detailed Drawing of Connection

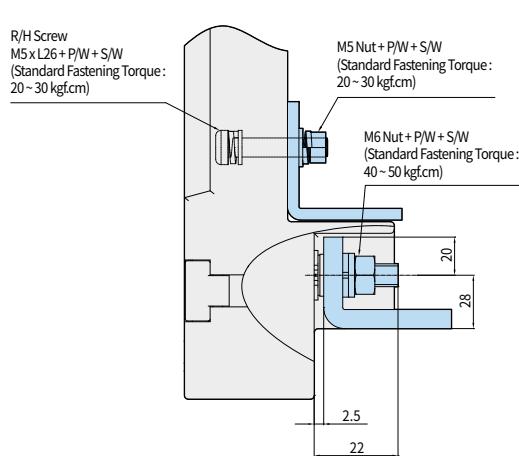

Mounting Drawing

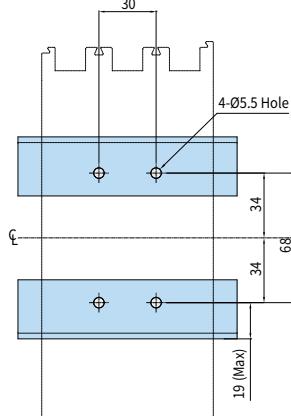

Process Criterion of Connecting Conductor



Dimensions

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Plug-in Type HGM125

• HGM50H/L, 125


#### External Dimension (TDA D Type)

Unit : mm

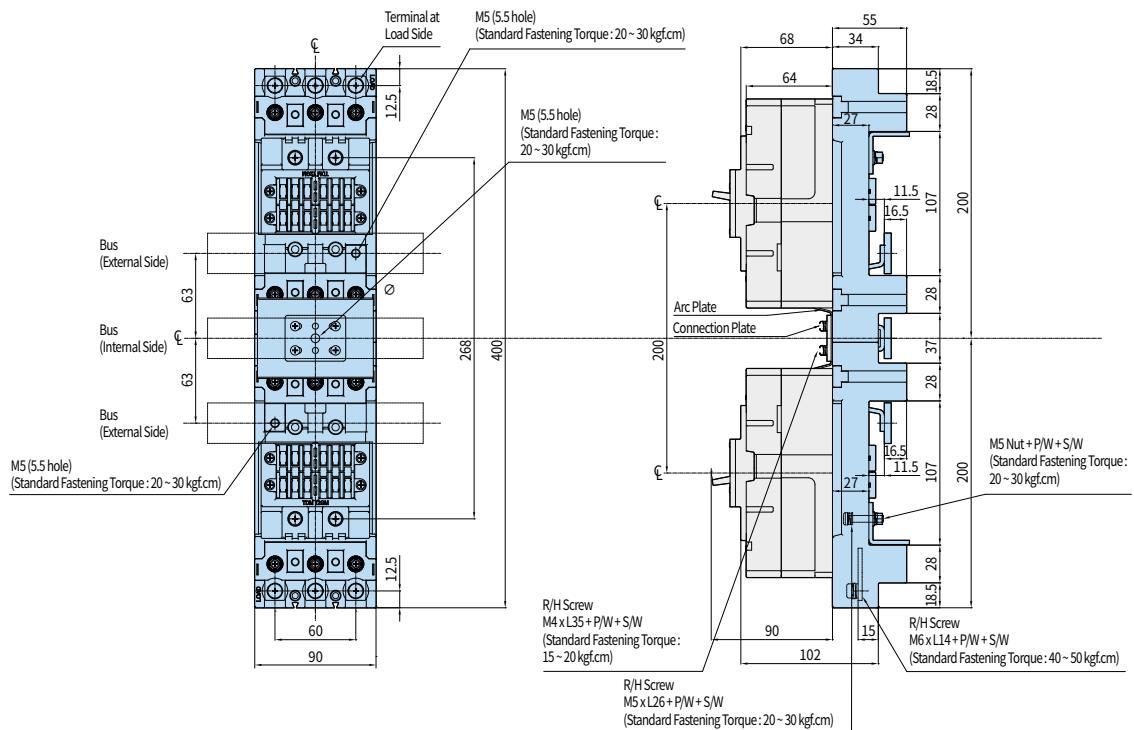

#### Panel Installation Dimension and Cover Cutting Dimension

Mounting Drawing

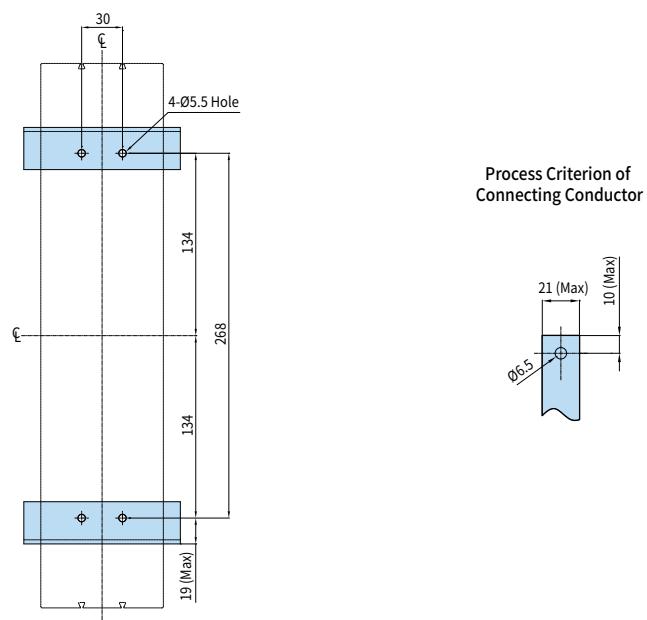


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Plug-in Type HGM125

• HGM50H/L, 125


### External Dimension (TDA S Type)

Unit : mm

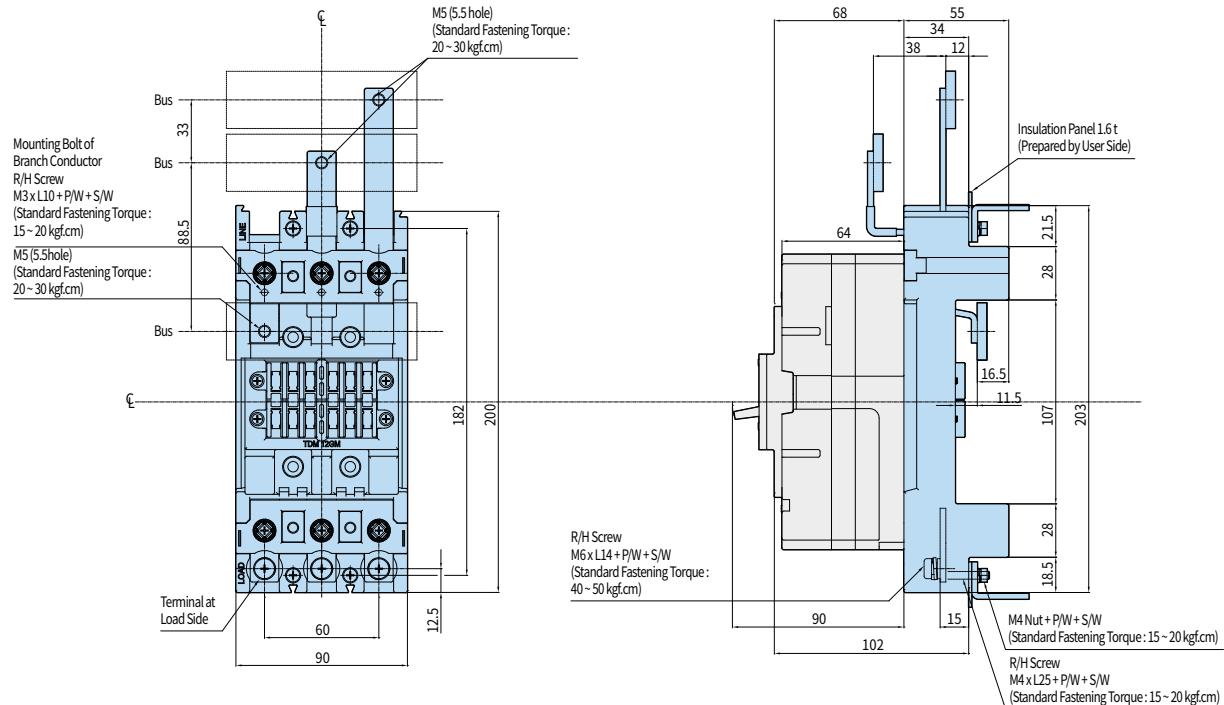


### Panel Installation Dimension and Cover Cutting Dimension

Mounting Drawing

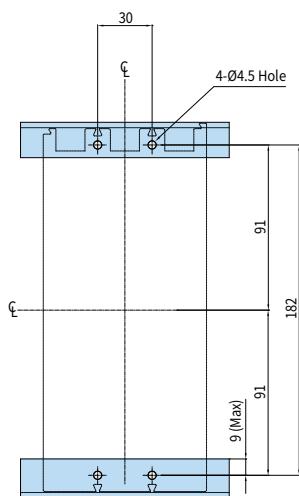

Process Criterion of Connecting Conductor



※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Plug-in Type HGM125

• HGM50H/L, 125

External Dimension (TDF Type)


Unit: mm

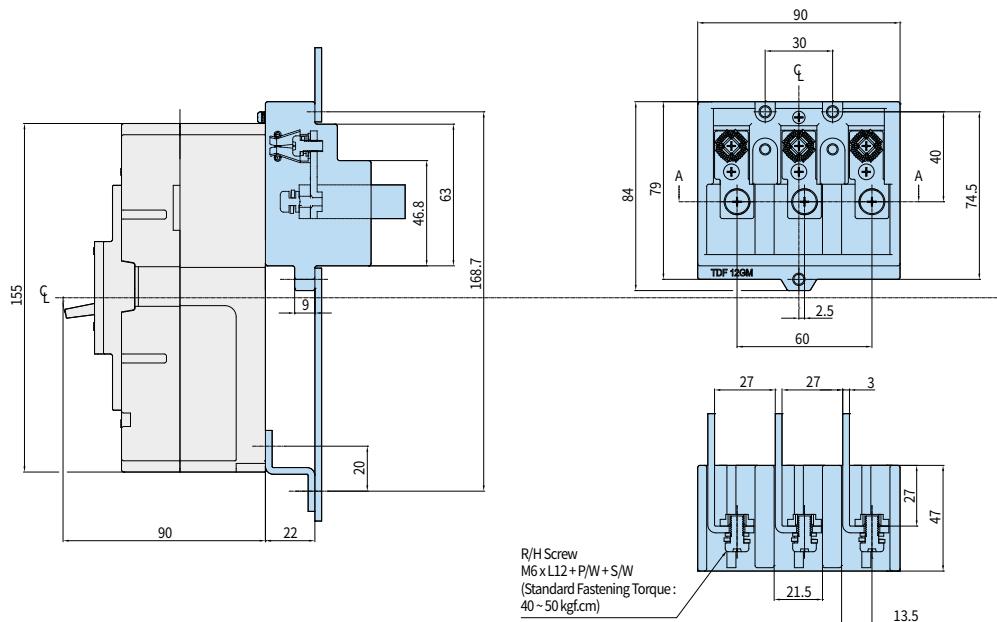

### Panel Installation Dimension and Cover Cutting Dimension

Mounting Drawing

Process Criterion of  
Connecting Conductor

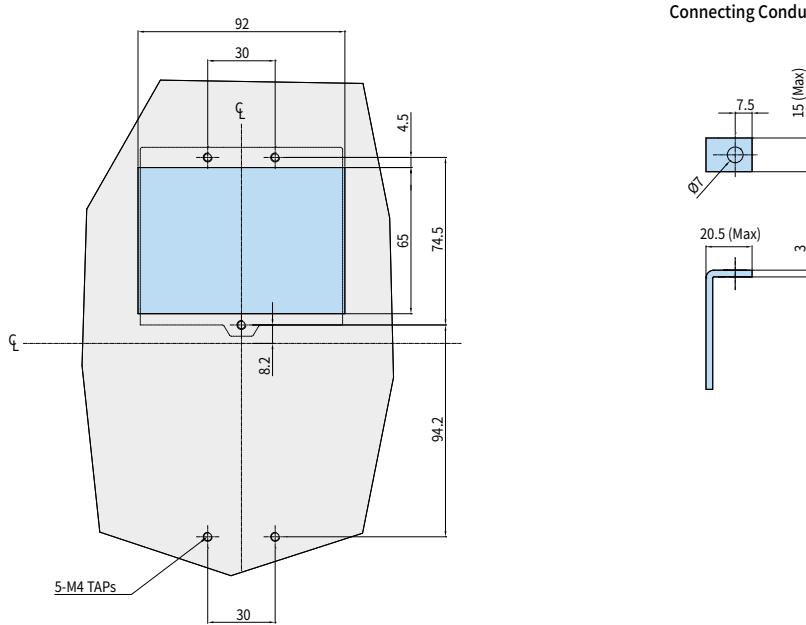


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Plug-in Type HGM250

• HGM160, 250


### External Dimension (TDM Type)

Unit : mm

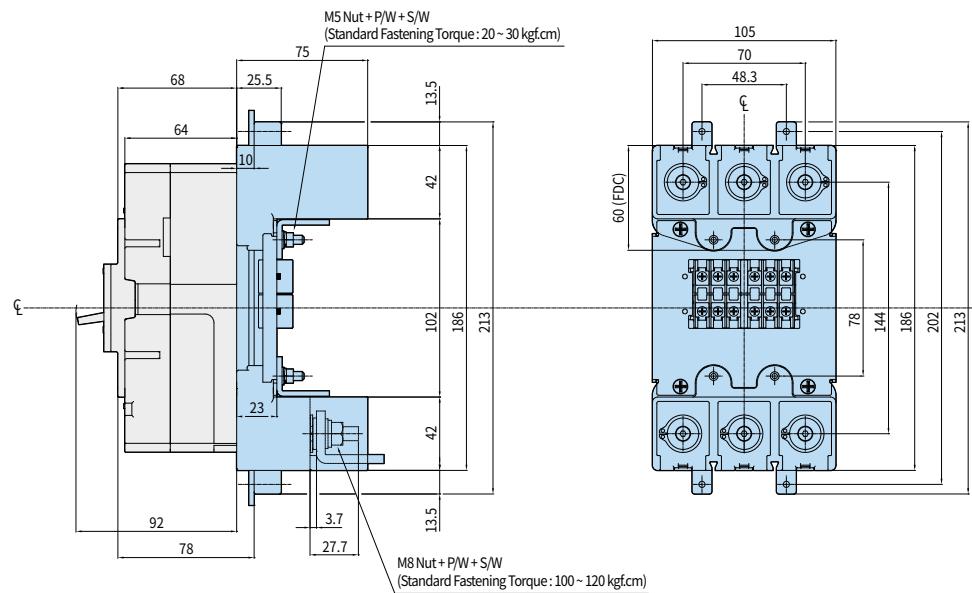


### Panel Installation Dimension and Cover Cutting Dimension


Mounting Drawing

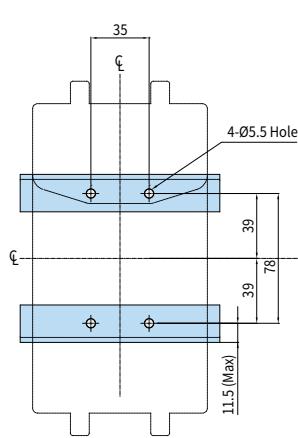

Dimension of Front Cover Cutting

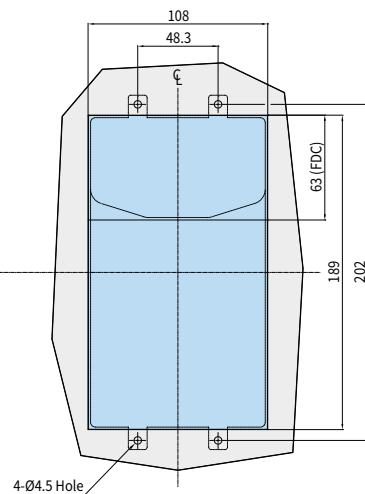

Process Criterion of  
Connecting Conductor



Dimensions

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Plug-in Type HGM400

• HGM400


External Dimension (TDM Type)

Unit : mm

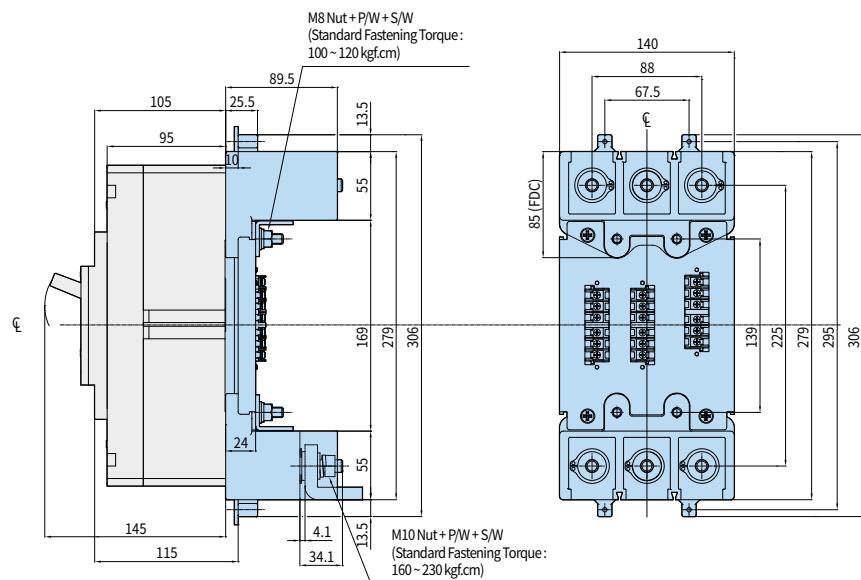


### Panel Installation Dimension and Cover Cutting Dimension


Mounting Drawing

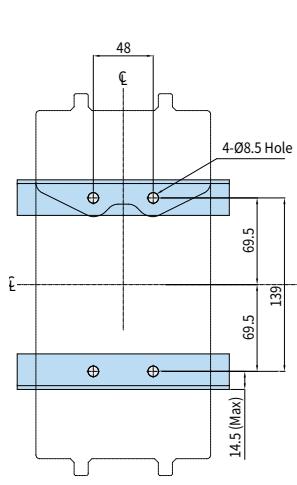

Dimension of Front Cover Cutting

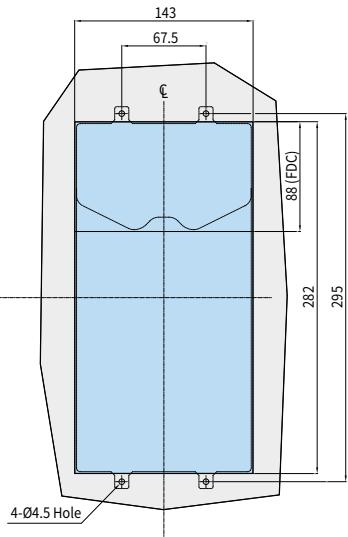

Process Criterion of Connecting Conductor




## Plug-in Type HGM800

• HGM630, 800


### External Dimension (TDM Type)

Unit : mm

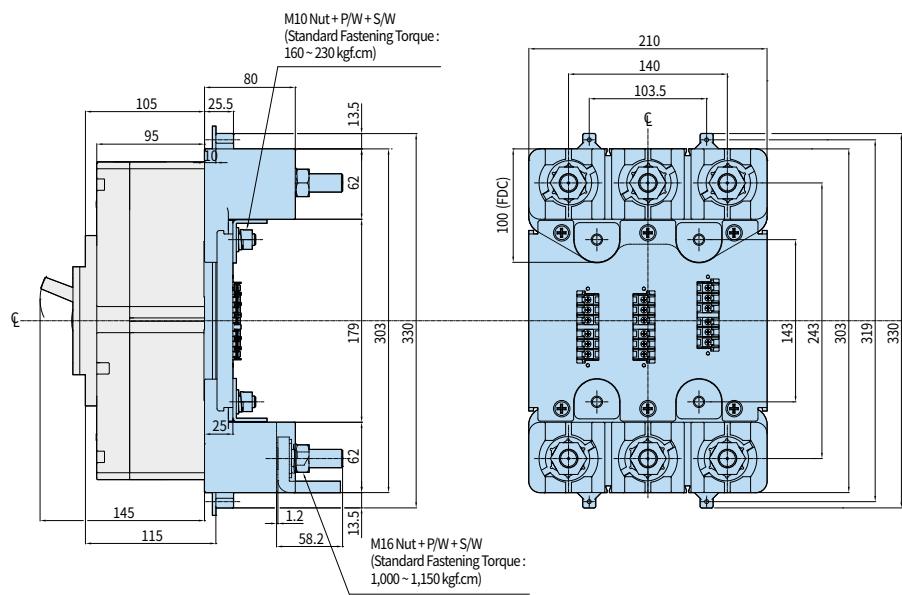


### Panel Installation Dimension and Cover Cutting Dimension


Mounting Drawing

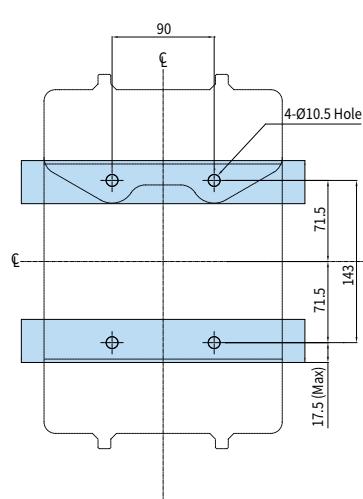

Dimension of Front Cover Cutting

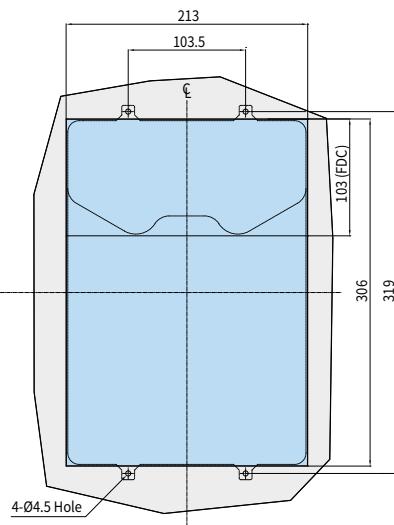

Process Criterion of  
Connecting Conductor



※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Plug-in Type HGP160D

• HGP50D, 125D, 160D


#### External Dimension

Unit: mm

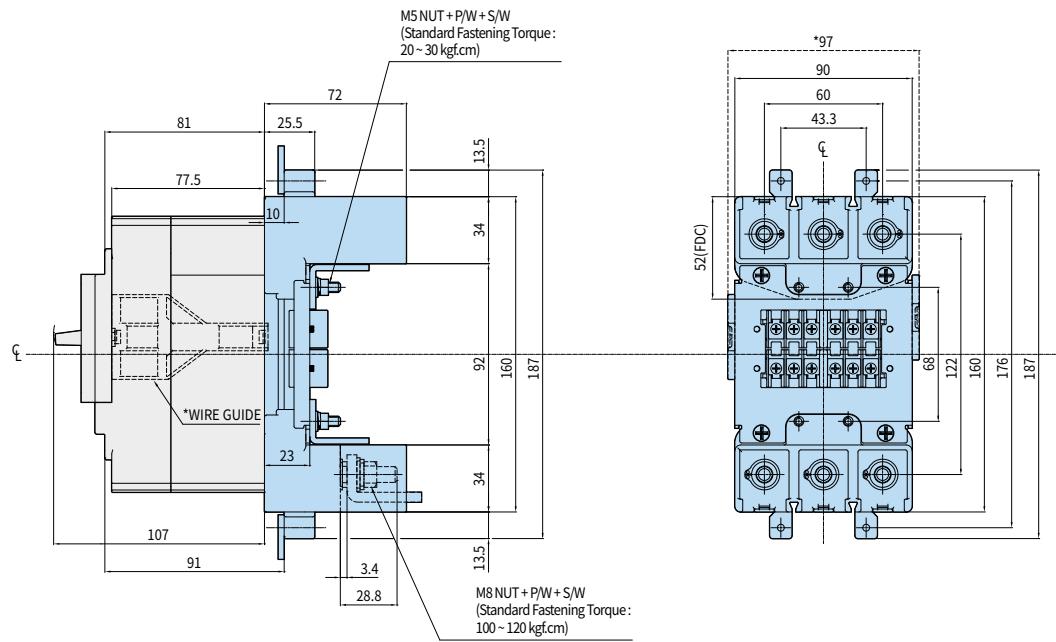

#### Panel Installation Dimension and TDM Cover Cutting Dimension

#### Dimensions

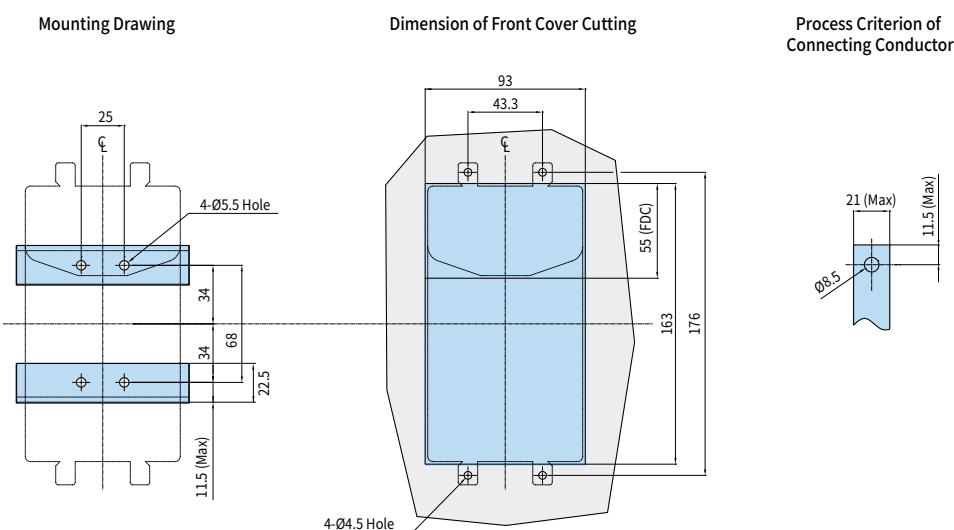


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Plug-in Type HGP250

• HGP100, 160, 250


### External Dimension

Unit : mm

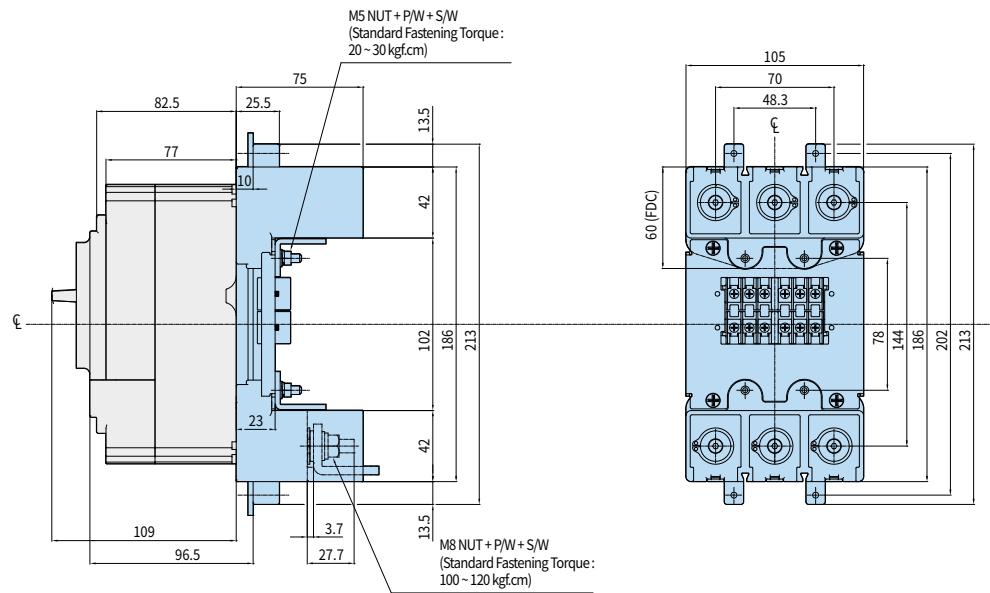


### Panel Installation Dimension and TDM Cover Cutting Dimension


Mounting Drawing

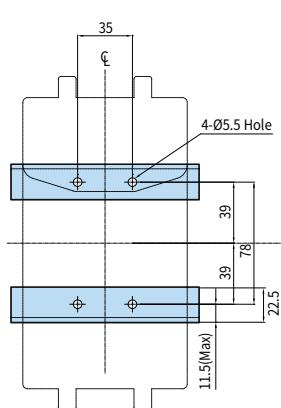

Dimension of Front Cover Cutting

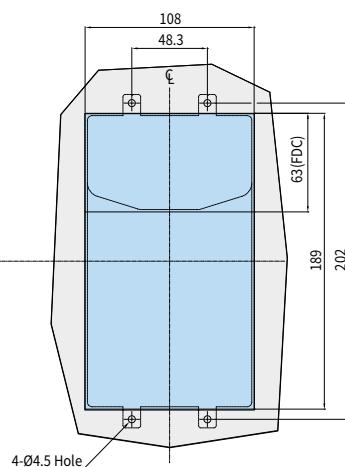

Process Criterion of  
Connecting Conductor



Dimensions

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Plug-in Type HGP630

• HGP400, 630

#### External Dimension


Unit : mm

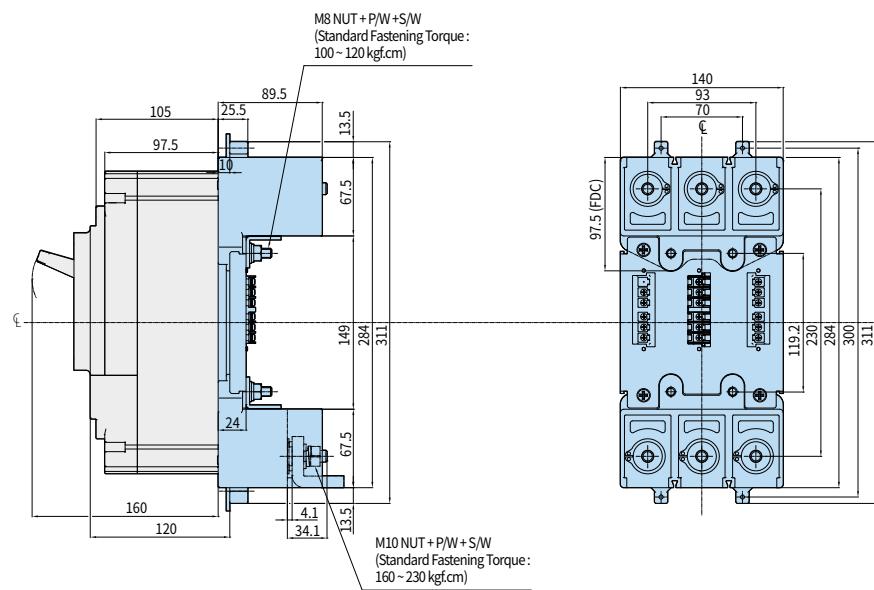


#### Panel Installation Dimension and TDM Cover Cutting Dimension

#### Dimensions


Mounting Drawing

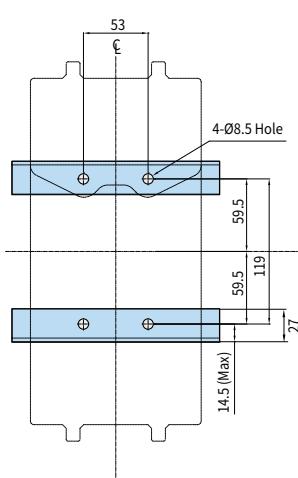

Dimension of Front Cover Cutting

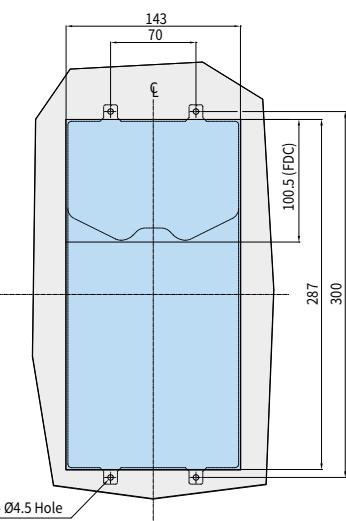

Process Criterion of  
Connecting Conductor




※ When installing the product in close contact, please consider tolerances for external dimensions.

## Plug-in Type HGP800

• HGP800


### External Dimension

Unit : mm

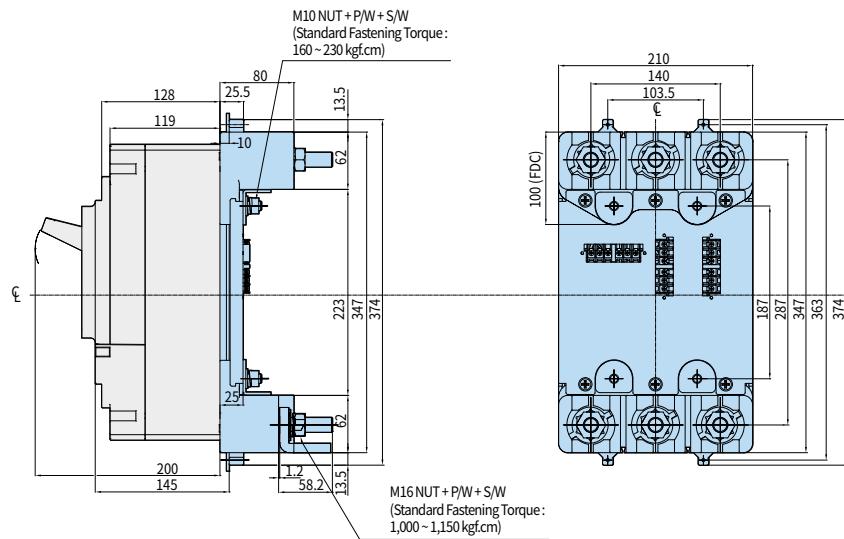


### Panel Installation Dimension and TDM Cover Cutting Dimension


Mounting Drawing

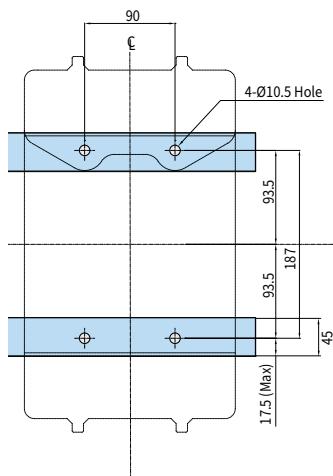

Dimension of Front Cover Cutting

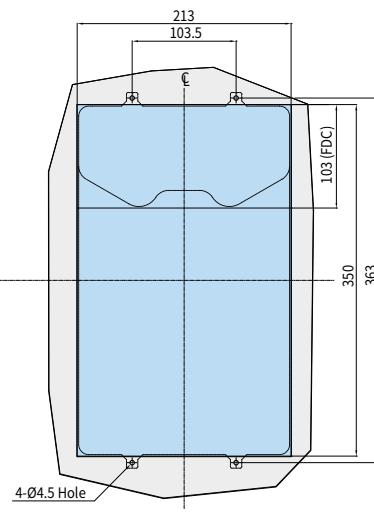

Process Criterion of Connecting Conductor



Dimensions

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### External Rotary Handle HGM100

• HGM30, 50E/S, 60, 100


#### External Dimension - Front Contact Type

Unit : mm

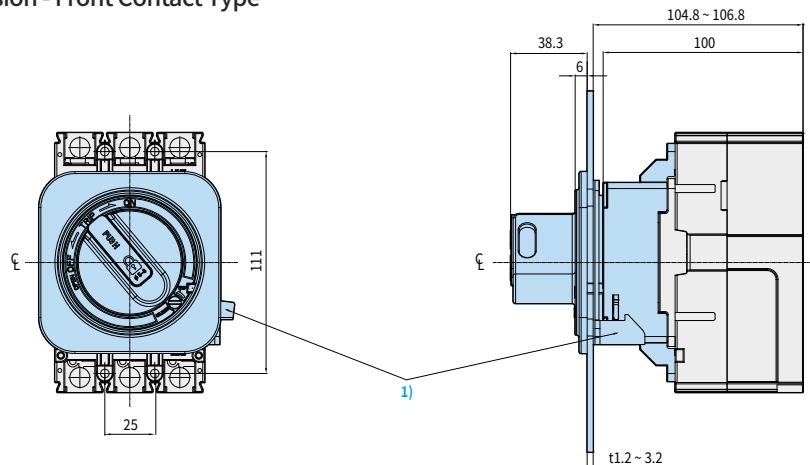


※ 1) Note that the LOCK PLATE may need to be positioned for combined operation with the handle.

#### External Dimension – Extension Type

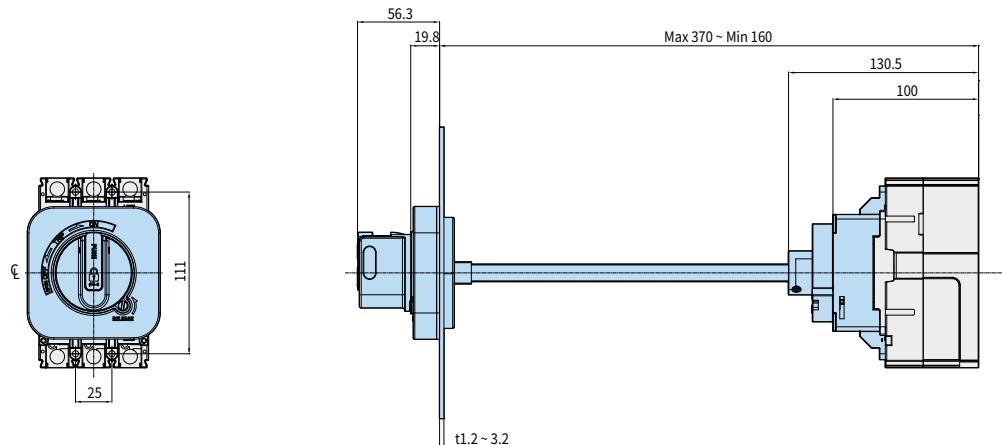

#### Panel Installation Dimension

Dimensions

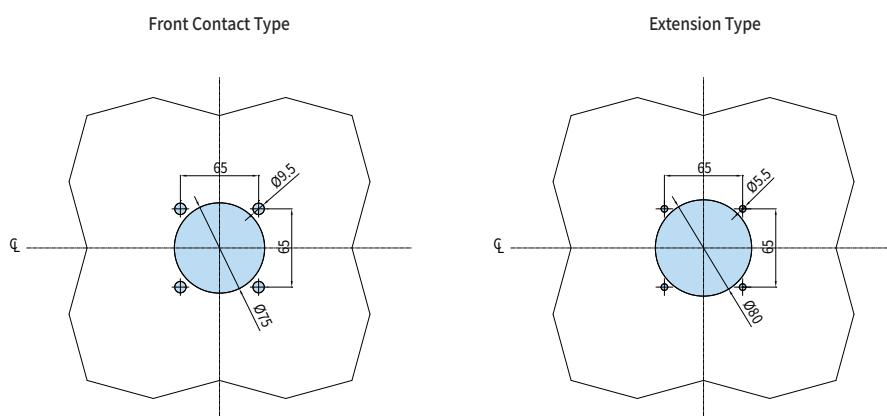


※ When installing the product in close contact, please consider tolerances for external dimensions.

## External Rotary Handle HGM125

• HGM50H/L, 125


### External Dimension - Front Contact Type

Unit : mm

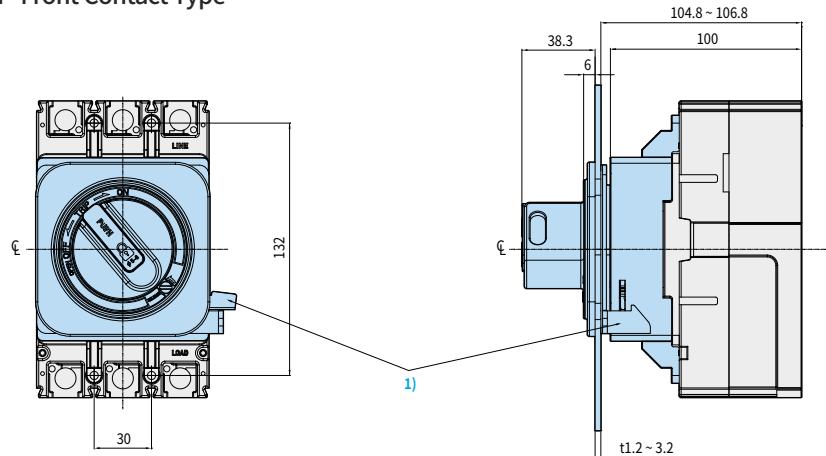


※ 1) Note that the LOCK PLATE may need to be positioned for combined operation with the handle.

### External Dimension – Extension Type

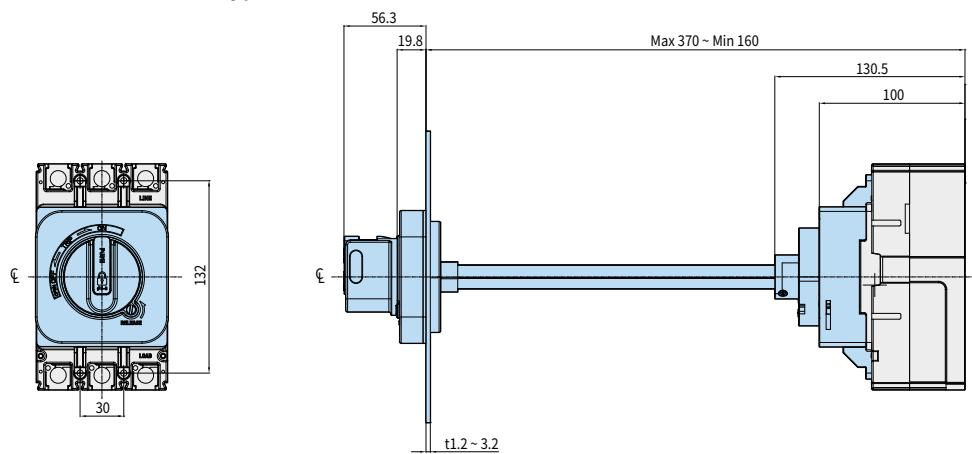

### Panel Installation Dimension

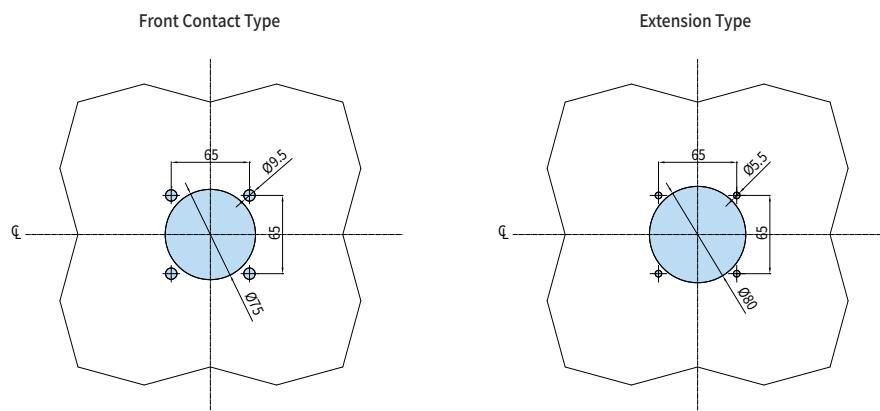

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### External Rotary Handle HGM250

• HGM160, 250


#### External Dimension - Front Contact Type

Unit : mm

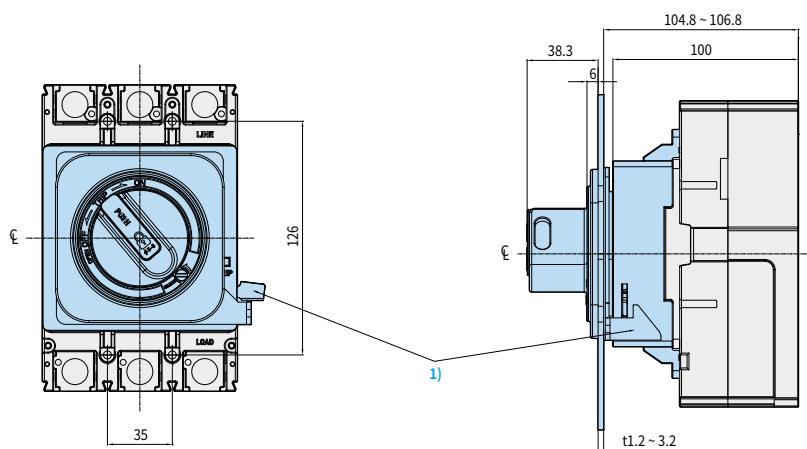


※ 1) Note that the LOCK PLATE may need to be positioned for combined operation with the handle.

#### External Dimension – Extension Type

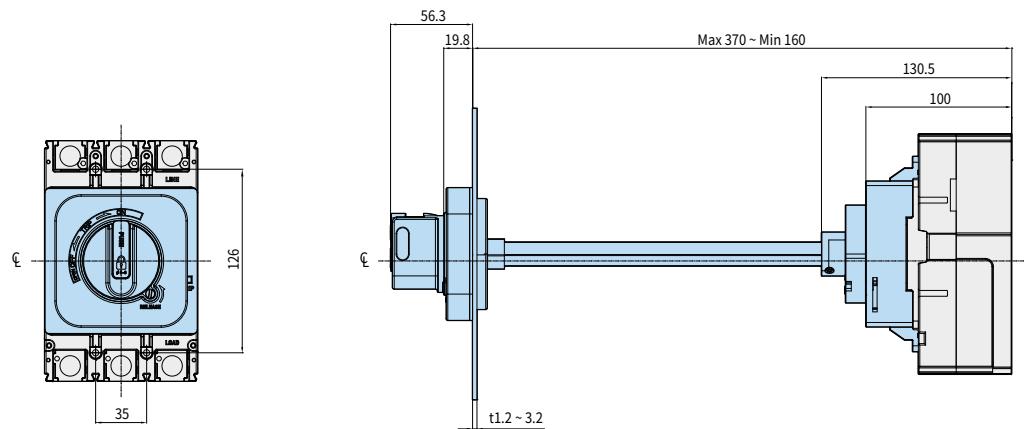

#### Panel Installation Dimension

Dimensions

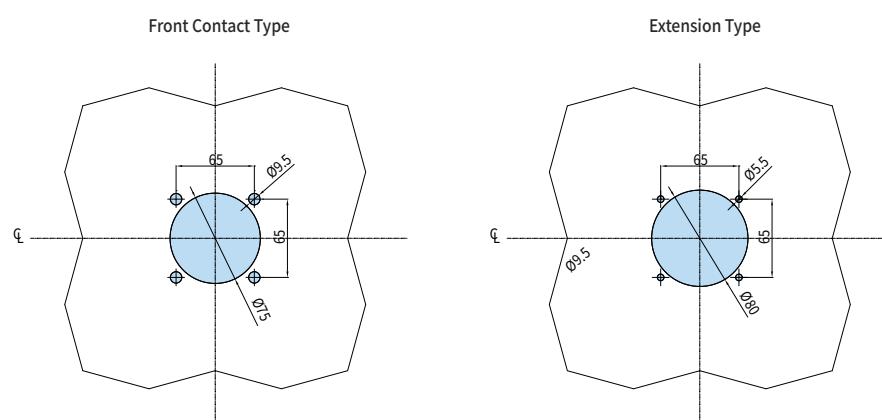


※ When installing the product in close contact, please consider tolerances for external dimensions.

## External Rotary Handle HGM400


• HGM400

### External Dimension - Front Contact Type


Unit : mm

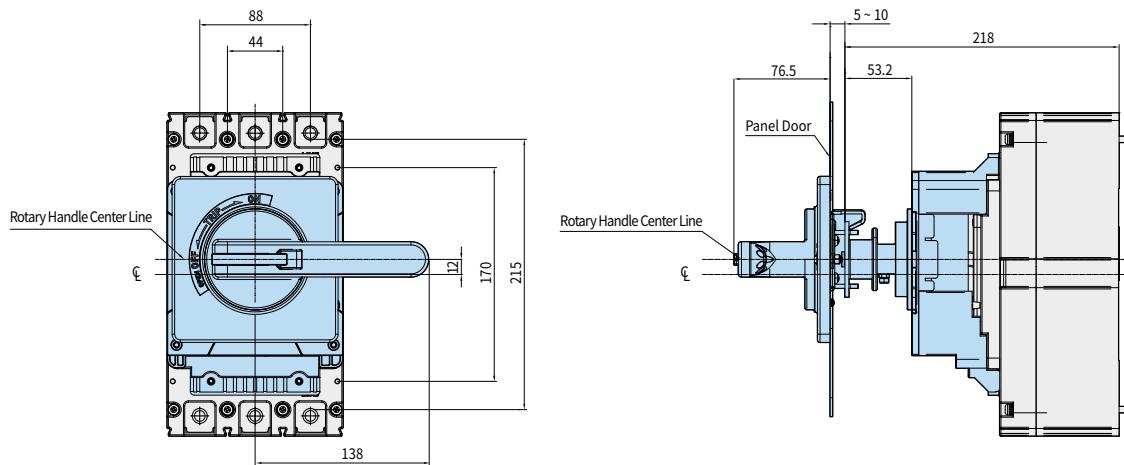


### External Dimension – Extension Type

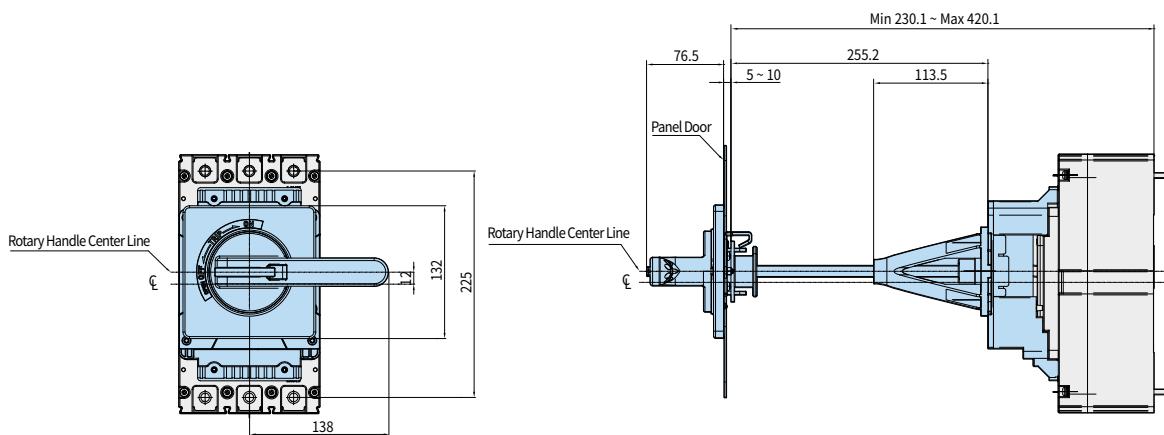

### Panel Installation Dimension

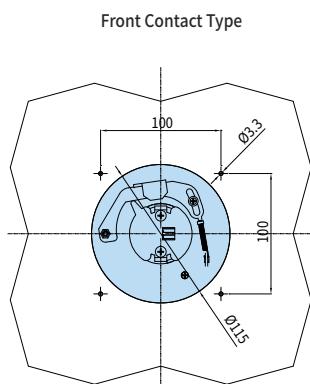

Front Contact Type

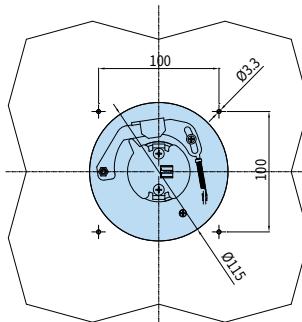

Extension Type

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### External Rotary Handle HGM800


• HGM630, 800

#### External Dimension - Front Contact Type


Unit : mm

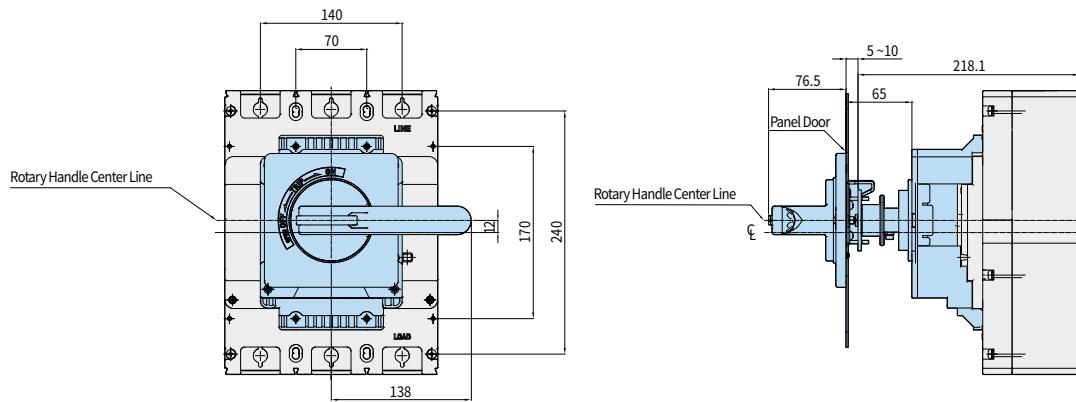

#### External Dimension – Extension Type

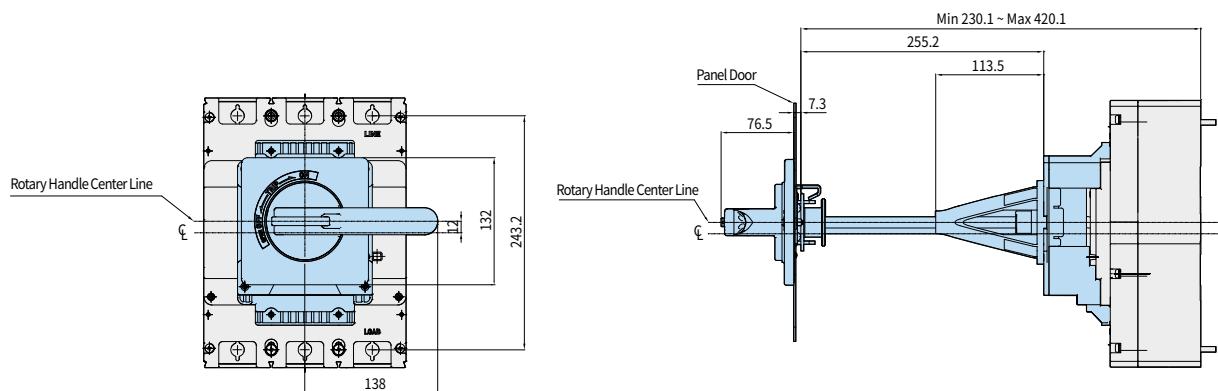

#### Panel Installation Dimension

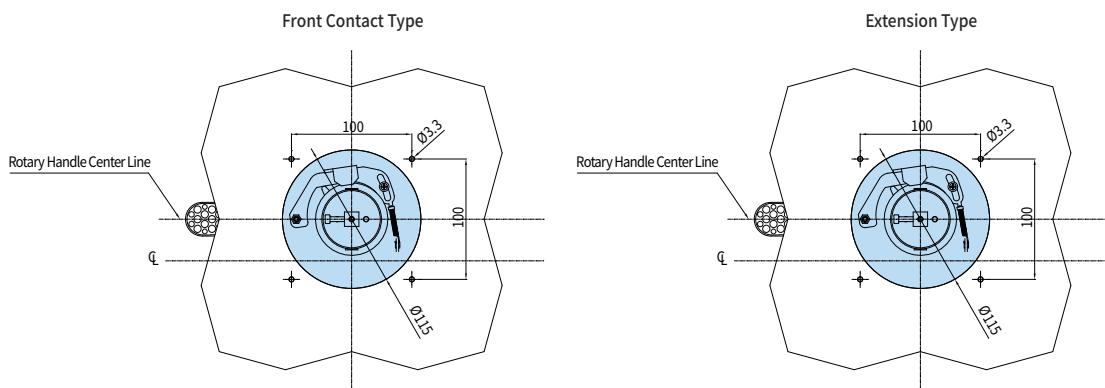


※ When installing the product in close contact, please consider tolerances for external dimensions.

## External Rotary Handle HGP160D

• HGP50D, 125D, 160D


### External Dimension - Front Contact Type

Unit : mm

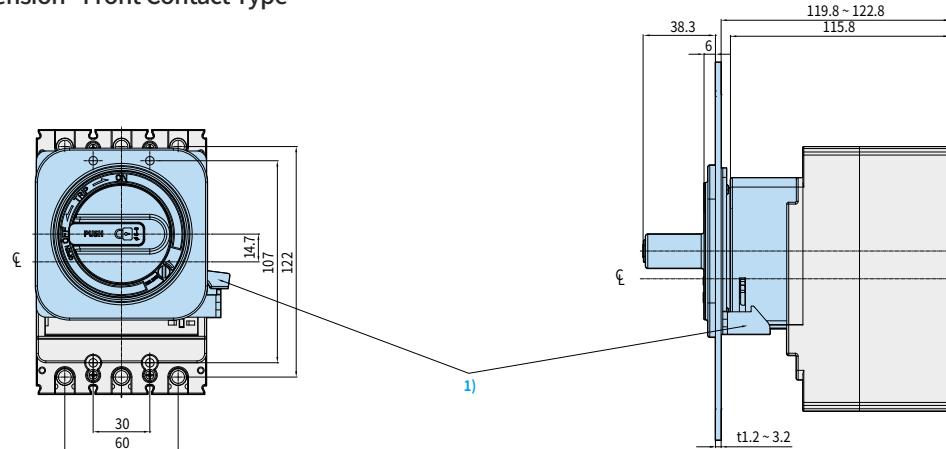


※ 1) Note that the LOCK PLATE may need to be positioned for combined operation with the handle.

### External Dimension – Extension Type

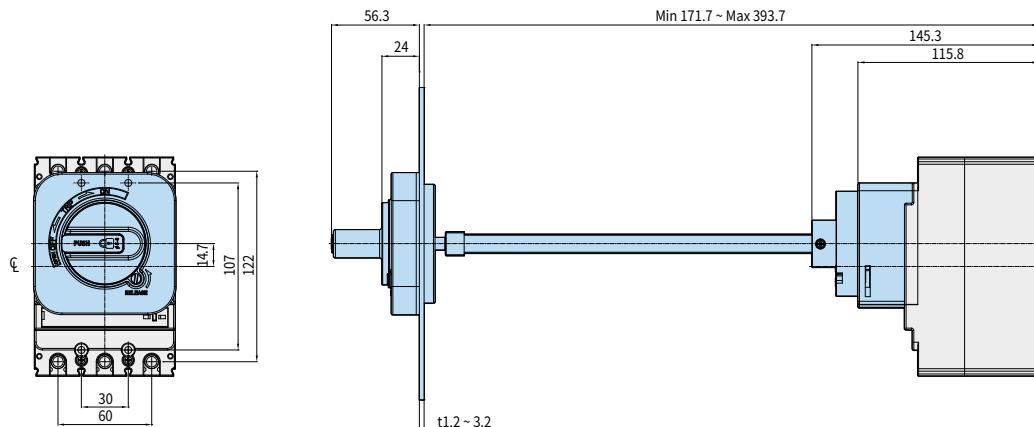

### Panel Installation Dimension

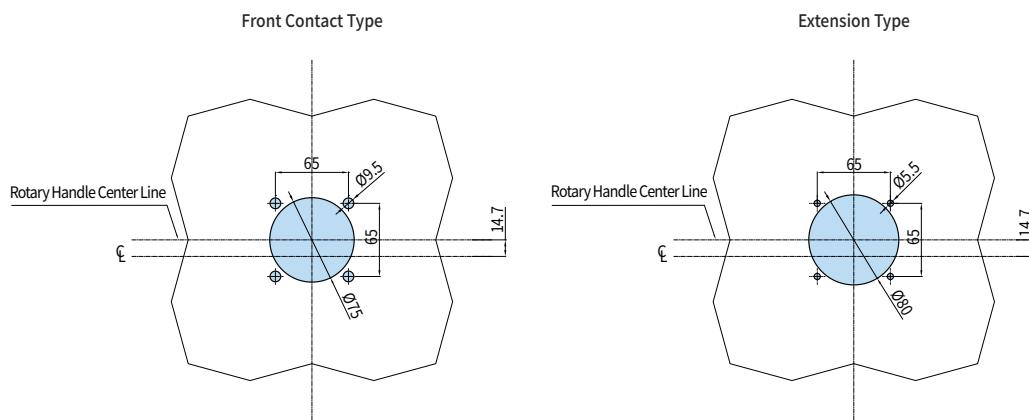

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### External Rotary Handle HGP250

• HGP100, 160, 250


#### External Dimension - Front Contact Type

Unit : mm

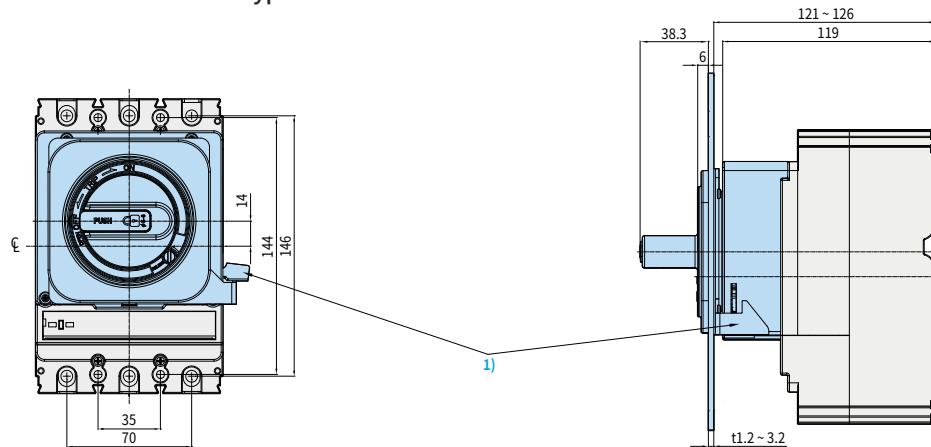


※ 1) Note that the LOCK PLATE may need to be positioned for combined operation with the handle.

#### External Dimension – Extension Type

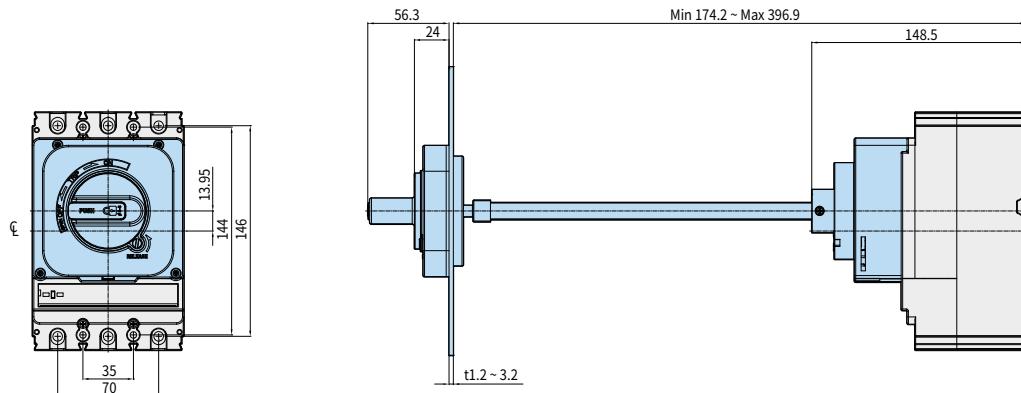

#### Panel Installation Dimension

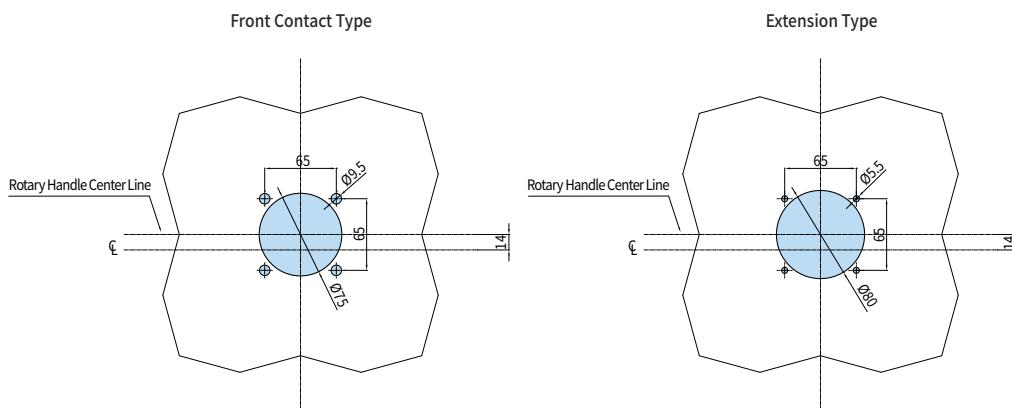


※ When installing the product in close contact, please consider tolerances for external dimensions.

## External Rotary Handle HGP630


• HGP400, 630

### External Dimension - Front Contact Type



Unit : mm

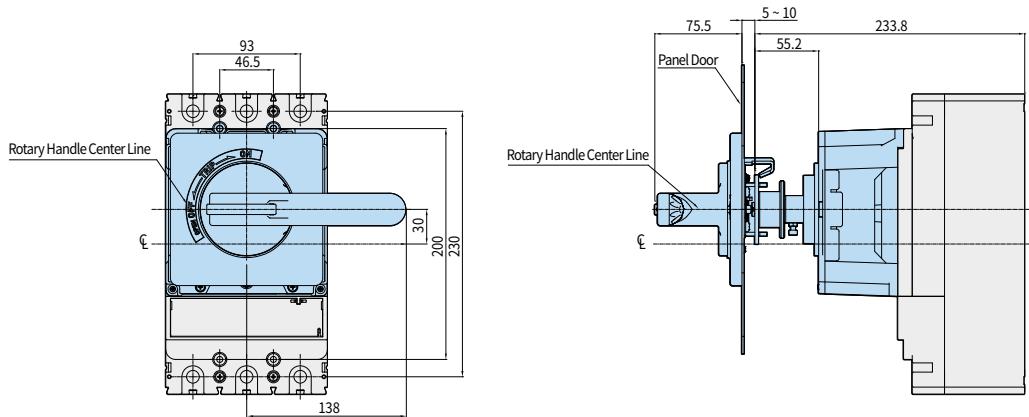

### External Dimension – Extension Type

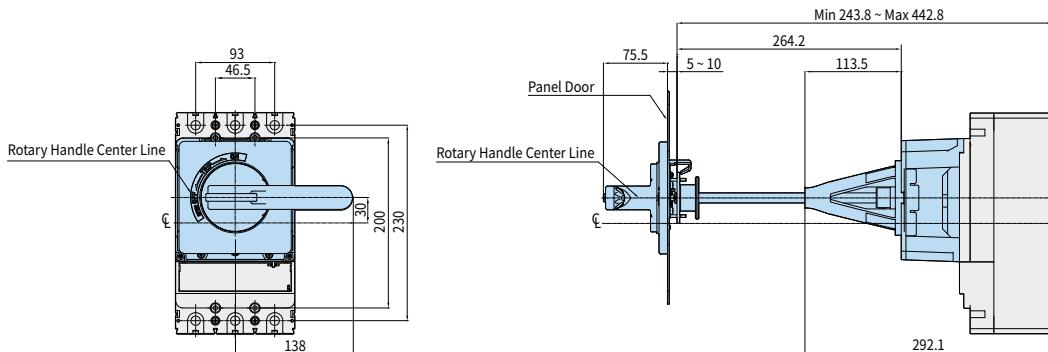

### Panel Installation Dimension

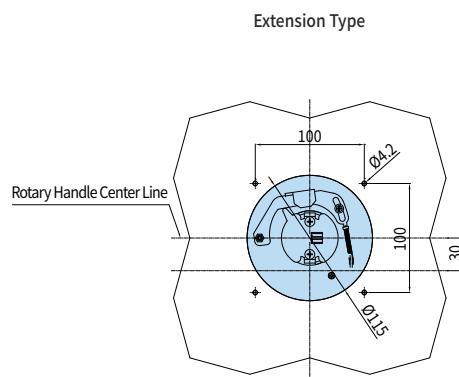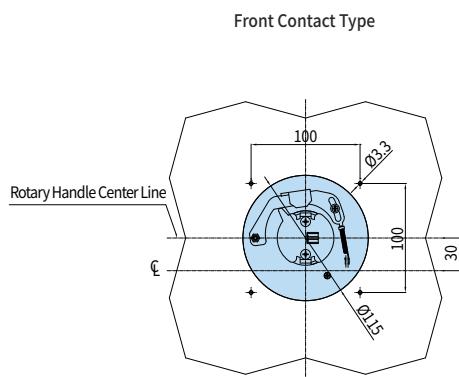

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### External Rotary Handle HGP800


• HGP800

#### External Dimension - Front Contact Type


Unit : mm

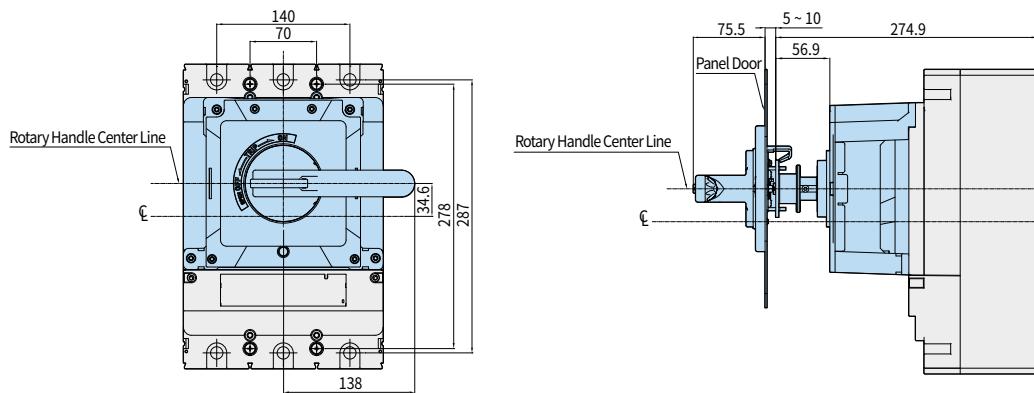

#### External Dimension – Extension Type

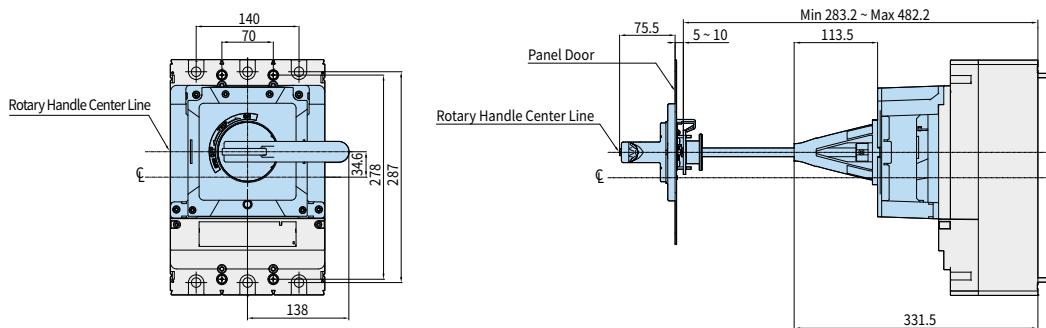

#### Panel Installation Dimension

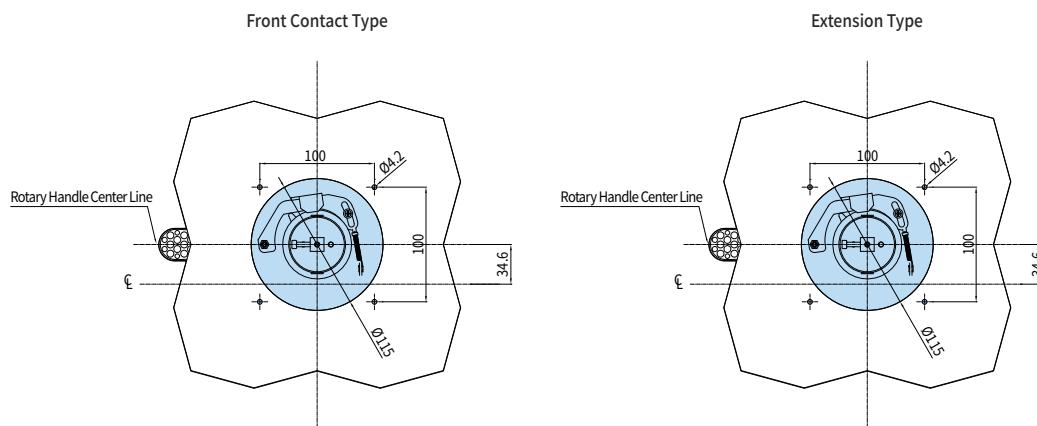




※ When installing the product in close contact, please consider tolerances for external dimensions.

**Mechanical Interlock HGM100**

• HGM30, 50E/S, 60, 100

**External Dimension**

Unit : mm

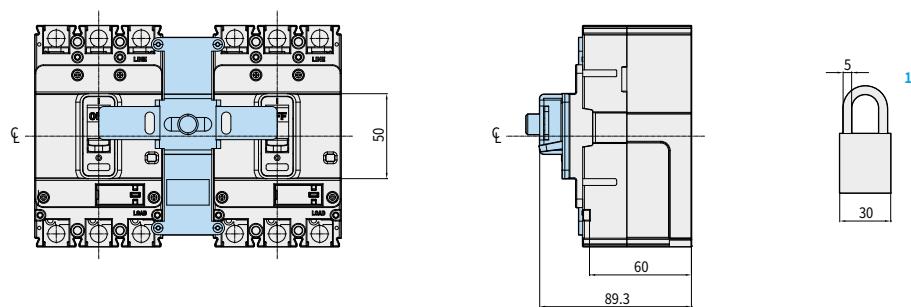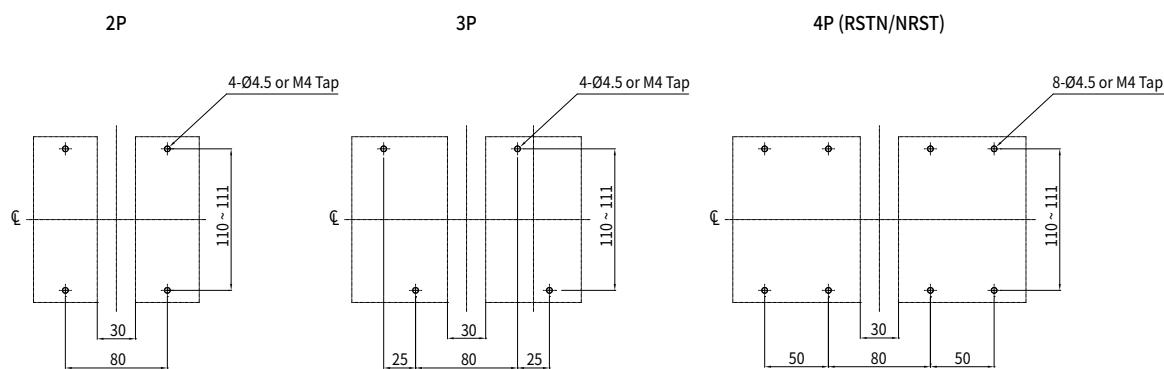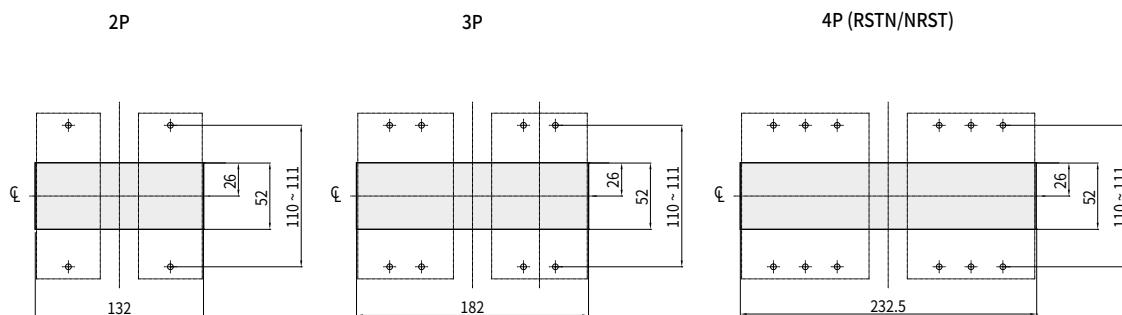**Panel Installation Dimension****Dimension of Panel Cover Cutting**

※ 1) Padlock not included.

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Mechanical Interlock HGM125


• HGM50H/L, 125

#### External Dimension


Unit: mm

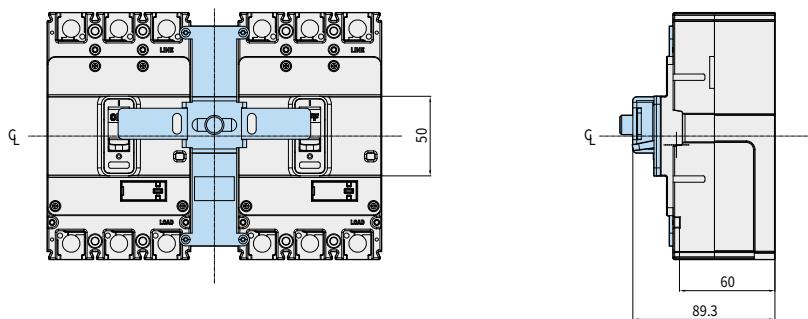

#### Panel Installation Dimension

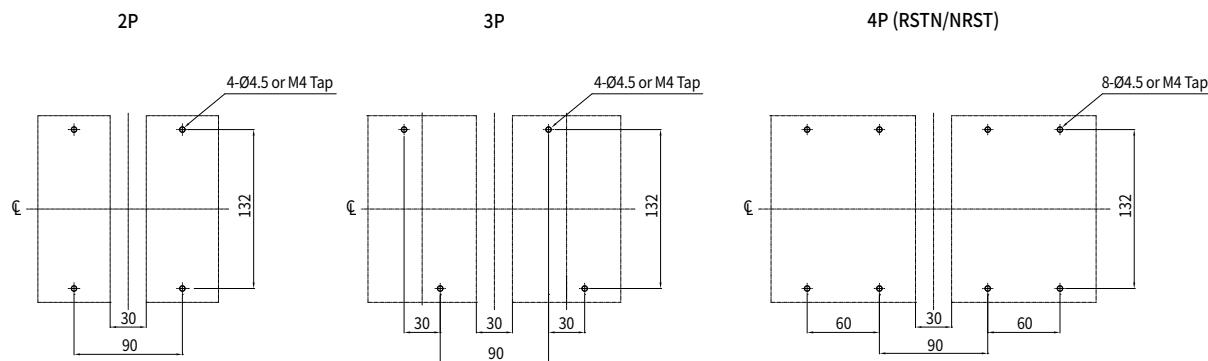

#### Dimension of Panel Cover Cutting

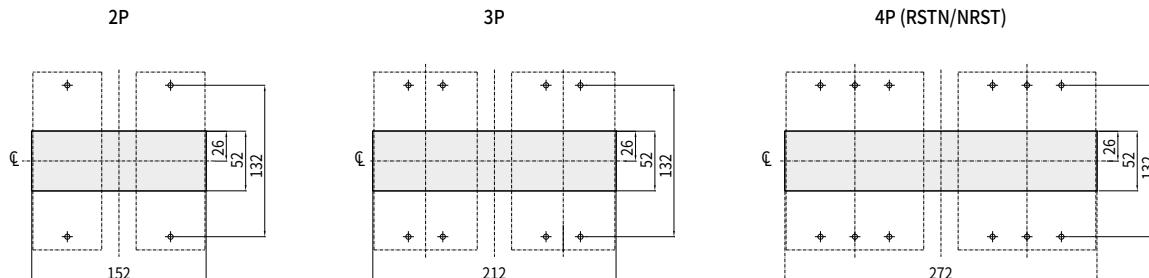


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Mechanical Interlock HGM250

• HGM160, 250


### External Dimension

Unit : mm

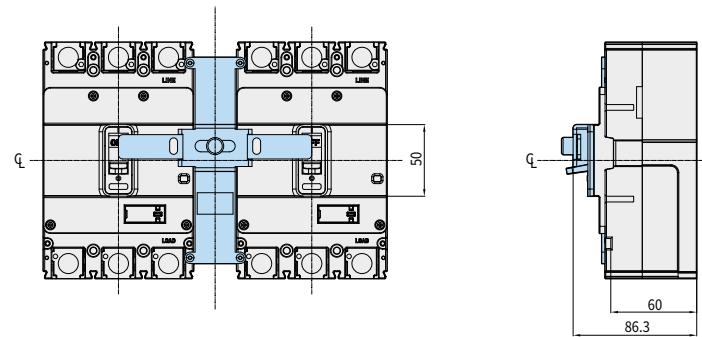


### Panel Installation Dimension

2/3P

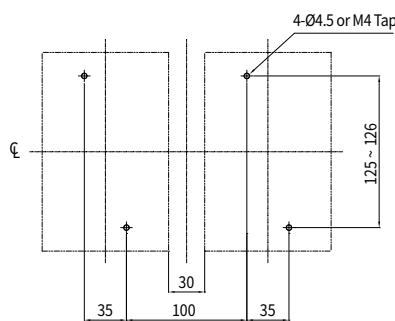


4P (RSTN/NRST)

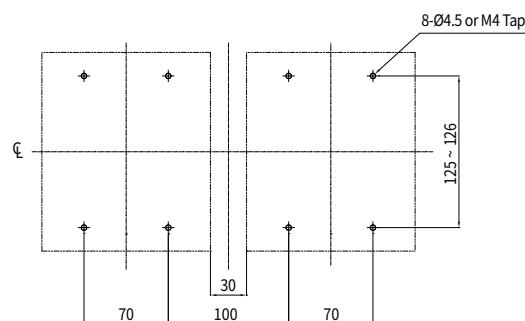


### Dimension of Panel Cover Cutting

2/3P

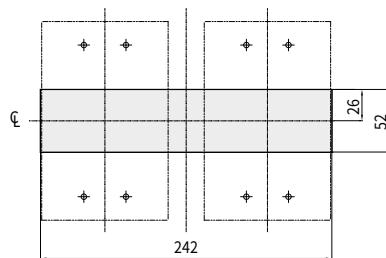

4P (RSTN/NRST)

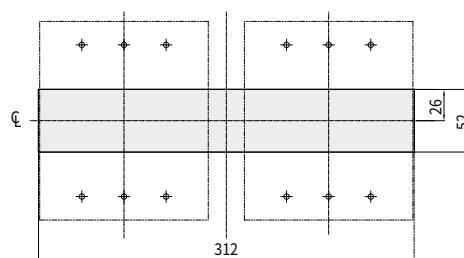

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Mechanical Interlock HGM400

• HGM400

#### External Dimension


Unit : mm

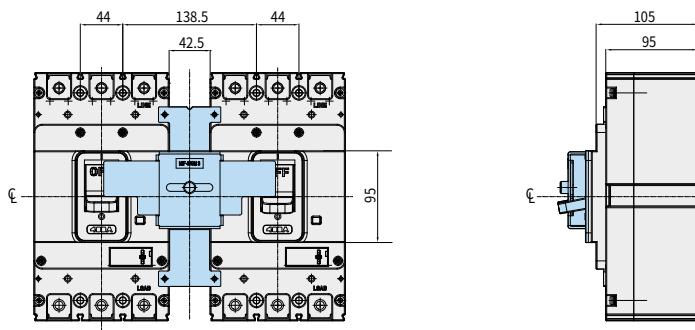

#### Panel Installation Dimension

2/3P


4P (RSTN/NRST)

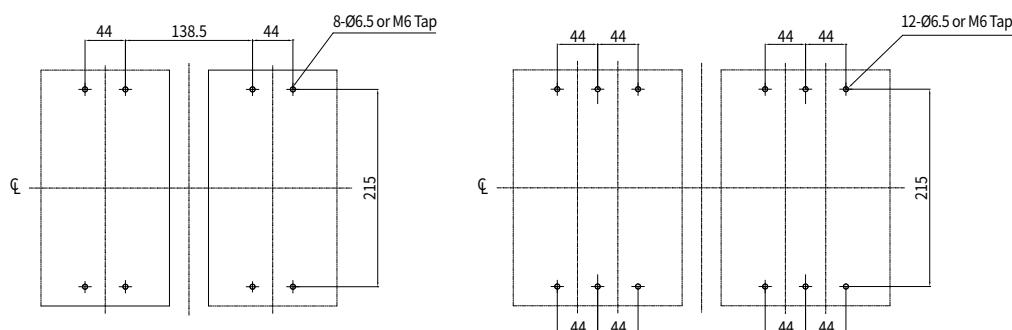

#### Dimension of Panel Cover Cutting

2/3P

4P (RSTN/NRST)

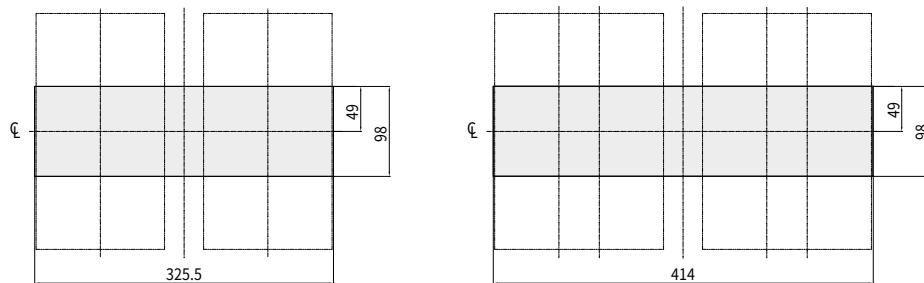


## Mechanical Interlock HGM800

• HGM630, 800

### External Dimension


Unit : mm

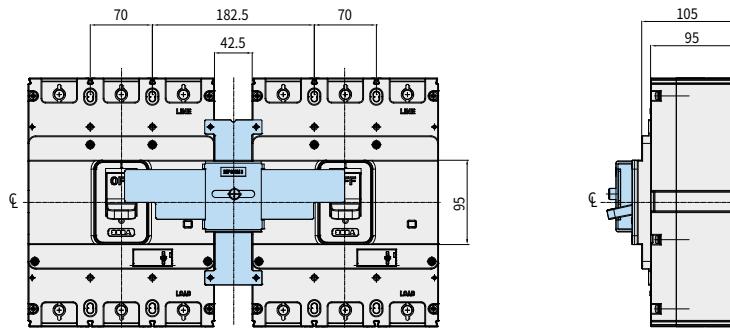

### Panel Installation Dimension

2/3P


4P (RSTN/NRST)

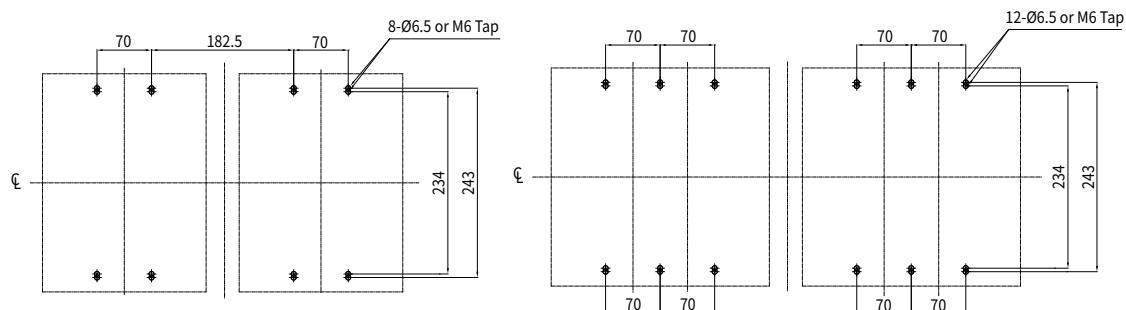

### Dimension of Panel Cover Cutting

2/3P

4P (RSTN/NRST)

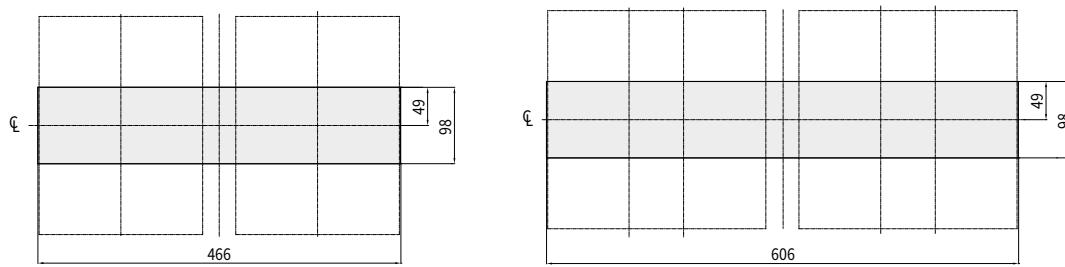

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Mechanical Interlock HGP160D

- HGP50D, 125D, 160D


#### External Dimension

Unit: mm

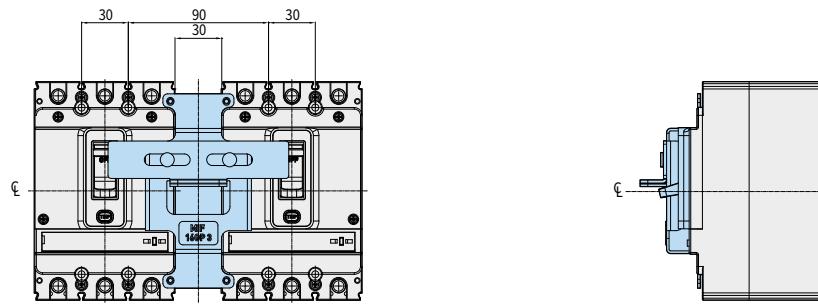


#### Panel Installation Dimension

3P

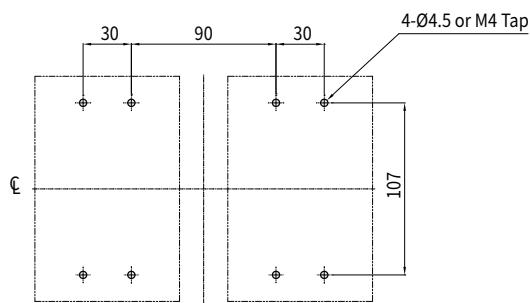


4P

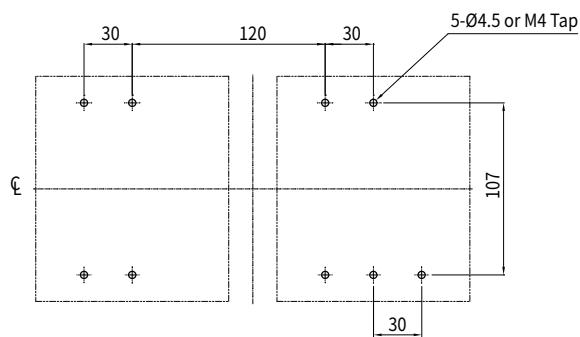


#### Dimension of Panel Cover Cutting

3P

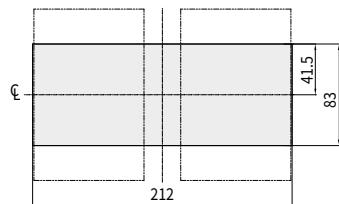

4P

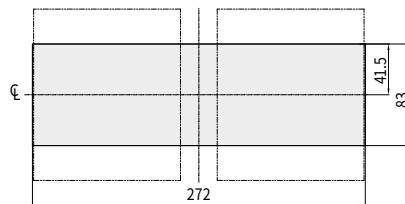


## Mechanical Interlock HGP250


• HGP100, 160, 250

### External Dimension


Unit : mm

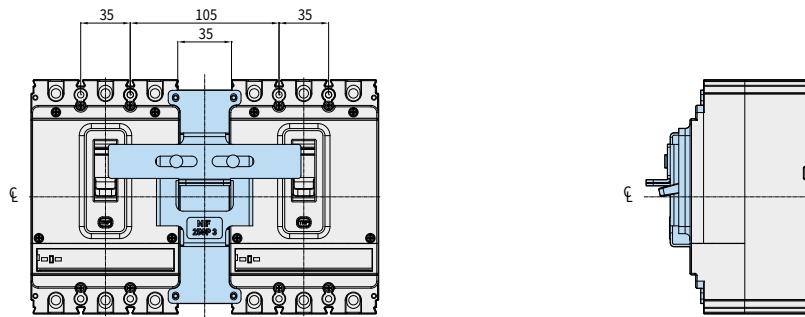

### Panel Installation Dimension

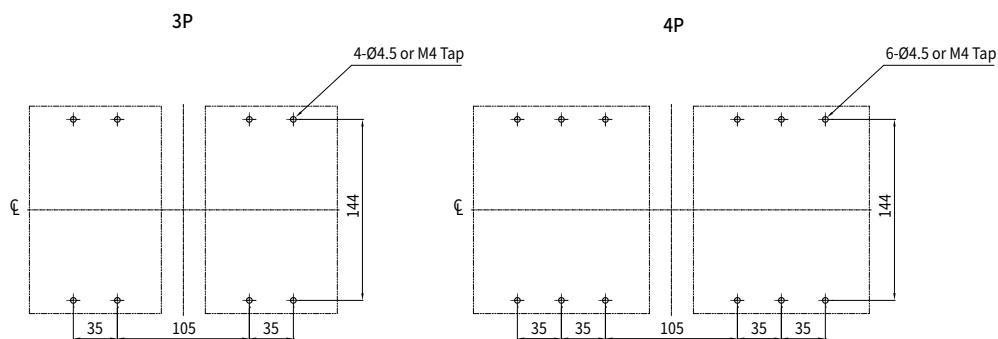

### Dimension of Panel Cover Cutting

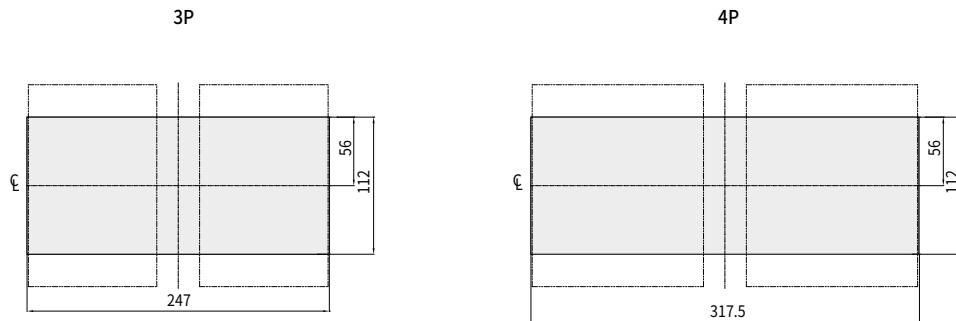

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Mechanical Interlock HGP630

• HGP400, 630


#### External Dimension

Unit: mm

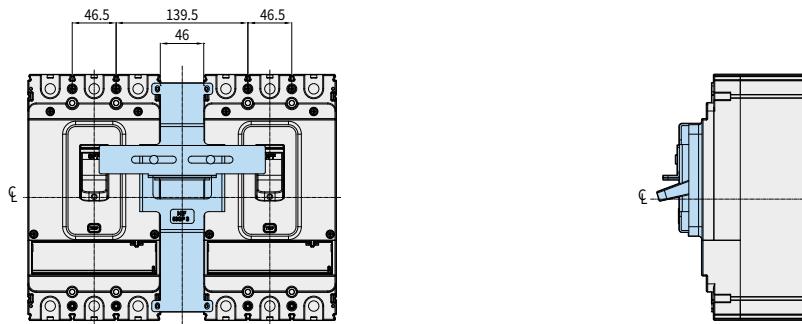


#### Panel Installation Dimension

3P

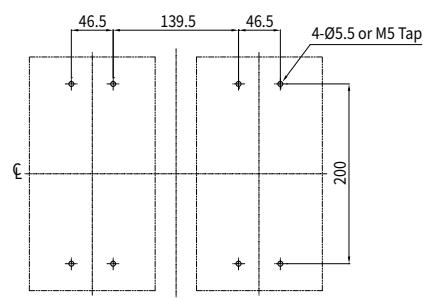


4P

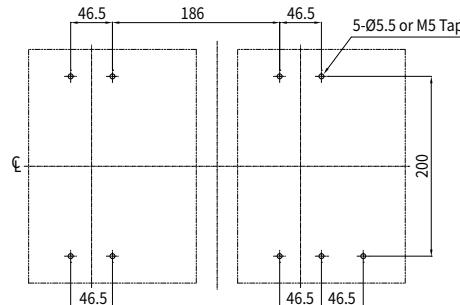


#### Dimension of Panel Cover Cutting

3P

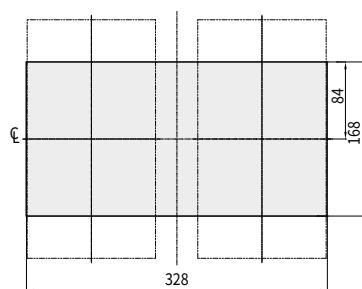

4P

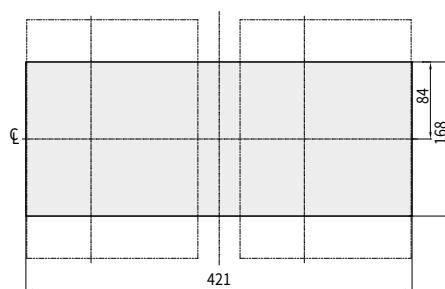


## Mechanical Interlock HGP800

• HGP800


### External Dimension

Unit : mm

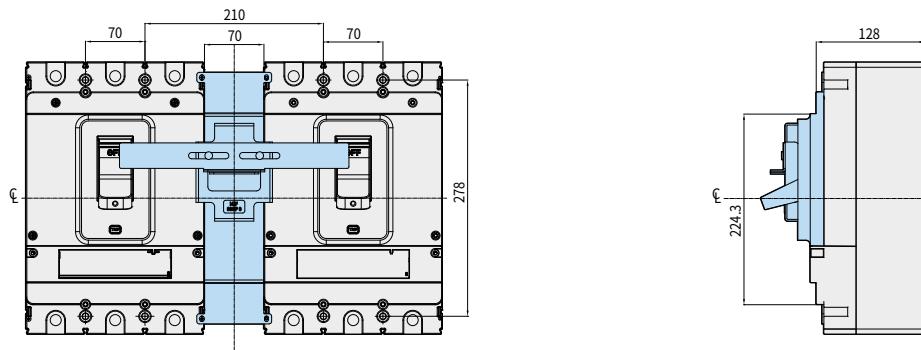


### Panel Installation Dimension

3P

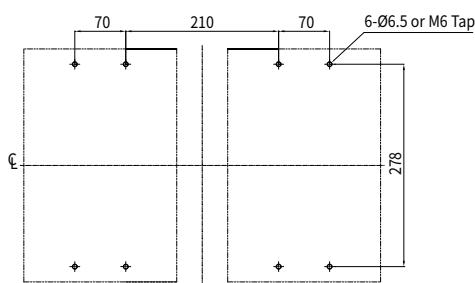


4P

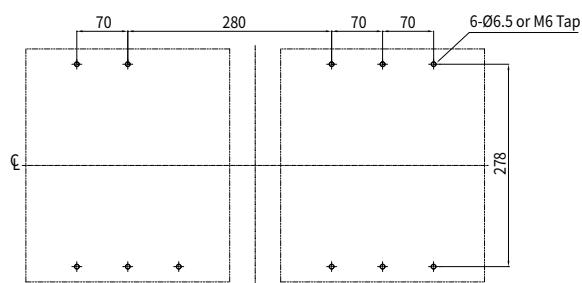


### Dimension of Panel Cover Cutting

3P

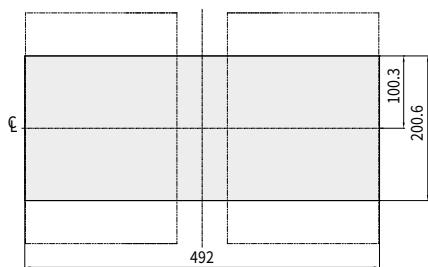

4P

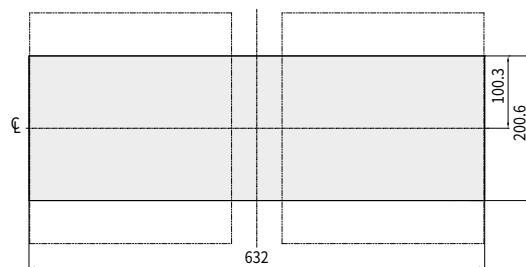


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Dimensions


### Terminal Cover HGM100

• HGM30, 50E/S, 60, 100



Long Type

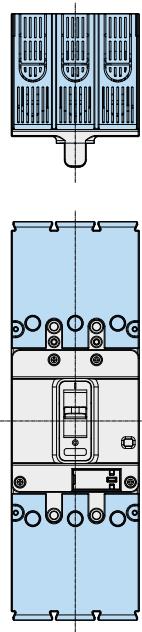

Short Type

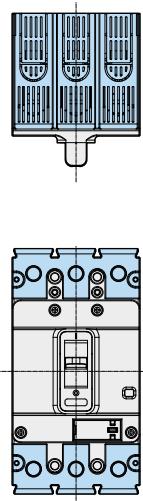


Unit: mm

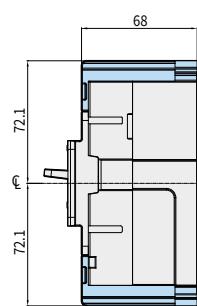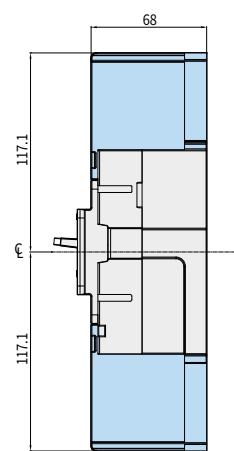


### Terminal Cover HGM125

• HGM50H/L, 125



Long Type

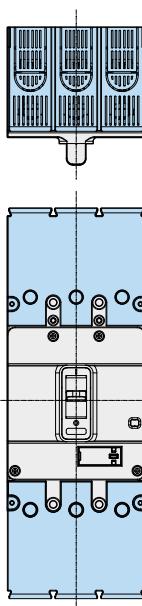

Short Type

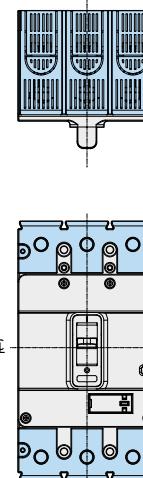


Unit: mm

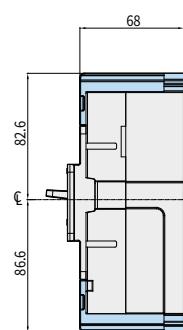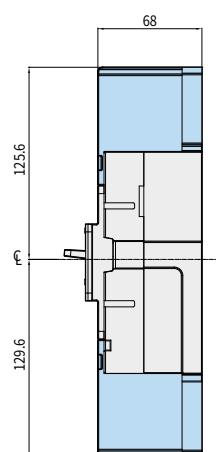


**Terminal Cover HGM250**

• HGM160, 250

Long Type

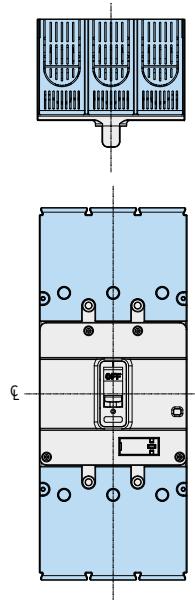

Short Type

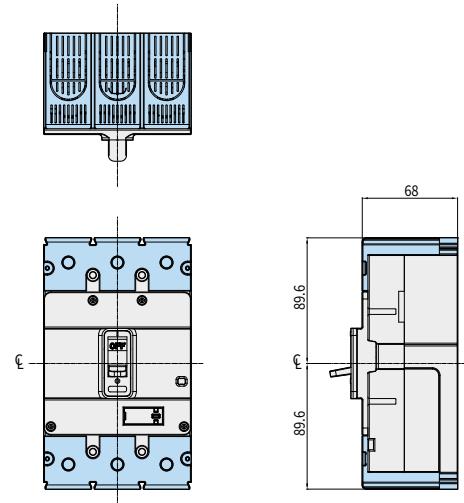


Unit : mm


**Terminal Cover HGM400**

• HGM400

Long Type

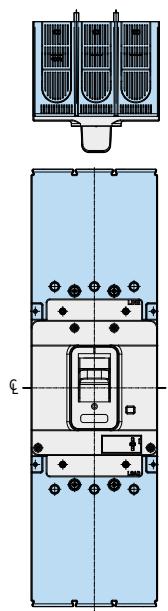

Short Type

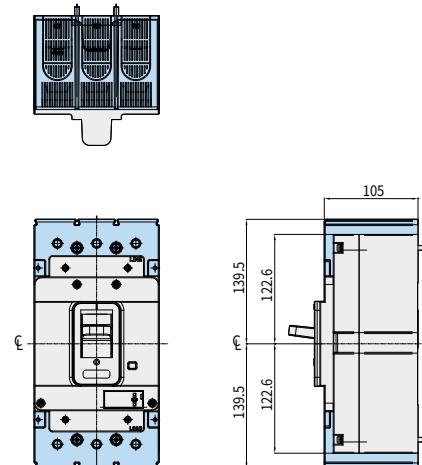

Unit : mm

Dimensions


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Dimensions


### Terminal Cover HGM800

• HGM630, 800



Long Type

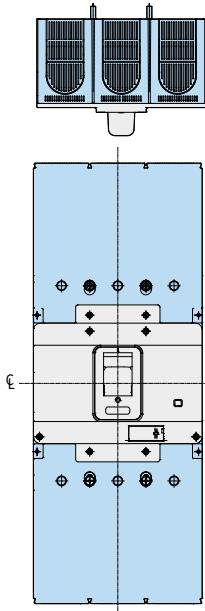

Short Type

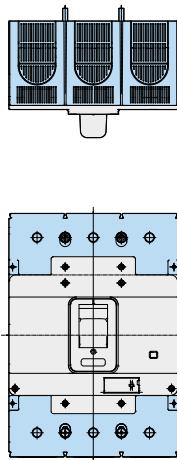



Unit : mm

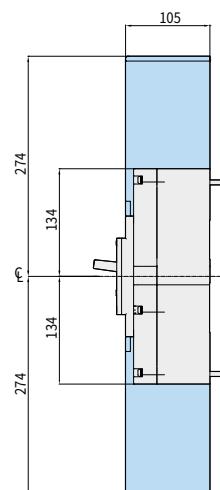



### Terminal Cover HDB100 (for Distribution Panel)

• HDB/HDG30, 50, 100 (for Distribution Panel)

Short Type 2P

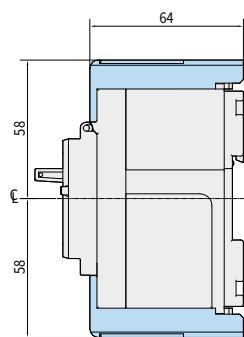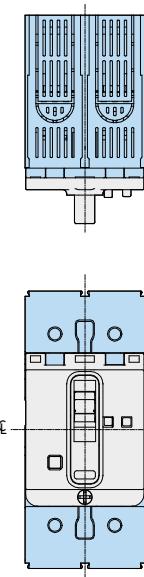

Short Type 3P

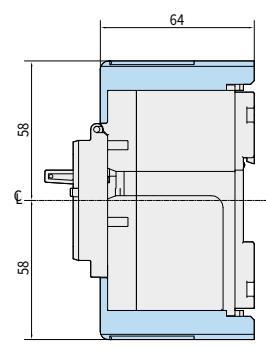
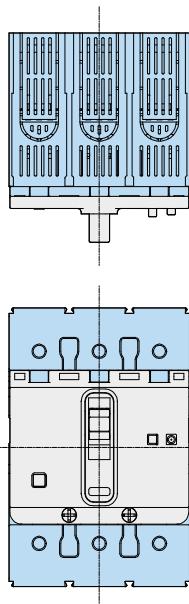


단위 : mm



**Terminal Cover HGP50D, 125D, 160D**

• HGP50D, 125D, 160D



Long Type 3P/4P

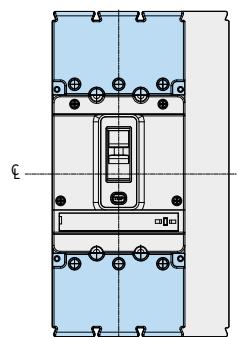

Short Type 3P





Unit : mm


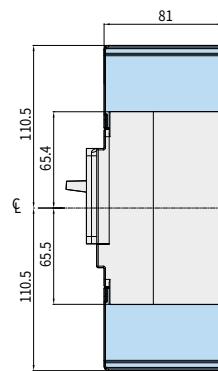
**Terminal Cover HGP250**

• HGP100, 160, 250



Long Type 3P/4P

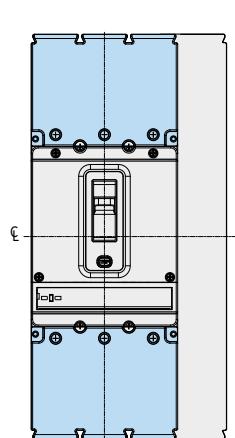

Short Type 3P



Unit : mm

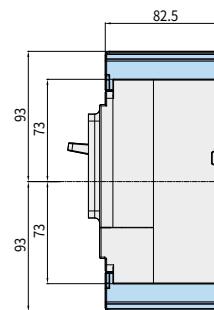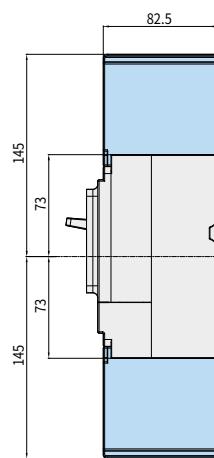

Dimensions



※ When installing the product in close contact, please consider tolerances for external dimensions.

## Dimensions



### Terminal Cover HGP400, 630

• HGP400, 630

Long Type 3P/4P

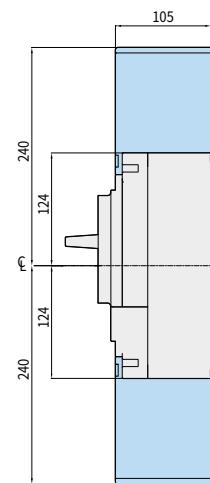

Short Type 3P

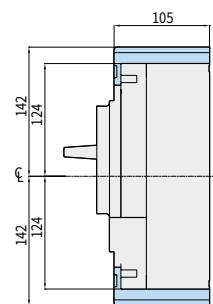



Unit: mm



### Terminal Cover HGP800

• HGP800

Long Type 3P/4P

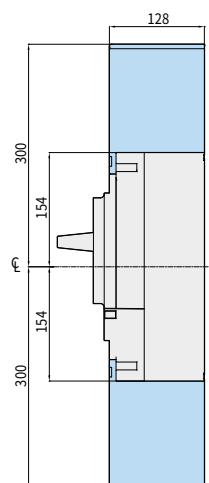

Short Type 3P

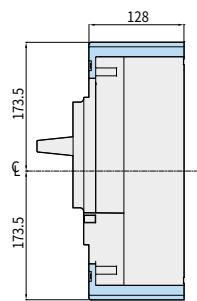


Unit: mm


## Motor Operator

HGM30, 50E/S, 60, 100


Unit : mm

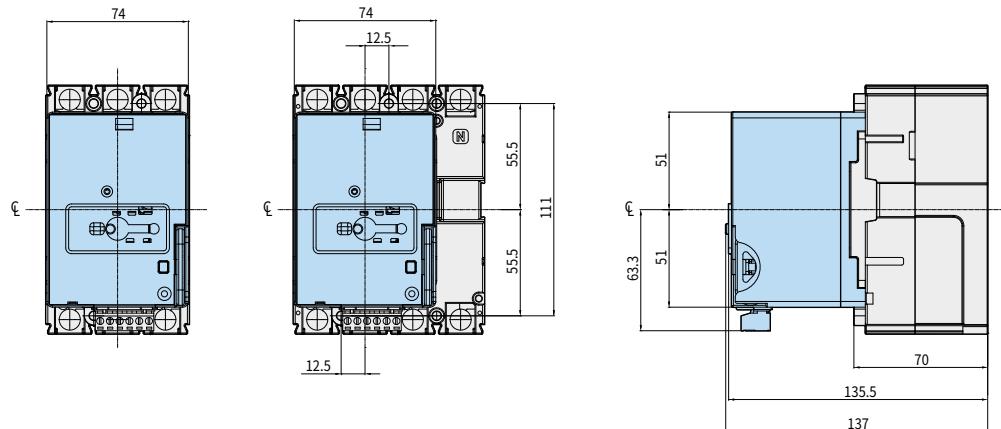

HGM50H/L, 125

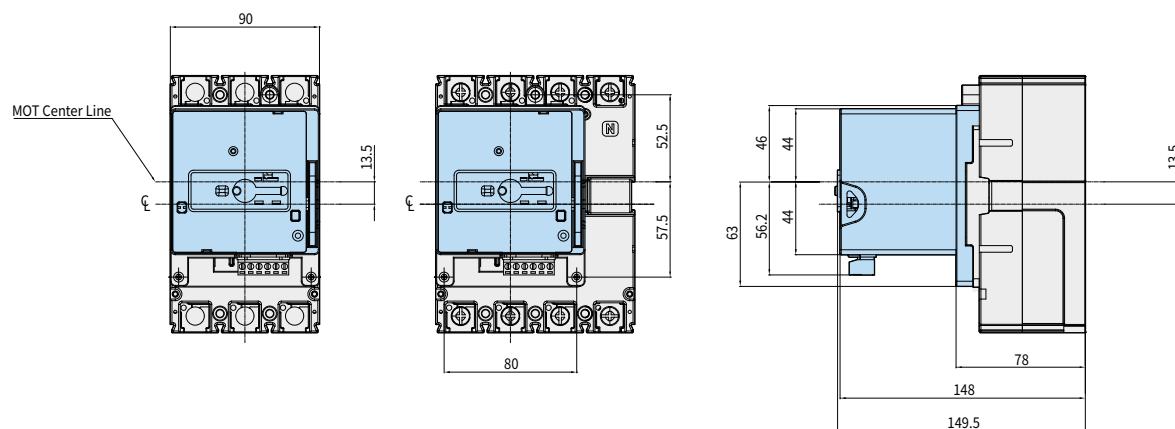

HGM160, 250

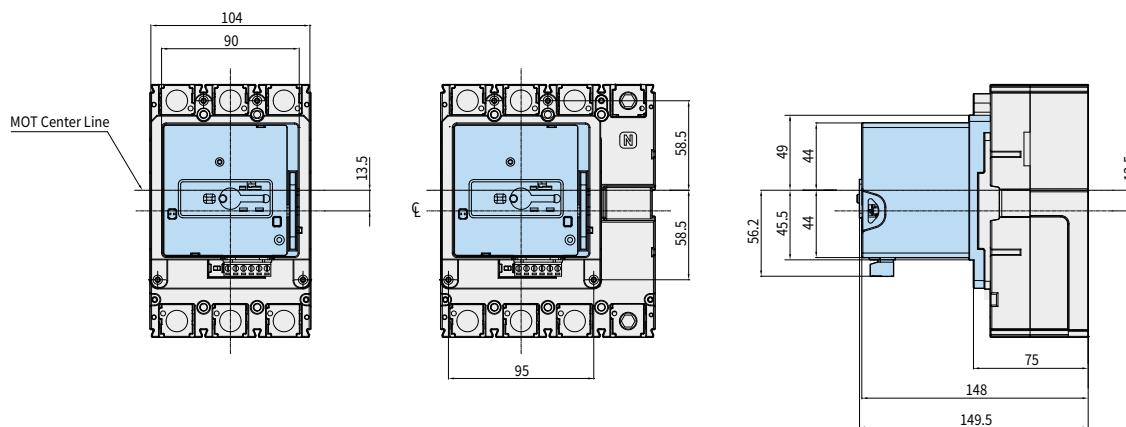


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Dimensions


### Motor Operator

HGM400

Unit: mm

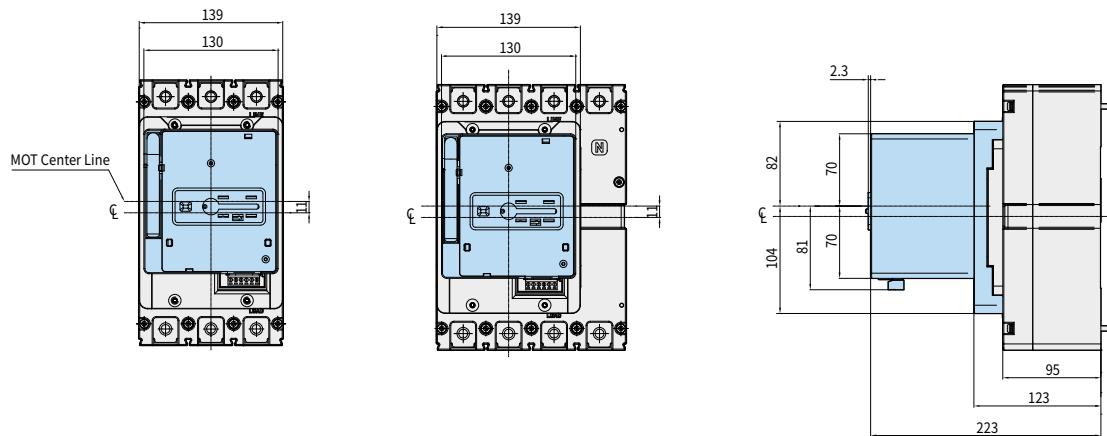





HGM630, 800

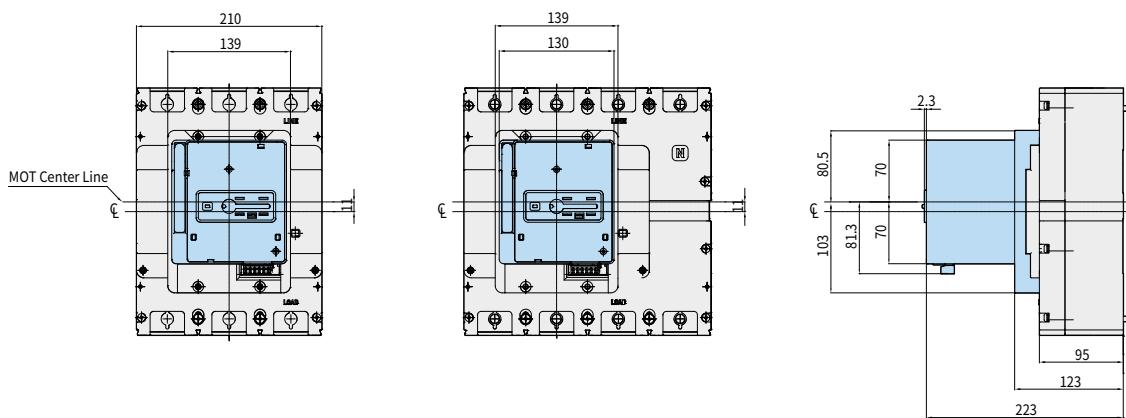

※ When installing the product in close contact, please consider tolerances for external dimensions.

**HGP50D, 125D, 160D**

Unit : mm

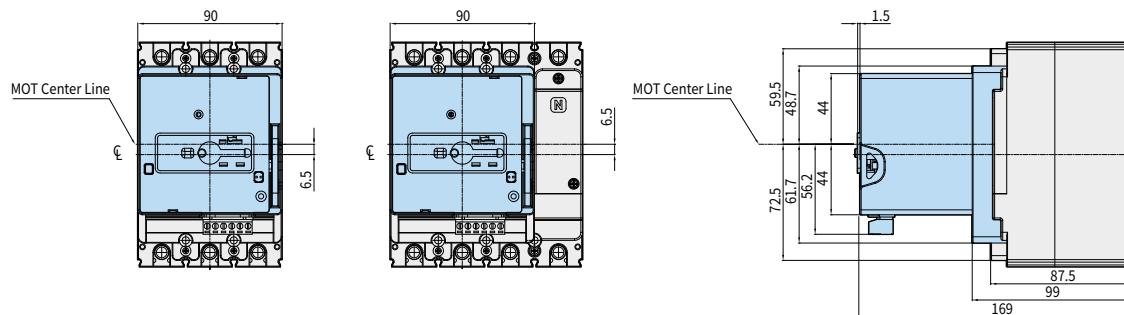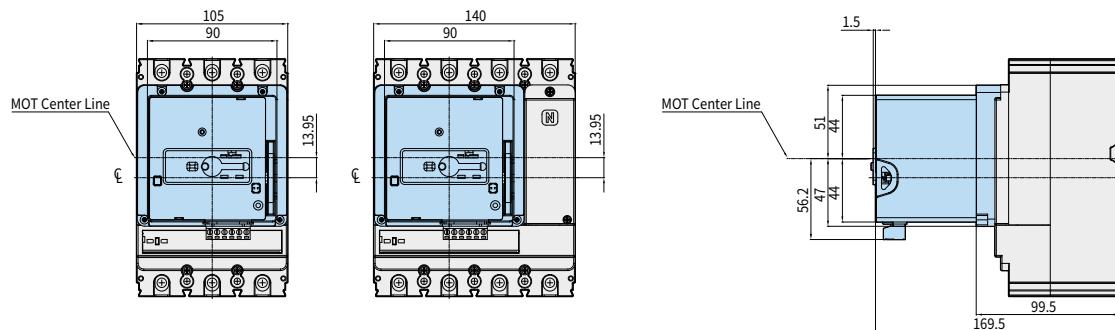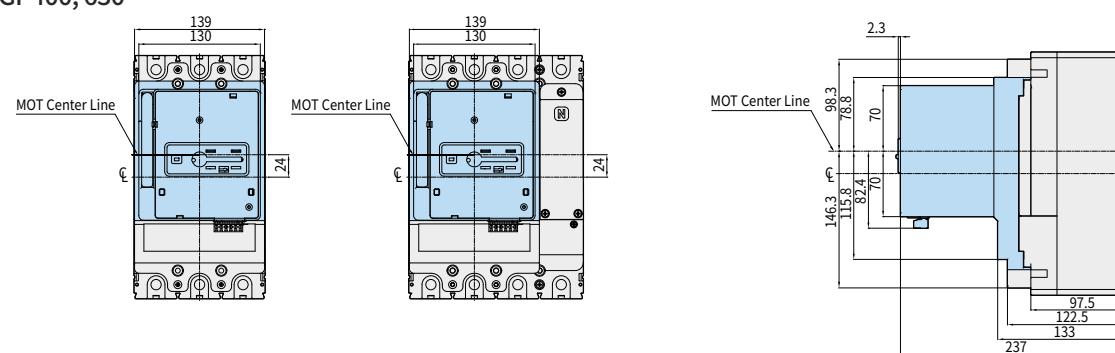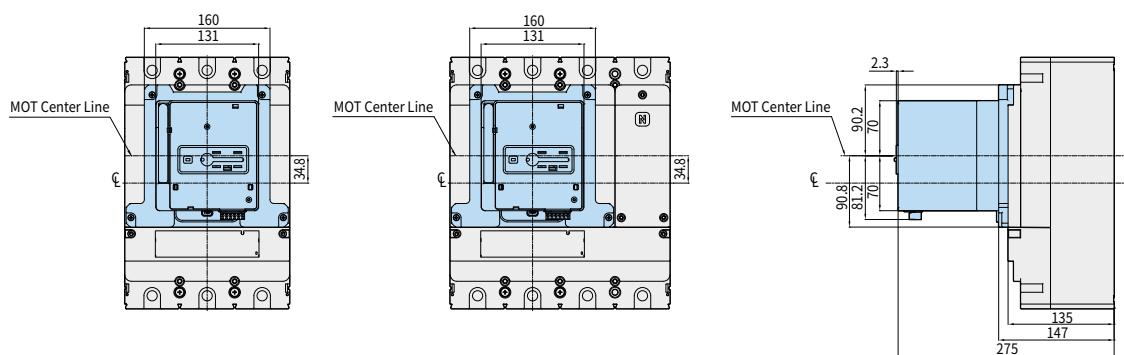**HGP100, 160, 250****HGP400, 630****HGP800**


※ When installing the product in close contact, please consider tolerances for external dimensions.

## Dimensions


### LUG Terminal

HGM30, 50E/S, 60, 100


Unit: mm

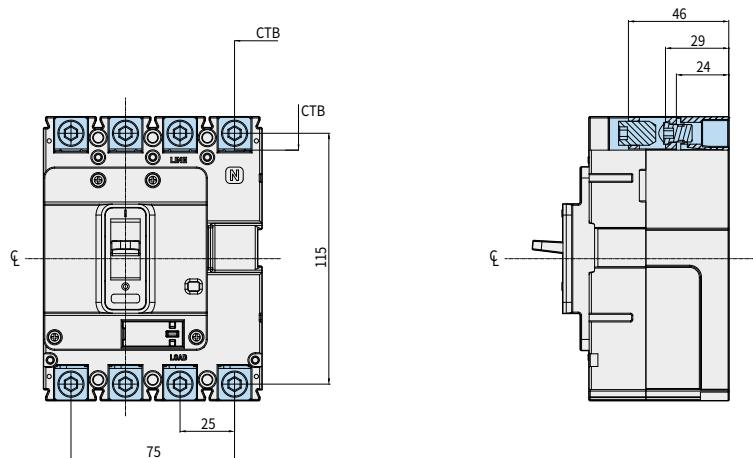

HGM50H/L, 125

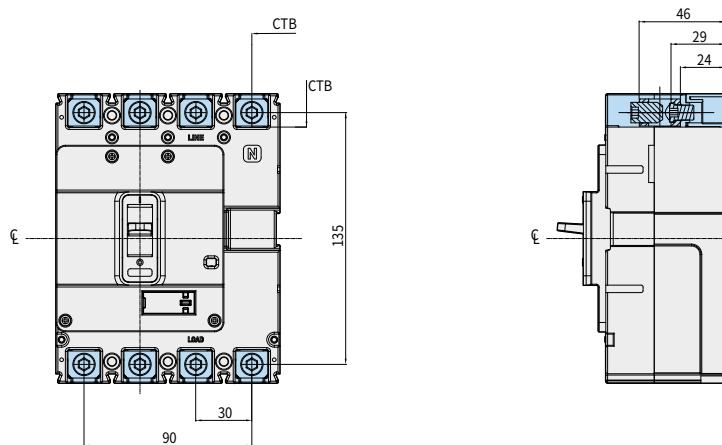

HGM160, 250

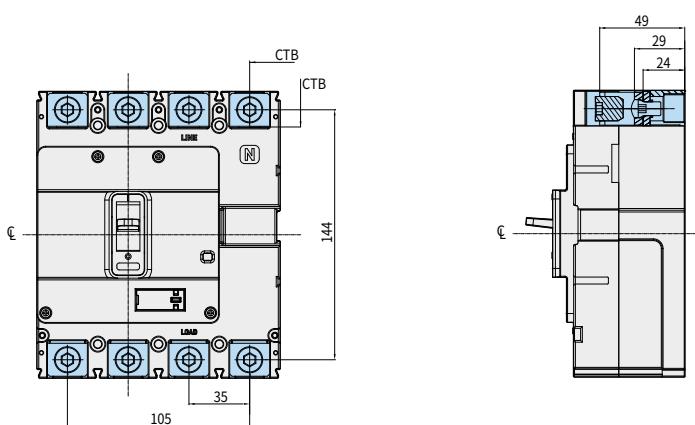


※ When using CTB, in case the Line/Load Insulation Barrier is not mounted, insulation tube or insulation tape does not provide complete insulation between bare conductors which may cause secondary short-circuit accidents so it must be used.


※ When installing the product in close contact, please consider tolerances for external dimensions.

HGM400

Unit : mm

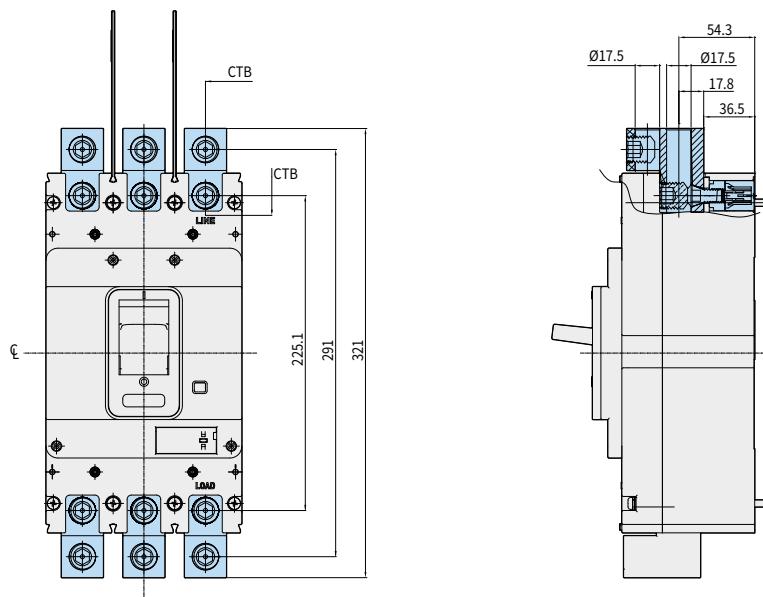

HGM630, 800

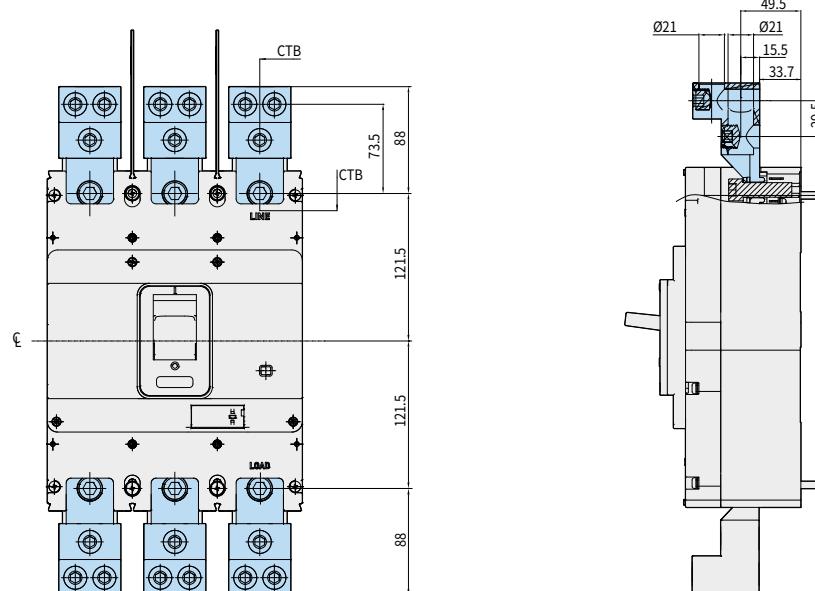

Dimensions


※ When using CTB, in case the Line/Load Insulation Barrier is not mounted, insulation tube or insulation tape does not provide complete insulation between bare conductors which may cause secondary short-circuit accidents so it must be used.

※ When installing the product in close contact, please consider tolerances for external dimensions.

## Dimensions


### LUG Terminal

HGP50D, 125D, 160D

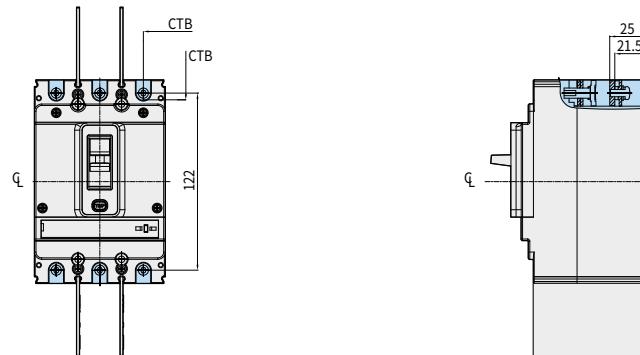


Unit: mm


HGP100, 160, 250

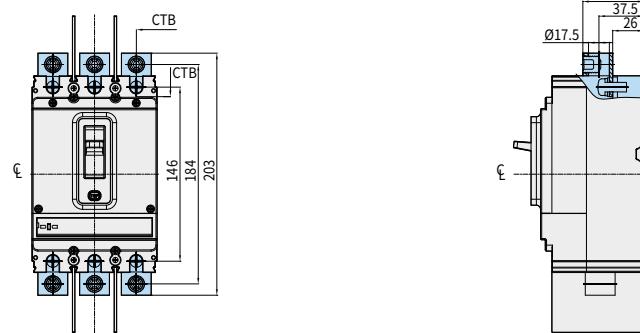

HGP400, 630

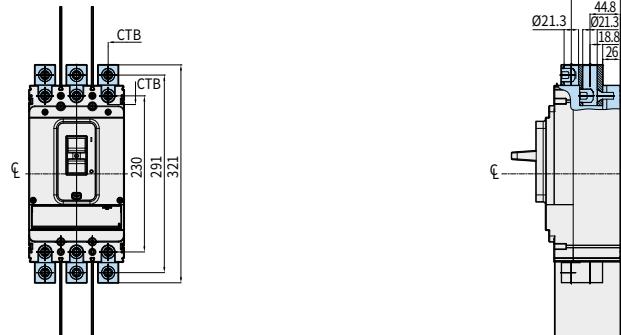

HGP800

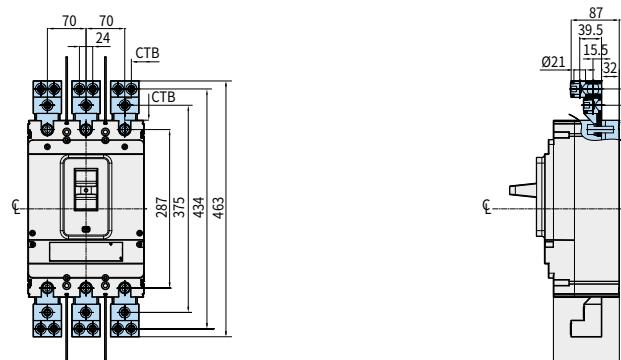


## Series Busbar(SBB) HGP250


• HGP100, 160, 250

### External Dimension


Unit : mm

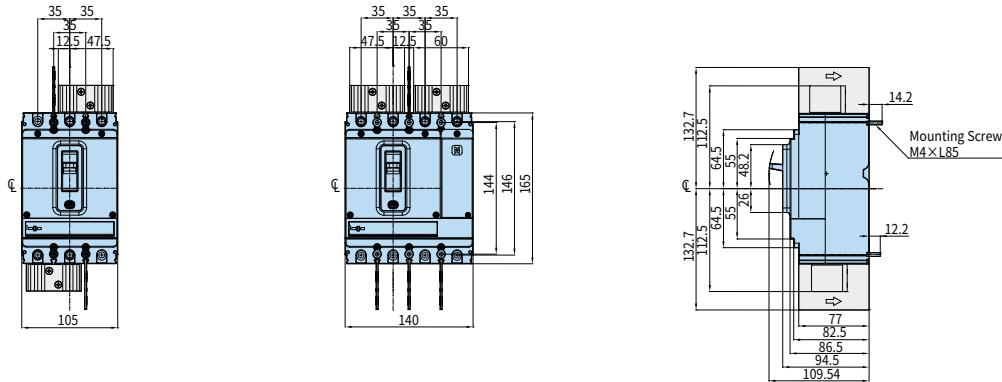

### Detail Drawing of Terminal Part

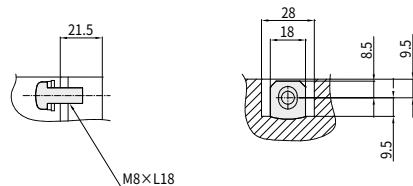

### Detail Drawing of SBB




## Series Busbar(SBB) HGP630


• HGP400, 630

### External Dimension


Unit : mm

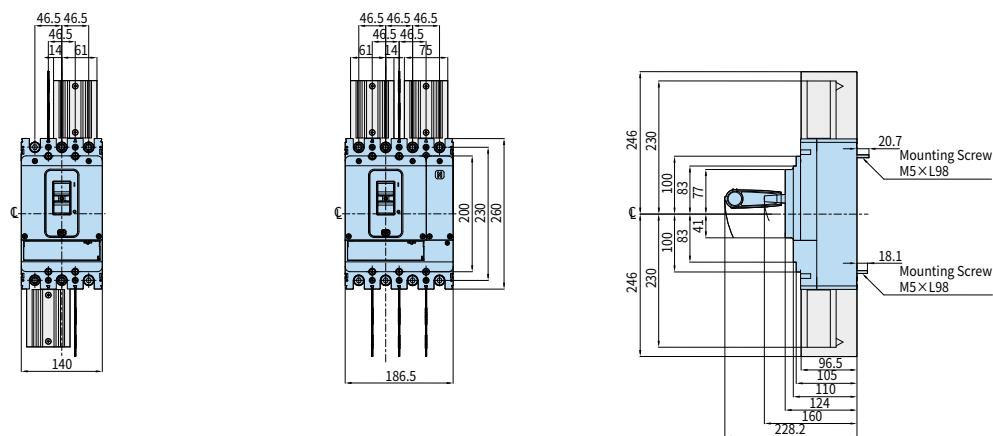

### Detail Drawing of Terminal Part

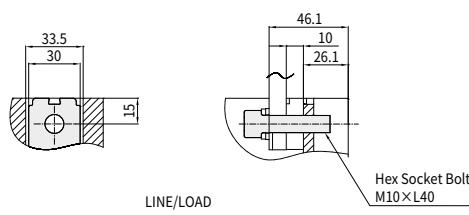

### Detail Drawing of SBB

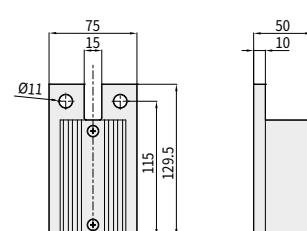

※ When installing the product in close contact, please consider tolerances for external dimensions.


## Dimensions

### Series Busbar(SBB) HGP800


• HGP800

#### External Dimension


Unit: mm

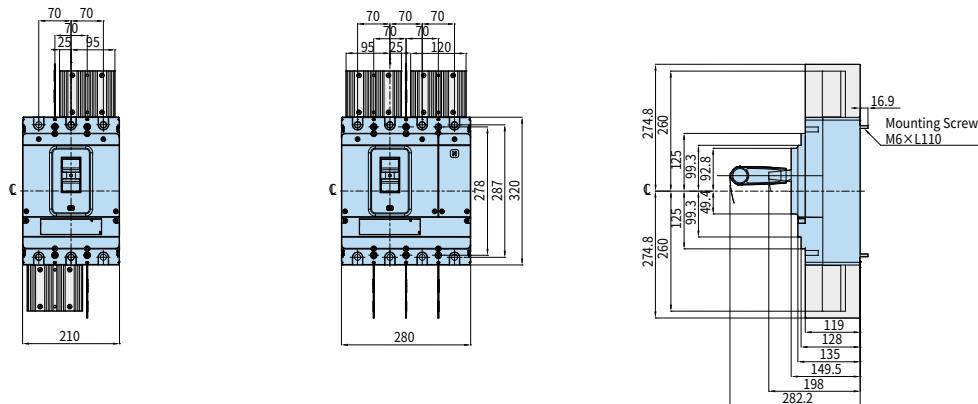

Detail Drawing of Terminal Part

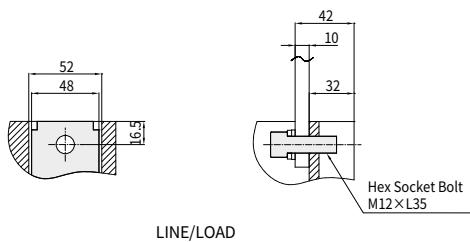

Detail Drawing of SBB

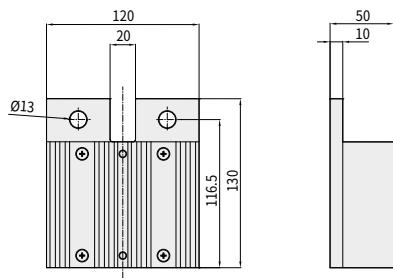


**DIN Rail Adaptor**

• HGM100

**Dimension of DIN Rail Mounting Hole**

Unit: mm

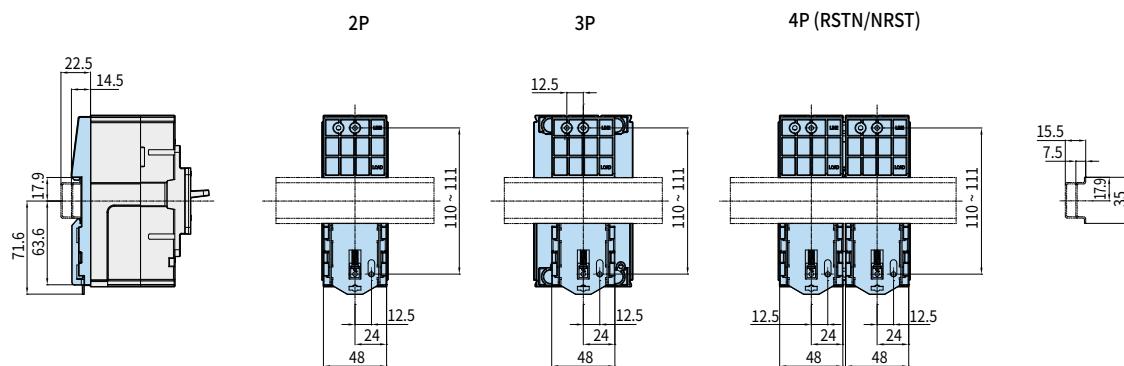

※ When assembling the DRA, remove the back barrier beforehand.  
 ※ When installing the product in close contact, please consider tolerances for external dimensions.

## Order Code

### HGM Type of Molded Case Circuit Breaker, Earth Leakage Circuit Breaker

| HGM        |                               | 50         |        | E                                    |                     | 3P  |               | T4                                 |                                   | S                 |  |
|------------|-------------------------------|------------|--------|--------------------------------------|---------------------|---|---------------|------------------------------------|-----------------------------------|-------------------|--|
| Model Name |                               | Frame Size |        | Short-Circuit Breaking Category Code |                     | No. of Poles (Category per Circuit Breaker) |               | Product Category                   |                                   | Connection Method |  |
| HGM        | Molded Case Circuit Breaker   | 30         | 32 AF  | E                                    | E Type              | General Type of MCCB/ELCB                   |               | MCCB : Ambient Temperature         |                                   | S                 | Front Connection                                 |
|            |                               | 50         | 50 AF  | S                                    | S Type              |   |               |                                    |                                   | BS <sup>3)</sup>  | Terminal Bus Bar (Straight Type)                 |
| HGE        | Earth Leakage Circuit Breaker | 60         | 63 AF  | H                                    | H Type              | 2P  | 2 Pole        | T4                                 | 40/45 °C                          | BE <sup>4)</sup>  | Terminal Bus Bar (Spreader Type)                 |
|            |                               | 100        | 100 AF | L                                    | L Type              | 3P  | 3 Pole        | T5                                 | 50 °C                             | P                 | Plug-in  |
|            |                               | 125        | 125 AF | NA                                   | Switch-Disconnector | 4P  | 4 Pole (RSTN) | ELCB : Adjustable Residual Current |                                   | F                 | Line Side : Plug-in Load Side : Front Connection |
|            |                               | 160        | 160 AF |                                      |                     | 4PN   | 4 Pole (NRST) | G4                                 | 30 mA                             | X                 | PC/CBM Not Attached                              |
|            |                               | 250        | 250 AF |                                      |                     | ZCT Embedded Type of MCCB                   |               | G5 <sup>1)</sup>                   | 100 mA                            |                   |  |
|            |                               | 400        | 400 AF |                                      |                     | 2Z  | 2 Pole        | Instantaneous Circuit Breaker      |                                   |                   |  |
|            |                               | 630        | 630 AF |                                      |                     | 3Z  | 3 Pole        | MO <sup>2)</sup>                   | Instantaneous Switch-Disconnector |                   |  |
|            |                               | 800        | 800 AF |                                      |                     | 4Z  | 4 Pole        | DS                                 | Switch-Disconnector               |                   |  |

※ 1) In case of 100/300/500/1,000 mA adjustable and time delay type, place order as 100 mA.

2) As for instantaneous products, only 3P can be ordered.

3) Only for 400 ~ 800 AF.

4) Only for 400 AF.

5) Rated current of instantaneous products : Above 40 A

| 00                      | 00              | C  | 00016        | F    |  |
|-------------------------|-----------------|--|--------------|------|--|
|                         |                 |  |              |      |  |
| Signal Device (AUX/ALT) |                 | Trip Device Characteristics<br>(Applicable To MCCB Only) |              |      |  |
| 00                      | Not Attached    | HGM/HGE 30 ~ 250 AF                                      | <b>00016</b> | 16 A | For Protecting Overload Short-Circuit            |
| 10                      | AUX 1C          | 00 Not Attached  | <b>00020</b> | 20 A | - Thermal Fixed/<br>Instantaneous Fixed          |
| 20                      | AUX 2C          | S1 SHT AC 100 - 120 V                                    |              |      | - Thermal Adjustable/<br>Instantaneous Fixed     |
| 01                      | ALT 1C          | S2 SHT AC 200 - 250 V                                    |              |      | <b>F</b> Instantaneous                           |
| 11                      | AUX 1C + ALT 1C | S3 -   |              |      | <b>B</b> Instantaneous Fixed ( $10 \times I_n$ ) |
| 21                      | AUX 2C + ALT 1C | S4 SHT AC 380 - 480 V                                    |              |      | Switch-Disconnector                              |
|                         |                 | S5 SHT DC 24 V   |              |      | - No Protection Function                         |
|                         |                 | S6 SHT DC 100 - 120 V                                    |              |      |  |
|                         |                 | S7 SHT DC 48 V   |              |      |  |
|                         |                 | S8 SHT DC 60 V   |              |      |  |
|                         |                 | S9 SHT DC 125 V  |              |      |  |
|                         |                 | U1 UVT AC 100 - 120 V                                    |              |      |  |
|                         |                 | U2 UVT AC 200 - 230 V                                    |              |      |  |
|                         |                 | U3 UVT AC 380 - 415 V                                    |              |      |  |
|                         |                 | U4 UVT AC 440 - 480 V                                    |              |      |  |
|                         |                 | U5 UVT DC 24 V   |              |      |  |
|                         |                 | U6 UVT DC 100 - 110 V                                    |              |      |  |
|                         |                 | U7 UVT DC 48 V   |              |      |  |
|                         |                 | HGM/HGE 400 ~ 800 AF                                     |              |      |  |
|                         |                 | 00 Not Attached  |              |      |  |
|                         |                 | S1 SHT AC 100 - 120 V                                    |              |      |  |
|                         |                 | S2 SHT AC 200 - 230 V                                    |              |      |  |
|                         |                 | S3 SHT AC 380 - 415 V                                    |              |      |  |
|                         |                 | S4 SHT AC 440 - 480 V                                    |              |      |  |
|                         |                 | S5 SHT DC 24 V   |              |      |  |
|                         |                 | S6 SHT DC 100 - 110 V                                    |              |      |  |
|                         |                 | U1 UVT AC 100 - 120 V                                    |              |      |  |
|                         |                 | U2 UVT AC 200 - 230 V                                    |              |      |  |
|                         |                 | U3 UVT AC 380 - 415 V                                    |              |      |  |
|                         |                 | U4 UVT AC 440 - 480 V                                    |              |      |  |
|                         |                 | U5 UVT DC 24 V   |              |      |  |
|                         |                 | U6 UVT DC 100 - 110 V                                    |              |      |  |

## Order Code

### HGP Type of Molded Case Circuit Breaker / Switch Disconnector

| HGP |   | 250                                     | X  | -G  | 3P           | T4  | S   |
|-----|---|---|--|---|--------------|---|---|
|     | Model Name  | Frame Size                              | Short-Circuit Breaking Category Code <sup>1)</sup> | Classification-250 AF   | No. of Poles | Product Category                              | Connection Method                                   |
| HGP | Molded Case Circuit Breaker / Earth Leakage Circuit Breaker | 50D 50 AF                               | AC   | -G<br>Classification-250 AF<br><br>-G <sup>2)</sup><br>New Type Terminal Height (21.5 mm) | 3P AC 3 pole | Molded Case Circuit Breaker                   | S Front Connection                                  |
|     | 125D 125 AF   | F <sup>8)</sup> 36 kA                   |  |   | 4P AC 4 pole | T4 <sup>9)</sup> Ambient Temperature of 40 °C | BS <sup>4)</sup> Straight Type of Bus Bar Packaging |
|     | 160D 160 AF   | S 65 <sup>6)</sup> /70 <sup>7)</sup> kA |  |   | D3 DC 3 pole | T5 Ambient Temperature of 50 °C               | BE <sup>4)</sup> Spreader Type of Bus Bar Packaging |
|     | 100 100 AF  | H 85 kA                                 |  |   | D4 DC 4 pole | Electronic <sup>3)</sup> Motor Protection     | P Plug-in PC/CBM Attached                           |
|     | 160 160 AF  | X 150 kA                                |  |   |              | Switch-Disconnector                           | F Line Side: Plug-in Load Side: Front Connection    |
|     | 250 250 AF  | NA Switch-Disconnector                  |  |   |              |   | X Plug-in PC/CBM Not Attached                       |
|     | 400 400 AF  | DC                                      |  |   |              |   |   |
|     | 630 630 AF  | F 10 kA                                 |  |   |              |   |   |
|     | 800 800 AF  | S 55 kA                                 |  |   |              |   |   |
|     |   | H 85 kA                                 |  |   |              |   |   |
|     |   | X 100 kA                                |  |   |              |   |   |

※ 1) Based on AC 440/460 V

2) Only applicable to mechanical type of HGP100, 160, 250 AC, DC (Can't be applicable to 50D, 125D, 160D, 250 of motor protection, etc)

3) 50D, 125D, 160D : Electronic type N/A

4) BS/BE : Applicable to both Line part/Load part

5) Applicable to HGP400 ~ 800

6) HGP50D, 125D, 160D, 100, 160, 250 AF

7) HGP400, 630, 800 AF

8) F type is for overseas and ship.

9) For DC products, only T4 is applicable.

10) Discontinued March 2020

| 00                      | 00              | C                     | 00016      | F   |
|-------------------------|-----------------|-----------------------|------------|---|
| Signal Device (AUX/ALT) |                 | Trip Device (SHT/UVT) | Frequency  | Trip Device Characteristics   |
| 00                      | Not Attached    |                       |            |   |
| 10                      | AUX 1C          | S1 SHT AC 100 - 120 V |            |   |
| 20                      | AUX 2C          | S2 SHT AC 200 - 230 V |            |   |
| 01                      | ALT 1C          | S3 SHT AC 380 - 415 V | C 50/60 Hz |   |
| 11                      | AUX 1C + ALT 1C | S4 SHT AC 440 - 480 V |            |   |
| 21                      | AUX 2C + ALT 1C | S5 SHT DC 24 V        |            |   |
| 31 <sup>5)</sup>        | AUX 3C + ALT 1C | S6 SHT DC 100 - 110 V |            |   |
| 32 <sup>5)</sup>        | AUX 3C + ALT 2C | U1 UVT AC 100 - 120 V | Z DC       |   |
|                         |                 | U2 UVT AC 200 - 230 V |            |   |
|                         |                 | U3 UVT AC 380 - 415 V |            |   |
|                         |                 | U4 UVT AC 440 - 480 V |            |   |
|                         |                 | U5 UVT DC 24 V        |            |   |
|                         |                 | U6 UVT DC 100 - 110 V |            |   |
|                         |                 |                       |            | Rated Current   |
|                         |                 |                       |            | 002.5 2.5 A   |
|                         |                 |                       |            | 006.3 6.3 A   |
|                         |                 |                       |            | 00800 800 A   |
|                         |                 |                       |            | For Protecting Overload Short-Circuit   |
|                         |                 |                       |            | - Thermal Fixed/Instantaneous Fixed (MTM - FF)                                    |
|                         |                 |                       |            | F Thermal Adjustable/Instantaneous Fixed (MTM - JF)                               |
|                         |                 |                       |            | H Thermal Adjustable/Instantaneous Adjustable (MTM - JJ)                          |
|                         |                 |                       |            | N Thermal Fixed/Instantaneous Fixed (MTM - FF) + 4P N Phase Protection            |
|                         |                 |                       |            | FN Thermal Adjustable/Instantaneous Fixed (MTM - JF) + 4P N Phase Protection      |
|                         |                 |                       |            | HN Thermal Adjustable/Instantaneous Adjustable (MTM - JJ) + 4P N Phase Protection |
|                         |                 |                       |            | Electronic  |
|                         |                 |                       |            | - Not Applicable (ETU)  |
|                         |                 |                       |            | Motor Protection  |
|                         |                 |                       |            | - No Thermal/Instantaneous Adjustable (MCP - OJ)                                  |
|                         |                 |                       |            | Switch-Disconnector   |
|                         |                 |                       |            | - No Protection Function (DSU)  |

## Order Code of Accessories

### HGM/HGE Type of Accessory Unit

#### HGM/HGE30, 50E/S, 60, 100

##### Connection Method

|                                |                          | 2 Pole            | 3 Pole   | 4 Pole            |
|--------------------------------|--------------------------|-------------------|--|-------------------|
| Plug-in                        | TDM (LINE/LOAD)          | -                 | TDM 10GM P3  | -                 |
|                                | TDM (LINE Only)          | -                 | TDM 10GM F3  | -                 |
|                                | TDF (LINE Only)          | -                 | TDF 10GM 3   | -                 |
|                                | TDA (1 row)              | -                 | TDA 10GM S3  | -                 |
|                                | TDA (2 rows)             | TDA 10GM D2       | TDA 10GM D3  | -                 |
| Conn. Block (CBM)              |                          | CBM 10GM 2P UNIT  | CBM 10GM UNIT  | -                 |
| CBB BLOCK UNIT                 |                          | -                 | CBB BLOCK UNIT<br>CBB BLOCK UNIT2C                               | -                 |
| CBB PLATE                      |                          | -                 | CBBPLATE 10GM  | -                 |
| PC MALE                        |                          | -                 | PCMALE 10GM 50 A ( $\leq$ 50 A)<br>PCMALE 10GM 100 A ( $>$ 50 A) | -                 |
| Terminal Busbar (TBB)          | Straight Busbar          | -                 | -  | -                 |
|                                | Spreader Busbar          | -                 | -  | -                 |
| Rear Connection Terminal (RCT) | LINE/LOAD ( $\leq$ 50 A) | RCT 05GM F2       | RCT 05GM F3  | RCT 05GM F4       |
|                                | LINE/LOAD ( $>$ 50 A)    | RCT 10GM F2       | RCT 10GM F3  | RCT 10GM F4       |
| Cage Terminal (CTB)            | ( $\leq$ 50 A) inch      | CTB 10GM 2S50     | CTB 10GM 3S50  | CTB 10GM 4S50     |
|                                | ( $>$ 50 A) inch         | CTB 10GM 2S100    | CTB 10GM 3S100   | CTB 10GM 4S100    |
|                                | ( $\leq$ 50 A) mm        | CTB 10GM 2S50-MM  | CTB 10GM 3S50-MM   | CTB 10GM 4S50-MM  |
|                                | ( $>$ 50 A) mm           | CTB 10GM 2S100-MM | CTB 10GM 3S100-MM  | CTB 10GM 4S100-MM |
| Din Rail Adaptor (DRA)         |                          | DRA 10GM          | DRA 10GM   | DRA 10GM          |

##### Internal Accessory

|                     | Auxiliary Switch (AUX)  | Alarm Switch (ALT)  | Auxiliary/Alarm (AXT)      |
|---------------------|---|---|----------------------------|
| Indication Contacts | AUX 10GM C1<br>AUX 10GM C2  | ALT 10GM L1<br>ALT 10GM R1  | AXT 10GM L1<br>AXT 10GM R1 |
|                     | Shunt Trip (SHT)  | Under-Voltage Trip (UVT)  |                            |
|                     | SHT 10GM DC 24 V<br>SHT 10GM DC 100 - 120 V<br>SHT 10GM DC 48 V<br>SHT 10GM DC 60 V<br>SHT 10GM DC 125 V<br>SHT 10GM AC 100 - 120 V<br>SHT 10GM AC 200 - 250 V<br>SHT 10GM AC 380 - 480 V | UVT 10GM DC 24 V<br>UVT 10GM DC 100 - 110 V<br>UVT 10GM DC 48 V<br>UVT 10GM AC 100 - 120 V<br>UVT 10GM AC 200 - 230 V<br>UVT 10GM AC 380 - 415 V<br>UVT 10GM AC 440 - 480 V |                            |
| Remote Tripping     |   |   | -                          |

##### External Accessory

|                              |                      | Front Contact (TFG) |             | Extension (TFH)          |                          |
|------------------------------|----------------------|---------------------|-------------|--------------------------|--------------------------|
|                              |                      | 2 Pole              |             | 3 Pole                   |                          |
|                              |                      | Upper Line          | TFG 10GM U  | TFG 10GM R               | TFG 10GM L               |
| Rotary Handle                | Right Line           | -                   | -           | -                        | TFH 10GM                 |
|                              | Left Line            | -                   | -           | -                        | TFH 10GM                 |
| Motor Operator <sup>1)</sup> |                      | -                   | -           | MOT 10GM DC 24 V         |                          |
|                              |                      | -                   | -           | MOT 10GM AC/DC 110 V     |                          |
|                              |                      | -                   | -           | MOT 10GM AC/DC 240 V     |                          |
| Terminal Cover               | Short                | TCF 10GM S2         | TCF 10GM S3 | TCF 10GM L3              | TCF 10GM S4              |
|                              | Long                 | TCF 10GM L2         | TCF 10GM L3 | TCF 10GM L4              | TCF 10GM L4              |
| Locking Device               | Padlock              | PLD 10GM            | PLD 10GM    | MIF 10GM 3               | PLD 10GM                 |
|                              | Mechanical Interlock | MIF 10GM 2          | MIF 10GM 3  | MIF 10GM 4 / MIF 10GM N4 | MIF 10GM 4 / MIF 10GM N4 |
|                              |                      | 2 Pole              | 3 Pole      | 4 Pole                   | 4 Pole RSTN / NRST       |
| Interpole Barrier            |                      | TQQ 10GM 2          | TQQ 10GM 3  | TQQ 10GM 4               | TQQ 10GM 4               |
| Auxiliary Handle             |                      |                     | -           | -                        | -                        |

<sup>※ 1)</sup> For HGM only.

**HGM/HGE50H/L, 125****Connection Method**

|                                |                 | 2 Pole         | 3 Pole                             | 4 Pole         |
|--------------------------------|-----------------|----------------|------------------------------------|----------------|
| Plug-in                        | TDM (LINE/LOAD) | -              | TDM 12GM P3                        | -              |
|                                | TDM (LINE Only) | -              | TDM 12GM F3                        | -              |
|                                | TDF (LINE Only) | -              | TDF 12GM 3                         | -              |
|                                | TDA (1 row)     | -              | TDA 12GM S3                        | -              |
|                                | TDA (2 rows)    | -              | TDA 12GM D3                        | -              |
| Conn. Block (CBM)              |                 | -              | CBM 10GM UNIT                      | -              |
| CBB BLOCK UNIT                 |                 | -              | CBB BLOCK UNIT<br>CBB BLOCK UNIT2C | -              |
| CBB PLATE                      |                 | -              | CBBPLATE 10GM                      | -              |
| PC MALE                        |                 | -              | PCMALLE 12GM                       | -              |
| Terminal Busbar (TBB)          | Straight Busbar | -              | -                                  | -              |
|                                | Spreader Busbar | -              | -                                  | -              |
| Rear Connection Terminal (RCT) | LINE/LOAD       | RCT 12GM F2    | RCT 12GM F3                        | RCT 12GM F4    |
| Cage Terminal (CTB)            | inch            | CTB 12GM 2S    | CTB 12GM 3S                        | CTB 12GM 4S    |
|                                | mm              | CTB 12GM 2S-MM | CTB 12GM 3S-MM                     | CTB 12GM 4S-MM |
| Din Rail Adaptor (DRA)         |                 | -              | -                                  | -              |

**Internal Accessory**

|                     | Auxiliary Switch (AUX)  | Alarm Switch (ALT)  | Auxiliary/Alarm (AXT)   |
|---------------------|---|---|---|
| Indication Contacts | AUX 10GM C1<br>AUX 10GM C2  | ALT 10GM L1<br>ALT 10GM R1  | AXT 10GM L1<br>AXT 10GM R1  |
|                     | <b>Shunt Trip (SHT)</b>   | <b>Under-Voltage Trip (UVT)</b>   |   |
|                     | SHT 10GM DC 24 V<br>SHT 10GM DC 100 - 120 V<br>SHT 10GM DC 48 V<br>SHT 10GM DC 60 V<br>SHT 10GM DC 125 V<br>SHT 10GM AC 100 - 120 V<br>SHT 10GM AC 200 - 250 V<br>SHT 10GM AC 380 - 480 V | UVT 10GM DC 24 V<br>UVT 10GM DC 100 - 110 V<br>UVT 10GM DC 48 V<br>UVT 10GM AC 100 - 120 V<br>UVT 10GM AC 200 - 230 V<br>UVT 10GM AC 380 - 415 V<br>UVT 10GM AC 440 - 480 V | UVT 10GM DC 24 V<br>UVT 10GM DC 100 - 110 V<br>UVT 10GM DC 48 V<br>UVT 10GM AC 100 - 120 V<br>UVT 10GM AC 200 - 230 V<br>UVT 10GM AC 380 - 415 V<br>UVT 10GM AC 440 - 480 V |
| Remote Tripping     |   |   | -   |

**External Accessory**

|                              | Front Contact (TFG)  | Extension (TFH)      |             |
|------------------------------|----------------------|----------------------|-------------|
| Rotary Handle                | Upper Line           | TFH 12GM             |             |
|                              | Right Line           | TFH 12GM             |             |
|                              | Left Line            | TFH 12GM             |             |
|                              | 2 Pole               | 3 Pole               | 4 Pole      |
| Motor Operator <sup>1)</sup> | -                    | MOT 12GM DC 24 V     |             |
|                              | -                    | MOT 12GM AC/DC 110 V |             |
|                              | -                    | MOT 12GM AC/DC 240 V |             |
| Terminal Cover               | Short                | TCF 12GM S3          | TCF 12GM S4 |
|                              | Long                 | TCF 12GM L3          | TCF 12GM L4 |
| Locking Device               | Padlock              | PLD 10GM             | PLD 10GM    |
|                              | Mechanical Interlock | MIF 12GM 2           | MIF 12GM 3  |
| Interpole Barrier            |                      | TQQ 10GM 2           | TQQ 10GM 3  |
| Auxiliary Handle             |                      |                      | TQQ 10GM 4  |

※ <sup>1)</sup> For HGM only.

## Order Code of Accessories

### HGM/HGE Type of Accessory Unit

#### HGM/HGE160, 250

##### Connection Method

|                                |                 | 2 Pole         | 3 Pole                             | 4 Pole         |
|--------------------------------|-----------------|----------------|------------------------------------|----------------|
| Plug-in                        | TDM (LINE/LOAD) | -              | TDM 25GM P3                        | -              |
|                                | TDM (LINE Only) | -              | TDM 25GM F3                        | -              |
|                                | TDF (LINE Only) | -              | -                                  | -              |
|                                | TDA (1 row)     | -              | -                                  | -              |
|                                | TDA (2 rows)    | -              | -                                  | -              |
| Conn. Block (CBM)              |                 | -              | CBM 10GM UNIT                      | -              |
| CBB BLOCK UNIT                 |                 | -              | CBB BLOCK UNIT<br>CBB BLOCK UNIT2C | -              |
| CBB PLATE                      |                 | -              | CBBPLATE 10GM                      | -              |
| PC MALE                        |                 | -              | PCMALE 25GM                        | -              |
| Terminal Busbar (TBB)          | Straight Busbar | TBB 25GP 2S    | TBB 25GP 3S                        | TBB 25GP 4S    |
|                                | Spreader Busbar | -              | TBB 25GP 3E45                      | TBB 25GP 4E45  |
| Rear Connection Terminal (RCT) | LINE/LOAD       | RCT 25GM F2    | RCT 25GM F3                        | RCT 25GM F4    |
| Cage Terminal (CTB)            | inch            | CTB 25GM 2S    | CTB 25GM 3S                        | CTB 25GM 4S    |
|                                | mm              | CTB 25GM 2S-MM | CTB 25GM 3S-MM                     | CTB 25GM 4S-MM |
| Din Rail Adaptor (DRA)         |                 | -              | -                                  | -              |

##### Internal Accessory

|                     | Auxiliary Switch (AUX)  | Alarm Switch (ALT)  | Auxiliary/Alarm (AXT)      |
|---------------------|---|---|----------------------------|
| Indication Contacts | AUX 10GM C1<br>AUX 10GM C2  | ALT 10GM L1<br>ALT 10GM R1  | AXT 10GM L1<br>AXT 10GM R1 |
|                     | Shunt Trip (SHT)  | Under-Voltage Trip (UVT)  |                            |
|                     | SHT 10GM DC 24 V<br>SHT 10GM DC 100 - 120 V<br>SHT 10GM DC 48 V<br>SHT 10GM DC 60 V<br>SHT 10GM DC 125 V<br>SHT 10GM AC 100 - 120 V<br>SHT 10GM AC 200 - 250 V<br>SHT 10GM AC 380 - 480 V | UVT 10GM DC 24 V<br>UVT 10GM DC 100 - 110 V<br>UVT 10GM DC 48 V<br>UVT 10GM AC 100 - 120 V<br>UVT 10GM AC 200 - 230 V<br>UVT 10GM AC 380 - 415 V<br>UVT 10GM AC 440 - 480 V |                            |
| Remote Tripping     |   |   |                            |

##### External Accessory

|                              | Front Contact (TFG)                   | Extension (TFH)                        |  |
|------------------------------|---------------------------------------|--|--|
|                              | 2 Pole                                | 3 Pole                                 | 4 Pole   |
| Rotary Handle                | Upper Line<br>Right Line<br>Left Line | TFG 25GM U<br>TFG 25GM R<br>TFG 25GM L | TFH 25GM<br>TFH 25GM<br>TFH 25GM                                 |
| Motor Operator <sup>1)</sup> |                                       | -                                      | MOT 25GM DC 24 V<br>MOT 25GM AC/DC 110 V<br>MOT 25GM AC/DC 240 V |
| Terminal Cover               | Short<br>Long                         | TCF 25GM S3<br>TCF 25GM L3             | TCF 25GM S4<br>TCF 25GM L4                                       |
| Locking Device               | Padlock<br>Mechanical Interlock       | PLD 10GM<br>MIF 25GM 3                 | PLD 10GM<br>MIF 25GM R4 / MIF 25GM N4                            |
| Interpole Barrier            |                                       | 2 Pole<br>TQQ 25GM 2                   | 3 Pole<br>TQQ 25GM 3   |
| Auxiliary Handle             |                                       |  | 4 Pole<br>TQQ 25GM 4   |

<sup>1)</sup> For HGM only.

**HGM/HGE400****Connection Method**

|                                |                 | 2 Pole      | 3 Pole                             | 4 Pole           |
|--------------------------------|-----------------|-------------|------------------------------------|------------------|
| Plug-in                        | TDM (LINE/LOAD) | -           | TDM 40GM P3                        | -                |
|                                | TDM (LINE Only) | -           | TDM 40GM F3                        | -                |
| Conn. Block (CBM)              |                 | -           | CBM 10GM UNIT                      | -                |
| CBB BLOCK UNIT                 |                 | -           | CBB BLOCK UNIT<br>CBB BLOCK UNIT2C | -                |
| CBB PLATE                      |                 | -           | CBBPLATE 40GM                      | -                |
| PC MALE                        |                 | -           | PCM40GM                            | -                |
| Terminal Busbar (TBB)          | Straight Busbar | TBB 40GM 2S | TBB 40GM 3S                        | TBB 40GM 4S      |
|                                | Spreader Busbar | -           | TBB 40GM 3E59                      | TBB 40GM 4E59    |
| Rear Connection Terminal (RCT) | LINE            | -           | RCT 40GM F3 LINE                   | RCT 40GM F4 LINE |
|                                | LOAD            | -           | RCT 40GM F3 LOAD                   | RCT 40GM F4 LOAD |
| Cage Terminal (CTB)            | 1 Hole          | -           | CTB 40GM 3S1H                      | CTB 40GM 4S1H    |
|                                | 2 Hole          | -           | CTB 40GM 3S                        | CTB 40GM 4S      |

**Internal Accessory**

|                     | Auxiliary Switch (AUX)  | Alarm Switch (ALT)       |
|---------------------|-------------------------|--------------------------|
| Indication Contacts | AUX 40GM C1             | ALT 40GM L1              |
|                     | Shunt Trip (SHT)        | Under-Voltage Trip (UVT) |
|                     | SHT 40GM DC 24 V        | UVT 40GM DC 24 V         |
|                     | SHT 40GM DC 100 - 110 V | UVT 40GM DC 100 - 110 V  |
| Remote Tripping     | SHT 40GM AC 100 - 120 V | UVT 40GM AC 100 - 120 V  |
|                     | SHT 40GM AC 200 - 230 V | UVT 40GM AC 200 - 230 V  |
|                     | SHT 40GM AC 380 - 415 V | UVT 40GM AC 380 - 415 V  |
|                     | SHT 40GM AC 440 - 480 V | UVT 40GM AC 440 - 480 V  |
|                     |                         |                          |
|                     |                         |                          |

**External Accessory**

|                              | Front Contact (TFG)  | Extension (TFH)      |                           |
|------------------------------|----------------------|----------------------|---------------------------|
| Rotary Handle                | Upper Line           | TFH 40GM             |                           |
|                              | Right Line           | TFH 40GM             |                           |
|                              | Left Line            | TFH 40GM             |                           |
|                              | 2 Pole               | 3 Pole               | 4 Pole                    |
| Motor Operator <sup>1)</sup> | -                    | MOT 40GM DC 24 V     |                           |
|                              | -                    | MOT 40GM AC/DC 110 V |                           |
|                              | -                    | MOT 40GM AC/DC 240 V |                           |
| Terminal Cover               | Short                | TCF 40GM S3          | TCF 40GM S4               |
|                              | Long                 | TCF 40GM L3          | TCF 40GM L4               |
| Locking Device               | Padlock              | PLD 40GM             | PLD 40GM                  |
|                              | Mechanical Interlock | MIF 40GM 3           | MIF 40GM R4 / MIF 40GM N4 |
| Interpole Barrier            |                      | TQQ 40GM 2           | TQQ 40GM 3                |
| Auxiliary Handle             |                      |                      | THA 48GM                  |

※ 1) For HGM only.

## Order Code of Accessories

### HGM/HGE Type of Accessory Unit

#### HGM/HGE630, 800

##### Connection Method

|                                |                 | 2 Pole   | 3 Pole   | 4 Pole   |
|--------------------------------|-----------------|--|--|--|
| Plug-in                        | TDM (LINE/LOAD) | -  | TDM 80GM P3  | -  |
|                                | TDM (LINE Only) | -  | TDM 80GP F3  | -  |
| Conn. Block (CBM)              |                 | -  | CBM 10GM UNIT  | -  |
| CBB BLOCK UNIT                 |                 | -  | CBB BLOCK UNIT<br>CBB BLOCK UNIT2C                   | -  |
| CBB PLATE                      |                 | -  | CBBPLATE 80GM  | -  |
| PC MALE                        |                 | -  | PCMALE 80GM  | -  |
| Terminal Busbar (TBB)          | Straight Busbar | TBB 63GM 2S (HGM/HGE630)<br>TBB 80GM 2S (HGM/HGE800) | TBB 63GM 3S (HGM/HGE630)<br>TBB 80GM 3S (HGM/HGE800) | TBB 63GM 4S (HGM/HGE630)<br>TBB 80GM 4S (HGM/HGE800) |
|                                | Spreader Busbar | -  | -  | -  |
| Rear Connection Terminal (RCT) | LINE            | -  | RCT 80GM F3 LINE                                     | RCT 80GM F4 LINE                                     |
|                                | LOAD            | -  | RCT 80GM F3 LOAD                                     | RCT 80GM F4 LOAD                                     |
| Cage Terminal (CTB)            |                 | -  | CTB 80GM 3S  | CTB 80GM 4S  |

##### Internal Accessory

|                     | Auxiliary Switch (AUX)  | Alarm Switch (ALT)       |
|---------------------|-------------------------|--------------------------|
| Indication Contacts | AUX 40GM C1             | ALT 40GM L1              |
|                     | Shunt Trip (SHT)        | Under-Voltage Trip (UVT) |
|                     | SHT 40GM DC 24 V        | UVT 40GM DC 24 V         |
|                     | SHT 40GM DC 100 - 110 V | UVT 40GM DC 100 - 110 V  |
| Remote Tripping     | SHT 40GM AC 100 - 120 V | UVT 40GM AC 100 - 120 V  |
|                     | SHT 40GM AC 200 - 230 V | UVT 40GM AC 200 - 230 V  |
|                     | SHT 40GM AC 380 - 415 V | UVT 40GM AC 380 - 415 V  |
|                     | SHT 40GM AC 440 - 480 V | UVT 40GM AC 440 - 480 V  |
|                     |                         |                          |
|                     |                         |                          |

##### External Accessory

|                              | Front Contact (TFG)  | Extension (TFH) |                           |
|------------------------------|----------------------|-----------------|---------------------------|
|                              | 2 Pole               | 3 Pole          | 4 Pole                    |
| Rotary Handle                | Upper Line           | TFG 80GM U      | TFH 80GM                  |
|                              | Right Line           | TFG 80GM R      | TFH 80GM                  |
|                              | Left Line            | TFG 80GM L      | TFH 80GM                  |
| Motor Operator <sup>1)</sup> |                      | -               | MOT 80GM DC 24 V          |
|                              |                      | -               | MOT 80GM AC/DC 110 V      |
|                              |                      | -               | MOT 80GM AC/DC 240 V      |
| Terminal Cover               | Short                | TCF 80GM S3     | TCF 80GM S4               |
|                              | Long                 | TCF 80GM L3     | TCF 80GM L4               |
| Locking Device               | Padlock              | PLD 40GM        | PLD 40GM                  |
|                              | Mechanical Interlock | MIF 80GM 3      | MIF 80GM R4 / MIF 80GM N4 |
| Interpole Barrier            | TQQ 40GM 2           | TQQ 40GM 3      | TQQ 40GM 4                |
| Auxiliary Handle             |                      | THA 48GM        |                           |

<sup>1)</sup> For HGM only.



## Order Code of Accessories

### HGP Type of Accessory Unit

**HGP50/125/160D**

#### Connection Method

| Plug-in                        |                                    | 3 Pole                             | 4 Pole      |
|--------------------------------|------------------------------------|------------------------------------|-------------|
| TDM (LINE/LOAD)                |                                    | TDM 16GP P3                        | -           |
| TDM (LINE Only)                |                                    | TDM 16GP F3                        | -           |
| Conn. Block (CBM)              |                                    | CBM 10GM UNIT                      | -           |
| CBB BLOCK UNIT                 |                                    | CBB BLOCK UNIT<br>CBB BLOCK UNIT2C | -           |
| CBB PLATE                      |                                    | CBBPLATE 16GP                      | -           |
| PC MALE                        |                                    | PCMALE 16GP                        | -           |
| Terminal Busbar (TBB)          | Straight Busbar<br>Spreader Busbar | -<br>-                             | -<br>-      |
| Rear Connection Terminal (RCT) | LINE/LOAD                          | RCT 16GP F3                        | RCT 16GP F4 |
| Cage Terminal (CTB)            |                                    | CTB 16GP 3                         | CTB 16GP 4  |

#### Internal Accessory

|                     | Auxiliary Switch (AUX)  | Alarm Switch (ALT)       |
|---------------------|-------------------------|--------------------------|
| Indication Contacts | AUX 16GP R1             | ALT 16GP L1              |
|                     | Shunt Trip (SHT)        | Under-Voltage Trip (UVT) |
|                     | SHT 16GP DC 24 V        | UVT 16GP DC 24 V         |
|                     | SHT 16GP DC 100 - 110 V | UVT 16GP DC 100 - 110 V  |
| Remote Tripping     | SHT 16GP AC 100 - 120 V | UVT 16GP AC 100 - 120 V  |
|                     | SHT 16GP AC 200 - 230 V | UVT 16GP AC 200 - 230 V  |
|                     | SHT 16GP AC 380 - 415 V | UVT 16GP AC 380 - 415 V  |
|                     | SHT 16GP AC 440 - 480 V | UVT 16GP AC 440 - 480 V  |

#### External Accessory

|                   | Extended (TFH)       | Front Contact (TFG)  | Extension (TFH) |
|-------------------|----------------------|----------------------|-----------------|
| Rotary Handle     | Upper Line           | TFG 16GP U           | TFH 16GP        |
|                   | Right Line           | TFG 16GP R           | TFH 16GP        |
|                   | Left Line            | TFG 16GP L           | TFH 16GP        |
| Motor Operator    |                      | 3 Pole / 4 Pole      |                 |
|                   |                      | MOT 16GP DC 24 V     |                 |
|                   |                      | MOT 16GP AC/DC 110 V |                 |
|                   |                      | MOT 16GP AC/DC 240 V |                 |
| Terminal Cover    | Short                | TCF 16GP S3          | -               |
|                   | Long                 | TCF 16GP L3          | TCF 16GP L4     |
| Locking Device    | Padlock              | PLD 16GP             | PLD 16GP        |
|                   | Mechanical Interlock | MIF 16GP 3           | MIF 16GP R4     |
| Interpole Barrier |                      | TQQ 16GP 3           | TQQ 16GP 4      |
| Auxiliary Handle  |                      |                      | -               |

**HGP100/160/250****Connection Method**

| Plug-in   |                                    | 3 Pole                               | 4 Pole                               |
|---|------------------------------------|--------------------------------------|--------------------------------------|
| TDM (LINE/LOAD)   |                                    | TDM 25GM P3                          | -                                    |
| TDM (LINE Only)   |                                    | TDM 25GM F3                          | -                                    |
| Conn. Block (CBM)   |                                    | CBM 10GM UNIT                        | -                                    |
| CBB BLOCK UNIT  |                                    | CBB BLOCK UNIT                       | -                                    |
| CBB PLATE   |                                    | CBBPLATE 25GP                        | -                                    |
| PC MALE   |                                    | PCMALE 25GP-G                        | -                                    |
| Terminal Busbar (TBB)                                     | Straight Busbar<br>Spreader Busbar | TBB 25GP 3S<br>TBB 25GP 3E45         | TBB 25GP 4S<br>TBB 25GP 4E45         |
| Rear Connection Terminal (RCT)                            | LINE/LOAD                          | RCT 25GP-G F3                        | RCT 25GP-G F4                        |
| Cage Terminal (CTB)                                       |                                    | CTB 25GP 3                           | CTB 25GP 4                           |
| Series Busbar (SBB)                                       |                                    | SBB 25 GP                            | SBB 25 GP                            |
| Terminal Height Compensation Terminal (STP) <sup>6)</sup> |                                    | STP 25GP-G 3T2.5<br>STP 25GP-G 3T4.5 | STP 25GP-G 4T2.5<br>STP 25GP-G 4T4.5 |

**Internal Accessory**

|                            |  | Auxiliary Switch (AUX)   | Alarm Switch (ALT)        |
|----------------------------|--|--|---------------------------|
| Indication Contacts        |  | AUX 16GP R1  | ALT 25GP L1               |
|                            |  | Shunt Trip (SHT)   | Under-Voltage Trip (UVT)  |
|                            |  | SHT 25GP-G DC 24 V   | UVT 25GP-G DC 24 V        |
| Remote Tripping            |  | SHT 25GP-G DC 100 - 110 V  | UVT 25GP-G DC 100 - 110 V |
|                            |  | SHT 25GP-G AC 100 - 120 V  | UVT 25GP-G AC 100 - 120 V |
|                            |  | SHT 25GP-G AC 200 - 230 V  | UVT 25GP-G AC 200 - 230 V |
|                            |  | SHT 25GP-G AC 380 - 415 V  | UVT 25GP-G AC 380 - 415 V |
|                            |  | SHT 25GP-G AC 440 - 480 V  | UVT 25GP-G AC 440 - 480 V |
| Electronic Internal Option | Indicator fault alarm LED<br>DC 24 V POWER CABLE <sup>2)</sup><br>DC 24 V TERMINAL BLOCK <sup>3)</sup><br>DC 3.6 V BATTERY | FAL 25GP <sup>1)</sup><br>PWC 25GP DC 24 V<br>TB 25GP DC 24 V<br>BAT 25GP 10 EA <sup>4)</sup><br>BAT 25GP 1 EA <sup>5)</sup> |                           |

**External Accessory**

|                            |                      | Front Contact (TFG)  | Extension (TFH) |
|----------------------------|----------------------|----------------------|-----------------|
| Rotary Handle              | Upper Line           | TFG 25GP U           | TFH 25GP        |
|                            | Right Line           | TFG 25GP R           | TFH 25GP        |
|                            | Left Line            | TFG 25GP L           | TFH 25GP        |
| Motor Operator             |                      | MOT 25GP DC 24 V     |                 |
|                            |                      | MOT 25GP AC/DC 110 V |                 |
|                            |                      | MOT 25GP AC/DC 240 V |                 |
| Terminal Cover             | Short                | TCF 25GP-G S3        | -               |
|                            | Long                 | TCF 25GP-G L3        | TCF 25GP-G L4   |
| Locking Device             | Padlock              | PLD 25GP             | PLD 25GP        |
|                            | Mechanical Interlock | MIF 25GP 3           | MIF 25GP R4     |
| Interpole Barrier          |                      | TQQ 25GP-G 3         | TQQ 25GP-G 4    |
| Auxiliary Handle           |                      | -                    | -               |
|                            |                      | TESTKIT 25GP         |                 |
| Electronic External Option | TEST KIT             | NFCMD 25GP           |                 |
|                            | NFC MODULE           |                      |                 |

\* <sup>1)</sup> FAL option for Electronic MCCB replace installation space of SHT/UVT 1 + AUX1 in MCCB internal accessory diagram of 81 page.

<sup>2)</sup> Applicable to ETU "A", "E" type only, length : 1.5 m

<sup>3)</sup> Applicable to ETU "A", "E" type only

<sup>4)</sup> 10 EA plastic wrapped

<sup>5)</sup> 1 EA plastic wrapped

<sup>6)</sup> Match of terminal height between old and new model (T2.5 : height 2.5 mm / T4.5 : height 4.5 mm, 3 Pole 3 EA / 4 Pole 4 EA)

<sup>7)</sup> 1 EA

## Order Code of Accessories

### HGP Type of Accessory Unit

#### HGP400/630

##### Connection Method

| Plug-in                        |                 | 3 Pole                             | 4 Pole           |
|--------------------------------|-----------------|------------------------------------|------------------|
| TDM (LINE/LOAD)                |                 | TDM 63GP P3                        | -                |
| TDM (LINE Only)                |                 | TDM 63GP F3                        | -                |
| Conn. Block (CBM)              |                 | CBM 10GM UNIT                      | -                |
| CBB BLOCK UNIT                 |                 | CBB BLOCK UNIT<br>CBB BLOCK UNIT2C | -                |
| CBB PLATE                      |                 | CBBPLATE 63GP                      | -                |
| PC MALE                        |                 | PCMALE 63GP                        | -                |
| Terminal Busbar (TBB)          | Straight Busbar | TBB 63GP 3S                        | TBB 63GP 4S      |
|                                | Spreader Busbar | TBB 63GP 3E61.5                    | TBB 63GP 4E61.5  |
| Rear Connection Terminal (RCT) | LINE            | RCT 63GP F3 LINE                   | RCT 63GP F4 LINE |
|                                | LOAD            | RCT 63GP F3 LOAD                   | RCT 63GP F4 LOAD |
| Cage Terminal (CTB)            |                 | CTB 63GP 3                         | CTB 63GP 4       |
| Series Busbar (SBB)            |                 | SBB 63 GP                          | SBB 63 GP        |

##### Internal Accessory

|                            | Auxiliary Switch (AUX)       | Alarm Switch (ALT)       |
|----------------------------|------------------------------|--------------------------|
| Indication Contacts        | AUX 63GP L1                  | ALT 63GP R1              |
|                            | Shunt Trip (SHT)             | Under-Voltage Trip (UVT) |
|                            | SHT 63GP DC 24 V             | UVT 63GP DC 24 V         |
|                            | SHT 63GP DC 100 - 110 V      | UVT 63GP DC 100 - 110 V  |
| Remote Tripping            | SHT 63GP AC 100 - 120 V      | UVT 63GP AC 100 - 120 V  |
|                            | SHT 63GP AC 200 - 230 V      | UVT 63GP AC 200 - 230 V  |
|                            | SHT 63GP AC 380 - 415 V      | UVT 63GP AC 380 - 415 V  |
|                            | SHT 63GP AC 440 - 480 V      | UVT 63GP AC 440 - 480 V  |
|                            | FAL 25GP <sup>1)</sup>       |                          |
| Electronic Internal Option | PWC 25GP DC 24 V             |                          |
|                            | TB 25GP DC 24 V              |                          |
|                            | BAT 25GP 10 EA <sup>4)</sup> |                          |
|                            | BAT 25GP 1 EA <sup>5)</sup>  |                          |

##### External Accessory

|                            | Front Contact (TFG)  | Extension (TFH) |
|----------------------------|----------------------|-----------------|
| Rotary Handle              | Upper Line           | TFH 63GP        |
|                            | Right Line           | TFH 63GP        |
|                            | Left Line            | TFH 63GP        |
|                            | 3 Pole/ 4 Pole       |                 |
| Motor Operator             | MOT 63GP DC 24 V     |                 |
|                            | MOT 63GP AC/DC 110 V |                 |
|                            | MOT 63GP AC/DC 240 V |                 |
|                            | 3 Pole               | 4 Pole          |
| Terminal Cover             | Short                | -               |
|                            | Long                 | TCF 63GP L4     |
| Locking Device             | Padlock              | PLD 63GP        |
|                            | Mechanical Interlock | MIF 63GP R4     |
| Interpole Barrier          |                      | TQQ 63GP 4      |
| Auxiliary Handle           |                      | THA 63GP        |
| Electronic External Option | TEST KIT             | TESTKIT 25GP    |
|                            | NFC MODULE           | NFCMD 25GP      |

※ 1) FAL option for Electronic MCCB replace installation space of SHT/UVT 1 + AUX1 in MCCB internal accessory diagram of 81 page.

2) Applicable to ETU "A", "E" type only, length : 1.5 m

3) Applicable to ETU "A", "E" type only

4) 10 Ea plastic wrapped

5) 1 Ea plastic wrapped

**HGP800****Connection Method**

| Plug-in                        |                                    | 3극                                   | 4극                                   |
|--------------------------------|------------------------------------|--------------------------------------|--------------------------------------|
| TDM (LINE/LOAD)                |                                    | TDM 80GP P3                          | -                                    |
| TDM (LINE Only)                |                                    | TDM 80GP F3                          | -                                    |
| Conn. Block (CBM)              |                                    | CBM 10GM UNIT                        | -                                    |
| CBB BLOCK UNIT                 |                                    | CBB BLOCK UNIT<br>CBB BLOCK UNIT2C   | -                                    |
| CBB PLATE                      |                                    | CBBPLATE 80GP                        | -                                    |
| PC MALE                        |                                    | PCMALLE 80GP                         | -                                    |
| Terminal Busbar (TBB)          | Straight Busbar<br>Spreader Busbar | TBB 80GP 3S<br>-                     | TBB 80GP 4S<br>-                     |
| Rear Connection Terminal (RCT) | LINE<br>LOAD                       | RCT 80GP F3 LINE<br>RCT 80GP F3 LOAD | RCT 80GP F4 LINE<br>RCT 80GP F4 LOAD |
| Cage Terminal (CTB)            |                                    | CTB 80GP 3                           | CTB 80GP 4                           |
| Series Busbar (SBB)            |                                    | SBB 80 GP                            | SBB 80 GP                            |

**Internal Accessory**

|                            | Auxiliary Switch (AUX)   | Alarm Switch (ALT)   |
|----------------------------|--|--|
| Indication Contacts        | AUX 63GP L1<br>Shunt Trip (SHT)<br>SHT 63GP DC 24 V<br>SHT 63GP DC 100 - 110 V<br>SHT 63GP AC 100 - 120 V<br>SHT 63GP AC 200 - 230 V<br>SHT 63GP AC 380 - 415 V<br>SHT 63GP AC 440 - 480 V | ALT 63GP R1<br>Under-Voltage Trip (UVT)<br>UVT 63GP DC 24 V<br>UVT 63GP DC 100 - 110 V<br>UVT 63GP AC 100 - 120 V<br>UVT 63GP AC 200 - 230 V<br>UVT 63GP AC 380 - 415 V<br>UVT 63GP AC 440 - 480 V |
| Remote Tripping            |  |  |
| Electronic Internal Option | Indicator fault alarm LED<br>DC 24 V POWER CABLE <sup>2)</sup><br>DC 24 V TERMINAL BLOCK <sup>3)</sup><br>DC 3.6 V BATTERY   | FAL 25GP <sup>1)</sup><br>PWC 25GP DC 24 V<br>TB 25GP DC 24 V<br>BAT 25GP 10 EA <sup>4)</sup><br>BAT 25GP 1 EA <sup>5)</sup>   |

**External Accessory**

|                            | Front Contact (TFG)                   | Extension (TFH)   |
|----------------------------|---------------------------------------|---|
| Rotary Handle              | Upper Line<br>Right Line<br>Left Line | TFH 80GP<br>TFH 80GP<br>TFH 80GP  |
| Motor Operator             |                                       | 3 Pole / 4 Pole<br>MOT 80GP DC 24 V<br>MOT 80GP AC/DC 110 V<br>MOT 80GP AC/DC 240 V |
| Terminal Cover             | Short<br>Long                         | 3 Pole<br>TCF 80GP S3<br>TCF 80GP L3  |
| Locking Device             | Padlock<br>Mechanical Interlock       | 4 Pole<br>PLD 80GP<br>MIF 80GP 3  |
| Interpole Barrier          |                                       | TQQ 80GP 3  |
| Auxiliary Handle           |                                       | THA 80GP  |
| Electronic External Option | TEST KIT<br>NFC MODULE                | TESTKIT 25GP<br>NFCMD 25GP  |

\* 1) FAL option for Electronic MCCB replace installation space of SHT/UVT 1 + AUX1 in MCCB internal accessory diagram of 81 page.

2) Applicable to ETU "A", "E" type only, length : 1.5 m

3) Applicable to ETU "A", "E" type only

4) 10 EA plastic wrapped

5) 1 EA plastic wrapped

## Handling and Maintenance Inspection

### Storage and Transportation

#### Storage Precaution

| Ambient Temperature | - 20 ~ + 60 °C

| Altitude | Below 1,000 m above sea level

| Relative Humidity | Within 45 % ~ 85 %

The surrounding environment may affect the insulation function and Endurance of the molded case and earth leakage circuit breakers so the environment condition for usage must accurately be checked before application.



- Do not store in places with corrosive gas  
Do not leave it around gas containing sulfurous gas or sulfur or ammonia gas and others.



- Do not store in places with high humidity for a long period of time



- Do not leave under direct sunlight for a long period of time.



- Avoid places with a lot of dust  
Do not store in exposed places and use cover or packing material to prevent dust from piling up on the circuit breaker.



- Avoid storage in high or low temperature  
Storage temperature must be maintained between - 20 °C ~ + 60 °C.  
(Exceptionally, the HGM/HGP-MCCB in the original packing can be stored up to - 40 °C.)

#### Transportation Precautions

##### Caution

- Do not apply impact during transportation. Dropping or applying strong impact may cause defect.
- Do not handle while holding the circuit breaker's accessory or the external plug-in wire of the accessory. It may cause injury in the handler or a malfunction of the circuit breaker.




- Hold the main unit of the circuit breaker during transportation  
Do not handle while holding the external guide line of the accessory or the terminal bar.



- Pay attention when handling metal accessories  
Sharp planes or edges in the metal accessory may cause injury.



- Do not apply impact during transportation  
Dropping or applying strong impact may cause defect.




- Pay attention to the packaging of the circuit breaker before transportation  
Inappropriate packaging may cause damage in the circuit breaker during transportation.

## Installation

As for the detailed dimension of each part required for installation, refer to the external structure.

### ⚠ Caution

- Electrical works shall only be conducted by a person qualified for electrical works.
- For wiring works, the upper circuit breaker must be cut off (OFF) and execute the work after checking that it is not charged.
- In case of disconnecting cable or terminal bar, tighten the terminal screw firmly at the standard tightening torque.  
In case the terminal screw is tightened loosely, it may cause damage and fire due to overheating.
- Strictly insulate up to the circuit breaker's portion with terminal barrier, insulating tube, insulating tape and others between bare conductors with regards to the front connection of the circuit breaker.  
In case it is not insulated, it may cause short circuit.

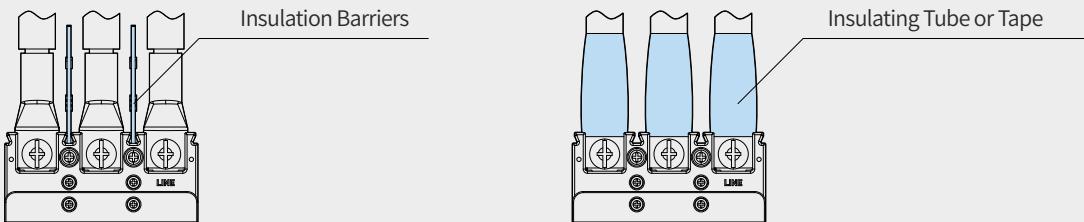

- Secure sufficient arc space (Insulation distance) so that the arc gas discharge outlet is not blocked.  
In case this discharge outlet is blocked, the current may not be blocked.
- Do not install the circuit breaker in abnormal environment such as high temperature, high humidity, dust, corrosive gas, vibration, impact and others. It may cause fire or abnormal trip.
- Install so that foreign substances (Metal powder, concrete powder etc.), rainwater and others do not enter the circuit breaker.  
Such foreign substances in the circuit breaker may cause fire or malfunction.
- In case of 4 pole circuit breaker, the neutral wire of 3 phase 4 wire must be connected to the N phase (Right end part of the circuit breaker).
- When mounting the product, the live part (LINE) signal must be connected to the live part and the load part (LOAD) signal must be connected to the load part. Wrong connection may cause damage in product and electric shock.
- In case the insulation barrier is not mounted between the circuit breaker terminals, it may cause secondary short-circuit accidents so it must be used.

## Handling and Maintenance Inspection

### Installation

#### Installation Precautions

- Install the circuit breaker in a place that satisfies the following environment conditions

Installing the circuit breaker in places and environment other than the following may cause malfunction of circuit breaker, fire and others.

- Ambient temperature should be within -5 °C to +40 °C degrees.  
(However, the 24-hour average temperature must not exceed 35 °C. If the ambient temperature is -40 °C to -5 °C, the HGM/HGP MCCB can be used under limited conditions.)
- Relative humidity to be within 45 ~ 85 %
- Excessive vibration or impact to be avoided
- True height to be below 2,000 m
- To be used in an environment without excessive water vapor, oil vapor, smoke, dust, alkaline, corrosive material and others
- To avoid direct sunlight



- Arc gas exhaust hole must not be blocked  
It may drop the breaking capacity.



- Attention to be paid to dust, metal fragments and others  
After installation, protection cover and covers to be covered during work



- The insulation plate attached to the bottom of the circuit breaker must not be separated  
It may destroy insulation and drop the insulation performance.

#### Connection Precautions



- When fastening the terminal screw, it should be fastened according to the specified torque  
Incomplete fastening of terminal screw may cause overheating so each terminal screw must be fastened completely according to the specified torque. In addition, excessive fastening torque may cause damage in the terminal screw and the circuit breaker case.



- Use of lubricant at the terminal screw part is prohibited  
Lubricant reduces the friction of the screw, causing the screw to loosen, ultimately leading to an increase in temperature.



- Exposed conductor must be insulated  
Insulating tube or insulating tape must be used for complete insulation between the bare conductors of the MCCB.  
In case the terminals are not insulated, it may cause secondary short-circuit during short-circuit accidents.



- Stud must not be deformed  
Excessive force must not be applied to the stud at the conductor connecting part of the rear connection type.  
In addition, stud must not be deformed during wiring.



- In case of 4 pole circuit breaker, the neutral wire of 3 phase 4 wire must be connected to the N phase.  
It may not function in overcurrent which may cause fire.



- The conductor must be fixed firmly on a flat state.  
As for the connecting conductor, electromagnetic force between conductors is generated by extremely big fault current so it must be fixed firmly.

## Connection Precautions


The following table is the impact electromagnetic force generated by fault current.

### Impact Electromagnetic Force per 1 m Conductor

| Regulated Short-Circuit Current kA<br>(Power Factor) | Electromagnetic Force (In Case of 3 Phase Short Circuit) N (kgf) |                          |
|--|--|--------------------------|
|  | 10 cm Conductor Interval   | 20 cm Conductor Interval |
| 10 (0.4)   | 490 (50)   | 245 (25)                 |
| 18 (0.3)   | 1,863 (190)  | 932 (95)                 |
| 25 (0.2)   | 4,412 (450)  | 2,206 (225)              |
| 35 (0.23)  | 8,630 (880)  | 4,315 (440)              |
| 42 (0.2)   | 12,455 (1,270)   | 6,277 (635)              |
| 50 (0.2)   | 17,652 (1,800)   | 8,826 (900)              |
| 65 (0.2)   | 29,910 (3,050)   | 14,955 (1,525)           |
| 85 (0.2)   | 51,190 (5,220)   | 25,595 (2,510)           |
| 100 (0.2)  | 70,804 (7,220)   | 35,402 (3,610)           |
| 125 (0.2)  | 110,815 (11,300)   | 55,408 (5,650)           |


- Contact surface must be clean**

Dust and others must be removed from the contact surface to prevent increase in connection resistance at the contact surface.



- Conductor must be connected so that it has direct contact with the contact surface**

Do not use bolt or nut between the contact surfaces of the conductor.  
If there is no direct contact between conductors, it may cause increase in temperature and fire.



- Do not overlap the conductors**

When numerous conductors are connected to the terminal bar, do not overlap and assemble.  
Assemble at both ends of the terminal bar.

## Maintenance Inspection

### Initial Inspection

- Residues of steel plate, grinded materials of the wire, other conductor's foreign substances and others must not be left around the terminal of the circuit breaker
- There must be no crack and damage in the cover and base
- The fastening status of the terminal fastening part must be checked
- Check must be made if the rated voltage and breaking capacity of the circuit breaker are correct
- When the insulation resistance is measured using a 500 V insulation-resistance tester, it must be above  $5\text{ M}\Omega$

### Withstand Voltage

| Main Circuit                 |  | Auxiliary Circuit or Control Circuit <sup>1)</sup> |  |
|------------------------------|--|--|--|
| Rated Insulation Voltage     | Test Voltage<br>(Effective Value of Interchange) | Rated Insulation Voltage of<br>Operational Circuit | Test Voltage<br>(Effective Value of Interchange) |
| $Ui \leq 300\text{ V}$       | 2,000 V for 1 min                                | $U_{is} \leq 60\text{ V}$                          | 1,000 V for 1 min                                |
| $300 < Ui \leq 600\text{ V}$ | 2,500 V for 1 min                                | $60\text{ V} < U_{is} \leq 600\text{ V}$           | $2 \cdot U_{is}$ 1,000 V (최소 1,500 V) for 1 min  |

※ Based on the above mentioned table, do not conduct withstand voltage test above it.

<sup>1)</sup> Between terminal and grounding

# Handling and Maintenance Inspection

## Installation

### Regular Inspection

Inspection shall be conducted once in 1 month before/after the commencement of the equipment operation in order to maintain the performance of the circuit breaker and to prevent unexpected accidents. After that, regular inspection is required depending on the environment.

#### Standard of Inspection Period

| Extent               | Environment  | Standard of Inspection Period   |
|----------------------|--|---|
| Standard Usage State | Clean and dry state of air   | Less than 10 years after installation - Once in 2 ~ 3 years<br>More than 10 years after installation - Once a year<br>More than 15 years after installation - Once in 6 months<br>Less than 10 years after installation - Once a year |
|                      | Place without corrosive gas even though there is dust inside                 | More than 10 years after installation - Once in 6 months<br>More than 15 years after installation - Once a month  |
|                      | Place containing sulfuric acid, hydrogen sulfide, salinity, vapor and others | Less than 5 years after installation - Once in 6 months<br>More than 5 years after installation - Once a year   |
|                      | Places with specially more corrosive gas                                     | Once a month  |

#### Regular Inspection Item

| Inspection Item                | Procedure  | Countermeasure   |
|--------------------------------|--|--|
| Tightening of Terminal Screw   | • Inspect tightening of terminal screw, conductor connecting screw   | • Tighten according to the specified torque<br>Ensure that it is not tightened excessively   |
| Dust and Foreign Substance     | • Check for foreign substance such as dust on the circuit breaker's surface, especially the top of the live part. There must be no dust or foreign substance to secure insulation distance   | • Remove dust, foreign substance and others using cloth with clean surface types (Do not use thinner or detergent)   |
| Damage in Mold Case            | • Check for damage or crack on the circuit breaker's cover and base  | • Replace circuit breaker  |
| Arc Exhaust Hole               | • Check for pollution in the arc exhaust hole  | • If there are burns or excessive pollution due to melted metal particles and others, replace the circuit breaker  |
| Switch Operation               | • If the circuit breaker was maintained at closed state at normal times, operate the switch multiple times. Friction caused by hardened grease and others will be reduced and the contact resistance can be stabilized<br>• Press the trip button to trip the circuit breaker multiple times | • If there is a problem in the switch operation of the circuit breaker, replace or contact the nearest store<br>• If the specified limit value of the switch operation has exceeded, replace |
| Discoloration of Terminal Part | • Check for severe discoloration in the terminal part or conductor part<br>• If there is severe discoloration in the copper conductor or silver coated part, check the insulation performance caused by thermal damage   | • Slight discoloration in the silver coated part is not a problem.<br>If there is a problem in insulation due to thermal damage, replace the circuit breaker                                 |
| Insulation Resistance          | • Separate all conductors connected to the circuit breaker and measure the insulation resistance between the poles, terminals and groundings   | • If the insulation resistance is not more than 5 MΩ, replace  |

#### Inspection and Processing after Blocking Fault Current

In case the circuit breaker has blocked the fault current, determine whether it can be re-used or whether it has to be replaced with a new product depending on the size of the fault current.

- In case the arc exhaust hole is not polluted or there are no other abnormalities, it can be reused.
- In case there is pollution such as dark burns around the arc exhaust hole and in case the insulation resistance is above 5 MΩ, there is no dielectric breakdown when the specified withstand voltage is applied and in case there is no excessive temperature increase in the terminal part, it can be reused.
- If there are burns at the handle part, severe pollution around the arc exhaust hole, melted metal particles and others, replace the circuit breaker immediately.

### Countermeasures with Regards to Abnormal Phenomenon

In case there is abnormal phenomenon during the use of circuit breakers, take appropriate action according to the following table.

| Type of Abnormality           | Phenomenon  | Assumed Cause   | Action to be Taken  |
|-------------------------------|---|---|---|
| Abnormal Heating              | Heating at terminal part  | <ul style="list-style-type: none"> <li>• Loose terminal screw, conductor connecting screw</li> <li>• Increased resistance of contact</li> </ul>   | Re-tighten according to the specified torque<br>Replace circuit breaker   |
|                               | Damage in insulation material at terminal part                      | <ul style="list-style-type: none"> <li>• Defect in contact between circuit breaker's terminal and terminal bar or cable lugs due to loose screw tightening and interference caused by foreign substance</li> </ul>  | Replace circuit breaker   |
|                               | Abnormal heating in the circuit breaker's external case             | <ul style="list-style-type: none"> <li>• Increased resistance of contact</li> <li>• Loosening at the internal connection part</li> <li>• Increased current density due to disconnection</li> <li>• Big consumption at contact</li> </ul>  | Replace circuit breaker   |
| Defect in Current Flow        | Abnormal voltage at load side                                       | <ul style="list-style-type: none"> <li>• Foreign substance between contacts</li> <li>• Fusing at conductive part (Excessive opening/closing and corrosion due to corrosive gas)</li> </ul>  | Replace circuit breaker   |
|                               |   | <ul style="list-style-type: none"> <li>• No reset in trip state</li> <li>• Damage in trip mechanism due to excessive opening/closing</li> <li>• Demagnetized state of under-voltage trip device</li> <li>• Fusing at contact</li> </ul>   | ON after reset<br>Replace circuit breaker<br>Apply specified voltage<br>Replace circuit breaker                                       |
|                               | OFF does not function   | <ul style="list-style-type: none"> <li>• Demagnetized state of under-voltage trip device</li> <li>• Bimetal has not been cooled sufficiently</li> <li>• Corrosion or deformation of bimetal</li> <li>• Abnormality in mechanism</li> <li>• Can't be used due to excessive opening/closing</li> <li>• Damage in mechanism due to excessive breaking current</li> </ul> | Apply specified voltage<br>Reset after sufficient cooling   |
|                               |   | <ul style="list-style-type: none"> <li>• High ambient temperature (Above 40 °C)</li> </ul>  | Replace circuit breaker   |
| Frequent Breaking             | Trip under rated current  | <ul style="list-style-type: none"> <li>• Abnormal heating due to loosening of screw at terminal part</li> <li>• Internal heating at the circuit breaker</li> <li>• In case the cross sectional area of connecting conductor is smaller than the regulation</li> </ul>   | Lower the ambient temperature using wind and others<br>Re-tighten according to the specified torque<br>Replace circuit breaker        |
|                               |   | <ul style="list-style-type: none"> <li>• Trip in running inrush current</li> <li>• Trip during switching at Y-Δ operation</li> <li>• Trip during switching in reversible operation</li> </ul>   | Change the connecting conductor or change the circuit breaker's rated current   |
|                               | Trip in running current   | <ul style="list-style-type: none"> <li>• Trip in big running current</li> <li>• Trip in long running current</li> <li>• Short circuit between motor layer</li> <li>• Wrong connection of SHT/UVT's operational circuit</li> </ul>   | Change the instantaneous trip current setting or replace with circuit breaker with bigger rated current                               |
| Overcurrent does Not Function | Does not function above specified operational current               | <ul style="list-style-type: none"> <li>• When current limiting breaking of upper fuse or cooperation with upper circuit breaker is low</li> <li>• When the ambient temperature is significantly low</li> <li>• Inappropriate rated current</li> </ul>   | Replace with circuit breaker with bigger rated current<br>Review cooperation again  |
|                               |   | <ul style="list-style-type: none"> <li>• Abnormal voltage of operational circuit</li> <li>• Does not function due to voltage drop in operational circuit</li> <li>• Coil damage due to difference in the coil's rated voltage, non-operation of damage prevention switch and others</li> </ul>  | Check the compensating current<br>Check the rated current<br>Check the rated voltage<br>Inspect wiring                                |
| Abnormality in Accessory      | Abnormal operation of shunt trip device (SHT)                       | <ul style="list-style-type: none"> <li>• Defect in mechanism</li> </ul>   | Maintain the rated voltage  |
|                               | Abnormal operation of under-voltage trip device (UVT)               | <ul style="list-style-type: none"> <li>• Difference in voltage used</li> <li>• Damage in UVT controller</li> </ul>  | Replace accessory   |
|                               |   | <ul style="list-style-type: none"> <li>• Contact damage due to excessive micro switch rating</li> </ul>   | Replace accessory   |
|                               | Abnormal operation of auxiliary switch (AUX) and alarm switch (ALT) | <ul style="list-style-type: none"> <li>• Defect in mechanism</li> </ul>   | Check the rated voltage<br>Replace and check disconnection<br>Replace and check the micro switch load<br>Replace and repair accessory |

## Current Status of Acquired Standards

### Approvals & Certificates

#### MCCB

| Type of Certification | Approvals   |   |   | Certificates  |   |
|-----------------------|---|---|---|---|---|
| Type of Standard      | Safety Certificate  | KS  | IEC   | GB  | DEKRA   |
| Mark                  |  |  |  |  |  |
| Testing Institute     | KETI  | KS  | CE  | GB 1984   | DEKRA   |
| Certification Country | Korea   | Korea   | Europe  | China   | Netherlands   |
| HGM30                 | E<br>S  | ●<br>●  | ●<br>●  | ●<br>●  | ●<br>●  |
| HGM50                 | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  |
| HGM60                 | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  |
| HGM100                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  |
| HGM125                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  |
| HGM160                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  |
| HGM250                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  |
| HGM400                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  |
| HGM630                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  |
| HGM800                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●  |

## Approvals & Marine Certificates

MCCB

## Current Status of Acquired Standards

### Approvals & Certificates

#### ELCB

| Type of Certification | Approvals   |   |  | Certificates  |
|-----------------------|---|---|--|---|
| Type of Standard      | Safety Certificate  | KS  | IEC  | IEC   |
| Mark                  |  |  |  |  |
| Testing Institute     | KETI  | KS  | CE   | DEKRA   |
| Certification Country | Korea   | Korea   | Europe   | Netherlands   |
| HGE30                 | E<br>S  | ●<br>●  | ●<br>●   | ●<br>●  |
| HGE50                 | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●   | ●<br>●<br>●<br>●  |
| HGE60                 | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●   | ●<br>●<br>●<br>●  |
| HGE100                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●   | ●<br>●<br>●<br>●  |
| HGE125                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●   | ●<br>●<br>●<br>●  |
| HGE160                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●   | ●<br>●<br>●<br>●  |
| HGE250                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●   | ●<br>●<br>●<br>●  |
| HGE400                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●   | ●<br>●<br>●<br>●  |
| HGE630                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●   | ●<br>●<br>●<br>●  |
| HGE800                | E<br>S<br>H<br>L  | ●<br>●<br>●<br>●  | ●<br>●<br>●<br>●   | ●<br>●<br>●<br>●  |

## Approvals & Certificates

### MCCB

| Type of Certification | Approvals   |   |   |   | Certificates  |
|-----------------------|---|---|---|---|---|
| Type of Standard      | Safety Certificate  | KS  | IEC   | GB  | IEC   |
| Mark                  |  |  |  |  |  |
| Testing Institute     | KETI  | KS  | CE  | GB  | DEKRA   |
| Certification Country | Korea   | Korea   | Europe  | China   | Netherlands   |
| F*                    |   |   | ●   | ●   | ●   |
| HGP50D                | ●   | ●   | ●   | ●   | ●   |
| H                     | ●   | ●   | ●   | ●   | ●   |
| X                     | ●   | ●   | ●   | ●   | ●   |
| F*                    |   |   | ●   | ●   | ●   |
| HGP125D               | ●   | ●   | ●   | ●   | ●   |
| H                     | ●   | ●   | ●   | ●   | ●   |
| X                     | ●   | ●   | ●   | ●   | ●   |
| F*                    |   |   | ●   | ●   | ●   |
| HGP160D               | ●   | ●   | ●   | ●   | ●   |
| H                     | ●   | ●   | ●   | ●   | ●   |
| X                     | ●   | ●   | ●   | ●   | ●   |
| F*                    |   |   | ●   | ●   | ●   |
| HGP100                | ●   |   | ●   | ●   | ●   |
| H                     | ●   |   | ●   | ●   | ●   |
| X                     | ●   |   | ●   | ●   | ●   |
| F*                    |   |   | ●   | ●   | ●   |
| HGP160                | ●   |   | ●   | ●   | ●   |
| H                     | ●   |   | ●   | ●   | ●   |
| X                     | ●   |   | ●   | ●   | ●   |
| F*                    |   |   | ●   | ●   | ●   |
| HGP250                | ●   |   | ●   | ●   | ●   |
| H                     | ●   |   | ●   | ●   | ●   |
| X                     | ●   |   | ●   | ●   | ●   |
| F*                    |   |   | ●   | ●   | ●   |
| HGP400                | ●   | ●   | ●   | ●   | ●   |
| H                     | ●   | ●   | ●   | ●   | ●   |
| X                     | ●   | ●   | ●   | ●   | ●   |
| F*                    |   |   | ●   | ●   | ●   |
| HGP630                | ●   | ●   | ●   | ●   | ●   |
| H                     | ●   | ●   | ●   | ●   | ●   |
| X                     | ●   | ●   | ●   | ●   | ●   |
| F*                    |   |   | ●   | ●   | ●   |
| HGP800                |   | ●   | ●   | ●   | ●   |
| S                     |   | ●   | ●   | ●   | ●   |
| H                     |   | ●   | ●   | ●   | ●   |
| X                     |   | ●   | ●   | ●   | ●   |

\* F type is for overseas sales.

\* Please refer to the certificate for specifications of certified products.

## Current Status of Acquired Standards

### Approvals & Marine Certificates

#### MCCB

| Type of Certification | Vessel  |   |   |   |   |   |   |   |
|-----------------------|---|---|---|---|---|---|---|---|
| Type of Standard      | Korea   | U.K.  | France  | U.S.A   | Germany   | Italy   | Japan   | Russia  |
| Mark                  |  |  |  |  |  |  |  |  |
| Testing Institute     | KR  | LR  | BV  | ABS   | DNV·GL  | RINA  | NK  | RMRS  |
| Certification Country | Korea   | U.K.  | France  | USA   | Germany   | Italy   | Japan   | Russia  |
| HGP50D                | F*  | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | S   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | H   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | X   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
| HGP125D               | F*  | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | S   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | H   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | X   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
| HGP160D               | F*  | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | S   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | H   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | X   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
| HGP100                | F*  | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | S   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | H   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | X   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
| HGP160                | F*  | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | S   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | H   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | X   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
| HGP250                | F*  | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | S   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | H   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | X   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
| HGP400                | F*  | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | S   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | H   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | X   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
| HGP630                | F*  | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | S   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | H   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | X   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
| HGP800                | F*  | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | S   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | H   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |
|                       | X   | ●   | ●   | ●   | ●   | ●   | ●   | ●   |

\* F type is for overseas sales.



## HYUNDAI ELECTRIC

---

### Korea

---

|                       |   |                              |                        |
|-----------------------|---|------------------------------|------------------------|
| <b>Head Office</b>    | Hyundai Bldg, 75, Yulgok-ro, Jongno-gu, Seoul, Korea  |                              |                        |
| <b>Sales Office</b>   | 5th Floor 55, Bundang-ro, Bundang-gu, Seongnam-si,<br>Gyeonggi-do, Korea                            | Tel : +82-31-8006-6780, 6786 | Fax : +82-31-8006-6629 |
| <b>Factories</b>      | 700, Bangeojinsunhwan-doro, Dong-gu, Ulsan, Korea<br>223, Sapyong-ro, Nam-gu, Ulsan, Korea (Seonam) |                              |                        |
| <b>R&amp;D Center</b> | 17-10, Mabuk-ro 240beon-gil, Mabuk-ro, Giheung-gu,<br>Yongin-si, Korea                              |                              |                        |

---

### Branch Offices

---

|                  |  |                         |                       |
|------------------|--|-------------------------|-----------------------|
| <b>Atlanta</b>   | 6100 Atlantic Boulevard, 2nd FL., Norcross, GA30071, U.S.A   | Tel : +1-678-823-7839   | Fax : +1-678-823-7553 |
| <b>Osaka</b>     | 5th Floor Nagahori Plaza Bldg. 2-4-8 Minami Senba, Chuo-ku,<br>Osaka 542-0081, Japan                         | Tel : +81-6-6261-5766~7 | Fax : +81-6-6261-5818 |
| <b>Moscow</b>    | World Trade Center, Ent.3, #703, Krasnopresnenskaya Nab.12,<br>Moscow, 123610, Russia                        | Tel : +7-495-258-1381   |                       |
| <b>Dubai</b>     | Unit 205, Emaar Square Building No.4 Sheikh Zayed Road,<br>Dubai 252458, U.A.E                               | Tel : +971-4-425-7995   | Fax : +971-4-425-7996 |
| <b>Frankfurt</b> | Mendelssohn strabe 55-59 Frankfurt 60325, Germany  | Tel : +49-69-4699-4988  |                       |
| <b>Bangkok</b>   | 19th Floor, Unit 1908, Sathorn Square Office Tower, 98 North<br>Sathorn Road, Silom, Bangkok 10500, Thailand | Tel : +66-02-115-7920   | Fax : +66-2-115-7898  |

---